Serial No. 3987

PTR No. 7408
P.O.
T C No. 107-244-01
Map Date

Date Issued January 11, 1974

**Do Not Issue A Building Permit Based On This Form**

# MECKLENBURG COUNTY HEALTH DEPARTMENT

## ENVIRONMENTAL HEALTH DIVISION


## PERCOLATION TEST REPORT

NAME OF OWNER Gettys Construction Co., Inc. (LAST / FIRST / MIDDLE)

ADDRESS OF OWNER 1319 Commercial Avenue ZIP

LOCATION OF PROPERTY 7124 Leesburg Road (STREET OR COUNTY ROAD)

SUBDIVISION Ravenwood III LOT NO 5 BLOCK NO 2

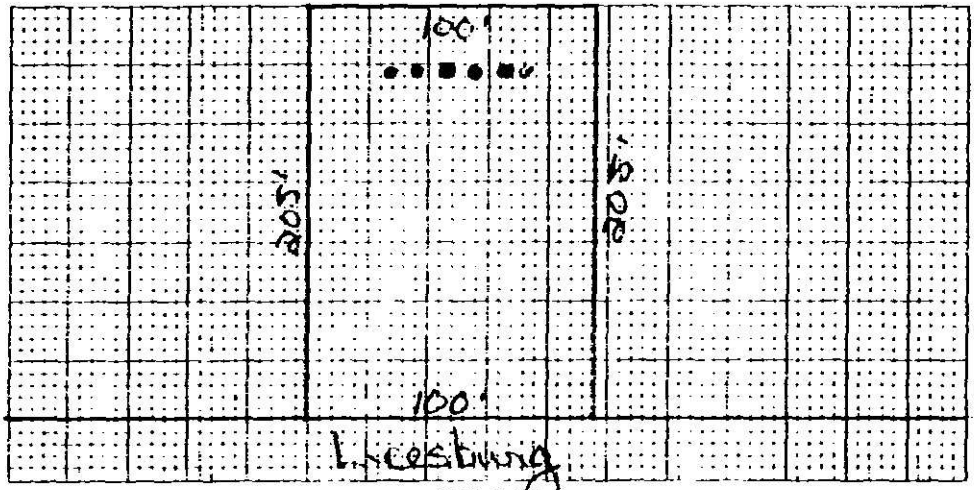


PLOT PLAN

This is to certify that a percolation test has been run and an on-site inspection made by the Mecklenburg County Health Department on the lot described above. The said test was conducted on that portion of the lot as indicated on above plot.

The percolation rate determined by the test was 55* min/in. The said lot is approved for the installation of an individual septic tank wastewater treatment system with sub-surface, soil absorption effluent discharge subject to the following terms and conditions:

1. A permit to install, construct, alter, or repair the specific system shall be obtained from the Mecklenburg County Health Department prior to the beginning of any construction of buildings, or of the wastewater treatment system on the said lot.
2. The size of the septic tank wastewater treatment system which must be installed will be determined by the Health Department prior to installation based on the percolation rate obtained above, and on the size and type of building constructed thereon.
3. This approval is valid only if the system is installed in the immediate area where the percolation test was run.
4. This approval is void if any grading, filling, or construction (including the drilling of a well) is performed on the lot which, in the opinion of the Health Department, renders the area where the percolation test was run unsuitable for the installation, construction, alteration, and/or repair of such a system.

This approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina State Board of Health and the Mecklenburg County Board of Health which were in effect on the date of issuance and is void if at any time in the future, prior to the completion of the system, these laws, rules, and regulations are changed such that this approval would not have been granted had the new or revised laws, rules, and regulations been in effect on the issue date.

*Results determined by soil analysis.

W. Carter Lyon, Jr. Soil Scientist

John R. Atkinson
Director Environmental Health Division or Authorized Section Head

FORM NO. E-2-9-1-72

HEALTH DEPARTMENT'S COPY

Date Received 2/6/78

RECEIVED

ICAR (S) Application No. 7408

T.C. No. 07-244-01

Map Date


# MECKLENBURG COUNTY HEALTH DEPARTMENT

## ENVIRONMENTAL HEALTH DIVISION

**Application for an**
**Installation, Construction, Alteration, and/or Repair Permit**
**(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)**

The owner of that property described hereinafter hereby applies to the Mecklenburg County Health Department for a permit to

1) X Install or Construct 2) ___ Alter or Repair on individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge

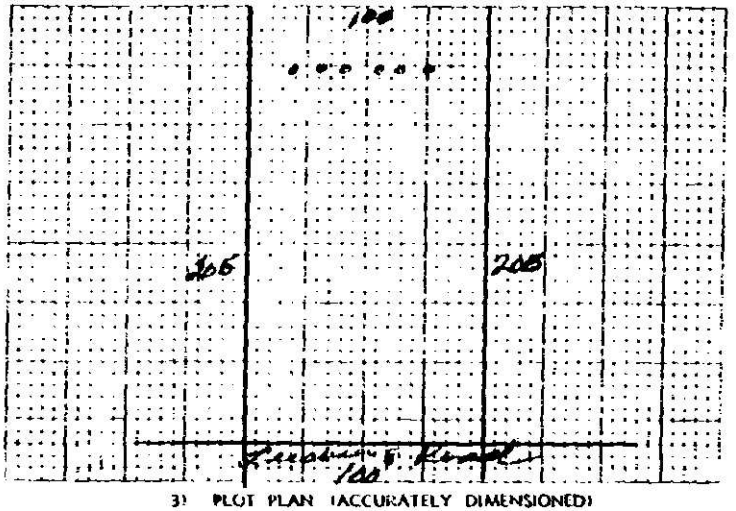


3) PLOT PLAN (ACCURATELY DIMENSIONED)

4) No. of Bedrooms 4

5) Estimated Max No Employees ___

6) Washing Machine X Yes ___ No

7) Garbage Disposal ___ Yes X No

8) Dishwasher ___ Yes X No

9) Water Supply
- A) Individual Well X
- B) Governmental System ___
- C) Community System
  - 1 Well source ___
  - 2 Governmental source ___

10) Sewage System
House located within 200 feet of public sewer ___ Yes X No
House located within 200 feet of community sewer ___ Yes X No

11) FHA Case No. no

12) VA Case No. no

13) NAME OF OWNER Jetty's Const. Co. Inc. (LAST / FIRST / MIDDLE)

14) ADDRESS OF OWNER 7116 Leesburg Road

15) PHONE NO. Home ___ Office 536-6504

16) LOCATION OF SYSTEM 7124 Leesburg Road (STREET OR COUNTY ROAD)

17) SUBDIVISION Ravenwood Lot No. 5 Block No. 2

Map Book No. 17 Page No. 242

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A PERCOLATION TEST BEEN RUN? X YES ___ NO DATE RUN 1-11-74

20) PTR NUMBER (See Instructions) 7408

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

2-7-78
DATE OF APPLICATION

Bruce Jetty
OWNER

FORM NO. E 4-4-2M 6-75

HEALTH DEPARTMENT'S COPY

Serial No. 1524

LA No. 7408

Date Issued February 8, 1978

T. C. No. P.O.107-244-01

Map Date

# MECKLENBURG COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH

**TO THE BUILDING INSPECTION DEPARTMENT**

IMPROVEMENT PERMIT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER Gettys Construction Company, Inc.
(LAST / FIRST / MIDDLE)

ADDRESS OF OWNER 7116 Leesburg Road, Charlotte, NC ZIP

LOCATION OF LOT 7124 Leesburg Road
(STREET OR COUNTY ROAD)

SUBDIVISION Ravenwood LOT NO. 5 BLOCK NO. 2

MAP BOOK NO. 17 PAGE NO. 242

The above specified lot is approved by the Mecklenburg County Department of Environmental Health for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the soil investigation, on an on-site inspection of the said lot; and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 7408. This approval is subject to the following terms and conditions:

1. That the nitrification field be installed, constructed, altered and/or repaired in the same area where the soil investigation was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altred, and/or repaired and that the system be installed in accordance with same

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration, and/or Repair Permit.

John A. Hudson

Environmentalist

Environmental Health Director, or Authorized Section Head

EHD-5-76

**Environmental Health Department's Copy**

Date Issued July 31, 1978

Serial No. 1836


ICAR(S) Permit No 7908

P.O. T C No 107-244-01

Map Date

# MECKLENBURG COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
## INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
### (Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, __ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 7908, dated , and this permit shall be void and of no effect if the information provided in the application is not true and correct. All work shall be completed on or before , after which date this permit shall be null and void.

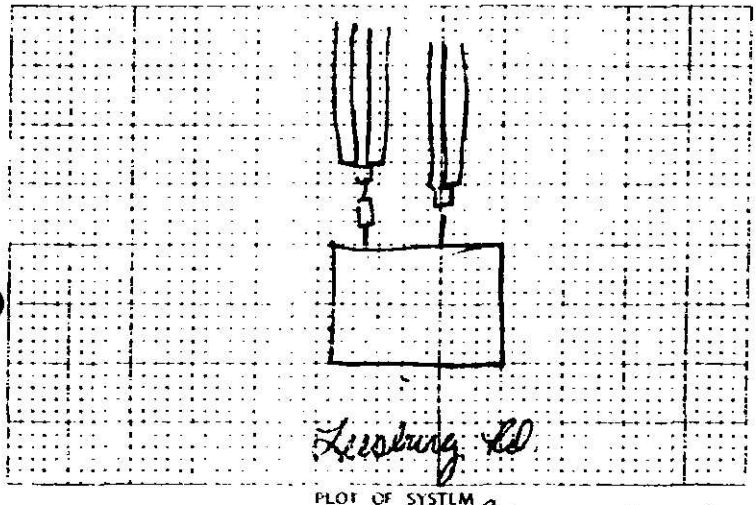


PLOT OF SYSTEM

Perced Rate —

Liquid Capacity of Tank 1500/gal.

Tank Construction PC

Absorption Field Construction Line

Total Line Length 440 ; 167

Number of Lines 5 ; 4

Distance from House 10'

Distance from Property Line 10'

Distance from Well 100'

NAME OF OWNER Lettys Const. Co. Inc.

LOCATION OF PROPERTY 7124 Leesburg Rd.

The system shall meet all applicable construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. **The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

Comments

15' x 88' x 17"

12' x 42' x 17"

Division or Section Head

Eddie Reynolds
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-S-76

Environmental Health Department's Copy

Date Issued August 11, 1978 Serial No. 1787

C of A (s) No. 7408

P.C. T C No 107-299-01

# MECKLENBURG COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
## ENVIRONMENTAL HEALTH DIVISION

**CERTIFICATE OF COMPLETION**
**CERTIFICATE OF APPROVAL**

**(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)**

Name of Owner Kettyo Const. Co. Inc. (LAST / FIRST / MIDDLE)

Location of Property 7124 Leesburg Rd.

Application Number 7408 Permit Number 7408

**Inspection Data:**

Liquid Capacity of Tank 1500/gal Tank Material PC

Total Length of Drain Tile 440 ; 167 Number of Lines

Depth of Filter Material 17" Cover Depth 18"

Water Supply Source Well Distance from Water Source 100'

Excavation Inspected — (DATE) Tank Inspected 8-11-78 (DATE)

Nitrification Field Inspected 8-11-78 (DATE)

Washing Machine Line Inspected, If Applicable 8-11-78 (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ✓ installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments

Eddie Reynolds
Environmentalist

EHD-5-76

**Environmental Health Department's Copy**