


2866-A

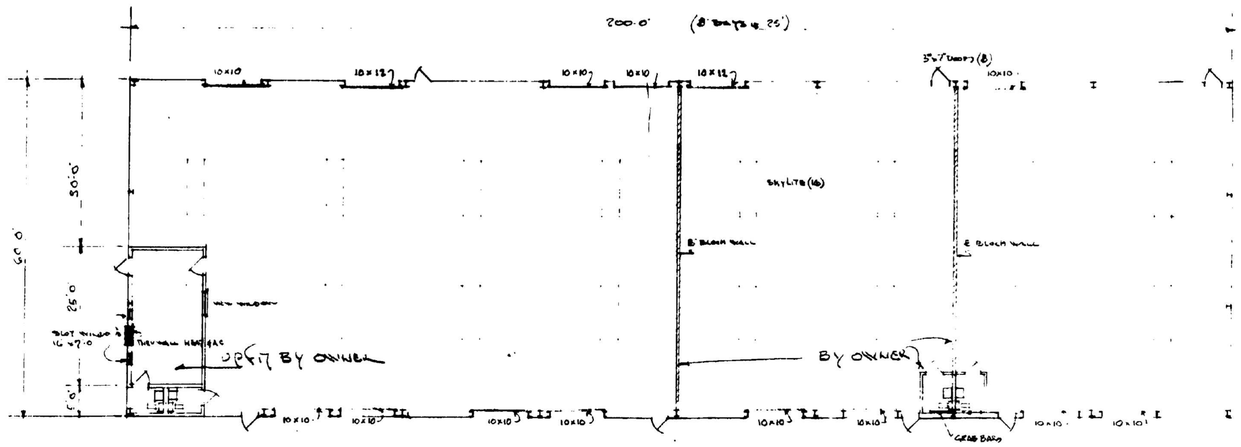

FLOOR PLAN 3/32" 1'-0"




RIGHT ELEVATION 3/32"=1'-0"

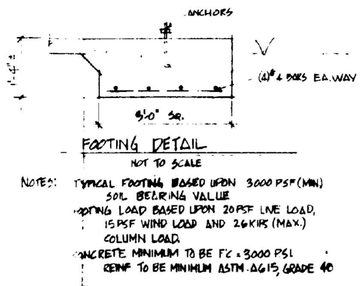

FOOTING DETAIL
NOT TO SCALE

NOTES: TYPICAL FOOTING BASED UPON 3000 PSF (MIN) SOIL BEARING VALUE
ROOFING LOAD BASED UPON 20 PSF LIVE LOAD, 15 PSF WIND LOAD AND 26 KIPS (MAX.) COLUMN LOAD.
CONCRETE MINIMUM TO BE F'c = 3000 PSI
REINF TO BE MINIMUM ASTM A615, GRADE 40

NOTES:
1. SURVEY INFORMATION PROVIDED BY OWNER
2. PRE-ENGINEERED METAL BUILDING TO SUPPORT 20# LIVE LOAD AND 25# WIND LOAD
3. ROOF AND WALL INSULATION = 3"
4. HULL ONLY - PRE-ENG METAL BLDG. 20# LL 80 MPH WIND - 3" INSUL.

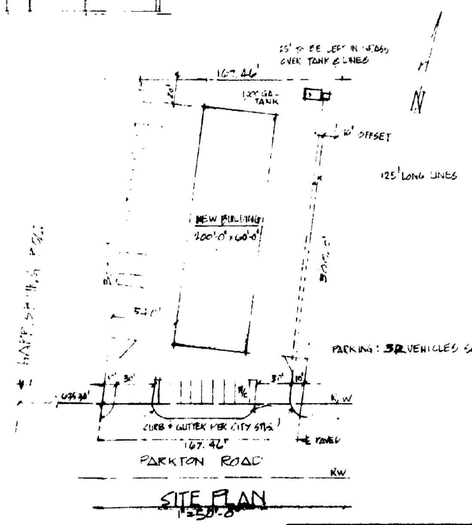

SITE PLAN
1"=30'-0"

FILE 2866A

NEW BLDG. FOR FRANK HARRIS
PARKTON RD CHARLOTTE, N.C.
DATE
HADKEY & ASSOC. INC.
MATTHEWS, N.C.

RECEIVED
MAR 24 1988
ENVIRONMENTAL HEALTH

ALBANENE® 10 6488 DUNCAN FARRELL INC
ARCHITECTS' STANDARD FORM

MARGINAL FILMING