

11324 N STATESVILLE RD

12/31/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Mecklenburg County
Health Department

July 20, 1998

Mr. Walter M. Pharr
11324 Statesville Road
Huntersville, NC 28078

Re: Off Statesville Road
File: 2549B
Parcel: 017-051-01PO

Dear Mr. Pharr:

Receipt of your Application for Improvement Permit for the above referenced property is acknowledged. A soil evaluation and a site visit have been conducted. The results of the evaluation indicated that the site is **UNSUITABLE** under Rules .1941 **SOIL CHARACTERISTICS (MORPHOLOGY)**, .1942 **SOIL WETNESS CONDITIONS**, .1943 **SOIL DEPTH** and .1945 **AVAILABLE SPACE**. For these reasons your Application for Improvement Permit is denied. A possible way to develop the site exists under Rule .1948(d) which reads as follows:

> A site classified as **UNSUITABLE** may be used for a ground absorption sewage treatment and disposal system specifically identified in Rules .1955, .1956, or .1957 of this Section or a system approved under Rule .1969 if written documentation, including engineering, hydrogeologic, geologic or soil studies, indicates to the local health department that the proposed system can be expected to function satisfactorily. Such sites shall be reclassified as **PROVISIONALLY SUITABLE** if the local health department determines that the substantiating data indicate that:
> (1) a ground absorption system can be installed so that the effluent will be non-pathogenic, non-infectious, non-toxic, and non-hazardous;
> (2) the effluent will not contaminate ground or surface water; and
> (3) the effluent will not be exposed on the ground surface or be discharged to surface waters where it could come in contact with people, animals, or vectors.

The State shall review the substantiating data if requested by the local health department.

Please be advised that you have the right to an informal review by this department. You also have the right to appeal under G.S. 130A-24, and to have the appeal held in Mecklenburg County.

If you have any questions regarding this matter, please call me at 336-5575.

Sincerely,

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems

FEE: 100.00 CK # 16328

DATE: 6/18/98

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR IMPROVEMENT PERMIT FOR COMMERCIAL/INDUSTRIAL SITE

[redacted]

1 1 CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 25498

PROJECT TRACKING #:

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 01705101 pp

STREET ADDRESS: off Statesville Rd

LOT NUMBER:

✓ COMMERICAL ___ INDUSTRIAL

DESCRIBE TYPE OF BUSINESS:

OFFICE SUPPLY SALES

Square footage of facility: 6000± APPROX.

NUMBER OF EMPLOYEES: 6 PER SHIFT: 1 SHIFT

TOWNSHIP (CHECK ONE):

___ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
✓ 6 HUNTERSVILLE
___ 7 MINT HILL

HOW WILL WATER BE USED IN THE FACILITY:

✓ TOLIETS/URINALS
✓ HANDSINK
___ SHOWERS
___ FLOOR DRAINS

OTHER, PLEASE DESCRIBE: 25

An IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change.

TYPE OF WASTEWATER:

✓ SEWAGE ___ INDUSTRIAL PROCESS WASTE WATER

IF EXPANSION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED ADDITION:

WATER SUPPLY (CHECK ONE): ___ COMMUNITY (C) ✓ MUNICIPAL (M) ___ PRIVATE WELL (P) ___ SHARED WELL (S) ___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES ✓ NO
EXISTING WASTE WATER SYSTEMS ___ YES ✓ NO
EASEMENTS OR RIGHT-OF-WAYS ___ YES ✓ NO
WELL SPRINGS OR WATERLINES ___ YES ✓ NO
DESIGNATED WETLANDS ___ YES ✓ NO

BUILDING PLANS TO INCLUDE ALL PLUMBING, FLOOR DRAINS AND ALL SOURCES OF WASTEWATER DISCHARGE AND GRADING PLANS MAY BE REQUIRED DURING THE EVALUATION STAGE.

PROPERTY OWNER:

NAME: PHARR WALTER M.
(LAST) (FIRST) (MI)

ADDRESS: 11324 STATESVILLE Rd.

CITY: Huntersville STATE: NC ZIP 28078

DAYTIME PHONE: 704 875 - 0969

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: MARTIN DANNY
(LAST) (FIRST) (MI)

DAYTIME PHONE: 704 372 - 4146

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 7-18-88

THE UNDERSIGNED, OWNER, OR LEGAL AGENT FOR THE OWNER, OF THE PROPERTY DESCRIBED ABOVE AS THE "JOB LOCATION" HAS READ THE FOREGOING APPLICATION, ACKNOWLEDGES THAT THE CONTENTS OF SAME ARE TRUE, AND AUTHORIZES AGENTS OF THE MECKLENBURG COUNTY HEALTH DEPARTMENT TO ENTER ONTO THE PROPERTY FOR THE PURPOSE OF PROCESSING THIS REQUEST.

SIGNED: [signature] DATE: 6-8-98

PROPOSED PLOT PLAN


COP

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2549B V

TC: 017-051-01 RP

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

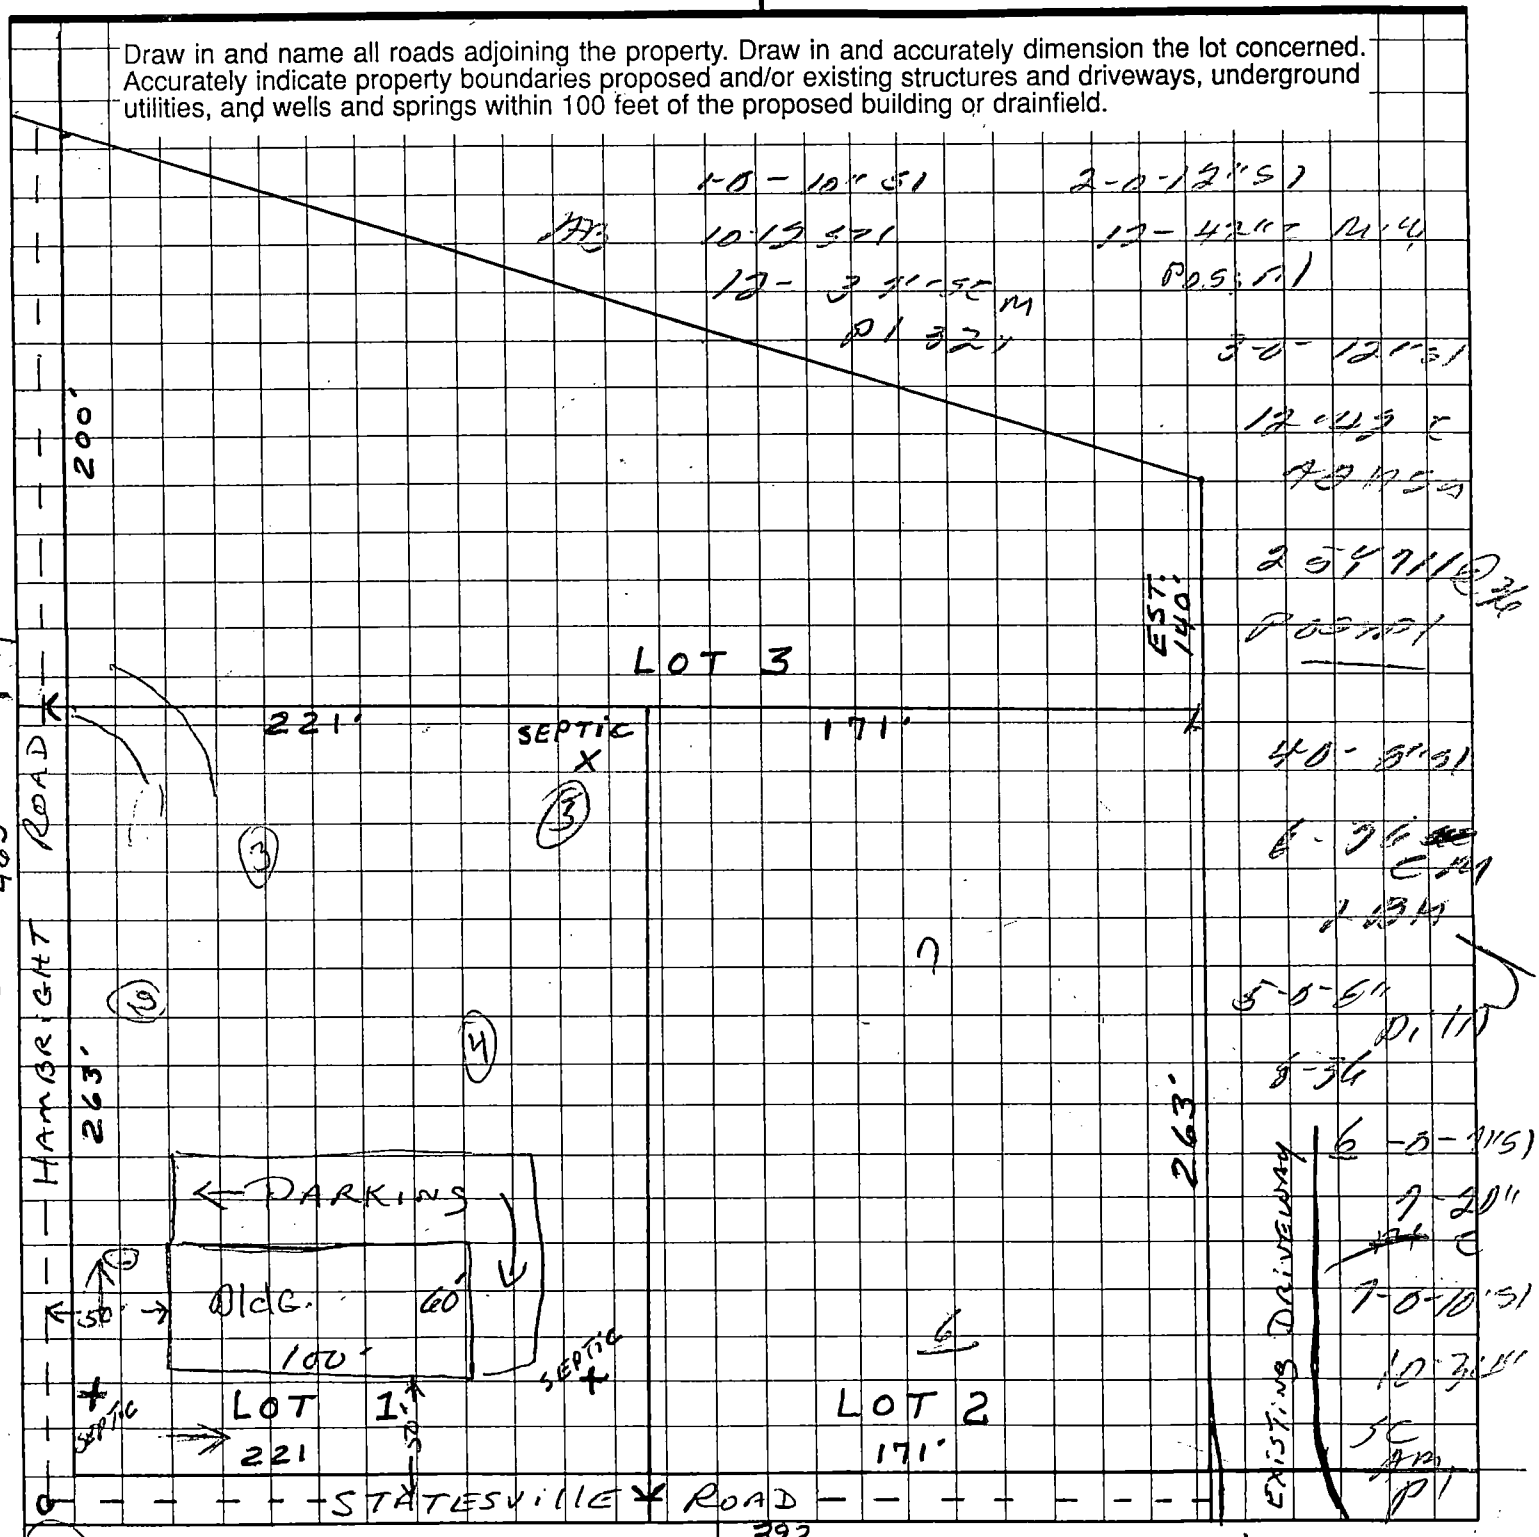

Danny Martin
OWNER/AGENT SIGNATURE

DATE 6-8-98

APPROVAL DATE 8-6-98

White - Health Department's Copy

Canary - E.H.S. Copy

Pink - Owner's Copy

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

#3

Sheet 1
PROPERTY ID #: 017-051-c
Lot # :
File # : 25493

SOIL/SITE EVALUATION *for* ON-SITE WASTEWATER SYSTEM

OWNER: Walter M. Shaw APPLICANT: Danny Marlin
ADDRESS: 11324 Statesville Road, Huntersville DATE EVALUATED: 7-8-98
PROPOSED FACILITY: Office PROPOSED DESIGN FLOW (.1949): 150gpd / PROPERTY SIZE: 2.86
LOCATION OF SITE: Statesville Road PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☑ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	Slopes 2-6% .1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS	0-10"	gr/ls	VFr/SEXP/NS/MO	737" TO soil wetness	37"	N/A	None	US
		10-12"	SBK/C	Fr/SEXP/SS/SP					
		12-37"	~~BK~~	Fi-VFi/M/VS/MO					
			SBK/SC						
			Poss Pl @ 37"						
2	LS	0-12"	gr/ls	VFr/SEXP/NS/MO	742" TO soil wetness	42"	N/A	None	US
		12-42"	SBK/C	Fi-VFi/M/SP					
			Poss Plowy @	24"					
3	LS	0-12"	gr/ls	VFr/SEXP/NS/MO	~~742~~ 2:5Y 7/1 @ 36"	42"	N/A	None	US IV
		12-42"	ABK/SC	Fi-VFi/SEXP/SP					
			poss. Plowy	436"					
4	LS	0-6"	gr/ls	VFr/SEXP/NS/MO	736" TO soil wetness	36"	N/A	None	US
		6-36"	ABK/C	Fi-VFi/M/VS/VP					
			poss. plowy						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Unsuitable
EVALUATED BY: W.A. Marlin 7-13-98
OTHER(S) PRESENT: LSS

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet 2
PROPERTY ID #:
Lot # :
File # : 25493

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: APPLICANT:
ADDRESS: DATE EVALUATED:
PROPOSED FACILITY: PROPOSED DESIGN FLOW (.1949): PROPERTY SIZE:
LOCATION OF SITE: PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
5	LS	0-6"	gr/SL	VFr/SEXP NS/NP	736" TO 50:1 wetness	36"	N/A	None	US
		6-36"	ABK/C	Fi/SEXP S/D					
			poss. platy						
6	LS	0-7"	gr/SL	VFr/SEXP NS/NP	720" TO 50:1 wetness	20"	N/A	None	US III
		7-20"	ABK/C	Fi/SEXP S/D					
			poss. platy						
7	LS	0-10"	gr/SL	VFr/SEXP NS/NP	734" TO 50:1 wetness	34"	N/A	None	US IV
		10-36"	ABK/SC	Fi/SEXP S/D					
			possible platy						
8	LS	0-6"	gr/SL	VFr/SEXP NS/NP	2:5Y 7/1 @ 30"	32"	N/A	None	US IE
		6-10"	SBK/STL	Fr/SEXP SS/SD					
		10-32"	ABK/SC	Fi/SEXP S/D					
			poss. platy	@ 22"					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948):
EVALUATED BY:
OTHER(S) PRESENT:

FILE # 25493

MMENTS Probably Mod Mesic

LANDSCAPE POSITION	GROUP	TEXTURE	.1955 LTAR
R-RIDGE	I	S-SAND	1.2-0.8
S-SHOULDER SLOPE		LS-LOAMY SAND	
L-LINEAR SLOPE			
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8-0.6
N-NOSE SLOPE		L-LOAM	
H-HEAD SLOPE			
CC-CONCLAVE SLOPE	III	SI-SILT	0.6-0.3
CV-CONVEX SLOPE		SICL-SILTY CLAY LOAM	
T-TERRACE		CL-CLAY LOAM	
FP-FLOOD PLAIN		SCL-SANDY CLAY LOAM	
	IV	SC-SANDY CLAY	0.4-0.1
		SIC-SILTY CLAY	
		O-ORGANIC	

CONSISTENCE MOIST	WET
VFR-VERY FRIABLE	NS-NON-STICKY
FR-FRIABLE	SS-SLIGHTLYSTICKY
FI-FIRM	S-STICKY
VFI-VERY FIRM	VS-VERY STICKY
EFI-EXTREMELY FIRM	NP-NON-PLASTIC
	SP-SLIGHTLYSTICKY
	P-PLASTIC
	VP-VERY PLASTIC


STRUCTURE


SG-SINGLE GRAIN
M-MASSIVE
CR-CRUMB
GR-GRANULAR
SBK-SUBANGULAR BLOCKY
ABK-ANGULAR BLOCKY
PL-PLATY
PR-PRISMATIC

MINERALOGY

SLIGHTLY EXPANSIVE

EXPANSIVE

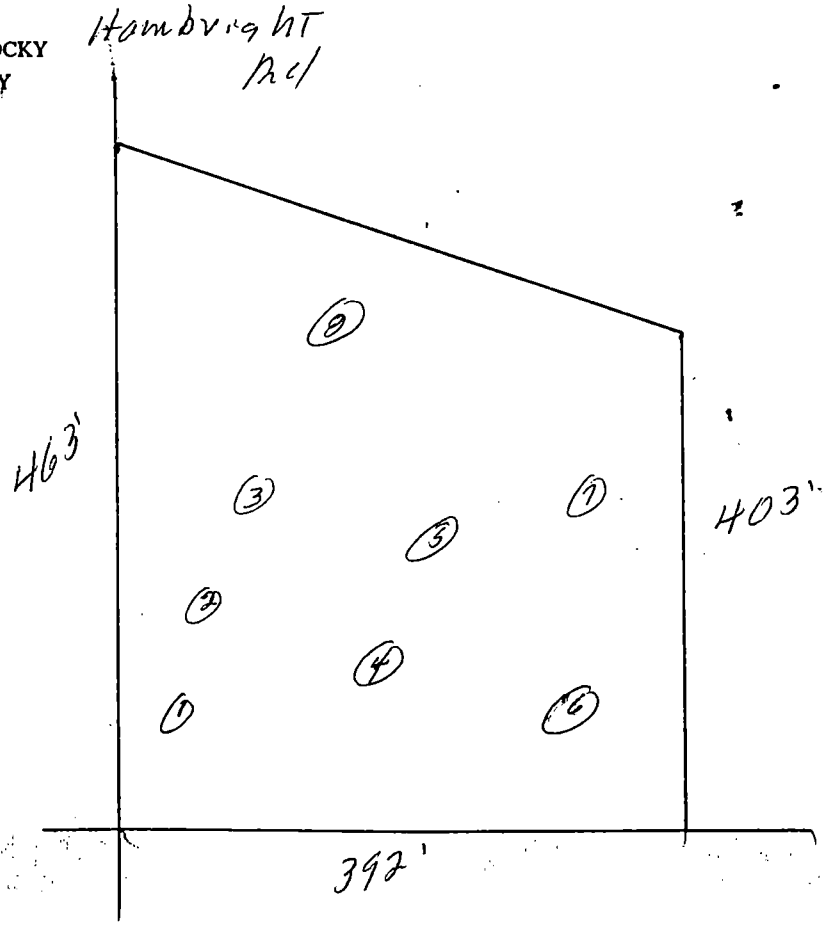

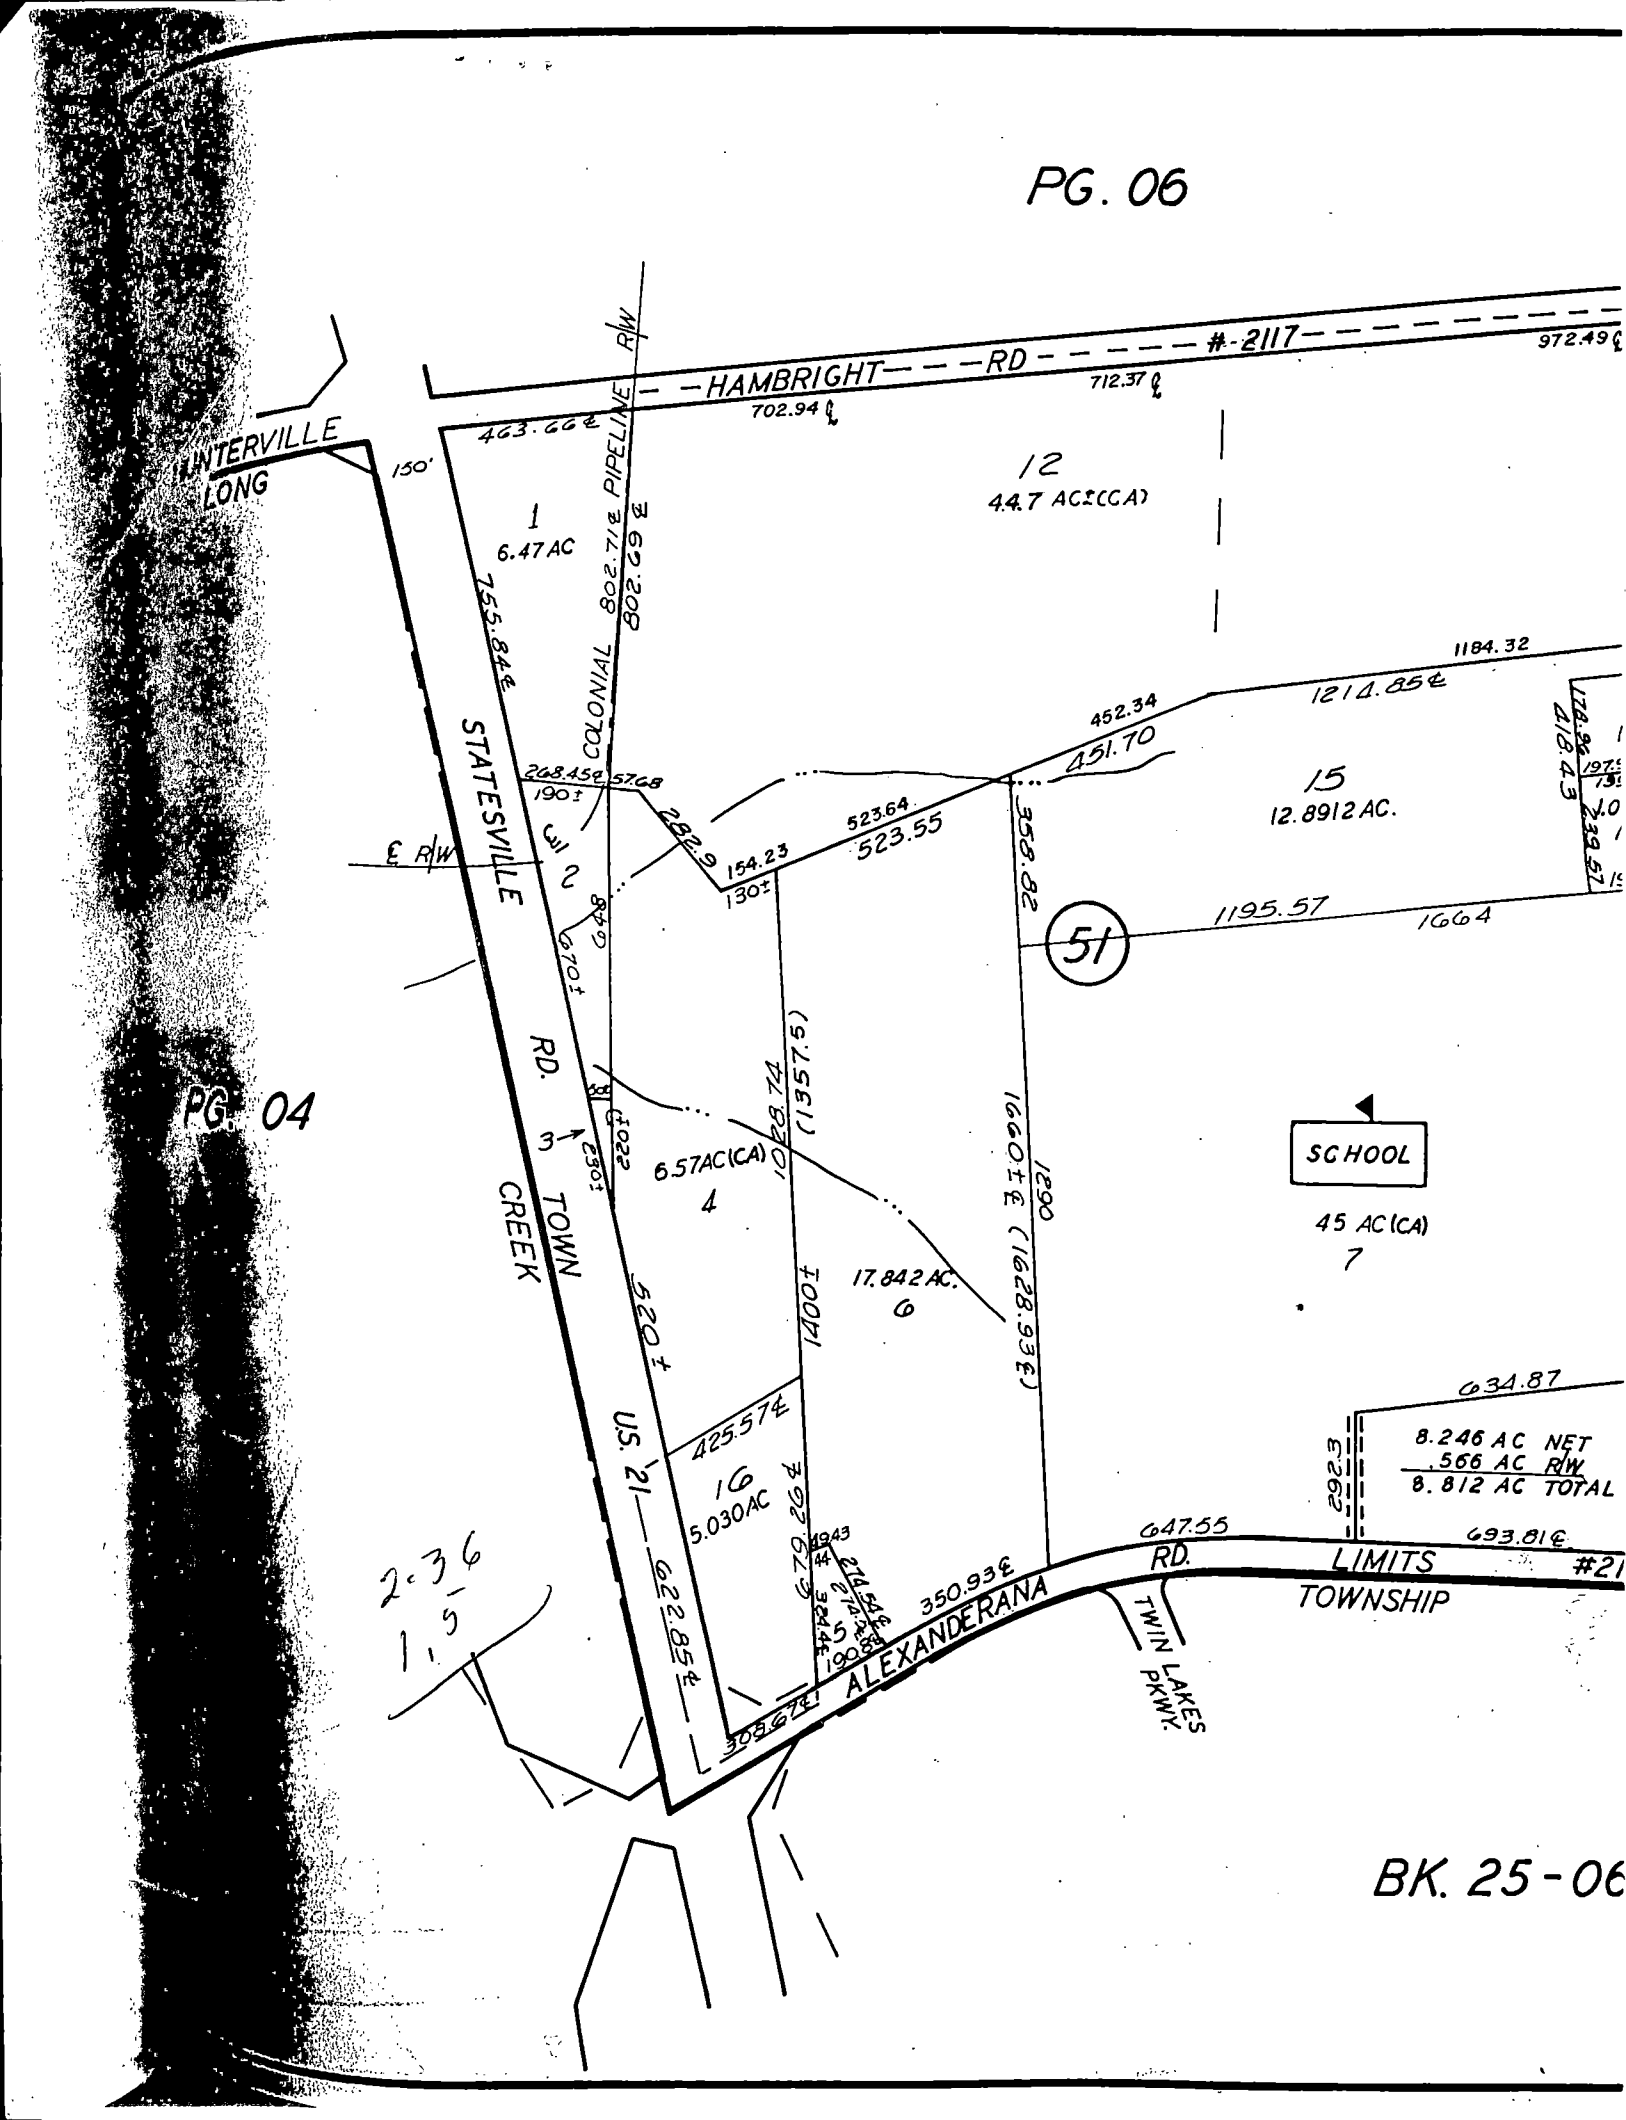
HAMBRIGHT RD #2117
972.49
712.37
702.94
463.66
R/W
802.71 PIPELINE
802.69
COLONIAL
150'
LONG
INTERVILLE
1
6.47 AC
755.84
STATESVILLE RD.
268.45
57.68
190±
2282.9
154.23
130±
523.64
523.55
451.70
452.34
1214.85
1184.32
12
44.7 AC±(CA)
15
12.8912 AC.
358.82
1195.57
1664
51
418.43
239.57
197
E R/W
840
670±
230±
220±
TOWN CREEK
3
6.57AC(CA)
4
1028.74
(1357.5)
1400±
17.842 AC.
6
1690±
(1628.93)
1290
520±
425.57
16
5.030AC
679.92
SCHOOL
45 AC(CA)
7
634.87
8.246 AC NET
.566 AC R/W
8.812 AC TOTAL
292.3
647.55
693.81
LIMITS
TOWNSHIP
#21
RD.
ALEXANDERANA
350.93
305.67
622.85
US 21
TWIN LAKES PKWY.
2.36
1.5

PG. 04

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

#3 400 Sheet 1
PROPERTY ID #: 012-051-01
Lot # :
File # : 25493

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Walter M. Shaw APPLICANT: Danny Merlin
ADDRESS: 11324 Statesville Road, Huntersville DATE EVALUATED: 1-8-98
PROPOSED FACILITY: Office PROPOSED DESIGN FLOW (.1949): 150gpd / PROPERTY SIZE: 2.86
LOCATION OF SITE: Statesville Road PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☑ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	Slopes 2-6% .1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS	0-10"	gr/sl	vFr/SEXP/NS/MO	737" TO Soil wetness	37"	N/A	None	US
		10-12"	SBK/cl	Fr/SEXP/SS/SP					
		12-37"	~~SBK/~~	Fi-VFi/M/US/MO					
			SBK/sc						
			poss Pl @ 37"						
2	LS	0-12"	gr/sl	vFr/SEXP/NS/MO	742" TO Soil wetness	42"	N/A	None	US
		12-42"	SBK/c	Fi-VFi/M/SP					
			poss plty @	24"					
3	LS	0-12"	gr/sl	vFr/SEXP/NS/MO	~~742~~ 2.5Y 7/1 @ 36"	42"	N/A	None	US TV
		12-42"	ABK/sc	Fi-VFi/SEXP/SP					
			poss. Plty	36"					
4	LS	0-6"	gr/sl	vFr/SEXP/NS/MO	736" TO Soil wetness	36"	N/A	None	US
		6-36"	ABK/c	Fi-VFi/M/US/MP					
			poss. plty						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Unsuitable
EVALUATED BY: W. A. Merlin 1-13-98
OTHER(S) PRESENT: LSS

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet 2
PROPERTY ID #:
Lot # :
File # : 2549B

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: APPLICANT:
ADDRESS: DATE EVALUATED:
PROPOSED FACILITY: PROPOSED DESIGN FLOW (.1949): PROPERTY SIZE:
LOCATION OF SITE: PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
5	LS	0-6"	gr/SL	VFr/SEXP/NS/MP	736" TO 50:1 WETNESS	36"	N/A	None	US
		@-36"	ABK/C	FI/SEXP/SL/D					
			poss. Platy						
6	LS	0-7"	gr/SL	VFr/SEXP/NS/MP	720" TO 50:1 wetness	20"	N/A	None	US III
		7-20"	ABK/C	FI/SEXP/SL/D					
			poss. Platy						
7	LS	0-10"	gr/SL	VFr/SEXP/NS/MP	734" TO 50:1 wetness	34"	N/A	None	US IV
		10-36"	ABK/SC	FI/SEXP/SL/D					
			possible platy						
8	LS	0-6"	gr/SL	VFr/SEXP/NS/MP	2:5Y 7/1 @ 30"	32"	N/A	None	US LE
		6-10"	SBK/SCL	FI/SEXP/SL/D					
		10-32"	ABK/SC	FI/SEXP/SL/D					
			poss. platy	@ 22"					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		
Site LTAR		


OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948):
EVALUATED BY:
OTHER(S) PRESENT:

FILE # 25493

COMMENTS Probably 1002 Repair

LANDSCAPE POSITION	GROUP	TEXTURE	.1955 LTAR	CONSISTENCE MOIST	CONSISTENCE WET
R-RIDGE	I	S-SAND	1.2-0.8		
S-SHOULDER SLOPE		LS-LOAMY SAND		VFR-VERY FRIABLE	NS-NON-STICKY
L-LINEAR SLOPE				FR-FRIABLE	SS-SLIGHTLYSTICKY
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8-0.6	FI-FIRM	S-STICKY
N-NOSE SLOPE		L-LOAM		VFI-VERY FIRM	VS-VERY STICKY
H-HEAD SLOPE				EFI-EXTREMELY FIRM	NP-NON-PLASTIC
CC-CONCLAVE SLOPE	III	SI-SILT	0.6-0.3		SP-SLIGHTLYSTICKY
CV-CONVEX SLOPE		SICL-SILTY CLAY LOAM			P-PLASTIC
T-TERRACE		CL-CLAY LOAM			VP-VERY PLASTIC
FP-FLOOD PLAIN		SCL-SANDY CLAY LOAM			
	IV	SC-SANDY CLAY	0.4-0.1		
		SIC-SILTY CLAY			
		O-ORGANIC			

STRUCTURE	MINERALOGY
SG-SINGLE GRAIN	SLIGHTLY EXPANSIVE
M-MASSIVE	
CR-CRUMB	EXPANSIVE
GR-GRANULAR	
SBK-SUBANGULAR BLOCKY	
ABK-ANGULAR BLOCKY	
PL-PLATY	
PR-PRISMATIC	

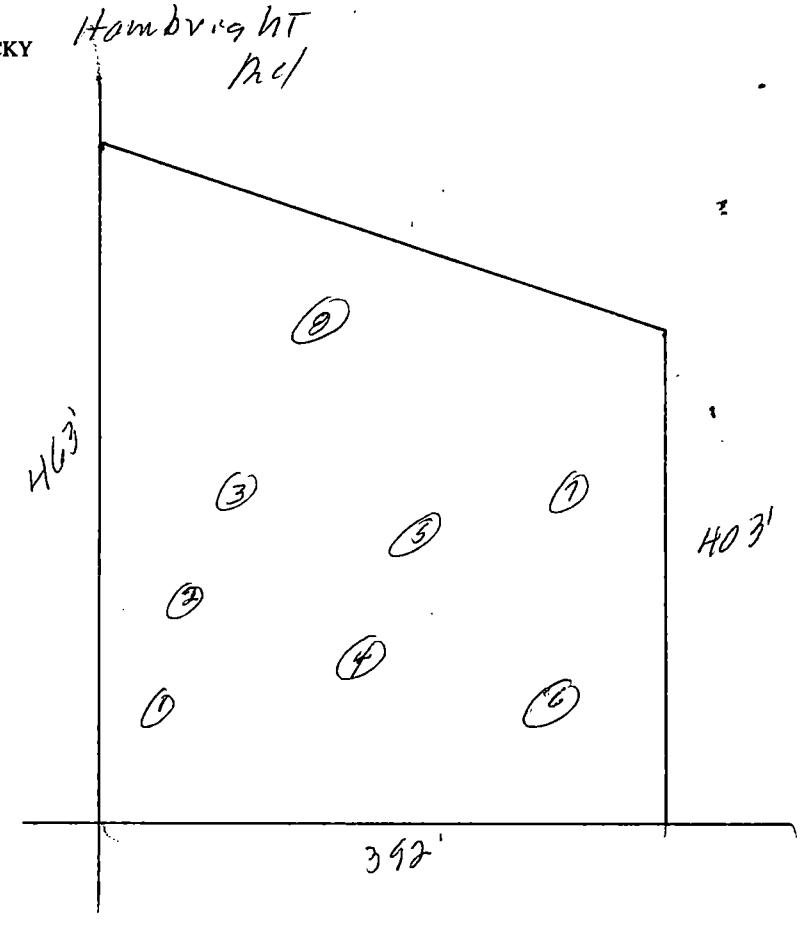

FEE: 100.00 CK # 16328

DATE: 6/19/98

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR IMPROVEMENT PERMIT FOR COMMERCIAL/INDUSTRIAL SITE

[redacted]

CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 25498

PROJECT TRACKING #:

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 01705101 PP

STREET ADDRESS: off Statesville Rd

LOT NUMBER:

✓ COMMERICAL ___ INDUSTRIAL

DESCRIBE TYPE OF BUSINESS:

OFFICE SUPPLY SALES

Square footage of facility: 6000± APPROX.

NUMBER OF EMPLOYEES: 6 PER SHIFT: 1 SHIFT

TOWNSHIP (CHECK ONE):

___ 0 MECKLENBURG ___ 4 PINEVILLE
___ 1 CHARLOTTE ___ 5 MATTHEWS
___ 2 DAVIDSON ✓ 6 HUNTERSVILLE
___ 3 CORNELIUS ___ 7 MINT HILL

HOW WILL WATER BE USED IN THE FACILITY:

✓ TOILETS/URINALS
✓ HANDSINK
___ SHOWERS
___ FLOOR DRAINS

OTHER, PLEASE DESCRIBE:

An IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change.

TYPE OF WASTEWATER:

✓ SEWAGE ___ INDUSTRIAL PROCESS WASTE WATER

IF EXPANSION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED ADDITION:

WATER SUPPLY (CHECK ONE): ___ COMMUNITY (C) ✓ MUNICIPAL (M) ___ PRIVATE WELL (P) ___ SHARED WELL (S) ___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	___ YES ✓ NO	WELL SPRINGS OR WATERLINES	___ YES ✓ NO
EXISTING WASTE WATER SYSTEMS	___ YES ✓ NO	DESIGNATED WETLANDS	___ YES ✓ NO
EASEMENTS OR RIGHT-OF-WAYS	___ YES ✓ NO		

BUILDING PLANS TO INCLUDE ALL PLUMBING, FLOOR DRAINS AND ALL SOURCES OF WASTEWATER DISCHARGE AND GRADING PLANS MAY BE REQUIRED DURING THE EVALUATION STAGE.

PROPERTY OWNER:

NAME: PHARR WALTER M.
(LAST) (FIRST) (MI)

ADDRESS: 11324 STATESVILLE RD.

CITY: Huntersville STATE: NC ZIP 28078

DAYTIME PHONE: 704 875 - 0969

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: MARTIN DANNY
(LAST) (FIRST) (MI)

DAYTIME PHONE: 704 372 - 4146

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 7-18-88

THE UNDERSIGNED, OWNER, OR LEGAL AGENT FOR THE OWNER, OF THE PROPERTY DESCRIBED ABOVE AS THE "JOB LOCATION" HAS READ THE FOREGOING APPLICATION, ACKNOWLEDGES THAT THE CONTENTS OF SAME ARE TRUE, AND AUTHORIZES AGENTS OF THE MECKLENBURG COUNTY HEALTH DEPARTMENT TO ENTER ONTO THE PROPERTY FOR THE PURPOSE OF PROCESSING THIS REQUEST.

SIGNED: Walter M. Pharr DATE: 6-8-98


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2549B

TC: 017-051-01 AR

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

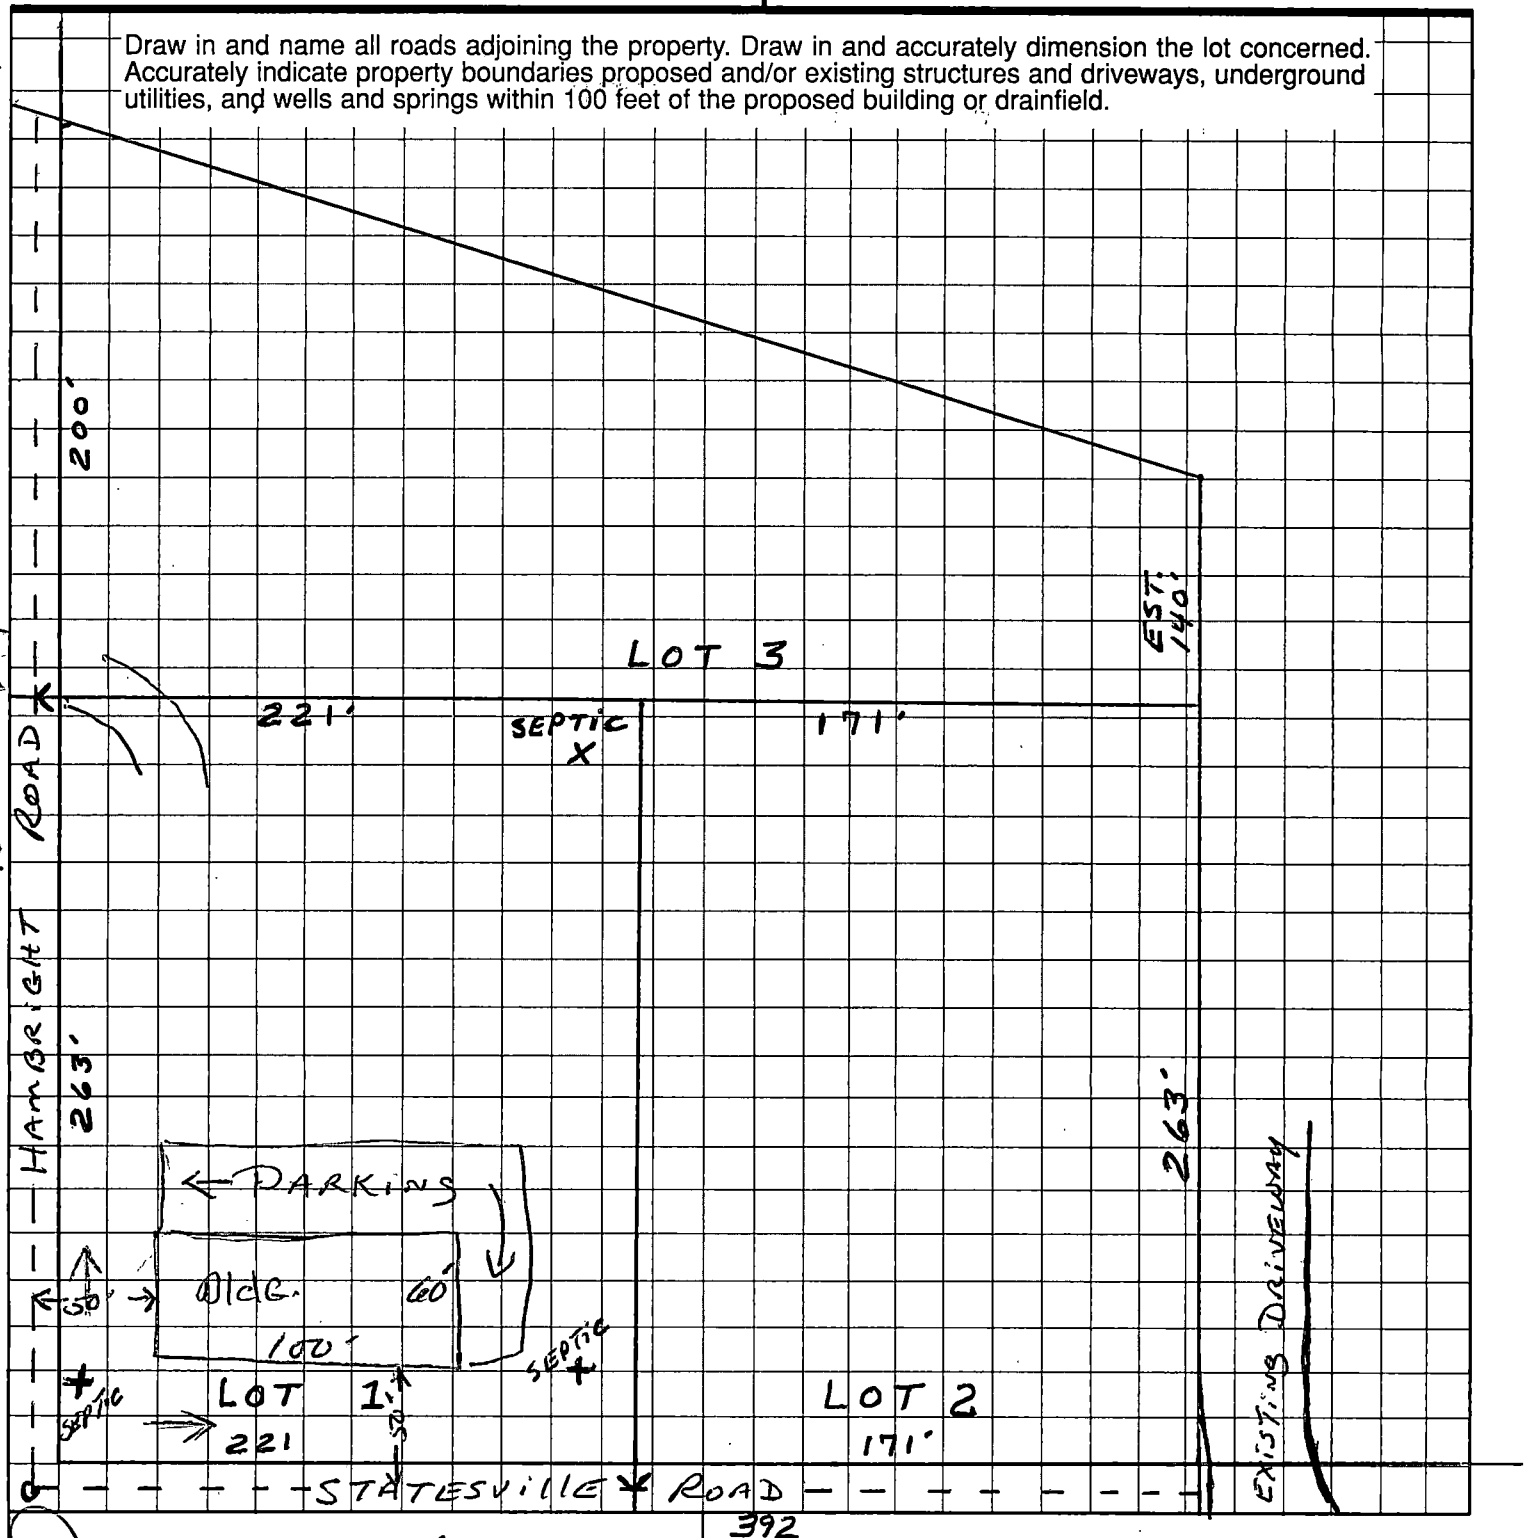

Danny Martin
OWNER/AGENT SIGNATURE

DATE 6-8-98

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy