

2439 SHELBURNE PL

19505132

1/3/2008

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

CR#316 $150.00 6/13/96

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3597 B DATE: 4-24-96

TC: 195-051-28 ☒ PO ☐ L ☐ ~~CRI~~

SERIAL Nº 16454

Name of Owner Lewis Steve Hunter Juris.:

Address of Property 2439 Shelburne Place

Inspection Data:

Tank Material PCC

Total Length of Drainfield 400

Number of Lines 3 @ 133'

Cover Depth 12-24"

Water Supply Source priv. well

Distance to Water Source approx. 86'

Excavation Inspected 4-24

Tank(s) Inspected 4-24

Wash Line Inspected N/A

High Water Alarm Inspected N/A

PLOT

Design 1996, 1500ST, CON, 1200SF, T, 12G, Cecil-like CTR# 117

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Type II a 3 bedroom residence

(3) 3'W x 133' x 12" stone

System repair type III b

Larry S. Thompson, Jr. L.S.

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 35976 DATE: 1-5-96

TC: 195-051-28 PP XL

SERIAL Nº 16590

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 5-30-95. All work shall be completed on or before 2-5-96, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

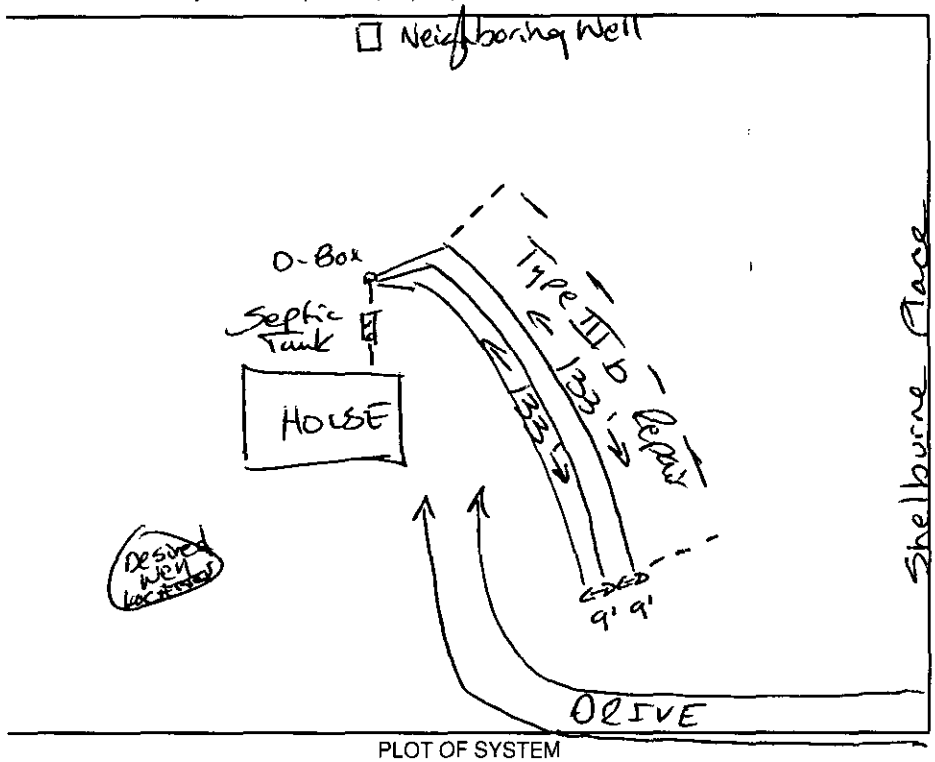

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank N/A gallons

Tank Construction PCC

Trench Depth 24"

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Trench Walls Scored and Porous Yes

Total Line Length 400 feet

Number of Lines X if → 3

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well 100 feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Lewis Steve Hunter

LOCATION OF PROPERTY 2439 Shelburne Place

Comments: Type IIa for a new 3-bedroom house
(3) 3'w x 133'l x 12"s May need type III b repair based on difference in elevations

for Daniel Thorpe, Chief, 1-10-95

Larry B. Thompson Jr., R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

Pd 50 ck# 2734 9/15/98 CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102 2597B

PERSON FILING APPLICATION:
NAME: HUNTER (last) STEVE (first) (mi)
ADDRESS: 2439 Shelburne Pl PHONE: (704) 545-0626
CITY: Charlotte STATE: nc ZIPCODE: 28207

Date:

PROPERTY OWNER:
NAME: SAME (last) (first) (mi)
ADDRESS: _____ PHONE: (__) _____
CITY: STATE: ZIPCODE:

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 195-05-128
STREET ADDRESS: 2439 Shelburne Pl
ZONING:

Township (check one):
[] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [X] 7 Mint Hill

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: LOT SIZE (in acres): 8 Acres

TYPE APPLICATION (check one):

[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[X] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X) Detached

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [X] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS: 2
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift __ __ __
Industrial Wastes (Y/N) __
Underground Storage Tanks On Property (Y/N) __ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: [signature] Date: 9-15-98

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

... 9/17/98 - Onsite visit. No one present. O.K. to use existing system. Addition does not appear to interfere with system.

Jeff Knight Environmentalist 9/17/98 Date

WATER : 122791

COPY


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3597B

TC: 195-051-28

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

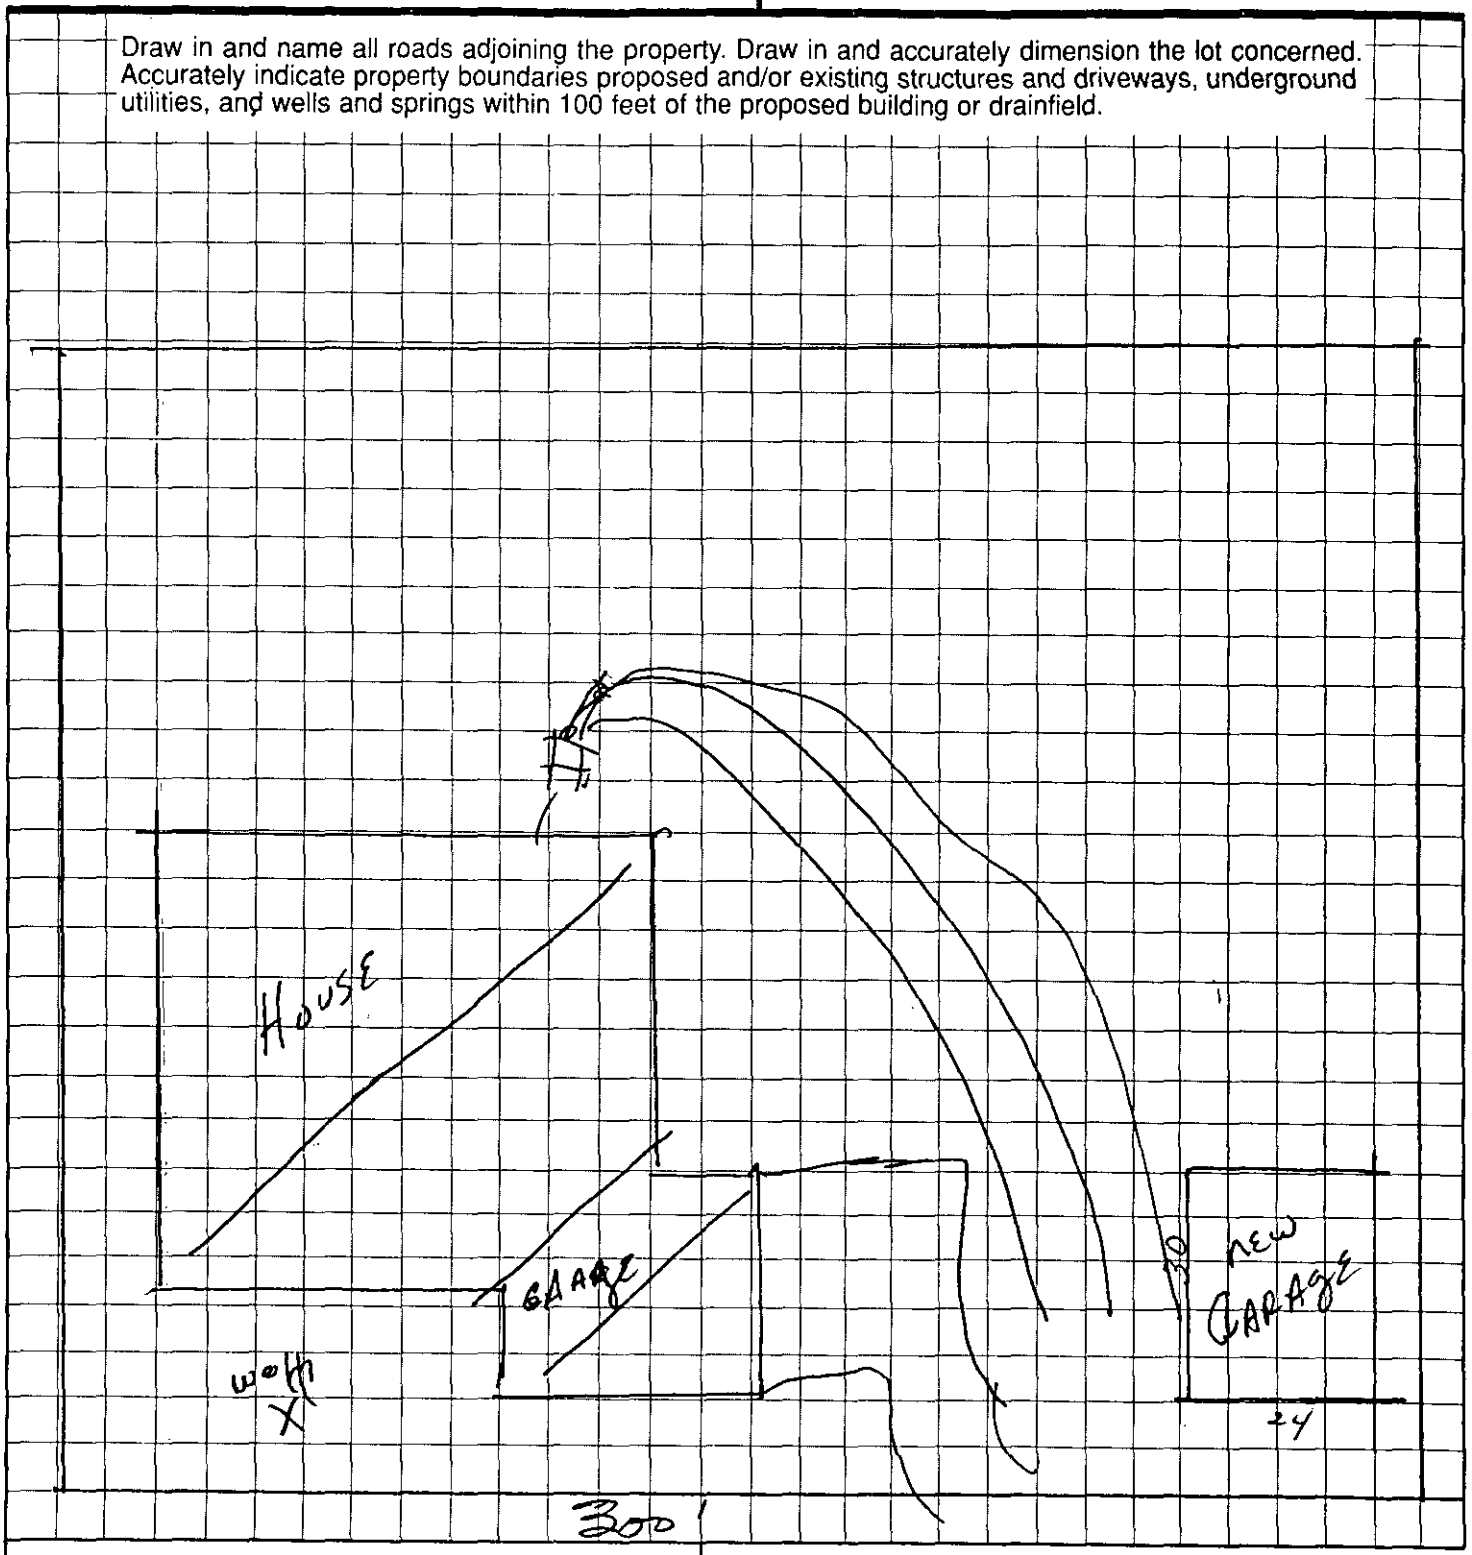

STEVE HUNTER
OWNER/AGENT SIGNATURE

DATE 9-15-98

APPROVAL DATE _____

White - Health Department's Copy

Canary - E.H.S. Copy

Pink - Owner's Copy

PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3597B


TC: 195-051-28 Po

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

COMMENTS

* 1500 gal septic tank
* Concrete distribution Box
* 3 drainlines at 3'w x 133'L x 24" deep
* 12" stone in drain lines
* Keep drainlines level and on contour.
* Keep all parts of system a minimum of 50' off of any existing wells.
* Keep any new wells 100' off of septic system and repair area.

Steve Hunter
2349 Shelburne Pl.

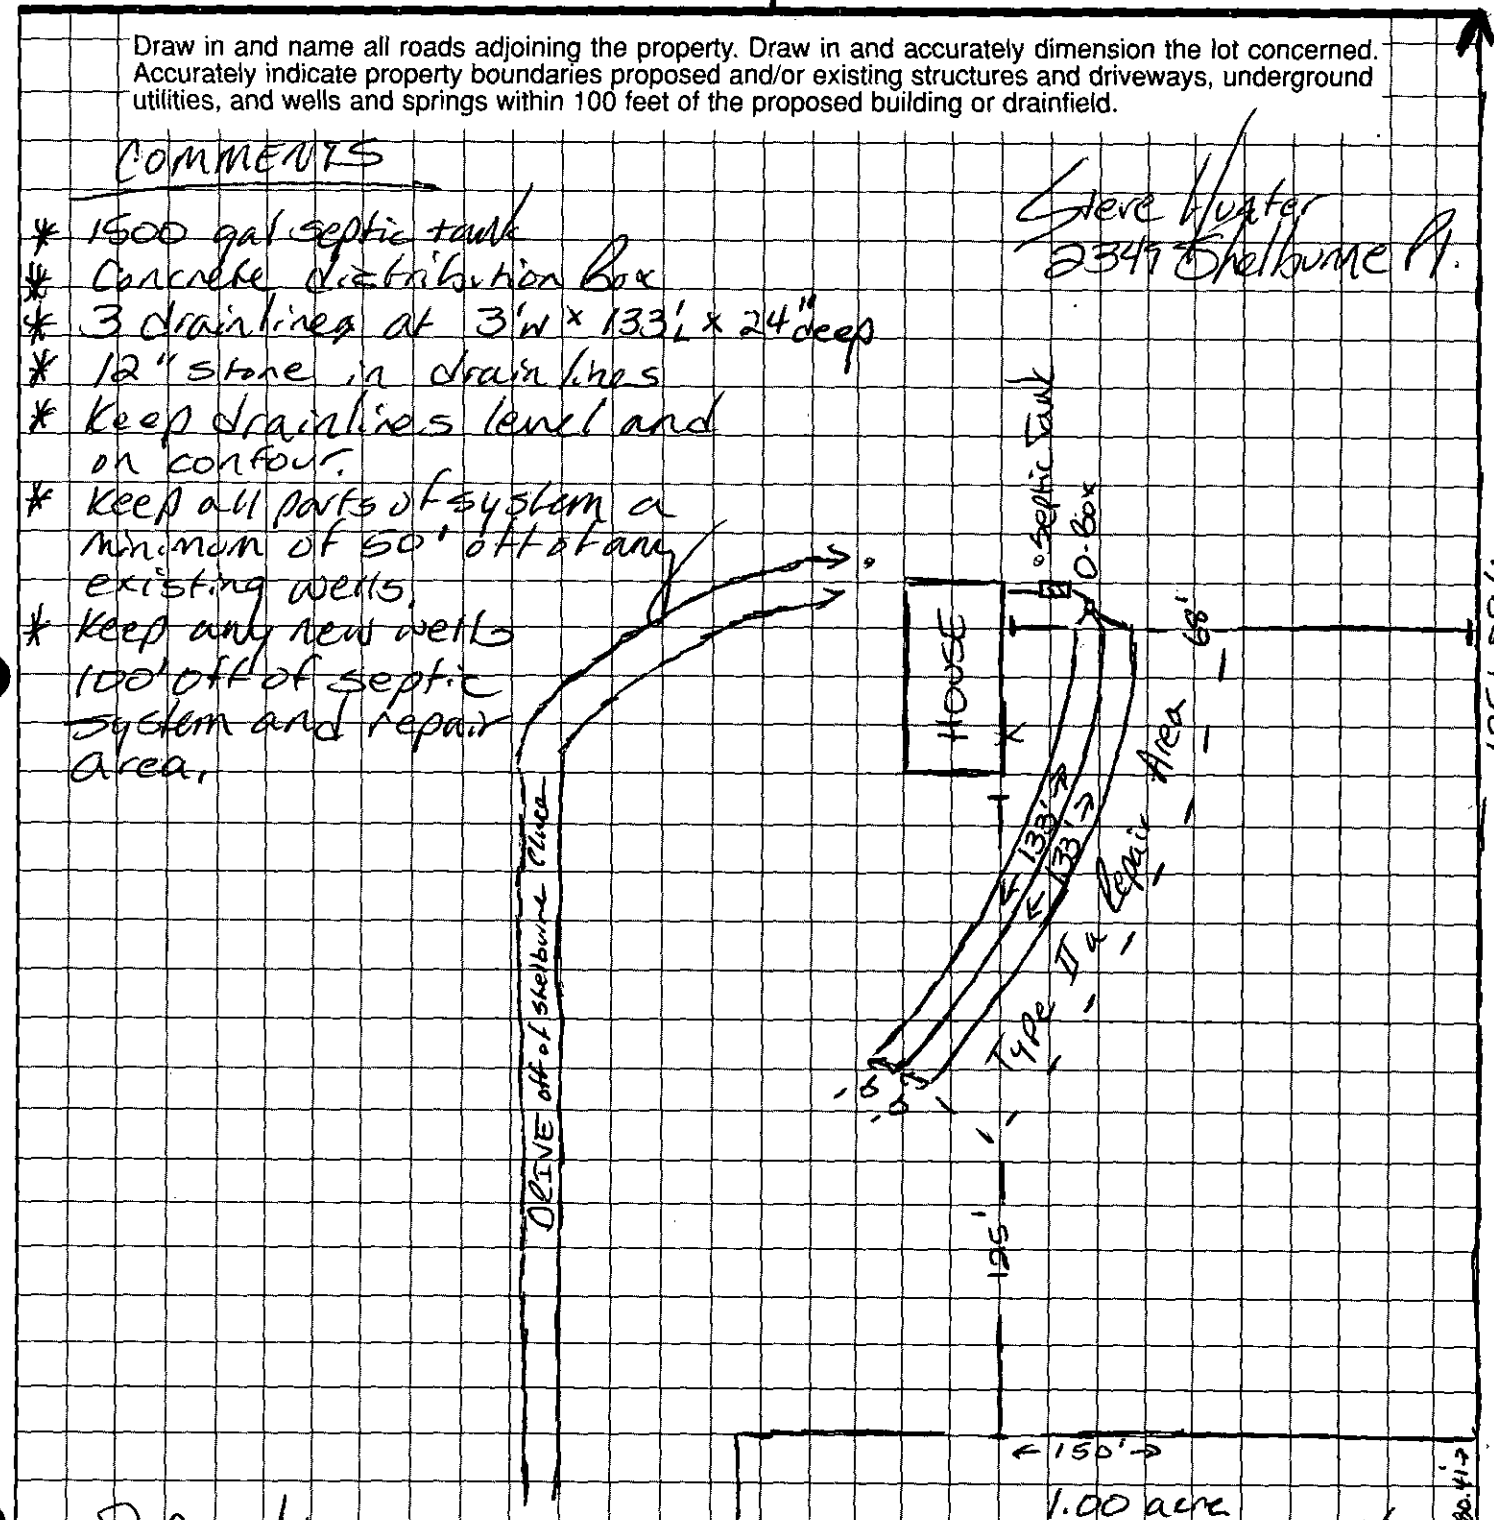

OWNER/AGENT SIGNATURE

DATE 7-3-95

SHELBURNE PLACE
APPROVAL DATE 6-19-95

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

3597B

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

$150.00 chk 10/30/95 DT CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date:

PERSON FILING APPLICATION:
NAME: Hunter (last) Louis (first) S (mi) (379-2883)
ADDRESS: 9500 Greyson Hights PHONE: (704) 541-7327
CITY: Charlotte STATE: NC ZIPCODE: 28277

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 195-051-28P0
STREET ADDRESS: 2439 Shelburne Pl.
ZONING:

PROPERTY OWNER:
NAME: Hunter (last) Louis (first) Steve (mi) (379-2883)
ADDRESS: 9500 Greyson Hights Pl PHONE: (704) 541-7327
CITY: Charlotte STATE: NC ZIPCODE: 28277

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
☐ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☐ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

LOT NUMBER: LOT SIZE (in acres):

TYPE APPLICATION (check one):
☒ SOIL TEST - INDIVIDUAL LOT (O)
☐ NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or N)
☐ COMMERCIAL OR INDUSTRIAL (N)
☐ SOIL TEST DEVELOPMENT (P)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☐ MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
☐ REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
☐ SINGLE MOBILE HOME (S) ☒ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS: 2
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Waste? (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☐ Community (C) ☐ Shared Well (S)
☐ Municipal (M) ☐ Other 'spring' (O)
☒ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☐ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☐ None
☐ Garage ☐ Storage Building ☐ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: [signature] Date: 5-30-95

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

... Type II a system for 3 bedroom house

☒ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Tommy B. Thompson, J. E.S. 6-19-95
Environmentalist Date

Director or Authorized Section Head Date

WATER : 12291


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3597B

TC: 195-05/-28RR

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

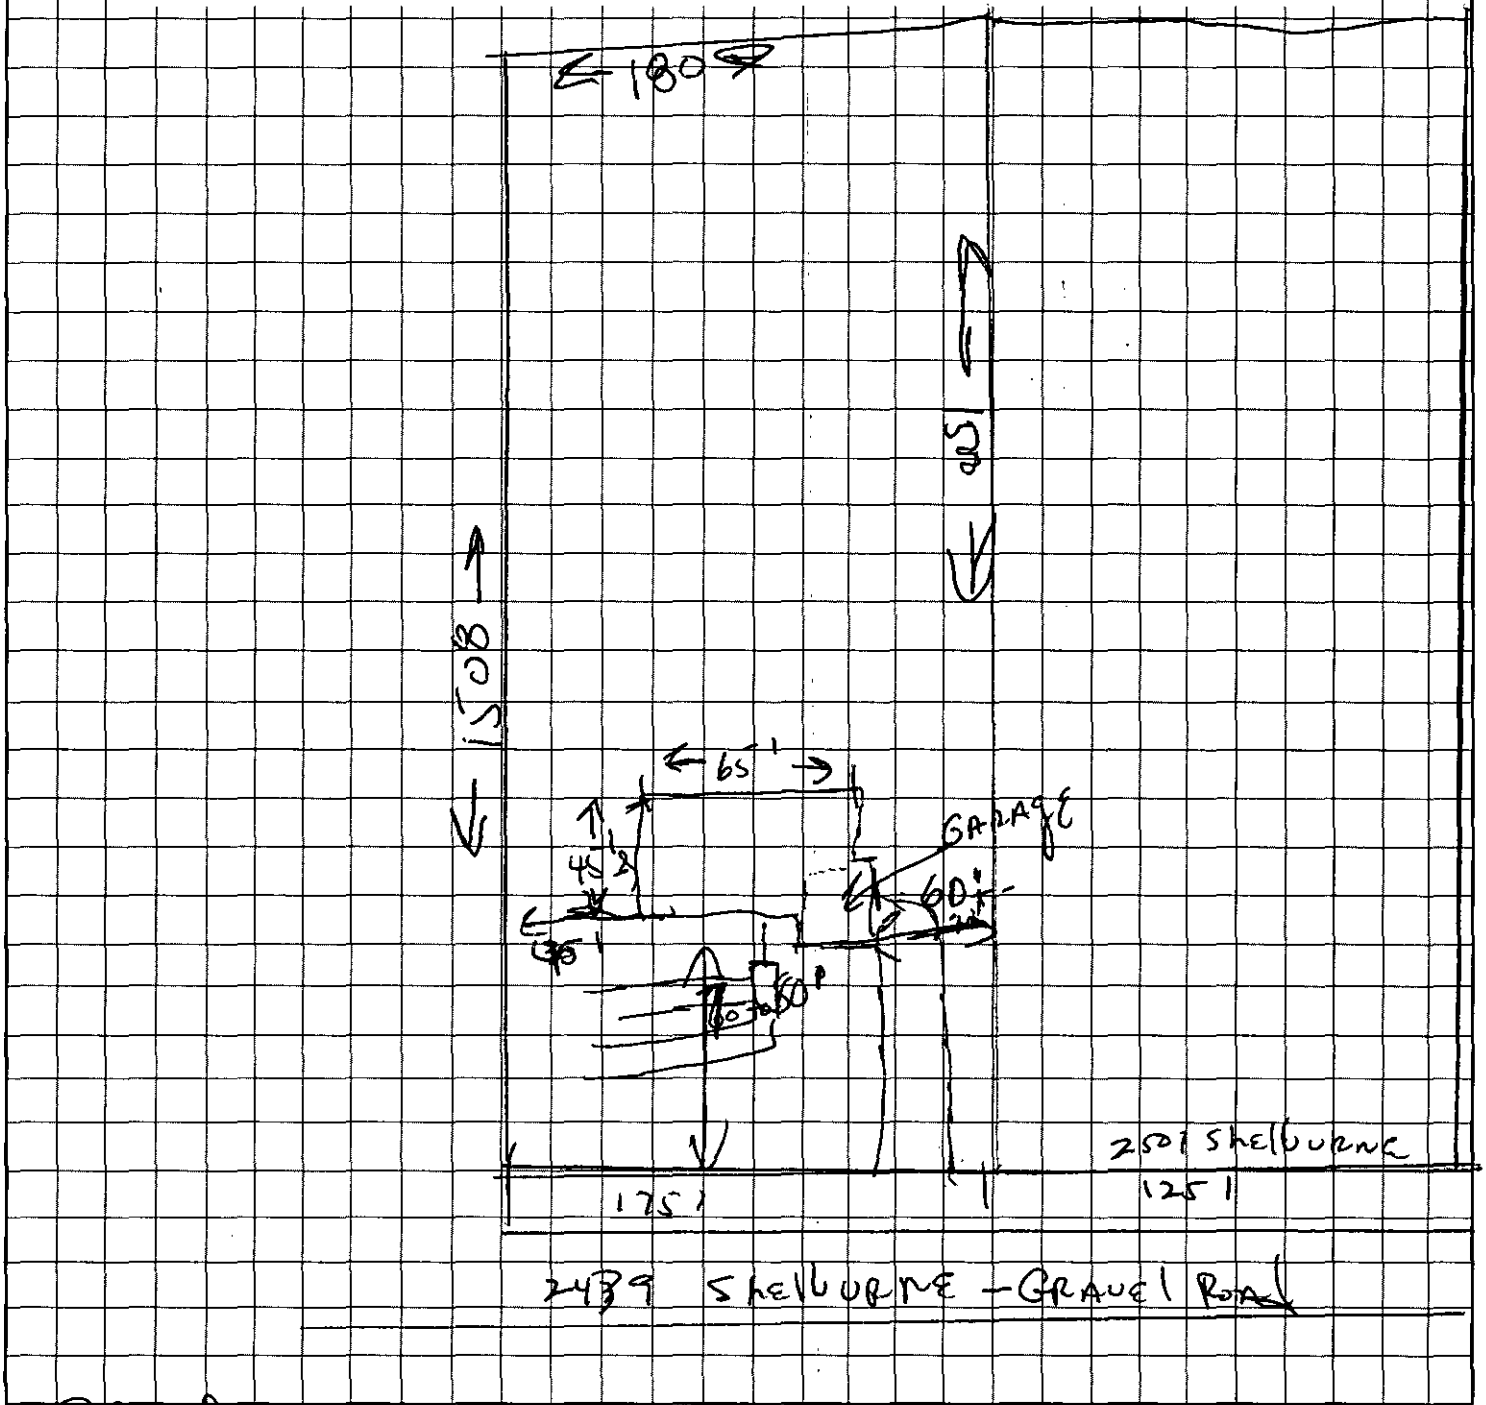

379-7883 U.P.

OWNER/AGENT SIGNATURE

DATE 5-30-95

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

DATE 5-23-95

TO: CHARLOTTE-MECKLENBURG BUILDING STANDARDS
PERMIT ISSUING SECTION

FROM: MECKLENBURG COUNTY ENGINEERING

JURISDICTION MINT

#195-051-28P0
PARCEL NUMBER

2439 SHELBURNE PL
ASSIGNED STREET ADDRESS (ADDRESS OF RECORD)

EXISTING STREET ADDRESS (IF DIFFERENT FROM ASSIGNED)

N/A
PROJECT NAME (IF APPLICABLE)

THE ABOVE DESCRIBED LOCATION HAS BEEN CHECKED CONCERNING:

1. SUBDIVISION REGULATIONS	**APPROVED**	**NOT APPROVED**
2. FLOODWAY REGULATIONS	**APPROVED**	**NOT APPROVED**
3. WATERSHED PROTECTION	**APPROVED**	**NOT APPROVED**
4. COMMERCIAL DRAINAGE PLAN	**APPROVED**	**NOT APPROVED**
5. PUBLIC UTILITY EASEMENT	**PRESENT**	**NOT PRESENT**
6. PROPERTY FRONTS ON THOROUGHFARE	**YES**	**NO**
7. DRIVEWAY PERMIT REQUIRED	**YES**	**NO**
8. DOES PROJECT CONFLICT WITH ROAD PROJECT?	**YES**	**NO**

REMARKS: S.F. HOME

NOTE: THIS FORM MUST BE TURNED IN AT THE CASHIERS OFFICE WHEN PAYING PERMIT FEE. CERTIFICATE OF OCCUPANCY WILL NOT BE GRANTED UNTIL TRANSPORTATION DIVISION GRANTS FINAL APPROVAL ON DRIVEWAY(S).

ALL OTHER FORMS OBSOLETE

X NEW ADDRESS

SIGNED: B. McCorkle

REVISED 1/91

TAX LINE MAP BOOK 195 PAGE 05
MECKLENBURG COUNTY, NORTH CAROLINA
REVISED 2-6-96 SCALE 1" = 400'

FOR TAX PURPOSES ONLY

BK. 197-01

BK. 135-27

PG. 07

PG. 07

PG. 04

PG. 18

SHELBURNE RD.

WEATHERSFORD RD.

BLOCK LINE

LAWYERS RD.

MATTHEWS — MINT HILL RD.

HAWTHORNE DR.

N.C. 51

PHYLISS LN.

ROBIN HOLLOW DR.

FARM RD.

BAIN RD.

#3127

#3128

42.37 AC±

30.28 AC

26.62 AC±

20.013 AC.

10.18 AC± P.

41.326 AC.

40.614 AC.

5.246 AC

2.95 AC.

1.83 AC

1.427 AC

7.727 AC.

MECKLENBURG COUNTY HEALTH DEPARTMENT
SITE EVALUATION REPORT
SERIAL NUMBER 028615

File: 35978 Action 1

Parcel: PO 195-051-28 ☐ PC

Location: 2439 Shelburne Place

Subdivision:


Lot: Block: Acres: .35

Owner: Louis L. Hunter
Address: 1500 Grayson Heights
Charlotte, N.C. 28277

Comments: 1000 Repair, 3gal/day

Described by: William R. Merlin

Date: 6-19-95

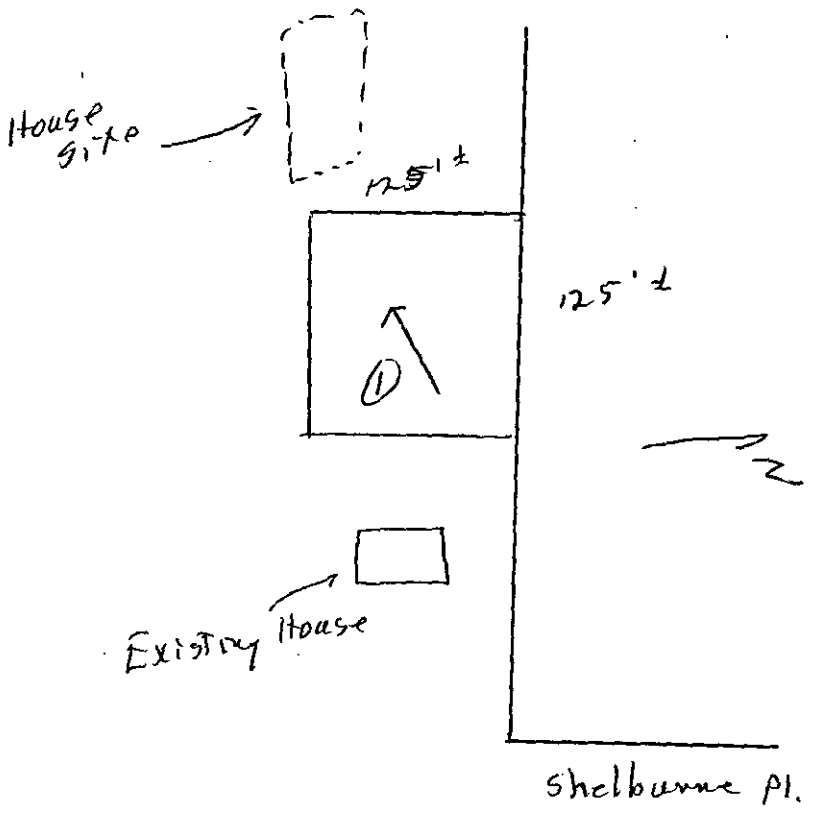

***** EVALUATION KEY *****

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	(S) PS U 2-8%	S PS U	S PS U	S PS U	S PS U	S PS U
Texture	S (PS) U Slight Exp. clay	S PS U	S PS U	S PS U	S PS U	S PS U
Structure	S (PS) U Blocky	S PS U	S PS U	S PS U	S PS U	S PS U
Drainage	(S) PS U 7-48" To soil Wetness	S PS U	S PS U	S PS U	S PS U	S PS U
Depth	S (PS) U 36-48"	S PS U	S PS U	S PS U	S PS U	S PS U
Restrictive Horizons	S (PS) U >36"	S PS U	S PS U	S PS U	S PS U	S PS U
Available Space	S (PS) U	S PS U	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	IR Cecil-Like					
Area Classification	S (PS) U	S PS U	S PS U	S PS U	S PS U	S PS U

THIS IS TO CERTIFY THAT ON THE 14th DAY OF June 19 95 I, Mapped THE PROPERTY SHOWN ON THIS PLAT AND THAT THE TITLE LINES AND THE WALLS OF THE BUILDINGS IF ANY ARE SHOWN HEREON.

SIGNED Bobby J Raye
REGISTERED SURVEYOR

NORTH CAROLINA REGISTERED SEAL L1100 LAND SURVEYOR BOBBY J RAYE

BOBBY J. RAYE
N.C.R.L.S.
627 EASTWAY DRIVE
CHARLOTTE, NC 28205

N. 1-45-33 E.
307.44

S 76-04-04 E
303.01

WADE HELMS
Now or Formerly
3614-981

1508.85

E.H. REYNOLDS
Now or Formerly
1680-369

9.582 ACRE

S 76-11-41 E
955.50

12

11

7

SHELBURNE
Map: 17-296
Block E

Ref. Map: 17-296

N. 76-11-41 W.

,79
,89
1,25
1,22

1251.09' TOTAL

N. 13-48-19 E.
150.00

1.000 ACRE

N. 76-11-41 W.
297.56

280.41

R: 1264.02
L: 120.99
S 7-44-32 W
120.94

240.7

S 4-51-51 W

60 R/W

79.77

S 13-48-19 W
199.39

R: 1279.02
L: 199.59
S 9-20-05 W
199.39

21.72

151.81

SHELBURN PLACE

& Proposed Road

N.C. HWY. #51
Lawyers Rd.
Shelburn Place
Site
Farm
Bain Rd.

Map
OF

10.582 Acre Parcel
Mint Hill Mecklenburg Co., N.C.

SCALE 1"=150'

THE PROPERTY OF Steve Hunter

MAP RECORDED IN BOOK AT PAGE DEED RECORDED IN BOOK PAGE

DUNCAN-PARNELL, INC. CHARLOTTE, NC 704-372-7766 N27217

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information


Date: 08/31/11
Receipt #: 73978
Check / Auth #: CHECK 1321
Received By: STEPHM

Amount: 100.00
Tendered: 0.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: CASH CUST (Louis S Hunter)
Attn:
Address: 2439Shelburne Place
Address:
City/State/Zip: Charlotte, NC 28227

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	MH Exc/Add/Repl w/o System Mod		1	100.00	100.00

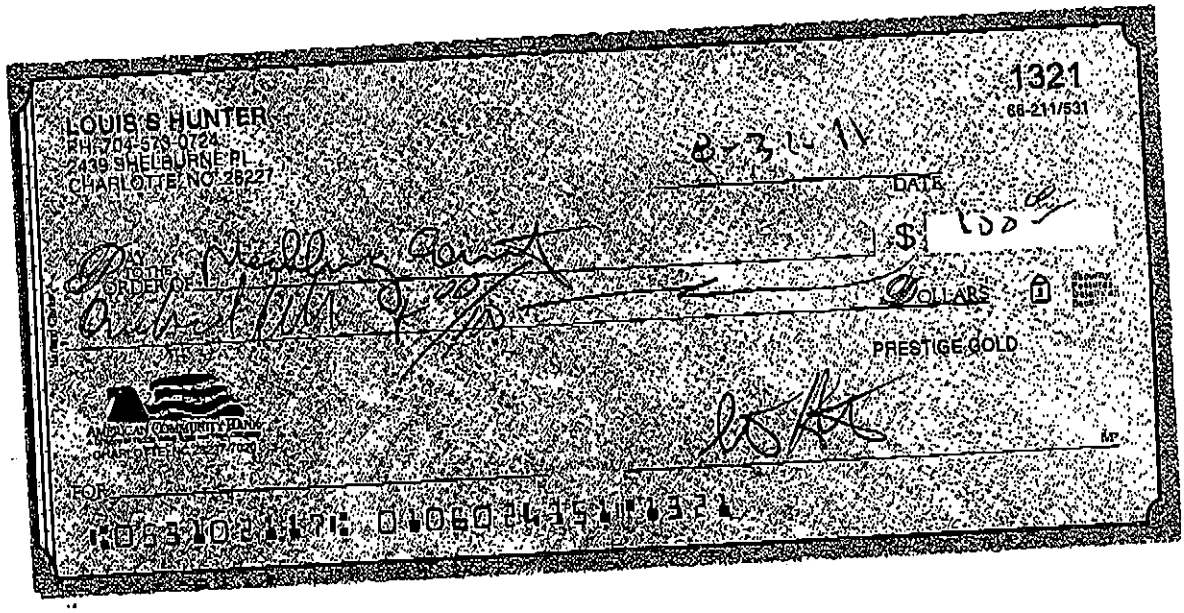

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

Aug. 31. 2011 11:30AM No. 4193 P. 4

2011
UTY
9K

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 3597B WASPS App #: 5219

Primary ES assigned to project: PW

Secondary ES assigned to project: _____

Project Type: New System ☐ Alteration ☐ Repair ☐ Modified Plot Plan ☐ UXS ☑

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☐	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: _____

OP issued date: _____

Review performed by: IR

Date performed: 9-6-11

Proj# 320607 35976

5219

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR APPROVAL TO USE AN EXISTING
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM / WATER SUPPLY WELL

APPLICATION TYPE: ○ SEPTIC ONLY ○ WELL ONLY ○ SEPTIC & WELL
○ ADDITION OR RENOVATION WITH OCCUPANCY INCREASE ○ EXCHANGE MOBILE HOME (SAME # BEDROOMS)
● ADDITION OR RENOVATION WITH NO OCCUPANCY INCREASE ○ COMMERCIAL OR INDUSTRIAL

PERSON FILING APPLICATION:
NAME: Steve Hunter
ADDRESS: 2439 Shelburne Pl
CITY: Charlotte
STATE: NC ZIP: 28217
PHONE: 704-363-4687
ALTERNATE PHONE:
E-MAIL: SHunterServices@Hotmail.com

PROPERTY OWNER: ☒ SAME AS PERSON FILING APPLICATION
NAME:
ADDRESS:
CITY:
STATE: ZIP:
PHONE:
ALTERNATE PHONE:
E-MAIL:

JOB LOCATION INFORMATION
TAX PARCEL #: 19505132 (19505113)
STREET ADDRESS: 2439 Shelburne Pl
CITY: Charlotte Shelburne Pl
STATE: NC ZIP: 28217

SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #:

WATER SUPPLY:
○ MUNICIPAL ● PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER

RESIDENTIAL PROPERTY TYPE: ○ N/A
● HOUSE ○ MODULAR HOME ○ MULTIPLE FAMILY
○ SINGLE MOBILE HOME ○ DOUBLE WIDE
○ OTHER

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 3

COMMERCIAL / INDUSTRIAL PROPERTY TYPE: ☐ N/A
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ○ YES ○ NO
UNDERGROUND STORAGE TANKS? ○ YES ○ NO

ADDITION/RENOVATION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☐ GARAGE ☐ SUNROOM ☐ PORCH ☐ DECK ☐ OTHER

ADDITION/RENOVATION TYPE DETACHED FROM EXISTING STRUCTURE:
☐ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☒ SHOP ☐ BARN
☒ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER CStorage

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature

8-31-11
Date

A PROPOSED PLOT PLAN (see page 2) is required to be submitted with each application.

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11

AUG. 31. 2011 11:30AM NO. 4193 P. 2

File #: 3597B


Proj# 320607

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 2439 Shelburne Pl

Tax Parcel #: 19505132

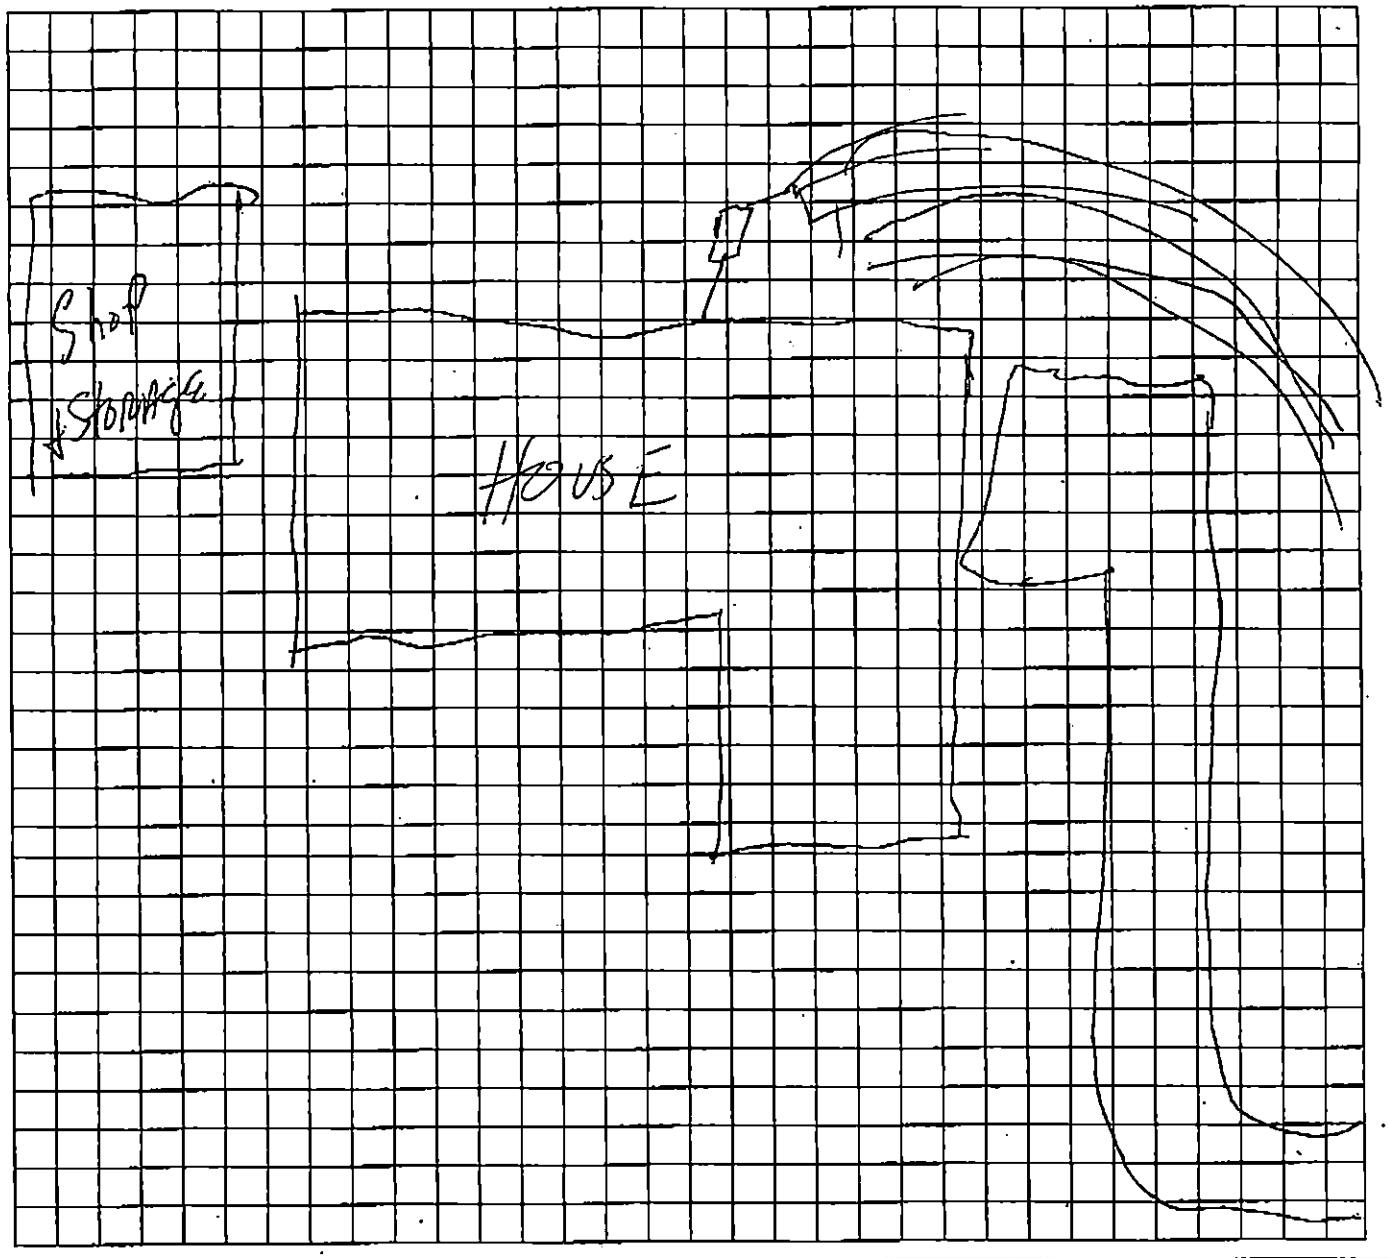

"The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the "Job Location" contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted by this Department.
- This permit is not transferable.
- Addition/Renovation approval valid 1 year from issuance date
- Mobile home exchange approval valid 6 months from issuance date

Approval for shop storage shed
use existing system
Thato Walker RS 9/1/11

REHS Signature Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11

AUG. 31. 2011 11:30AM NO. 4193 P. 3