SEE INSTRUCTIONS ON BACK

Date Received 9/23/77

ICAR(S) Application No. 12808

T C No. 111-211-035


Map Date 1-14-77

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to

1 ____ Install or Construct 2 X Alter or Repair an individual septic tank wastewater treatment system with a subsurface soil absorption effluent discharge

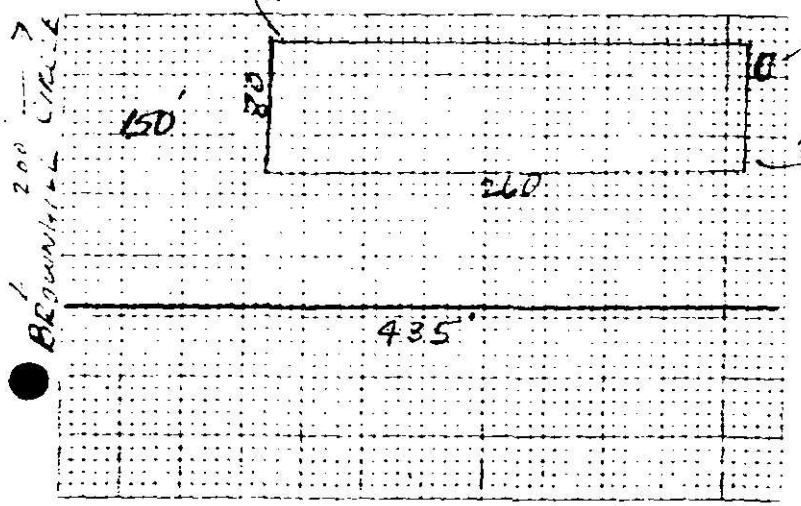

3) PLOT PLAN (ACCURATELY DIMENSIONED)

4) Mobile Home Yes ___ No ___
Residence Yes ___ No ___

5) No. of Bedrooms ___

6) Business Use X Max. No. Employees 30

7) Washing Machine ___ Yes X No

8) Garbage Disposal ___ Yes X No

9) Dishwasher ___ Yes X No

10) Water Supply
A) Individual Well ___
B) Governmental System X
C) Community System
1) Well source ___
2) Governmental source ___

Sewage System
House located within 200 feet of public sewer ___ Yes X No
House located within 200 feet of community sewer ___ Yes X No

11) FHA Case No. ___

12) VA Case No. ___

13) NAME OF OWNER Peachtree Investment Corporation
LAST FIRST MIDDLE

14) ADDRESS OF OWNER 4329 Belhaven Boulevard

15) PHONE NO. Home ___ Office 392-5146

16) LOCATION OF SYSTEM 1000 Browhill Circle (Emery Air Freight Building)
STREET OR COUNTY ROAD

17) SUBDIVISION ___ Lot No ___ Block No. ___

Map Book No ___ Page No. ___

18) DEED REFERENCE -- DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? X YES NO DATE RUN 1970

20) PTR NUMBER (See Instructions ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

September 21, 1977
DATE OF APPLICATION

Peachtree Investment Corp
Wm. E. Godley
OWNER

EHD-S-76

Environmental Health Department's Copy

Date Issued 26 Sep 1977

Serial No. 1134


ICAR(S) Permit No. 12808

T C No 111-211-035

Map Date 1-12-77

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to Install or Construct ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface soil absorption effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 12808, dated 9-21-77 and this permit shall be void and of no effect if the information provided in the application is not true and correct. All work shall be completed on or before 10 Oct 1977 after which date this permit shall be null and void.

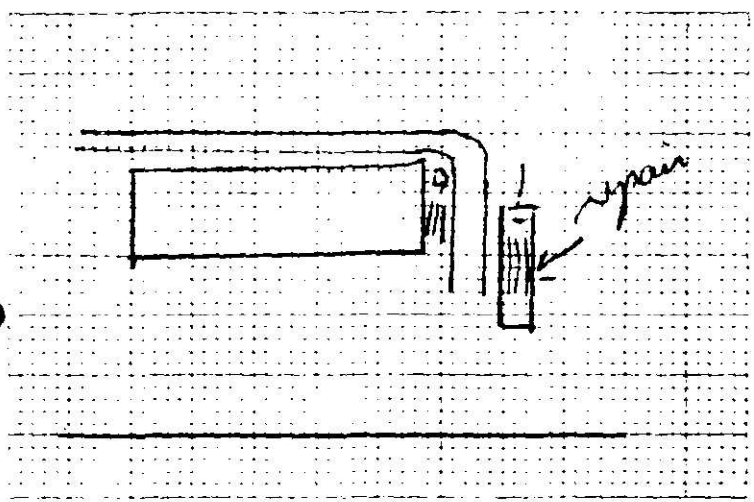

PLOT OF SYSTEM

Permeability Rate —

Liquid Capacity of Tank 1000

Tank Construction precast

Absorption and/or Nitrification Lines

Total Line Length 200

Number of Lines 4

Distance from House 10'

Distance from Property Line 10

Distance from Well —

NAME OF OWNER Peachtree Investment Corp

LOCATION OF PROPERTY ~~Eastway~~, 1000 Brownhill Circle

The system is designed and shall be constructed in accordance with the requirements as set forth in the Regulations of the Mecklenburg County Commissioners which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered inaccessible for use. **The issuance of this permit does not in any way guarantee that the system anticipated to be cosntructed will oeprate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

Comments in bed

12 x 5'0" x 1'0"

John R. Robinson

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

Date Issued 28 Sept 1977 Serial No. 1066 C of A Isl No. 12402

T C No 111-211-035

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Peachtree Investment Corp (LAST / FIRST / MIDDLE)

Location of Property 1000 Brownhill Circle

Application Number _____ Permit Number 12402

~~Inspection Date:~~ Repair

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 200 Number of Lines 4

Depth of Filter Material 12" Cover Depth 15"

Water Supply Source municipal Distance from Water Source —

Excavation Inspected — (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 9-28-77 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit as in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments installed as permitted

John R Atkinson
Environmentalist

EHD-S-76

Environmental Health Department's Copy