FILE NUMBER: 7389B Chk 6284 Revised On: August 31, 2007 APPLICATION NUMBER: 2842

SEPTIC FEE: 200
DATE: 10/17/07

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: _____
DATE: _____

1. SEPTIC / TYPE APPLICATION: ☐ NONE ☒ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☒ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 139-161-08
STREET ADDRESS: Old Camden Rd
CITY: Midland
STATE: NC ZIP: 28107
SUBDIVISION NAME:
LOT #: 3 LOT SIZE (acres): 8/3
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☒ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:
BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☒ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE: 3000
NUMBER OF BEDROOMS: 5
NUMBER OF OCCUPANTS:
FOUNDATION TYPE:
☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☒ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A
NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☐ MUNICIPAL ☒ PUBLIC WELL ☐ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

	☒ ANY TYPE	☐ CONVENTIONAL	☐ ACCEPTED	☒ INNOVATIVE	☒ ALTERNATIVE	☐ OTHER _____
8A. RANK:	4	1	___	2	3	___

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES ☒ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES ☒ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☐ YES ☒ NO	JURISDICTIONAL WETLANDS	☐ YES ☒ NO
WELLS, SPRINGS, OR WATER LINES	☐ YES ☒ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES ☒ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES ☒ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES ☒ NO

10. PROPERTY OWNER:
NAME: Gold Medallion Homes, LLC
ADDRESS: 5923-A Stockbridge Drive
CITY: Monroe
STATE: NC ZIP: 28110
HOME PHONE: WORK PHONE: (704)821-7606
MOBILE PHONE: FAX:

11. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: Joseph L. Collins
ADDRESS: 1101 Lester Mullis Road
CITY: Indian Trail
STATE: NC ZIP: 28079
HOME PHONE: WORK PHONE:
MOBILE PHONE: (704)641-5898 FAX: (704)753-5898

12. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 9/7/2007
13 WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? already closed on 9/7/2007


14. SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

Joseph L Collins 10/16/07
Property Owner's or Owner's Legal Representative Signature Date

15. WELL PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

_____
Property Owner's or Owner's Legal Representative Signature Date

☐ SURVEY PLAT TO SCALE SUBMITTED ☒ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

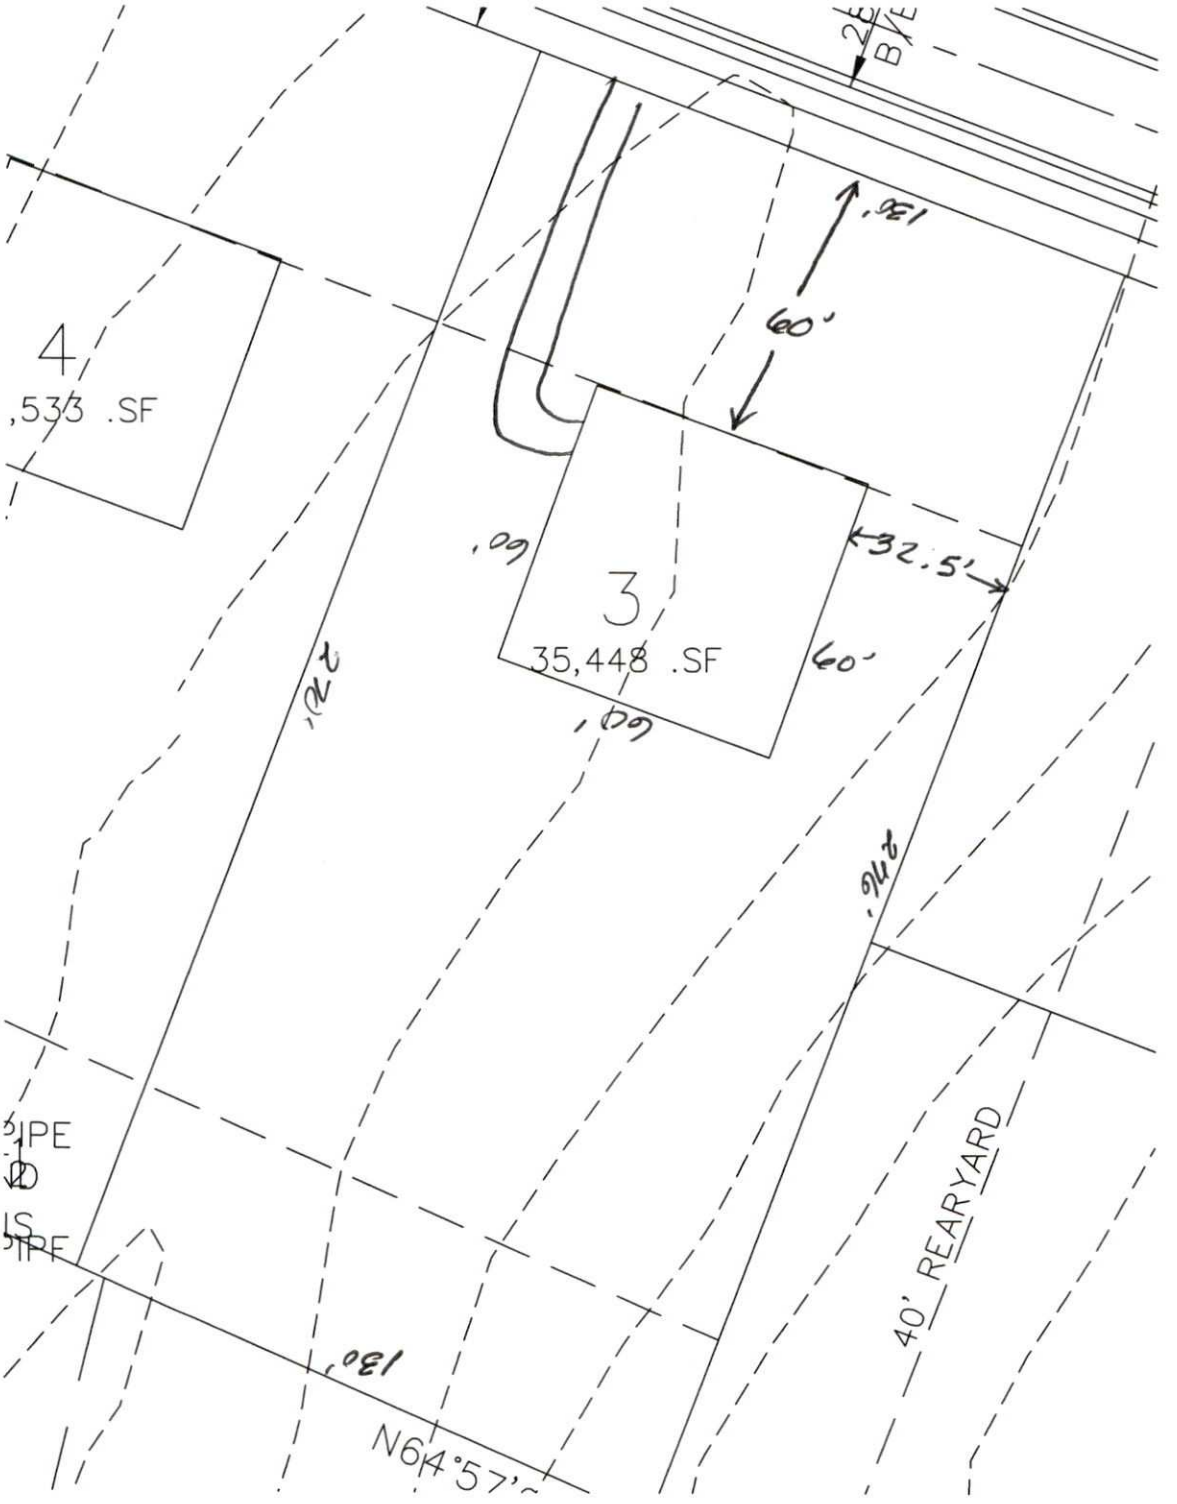
4
,533 .SF
3
35,448 .SF
60'
60'
60'
32.5'
216'
216'
130'
40' REARYARD
N64°57'
IPE
IS
IPE

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: PO 139-161-08
Lot #: 3
File #: 7389B
AppID: 2842

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Gold Medallion Homes LLC
Applicant: Joseph L. Collins
Address: 5923-A Stockbridge Drive, Monroe, N. C. 28110
Date Evaluated: 11/15/07
Proposed Facility: Residence
Design Flow (.1949): 600gpd
Property Size: .81a
Location of Site: Off Old Camden Road
Property Recorded:
Water Supply: [x] Public [ ] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 6	0-25	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	48	N/A	NONE	PS, IV
		25-34	SBK/CL	"					.25GPD/FT^2
		34-48	SBK/ABK/C	FI/SEXP/S/P					
2	"	0-6	GR/CL	FR/SEXP/SS/SP	"	"	"	"	PS, III
		6-39	SBK/CL	"					.25GPD/FT^2
		39-48	SBK/ABK/C	FI/SEXP/S/P					
3	LS, 8	0-4	GR/CL	FR/SEXP/SS/SP	"	"	"	"	PS, IV
		4-15	SBK/CL	"					.275GPS/FT^2
		15-48	SBK/ABK/C	FI/SEXP/S/P					
4	"	0-5	GR/CL	FR/SEXP/SS/SP	"	"	"	"	"
		5-48	SBK/ABK/C	FI/SEXP/S/P					
5	"	0-6	GR/CL	FR/SEXP/SS/SP	"	"	"	"	"
		6-48	SBK/ABK/C	FI/SEXP/S/P					
					SITE LTAR				
					BORINGS 1, 2- .25GPD/FT^2				
					BORINGS 3-5- .275GPD/FT^2				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)		
Site LTAR		


Other Factors (.1946):
Soil Evaluation By: W. R. Marlin, LSS, 11/15/2007, W. R. Marlin
Others Present:
Site Classification (.1948):
Site Evaluation By:
Others Present:

COMMENTS:
100% repair

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

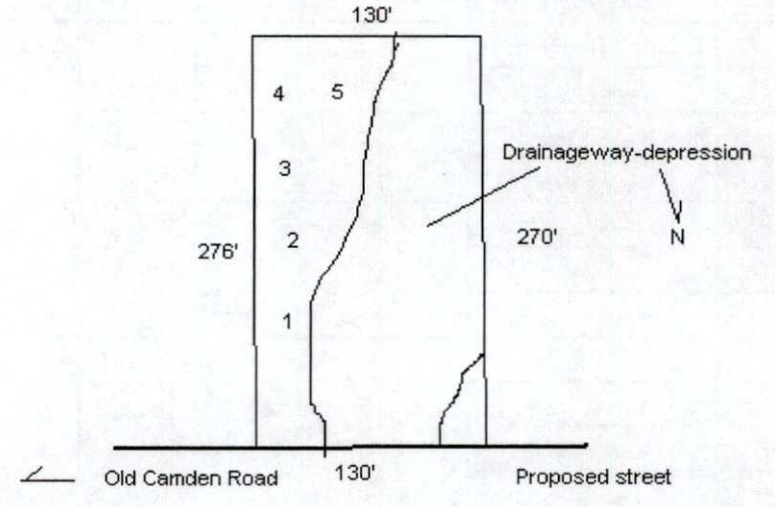

11/26/08

To: Jason Jackson, R.S.

From: T. Whitt.
704 930-43444

RE: OID Camden

Lot 3

REVISION

(3) ~~Bedrm~~. Pumped Chamber
panel Repair (See plan)


cover plus IPS.

Thanks,

T.W.

M.C.G.W.S.
File: 7387-B
Lot 3 Old Camden Est.

(3) Bedrm. 25% Reduction - Quick Four Septic Sys.
LTAR .25 1,500 gal. Septic Tank, 1,000 gal. Pump Tank,
Distribution - pressure manifold.
(3) 120' chamber Lines = 360'
(30) chambers per Line = 90 chambers REQ.

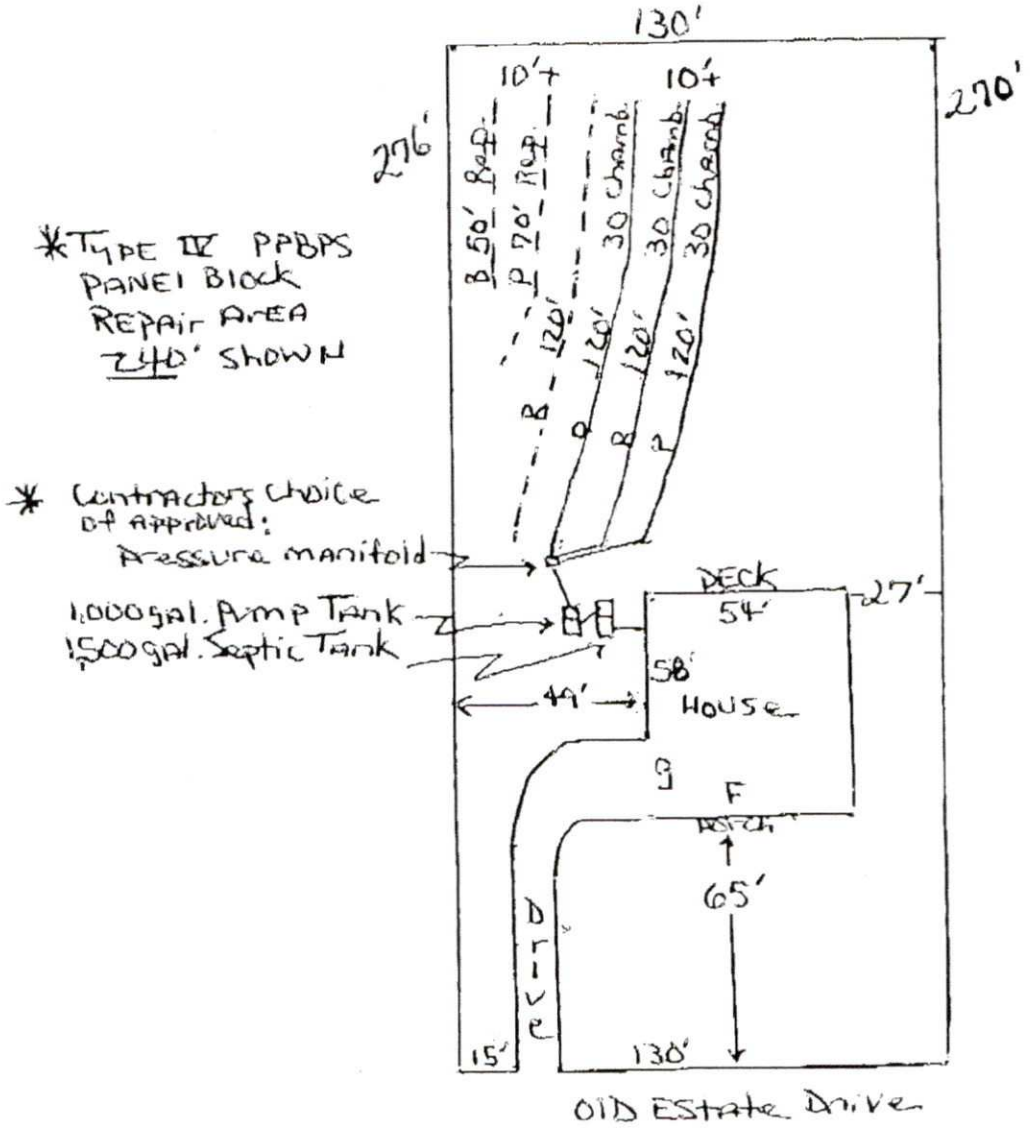

Revised 11/25/08
Tim Whittaker
704 636-4344
C/SC

M.C.G.W.S.


File: 7389-B

Lot 3 Old Camden Estate

(3) Bedrm. Gravity Fed, 25% Reduction Septic Sys, LTAR .25 Quick Four Chamber. 1,500 GAL. Septic Tank, Distribution Box

(4) 92' Chamber Lines = 368'

(23) Chambers per Line = 92 Chambers Req.

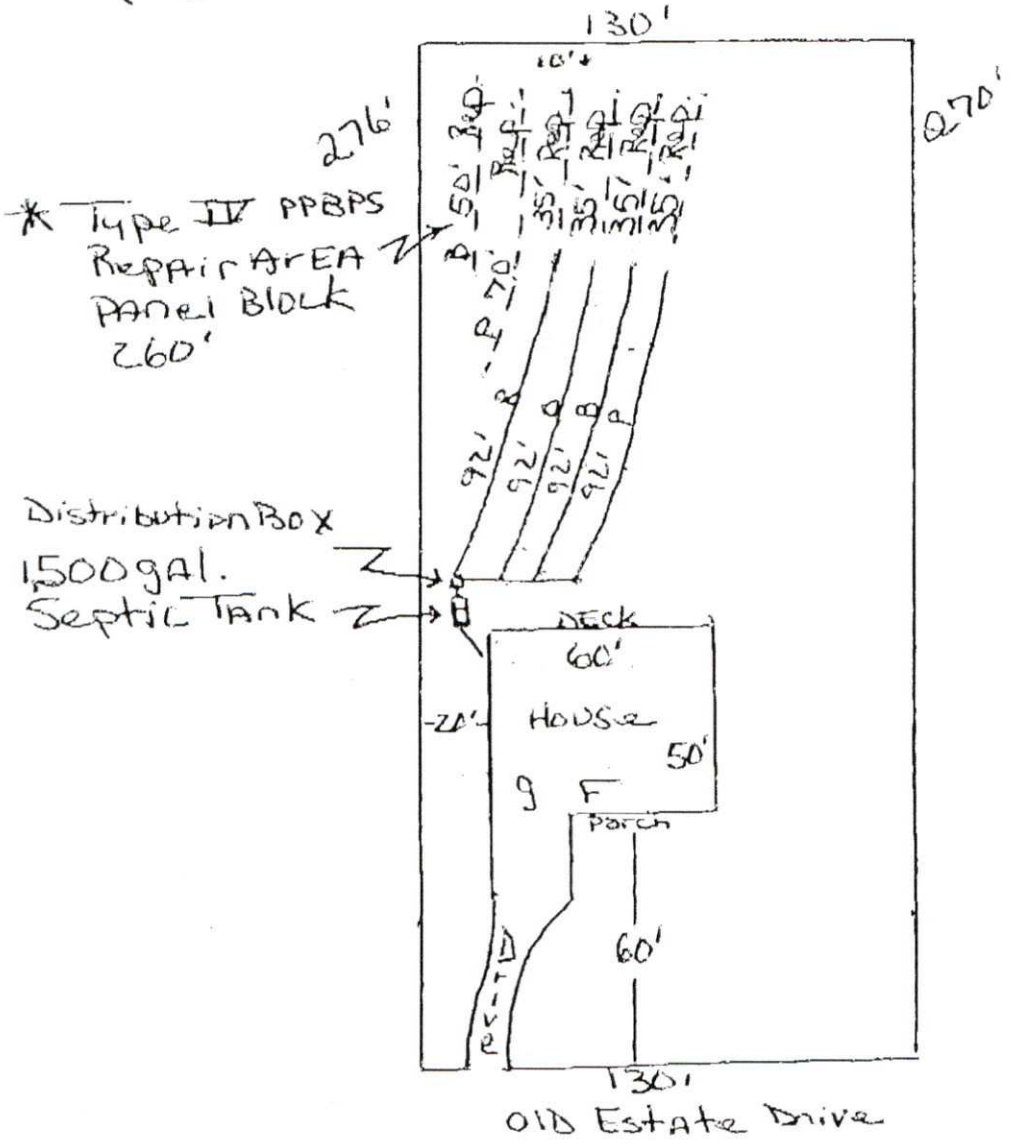

* Bldr. Responsible for final grade to maintain gravity flow Septic Sys.

11/24/08
Tim Whittaker
704 636-4364
5150