

9231 GARRISON RD

14112131

5/31/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

5327A

Mecklenburg County
Health Department

February 13, 1990

CERTIFIED MAIL
RETURN RECEIPT REQUESTED

Steve Autry
Autry Septic Tank Service
8918 Byrum, NC 28210
Charlotte, NC 28210

Re: Illegal Repair at 9231 Garrison Rd.

Dear Mr. Autry:

This department has been informed of an illegal repair performed by you. If illegal repairs are made in the future on any property in Mecklenburg we will pursue legal action against you as this is a violation of Article 11 of Chapter 130A of the GENERAL STATUTES OF NORTH CAROLINA - SANITARY SEWAGE SYSTEMS.

As a registered contractor you are aware that: (1) §130A-335 requires an approved sanitary sewage system; (2) §130A-336 requires an improvement permit to be issued prior to proceeding with construction and/or the installation or repair of a sanitary sewage system; and (3) §130A-337 requires that no sanitary system of sewage collection, treatment, and disposal be covered or placed into use until and inspection is made by the local health department. These requirements exist to protect the public's health by preventing groundwater contamination as well as protect the environment.

This correspondence is to advise you that this department is aware of the occurrence of an illegal repair, to reiterate to you the illegality of such activities under the General Statutes of North Carolina, and to provide formal documentation to be used as evidence in court should notification of such violations reoccur in the future.

I suggest you contact me if you have any questions concerning this matter.

Very truly yours,

Gene Vaughan, R.S., Supervisor
On Premises Waste Disposal & Water Supply

\DAN\ILLEGAL.CON

Environmental Health Division
1200 Blythe Boulevard • Charlotte, North Carolina 28203 • (704) 376-4603

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT

MECKLENBURG COUNTY · ENVIRONMENTAL HEALTH


1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 5327A DATE: 1/6/89

TC: 141-121-31 ☐ L

SERIAL № 12421

Permission is hereby given to ____ Install or Construct, ✓ Alter or ~~Repair~~ the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 1/6/89. All work shall be completed on or before 2/6/89, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Department of Environmental Health before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

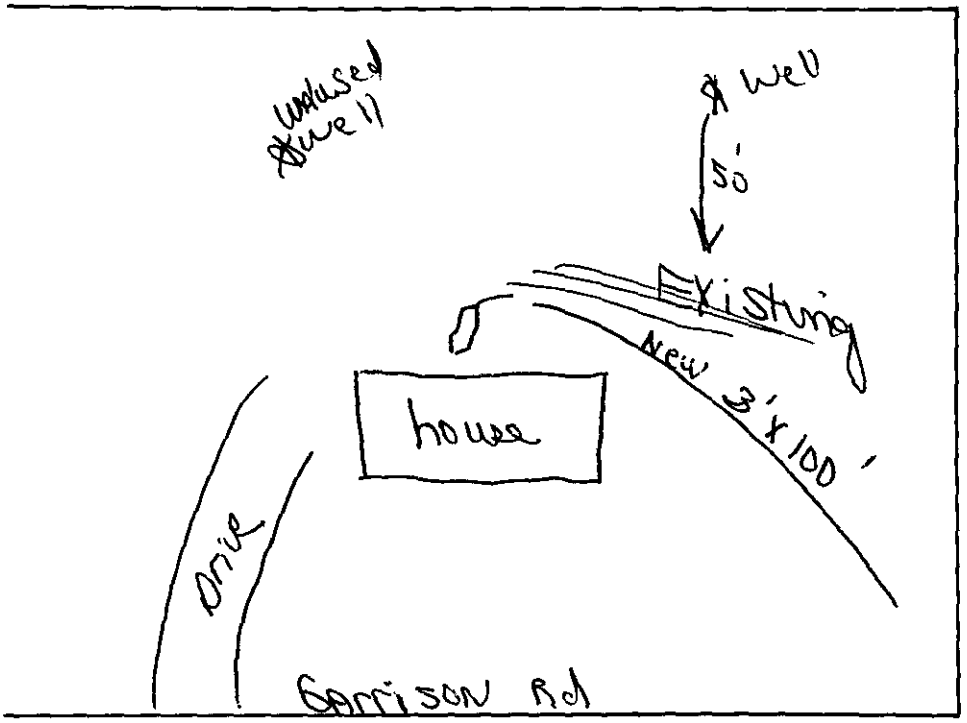

PLOT OF SYSTEM

Liquid Capacity of Septic Tank ____ gallons

Liquid Capacity of Dosing Tank ____ gallons

Tank Construction Repair

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 100 feet

Number of Lines 1

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well 50 feet

NAME OF OWNER Aldrich, Louis

LOCATION OF PROPERTY 9231 Garrison Rd

Comments: INSTALL one Trench 3' x 100' 12" Stone
Straw Cover

Division or Section Head

Judy J Kuei R.S.
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - ENVIRONMENTAL HEALTH DEPARTMENT'S COPY ● CANARY - ENVIRONMENTALIST'S COPY ● PINK - OWNER OR AGENTS COPY

APPLICATION FOR AN IMPROVEMENT PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

(OFFICE USE ONLY)
FILE: 5327A
TC: 141-12-31
SERIAL: № 17484 ☐ L ☐ CRT

JOB LOCATION

① ADDRESS: 9231 Garrison Rd. (STREET NO. / STREET) ② FILE:
③ JURISDICTION: ④ TAX PARCEL NO.: 141-121-31 (shown as 93-11)
⑤ SUBDIVISION: ⑥ LOT: ⑦ BLOCK:

OWNER

⑧ NAME: Louis W. Aldrich (FIRST) W Wolson (MIDDLE) Aldrich (LAST)
⑨ MAILING ADDRESS: 9231 Garrison Rd.
⑩ CITY: Charlotte ⑪ STATE: N.C. ⑫ ZIP: 28208
⑬ PHONE: (WORK) Retired ⑭ (HOME) 588-0487

REQUEST

This request is for a(n):

⑮ ☐ New permit
⑯ ☒ Repair or alteration permit
⑰ ☐ Authorization for mobile home exchange
⑱ ☐ Other (specify)

DESIGN CRITERIA

System will serve:

⑲ ☐ Residence ⑳ ☐ Mobile home ㉑ ☐ Business or place of public assembly
㉒ Number of bedrooms? 2 ㉕ Type?
㉓ Maximum occupancy? 2 ㉖ Maximum number of employees?
㉔ Basement? ☐ yes ☒ no ㉗ Maximum number of seats?

WATER SUPPLY

㉘ Water supply from (present or proposed):

A ☑ Individual well
B ☐ Municipal system
C ☐ Community well
D ☐ Community system

㉙ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Louis W. Aldrich
Date: Jan. 6, 1989

IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

... No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair permit is issued by this Department.

... This permit is not transferable, and shall become null and void 36 months from the date of issuance.

Environmentalist / Date

Director or Authorized Section Head / Date

*This permit must be signed by the Director of Mecklenburg County Health Department or an authorized section head in order to be valid.