89798

# Supervisor/Administrative Professional Checklist

**New Septic** ☐ **New Well** ☐ **Use Existing** ☐ **Alteration** ☐ **Modified Plot Plan** ☐

**New Septic Fees Paid:**

IP ($250.00) lwa 6/30/14 Initials/Date

CA ($200.00) lwa 7/22/14 Initials/Date

OP ($200.00) lwa 7/22/14 Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

**New Well Fee Paid:** $550.00 _____ Initials/Date

**Use Existing Fee Paid:** $100.00 _____ Initials/Date

**Alteration Fee Paid:** $300.00 (Total) $200 (If use existing was paid)_____ Initials/Date

**Modified Plot Plan Fee Paid:** $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. ☒ Reviewed ☒ JAM
✓ OK TO RELEASE CA.

This site is served by septic and well. Verify each is complete before final hold is released. ☐

Septic file completed. ☒ SAM Well file completed. ☐ NA

Send permit for signature. ☒ Signature received. ☑ 7/17/14

This septic system requires a certified operator contract before final hold is released. ☐

Certified operator contract is on file. ☐ _____

## Groundwater & Wastewater Services
### Septic Project File & Data Review Worksheet

GWS File #: 19798 WASPS App #: 6916

Primary ES assigned to project: Josh Sellers

Secondary ES assigned to project: _____

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

**I. File Review:**

| Rule or Law | Permit Application | | | |
|---|---|---|---|---|
| .1937(d) | Is the Application complete | Yes ☑ | No ☐ | N/A ☐ |
| .1937(d) | Is there a Site plan/Plat with application | Yes ☑ | No ☐ | N/A ☐ |
| .1937(d) | Is the Facility shown? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(d) | Are appurtenances shown | Yes ☑ | No ☐ | N/A ☐ |
| | **Site Evaluation Information** | | | |
| .1939 (a)(1) | Topography and Landscape Position Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1940 (a-g) | Slope % Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(2) | Texture Class Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(2) | Structure type Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(2) | Consistence Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(2) | Mineralogy Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(3) | Soil Wetness Condition Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(4) | Soil Depth to Rock or Parent Material Recorded When Encountered | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(5) | Depth to Restrictive Horizons Recorded When Encountered? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(6) | Sufficient Available Space Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(m) | Are the Profile Locations Shown? | | | |
| .1939(a) | Are the S/PS Profiles in system & in repair area? | Yes ☑ | No ☐ | N/A ☐ |
| & .1945(b) | Number of auger borings made: 5 | | | |
| | Were sufficient auger borings made? | Yes ☑ | No ☐ | N/A ☐ |
| .1939(d), .1955, .1956, .1957 | LTAR 0.3 | Yes ☑ | No ☐ | N/A ☐ |
| | **Improvement Permit/Construction Authorization** | | | |
| .1937(g) 130A-336(a) | Proposed System Type stated-Initial | Yes ☑ | No ☐ | N/A ☐ |
| .1945(b) | Proposed System Type stated-Repair | Yes ☑ | No ☐ | N/A ☐ |
| 130A-336 (a)(3) | System location identifiable by setbacks - Initial | Yes ☑ | No ☐ | N/A ☐ |
| .1937(g) .1945(b) | System components shown – Initial | Yes ☑ | No ☐ | N/A ☐ |
| .1945(b) | Repair area shown | Yes ☑ | No ☐ | N/A ☐ |
| .1937 (f)(g) | Does System design match facility, flow & WWcharacteristics? | Yes ☑ | No ☐ | N/A ☐ |
| ~~.1937 (f)(g)~~ | ~~Is System design consistent with~~ soil/site conditions? | Yes ☑ | No ☐ | N/A ☐ |
| .1937 (f)(g) | Is the System located in the approved area? | Yes ☑ | No ☐ | N/A ☐ |
| 130A-336(a) | Is the Design flow (gpd) indicated? 480 | Yes ☑ | No ☐ | N/A ☐ |

| | | | | |
|---|---|---|---|---|
| 130A-336(a) | Number of Bedrooms, employees, seats, etc. indicated? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(g) | Trench depth indicated? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(g) | Trench width indicated? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(g) | Trench length indicated? | Yes ☑ | No ☐ | N/A ☐ |
| 130A-336(a)(1) | Proposed/existing well shown? | Yes ☐ | No ☐ | N/A ☑ |
| 130A-336(a)(1) | Property line lengths shown? | Yes ☑ | No ☐ | N/A ☐ |
| 130A-336(a) | Facility/appurtenance setbacks shown from fixed points? | Yes ☑ | No ☐ | N/A ☐ |

**Operation Permit**

| | | | | |
|---|---|---|---|---|
| .1937(i) | System type as described in table V(a) of rule .1961 | Yes ☑ | No ☐ | N/A ☐ |
| .1937(i) | Conditions for system performance, operation, maintenance, monitoring and reporting. | Yes ☑ | No ☐ | N/A ☐ |

**II. WASPS Review:**

| | | | |
|---|---|---|---|
| Construction authorization issued | Yes ☑ | No ☐ | N/A ☐ |
| Installation approval issued | Yes ☑ | No ☐ | N/A ☐ |
| Operation permit issued | Yes ☑ | No ☐ | N/A ☐ |
| Other related documentation | Yes ☑ | No ☐ | N/A ☐ |

# Items requiring correction/modification: _____

Comments:

IA issued date: 4/22/15

OP issued date: 4/30/15

Review performed by: JMM Date performed: 6/1/15

8979B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

App # 6916

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION
FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ● NEW SYSTEM ○ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ● N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 195-073-64
STREET ADDRESS: 3506 Piaffe Ave.
CITY: Mint Hill, NC 28227
STATE: NC ZIP: 28227
SUBDIVISION NAME: Cheval
LOT #: 31 LOT SIZE (acres): _____
TOWNSHIP:
○ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ● MINT HILL

4. BUILDING INFORMATION:
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
● HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 3651
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
● CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☒ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ● MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. PROPOSED USE OF WELL: ● N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 6-LEAST DESIRED)*:

☐ N/A ☐ ANY TYPE ☒ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: 1 ___ ___ ___ ___ ___

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

| | | | |
|---|---|---|---|
| BURIED CABLES, LANDFILLS, STUMPHOLES | ○ YES ● NO | GRADING/SOIL REMOVAL PERFORMED | ● YES ● NO |
| EXISTING WASTEWATER (SEPTIC) SYSTEMS | ○ YES ● NO | JURISDICTIONAL WETLANDS | ○ YES ● NO |
| WELLS, SPRINGS, OR WATER LINES | ○ YES ● NO | APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY | ○ YES ● NO |
| EASEMENTS OR RIGHT-OF-WAYS | ● YES ○ NO | WASTEWATER OTHER THAN DOMESTIC SEWAGE | ○ YES ● NO |
| CHEMICAL/PETROLEUM STORAGE TANKS | ○ YES ● NO | KNOWN UNDERGROUND CONTAMINATION | ○ YES ● NO |
| WASTE STORAGE | ● YES ● NO | GROUNDWATER USE RESTRICTIONS/VARIANCES | ○ YES ● NO |

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☒ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____ ☒ N/A

12. PROPERTY OWNER:
NAME: Bains Farm Inc.
ADDRESS: 1111 Metropolitan Ave.
CITY: Charlotte
STATE: NC ZIP: 28204
WORK PHONE: 704-373-9996
MOBILE PHONE: _____
FAX: _____
E-MAIL: jjoles@parisprojects

13. ~~OWNER'S LEGAL REPRESENTATIVE~~ (Builder), IF APPLICABLE:
NAME: Paragon Homes of Charlotte
ADDRESS: 6000 Towne Centre Blvd. STE 201
CITY: Pineville
STATE: NC ZIP: 28134
WORK PHONE: (704) 889-0218
MOBILE PHONE: John Belmont 704-408-2779
FAX: 704-889-0221
E-MAIL: JWitmer@arhomes.com



MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

**14. SEPTIC SYSTEM PERMIT APPLICATION:**

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labelling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

**15. WELL PERMIT APPLICATION:**

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

**16. APPLICATION SIGNATURE SECTION:**

**ONLY COMPLETE APPLICATIONS WILL BE PROCESSED.** A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

_____ 6.30.14

Property Owner's or Owner's Legal Representative Signature — Date

---

*OFFICE USE ONLY*

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ 250 DATE FEE RECEIVED: 6/30/14

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: DWR

GWS FILE NUMBER ASSIGNED: 8979B

APPLICATION ID NUMBER ASSIGNED: 6916

COMMENTS:



MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 195-073-64
Lot #: 37
File #: 8979B
AppID: 6916

# SOIL/SITE EVALUATION
# for ON-SITE WASTEWATER SYSTEM

Property Owner: Bains Farm Inc.
Applicant: Paragon Homes of Charlotte
Address: 1111 Metropolitan Ave., Charlotte, NC 28204
Date Evaluated: 7/11/2014
Proposed Facility: 4 Bedroom House
Design Flow (.1949): *480 GPD*
*Property Size: 1.57 ac*
Location of Site: 3506 Piaffe Ave, Mint Hill, NC 28227
Property Recorded: Unknown
Water Supply: [X] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

| PROFILE # | 1940 Landscape Position/ Slope% | Horizon Depth (IN.) | SOIL MORPHOLOGY 1941 1941 Structure/ Texture | 1941 Consistence Mineralogy | b PROFILE FACTORS 1942 Soil Wetness/ Color | 1943 Soil Depth (IN.) | 1956 Sapro Class | 1944 Restr Horiz | General Comments | Profile Class & LTAR | Maximum Trench Bottom Depth for 3' Wide Conventional Trench |
|---|---|---|---|---|---|---|---|---|---|---|---|
| Boring #1 | LS 6% | 0 - 13 | wfsbk SCL | FR SEXP | >32" | 32 | NA | NA | 3 auger attempts hit rock around 32" | PS IV 0.3 | 18" |
| | | 13 - 32 | mfsbk C | FR SEXP | | | | | | | |
| | | 32 | Rock | | | | | | | | |
| Boring #2 | LS 6% | 0 - 6 | wfsbk SCL | FR SEXP | >50" | 50 | NA | NA | saprolite inclusions 40 - 50" | PS IV 0.3 | 36" |
| | | 6 - 30 | mmsbk C | FI SEXP | | | | | | | |
| | | 30 - 50 | wfsbk CL | FR SEXP | | | | | | | |
| Boring #3 | LS 10% | 0 - 8 | wfsbk CL | FR SEXP | >52" | 52 | NA | NA | | PS IV 0.3 | 36" |
| | | 8 - 45 | mmsbk C | FI SEXP | | | | | | | |
| | | 45 - 52 | mfsbk CL | FR SEXP | | | | | | | |
| Boring #4 | LS 13% | 0 - 16 | wfsbk CL | FR SEXP | >53" | 53 | NA | NA | | PS IV 0.3 | 36" |
| | | 16 - 53 | mfsbk C | FI SEXP | | | | | | | |
| Boring #5 | LS 13% | 0 - 8 | wfsbk CL | FR SEXP | >53" | 53 | NA | NA | | PS IV 0.3 | 36" |
| | | 8 - 39 | mmsbk C | FI SEXP | | | | | | | |
| | | 39 - 53 | mfsbk SCL | FR SEXP | | | | | | | |
| Boring #A | LS 5% | 0 - 2 | gr CL | FR SEXP | >35" | 35 | US | NA | | PS IV 0.3 | 21" |
| | | 2 - 30 | mmabk C | FI SEXP | | | | | | | |
| | | 30 - 35 | mfabk CL | FR SEXP | | | | | | | |
| | | 35 | Rock/Sap | | | | | | | | |
| Boring #B | LS 6% | 0 - 4 | Fill | | >48" | 48 | NA | NA | | PS IV 0.3 | 34" |
| | | 4 - 12 | gr SL | FR SEXP | | | | | | | |
| | | 12 - 48 | mmabk C | FI SEXP | | | | | | | |

| Description | Initial System | Repair System |
|---|---|---|
| Available Space (.1945) | | |
| System Type(s) | | |
| Site LTAR (gpd/sq ft) | 0.3 | 0.3 |


Other Factors (.1946):
Soil Evaluation By: Jacob Presley, REHSI, LSS
Others Present:
Site Classification (.1948):
Site Evaluation By:
Others Present:

**COMMENTS: Recommend installation depth at 36".**

| Landscape Position | Group | Texture | .1955 LTAR | Structure |
|---|---|---|---|---|
| R-Ridge | I | S-Sand | 1.2 - 0.8 | sg-Single Grain |
| SS-Shoulder Slope | | LS-Loamy Sand | | mass-Massive |
| LS-Linear Slope | | | | cr-Crumb |
| FS-Foot Slope | II | SL-Sandy Loam | 0.8 - 0.6 | gr-Granular |
| NS-Nose Slope | | L-Loam | | sbk-Subangular Blocky |
| HS-Head Slope | | | | abk-Angular Blocky |
| CC-Concave Slope | III | Si-Silt | 0.6 - 0.3 | pl-Platy |
| CV-Convex Slope | | SiCL-Silty Clay Loam | | pr-Prismatic |
| T-Terrace | | | | Sap-Saprolite |
| FP-Flood Plain | | CL-Clay Loam | | **Structure Prefixes** |
| D-Drainage Way | | SCL-Sandy Clay Loam | | w-weak |
| | | | | m-moderate |
| | | SiL-Silt Loam | | s-strong |
| | | | | f-fine |
| | IV | SC-Sandy Clay | 0.4 - 0.1 | m-medium |
| | | SiC-Silty Clay | | c-coarse |
| | | C-Clay | | |

| Consistence Moist | Consistence Wet | Mineralogy |
|---|---|---|
| VFR-Very Friable | SS-Slightly Sticky | SEXP-Slightly Expansive |
| FR-Friable | S-Sticky | EXP-Expansive |
| FI-Firm | VS-Very Sticky | |
| VFI-Very Firm | NP-Non-Plastic | **Classification** |
| EFI-Extremely Firm | SP-Slightly Plastic | US-Unsuitable |
| | P-Plastic | PS-Provisionally Suitable |
| | VP-Very Plastic | S-Suitable |
| | | NA-Not Applicable |


**Sketch of Soil Evaluation Locations**

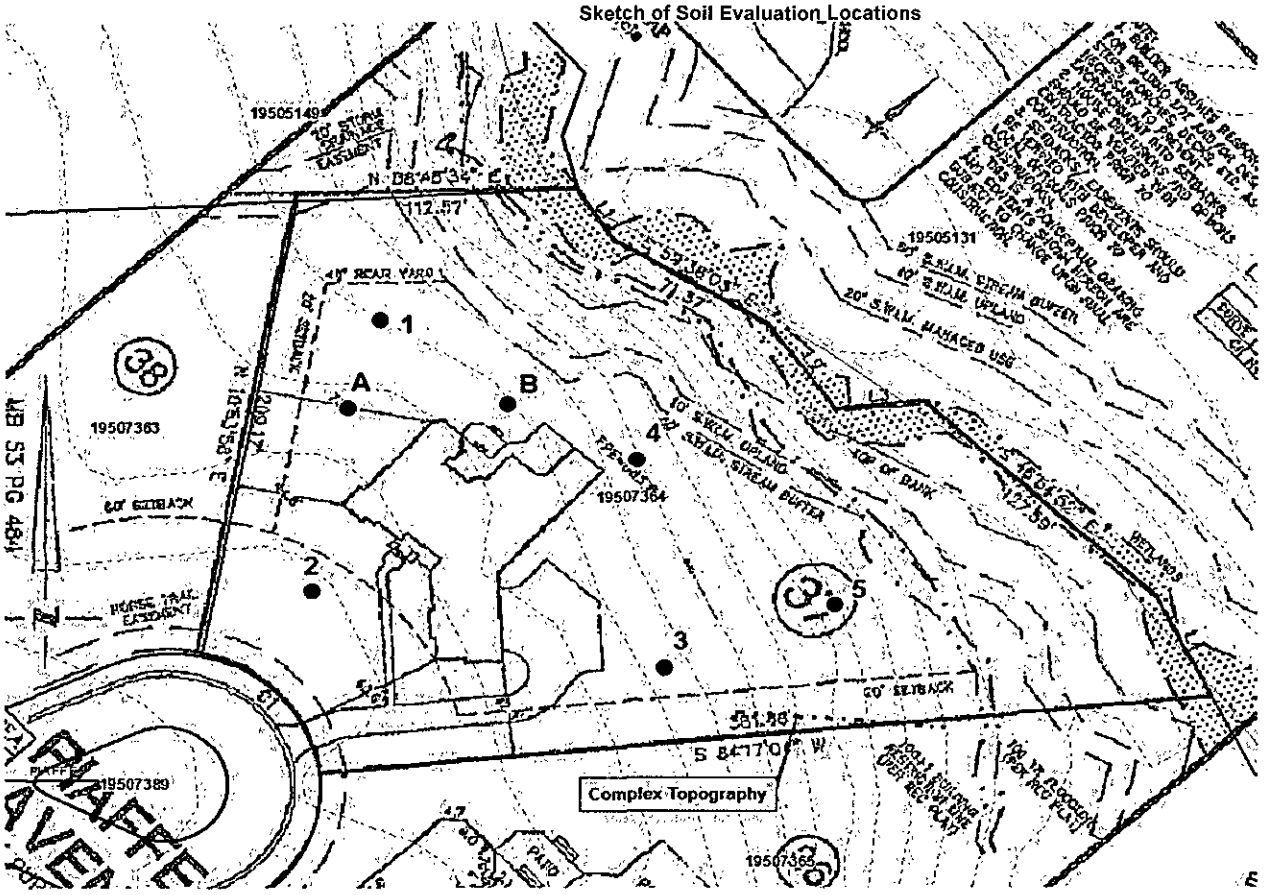

Comments: ① 1500 gal. Septic Tank.
② Type III g Initial System
Type IV Repair for (4) bedroom design unit.

**Parcel # 195-073-64**
**File # 8979B**
**AppID: 6916**


③ Install lines level and on contour
④ Stay 7'10 off property lines
>5' off bldg foundation

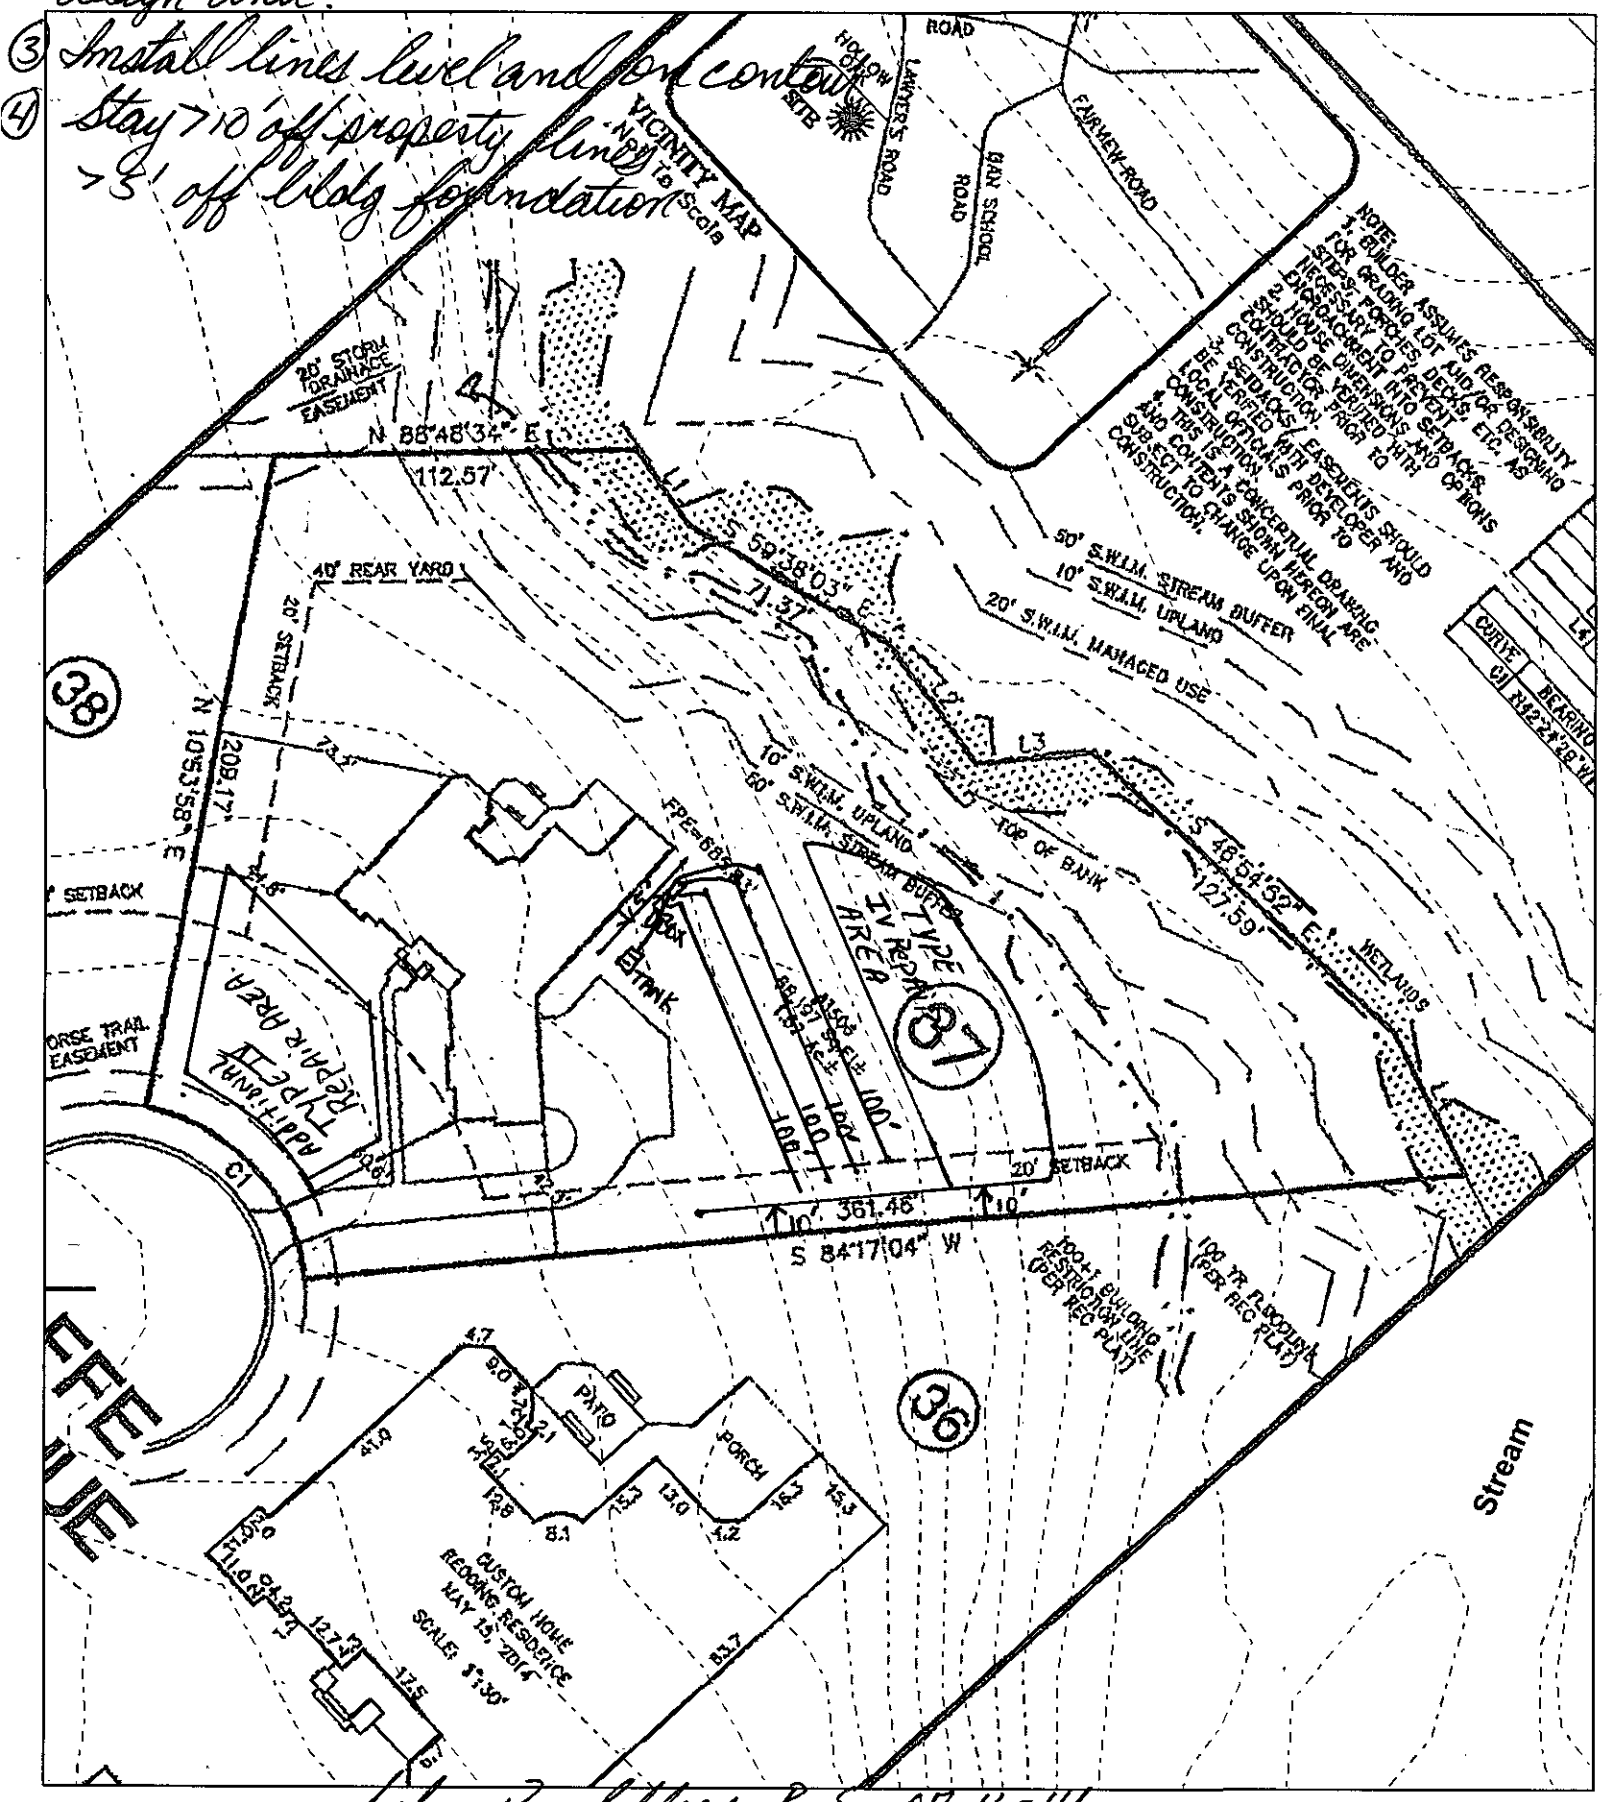


Joshua R. Sellers R.S 07-16-14

Map Created By:
Map Created On:

0 30 60 Feet

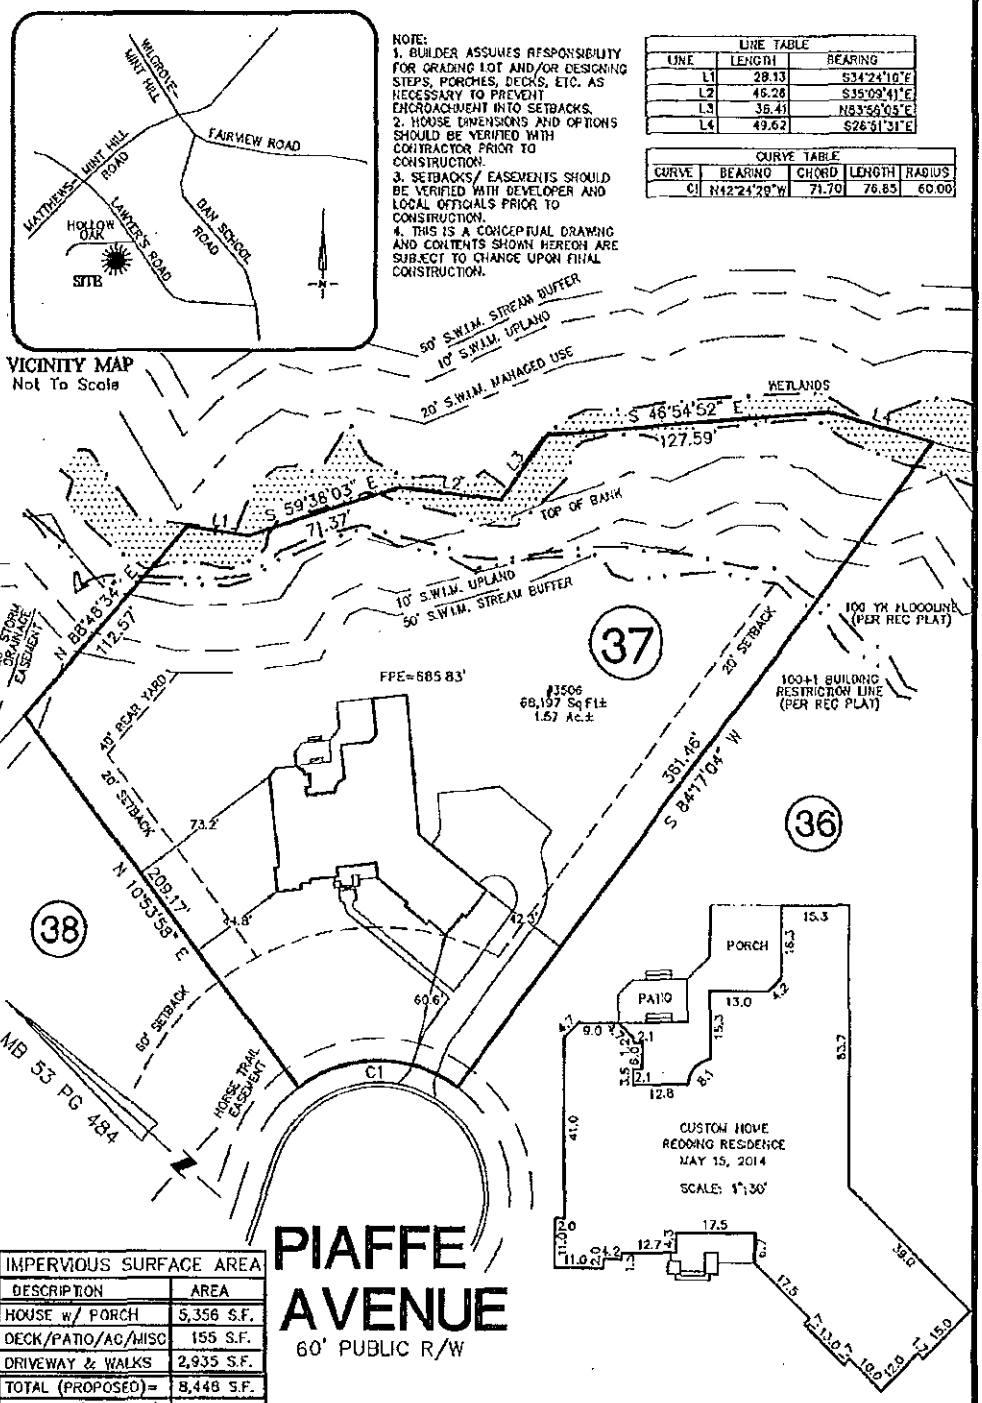


| IMPERVIOUS SURFACE AREA | |
|---|---|
| DESCRIPTION | AREA |
| HOUSE w/ PORCH | 5,356 S.F. |
| DECK/PATIO/AC/MISC | 155 S.F. |
| DRIVEWAY & WALKS | 2,935 S.F. |
| TOTAL (PROPOSED)= | 8,446 S.F. |
| REMAINING (PROPOSED) | 59,751 S.F. |
| LOT AREA = | 68,197 S.F. |

THIS PROPERTY MAY BE SUBJECT TO ANY AND ALL APPLICABLE DEED RESTRICTIONS, EASEMENTS, RIGHT-OF-WAY, UTILITIES AND RESTRICTIVE COVENANTS WHICH MAY BE OF RECORD OR IMPLIED

THIS DRAWING DOES NOT REFLECT AS-BUILT INFORMATION

**PRELIMINARY PLAT**
NOT FOR RECORDATION, CONVEYANCES, OR SALES.

60 0 60
SCALE: 1" = 60'


**EASTOVER**
LAND SURVEYING COMPANY, P.A.
LAND SURVEYORS - PLANNERS - (C-1833)
600 JOHNIE CENTRE BOULEVARD, SUITE #309
PINEVILLE, NORTH CAROLINA 28134
PHONE (704) 927-8080
FAX (704) 889-0105


# HOUSE LOCATION PLOT PLAN
FOR

LOT 37, CHEVAL - PHASE 5, MAP 2

Town of Mint Hill, Mecklenburg County, North Carolina

PROPERTY OF: ARTHUR RUTENBERG

MAP BOOK 53 PAGE 484 DEED REFERENCE

DRAWN BY: ERG | DATE: MAY 2, 2014

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

# Septic System Pre-Construction Meeting Checklist

File # 897913 App # 6916 Tax Parcel # 195-073-64

Property Owner: Bains Farm Inc

Job Location Address: 3506 Piaffe Ave

City: Mint Hill State: NC Zip Code: 28227

1. Does System design match facility, flow & wastewater characteristics?

   ☑ YES ☐ NO

   Comments: _____

2. Is there sufficient available space for the septic systems initial and repair areas?

   ☑ YES ☐ NO

   Comments: _____

3. Can the septic system be installed per the permit conditions and drawing on file?

   ☑ YES ☐ NO

   Comments: _____

* If "NO" is checked for any of the above the existing permit may need to be revoked.

Permission is hereby given to ☑ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge meeting all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. **System shall not be installed while soils are in wet condition.**

Brodkey W. Hallman — 4/28/15

Authorized Agent — Date

Steve Autry

Others Present

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

**OPERATION PERMIT for an**
**ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM**

File #: 8979B Permit #: 6916 Tax Parcel #: 195 073 64

Property Owner: Bains Farm Inc

Job Location Address: 3506 Piaffe Ave

City: Mint Hill State: NC Zip Code: 28227

**Operation Permit Issuance Date:** 4/30/15 Contractor Name: Steve Autry

Permitted Design Flow: 480 GPD Liquid Capacity of Dosing Tank: NA gallons

Liquid Capacity of Septic Tank: 1000 gallons Manufacture Dellinger Effluent Pump Model: NA

Drainfield Installation ☐ N/A

Trench Depth: 36 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 4 @ various feet lengths

Depth of Media: 12 inches (Type) EZflow

Depth of Cover: 24 inches

Distribution Device: Drop Boxes

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 10 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10 feet


Inspection Dates

Tank(s) Inspected: 4/30/15

Excavation Inspected: 4/30/15

Pump & Controls Inspected: NA

SKETCH OF SYSTEM ~~INSTALLATION~~
(As-Built Drawing)

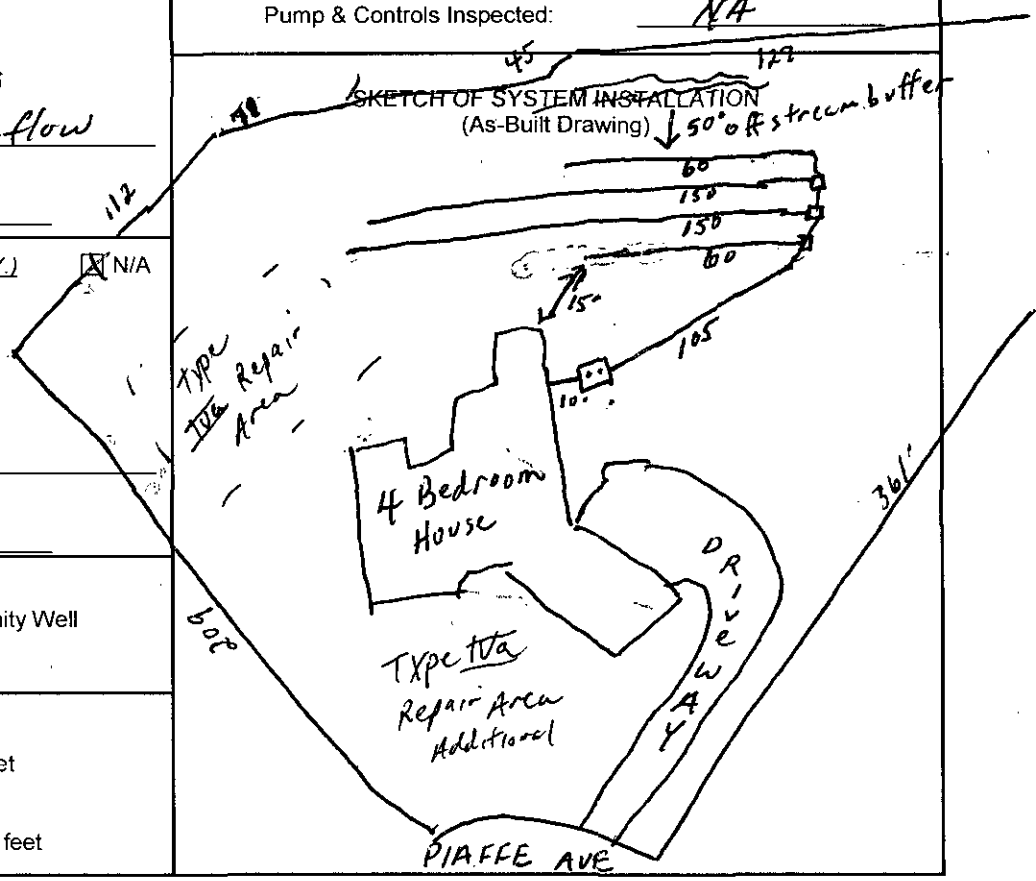



The undersigned has inspected the Septic Tank System described above, and certifies it has been ☑ installed ☐ altered ☐ repaired ☑ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

**Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.**

Comments: System Classification & Type: IIIg Gravity EZ Flow EZ1063T, G, NA, NA

DENR Authorized Agent: Philo Walker Signature: Philo Walker REHS

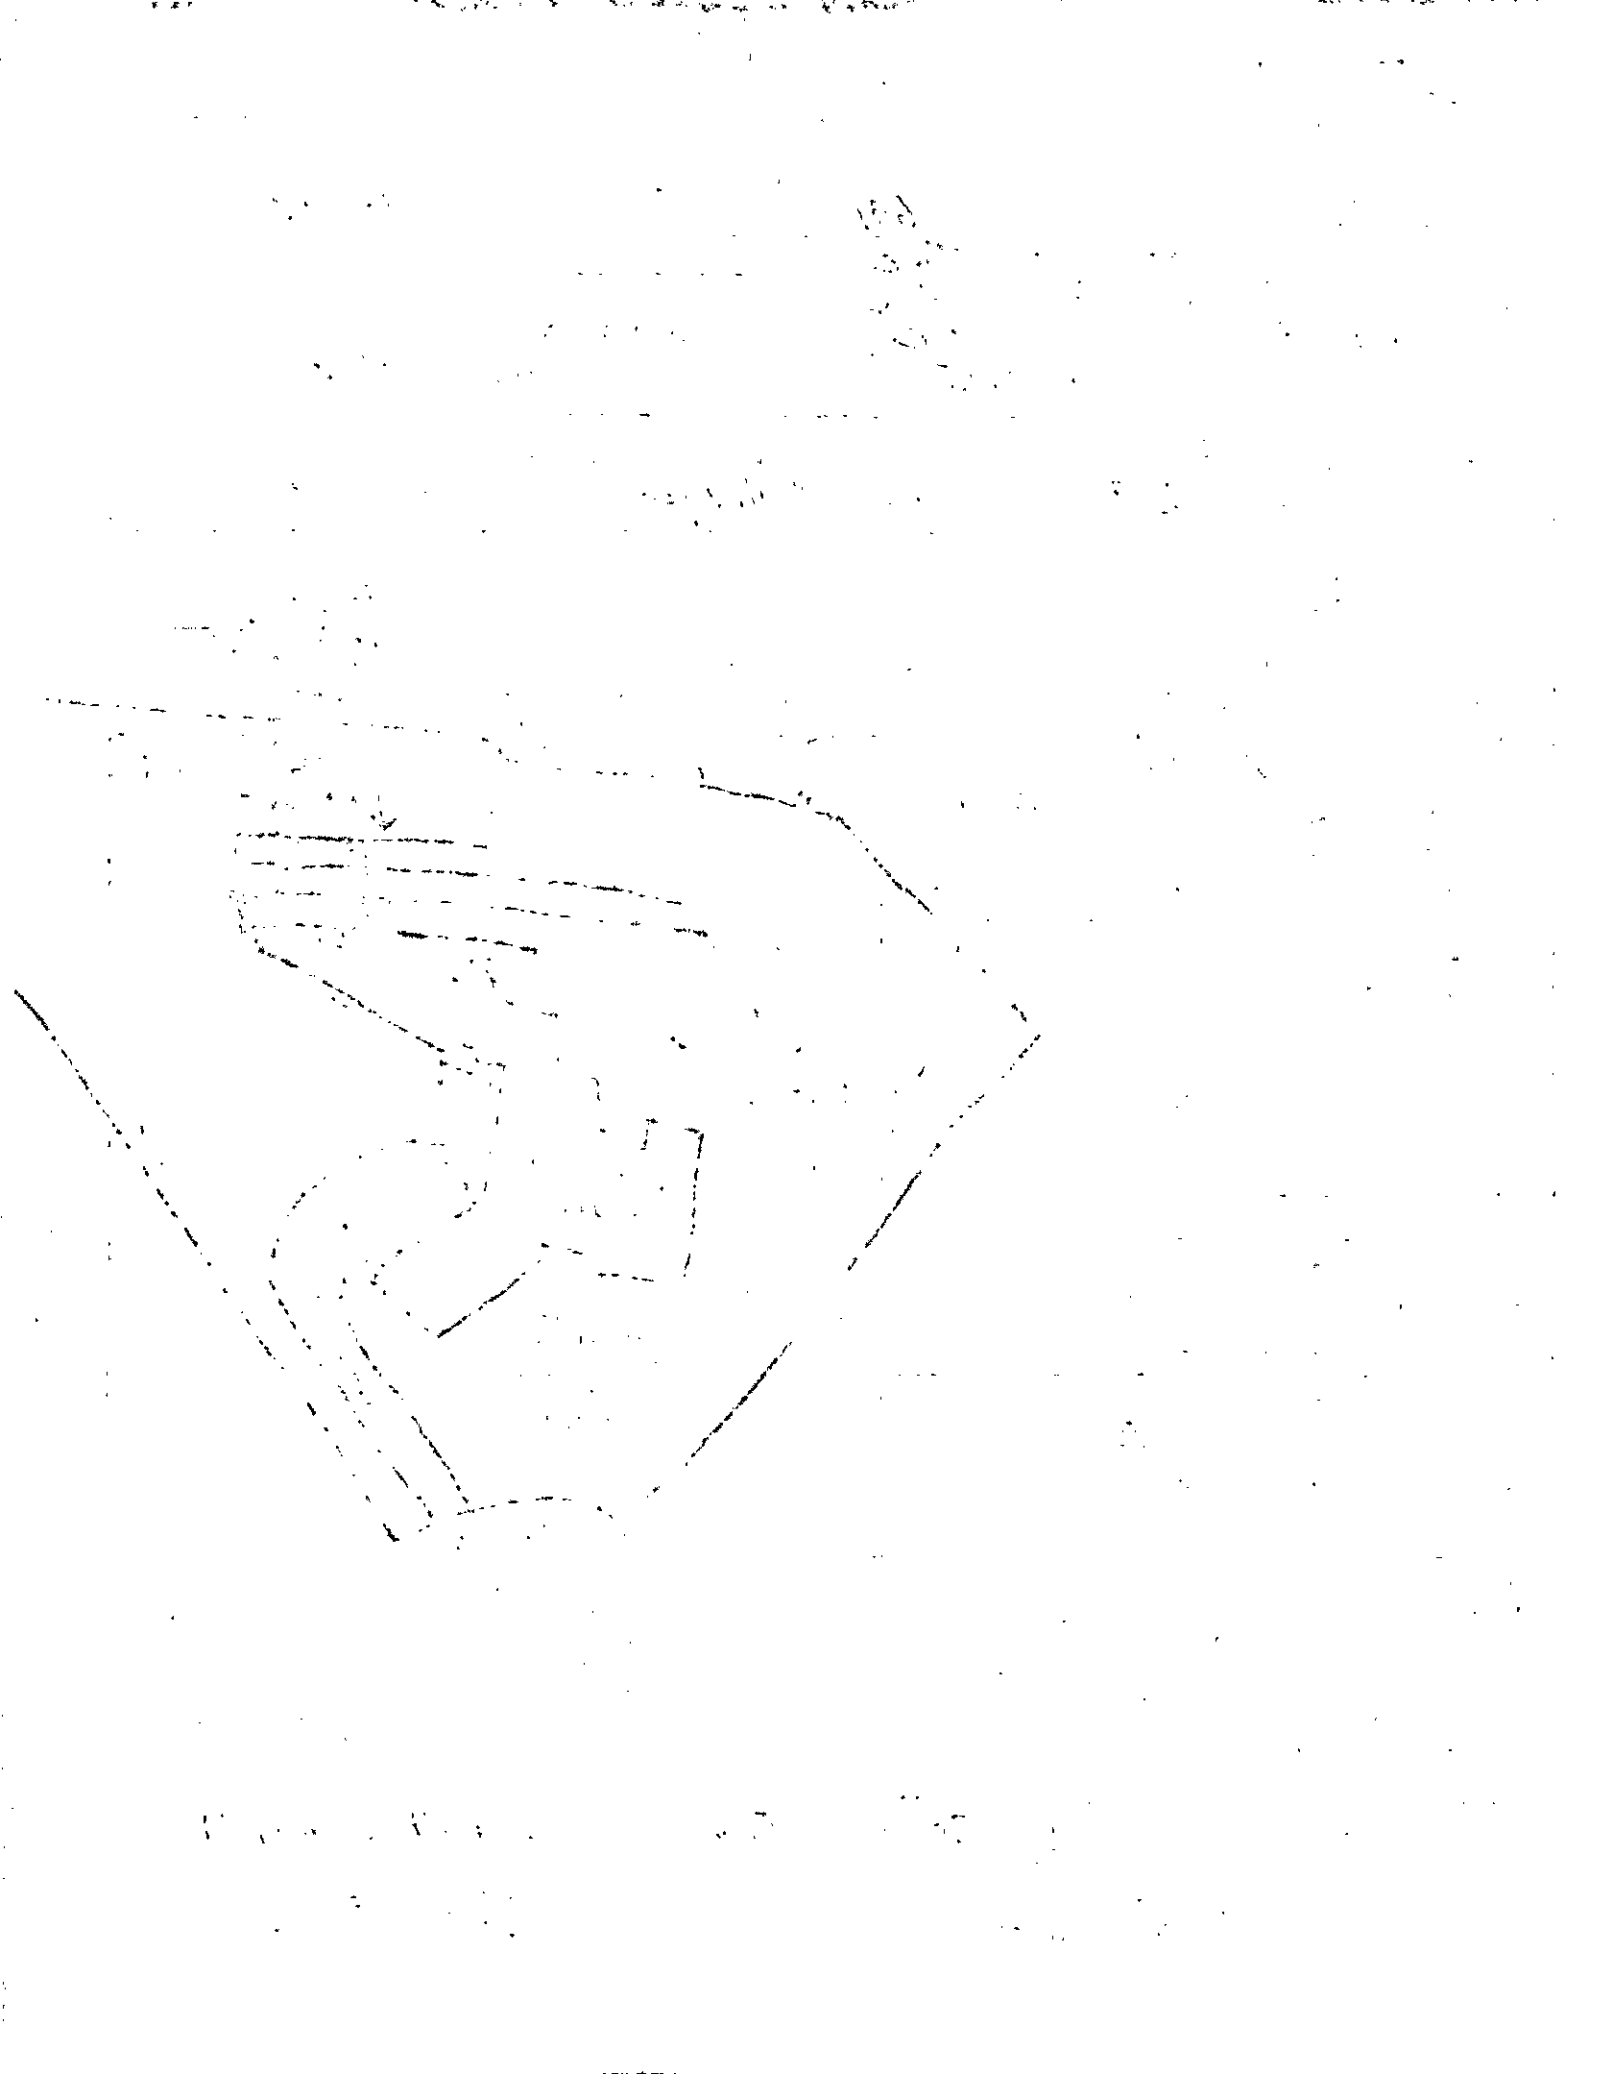

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

**OPERATION PERMIT for an**
**ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM**

File #: 8979B Permit #: 6916 Tax Parcel #: 195 073 64

Property Owner: Bains Farm INC

Job Location Address: 3506 Piaffe Ave

City: Mint Hill State: NC Zip Code: 28227

**OPERATION PERMIT CONDITIONS:**

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: III g

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☑

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☑ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.


☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: Gravity EZ Flow

DENR Authorized Agent: Philo Walker Date: 4/30/15

Signature: Philo Walker REHS

3506 Piaffe Ave, lot 37
File # 8979B

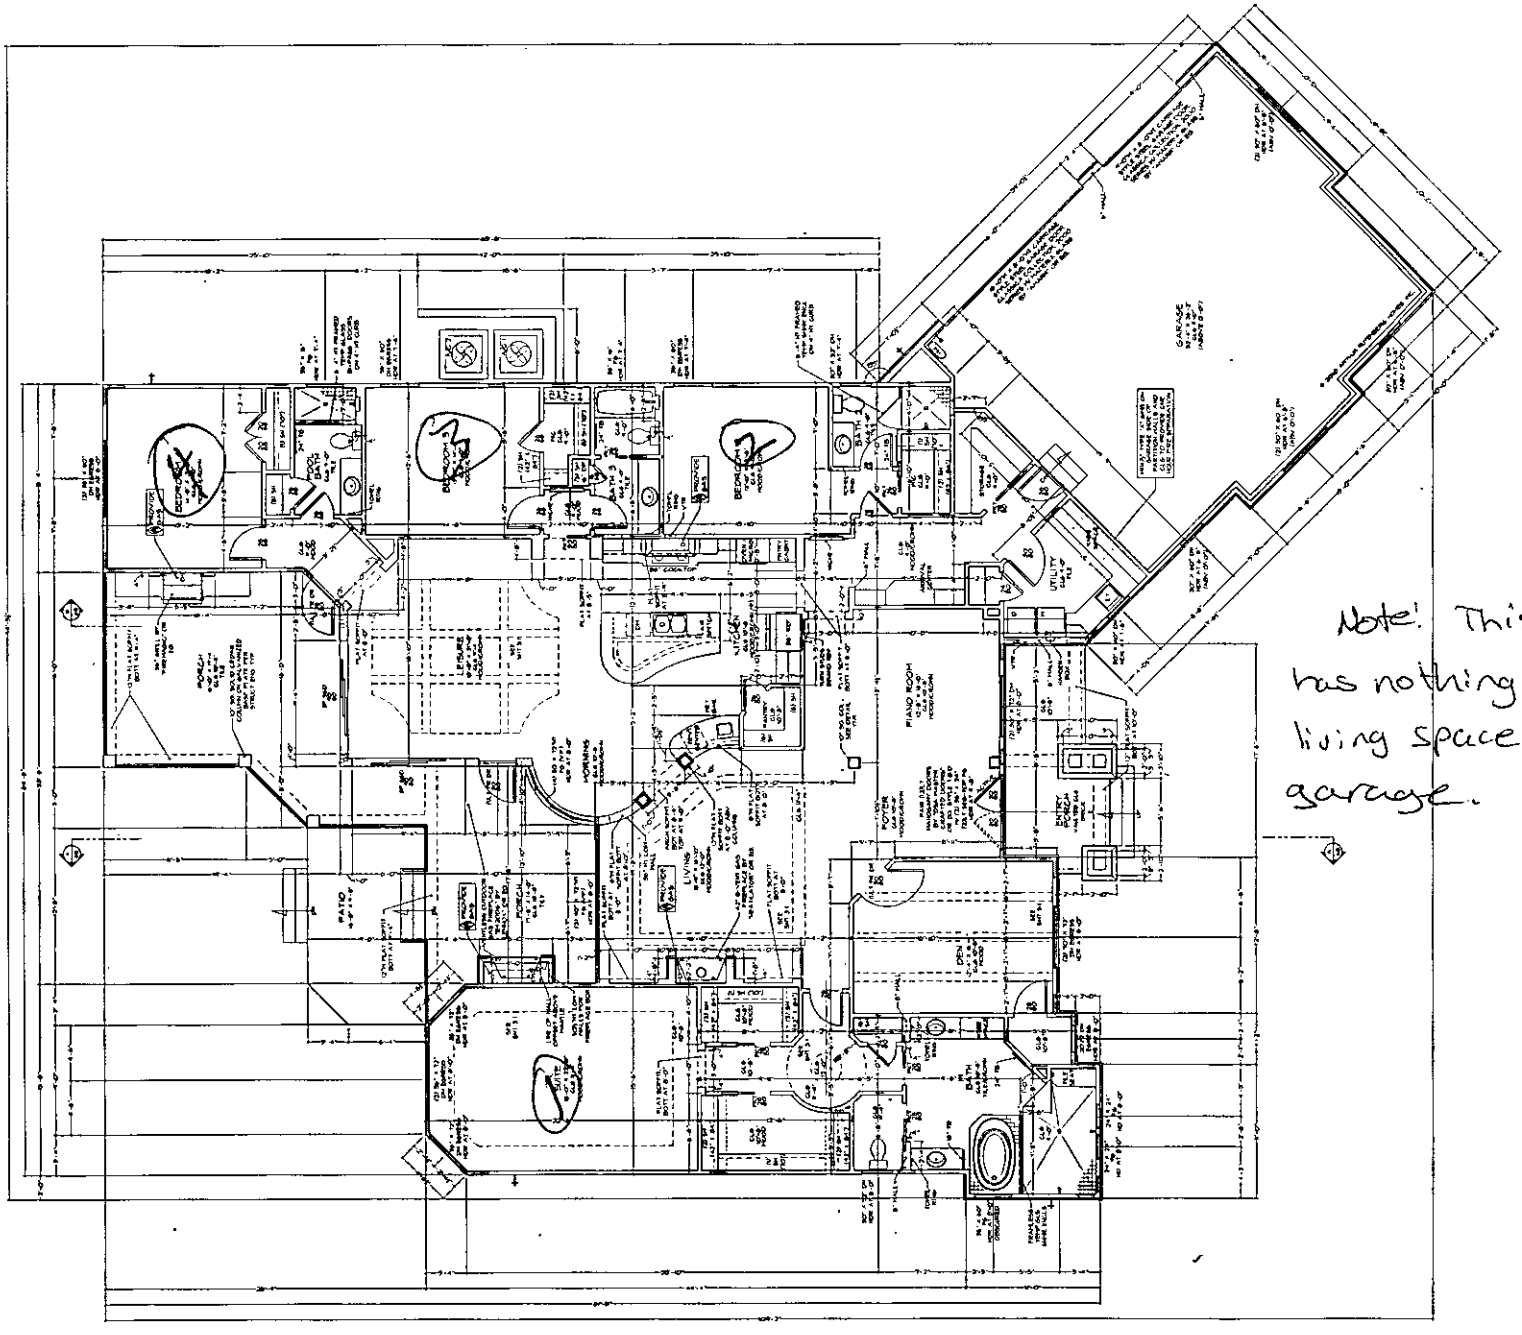

| SQUARE FOOTAGES | |
|---|---|
| AREA | SQ. FT. |
| ENTRY PORCH | 148 SF |
| GARAGE | 933 SF |
| LIVING | 3054 SF |
| PORCH | 548 SF |
| TOTAL | 3931 SF |

| MISC. NOT UNDER ROOF | |
|---|---|
| AREA | SQ. FT. |
| PATIO | 144 SF |
| TOTAL | 144 SF |

Note! This plan has nothing showing living space over garage.

NOT FOR CONSTRUCTION

A CUSTOM RESIDENCE FOR MR. & MRS. REDDING
BUILDER: PARAGON HOMES OF CHARLOTTE, INC.

FLOOR PLAN

5


File #: _____

## PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: _____ Tax Parcel #: _____

Subdivision Name: _____ Lot #: _____

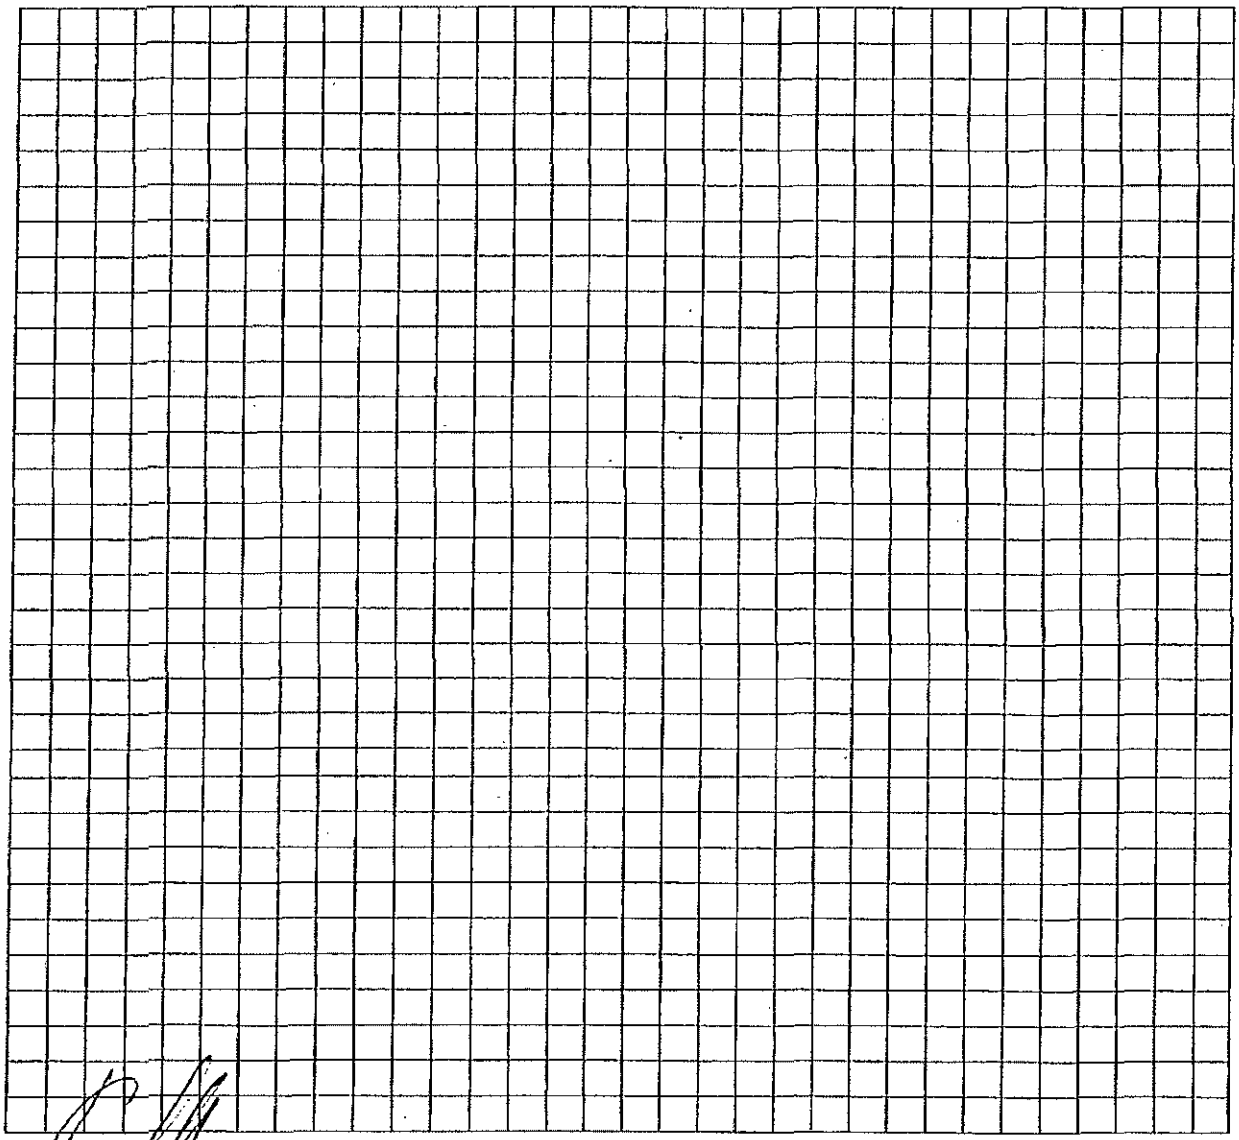

Property Owner's or Owner's Legal Representative Signature

6-30-14
Date



MECKLENBURG COUNTY -- GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


Revised on: 12/15/10

**COMMENTS: Recommend installation depth at 36".**

| Landscape Position | Group | Texture | .1955 LTAR | Structure |
|---|---|---|---|---|
| R-Ridge | I | S-Sand | 1.2 - 0.8 | sg-Single Grain |
| SS-Shoulder Slope | | LS-Loamy Sand | | mass-Massive |
| LS-Linear Slope | | | | cr-Crumb |
| FS-Foot Slope | II | SL-Sandy Loam | 0.8 - 0.6 | gr-Granular |
| NS-Nose Slope | | L-Loam | | sbk-Subangular Blocky |
| HS-Head Slope | | | | abk-Angular Blocky |
| CC-Concave Slope | III | Si-Silt | 0.6 - 0.3 | pl-Platy |
| CV-Convex Slope | | SiCL-Silty Clay Loam | | pr-Prismatic |
| T-Terrace | | CL-Clay Loam | | Sap-Saprolite |
| FP-Flood Plain | | SCL-Sandy Clay Loam | | **Structure Prefixes** |
| D-Drainage Way | | SiL-Silt Loam | | w-weak |
| | | | | m-moderate |
| | | | | s-strong |
| | | | | f-fine |
| | IV | SC-Sandy Clay | 0.4 - 0.1 | m-medium |
| | | SiC-Silty Clay | | c-coarse |
| | | C-Clay | | |

| Consistence Moist | Consistence Wet | Mineralogy |
|---|---|---|
| VFR-Very Friable | SS-Slightly Sticky | SEXP-Slightly Expansive |
| FR-Friable | S-Sticky | EXP-Expansive |
| FI-Firm | VS-Very Sticky | |
| VFI-Very Firm | NP-Non-Plastic | **Classification** |
| EFI-Extremely Firm | SP-Slightly Plastic | US-Unsuitable |
| | P-Plastic | PS-Provisionally Suitable |
| | VP-Very Plastic | S-Suitable |
| | | NA-Not Applicable |

**Sketch of Soil Evaluation Locations**

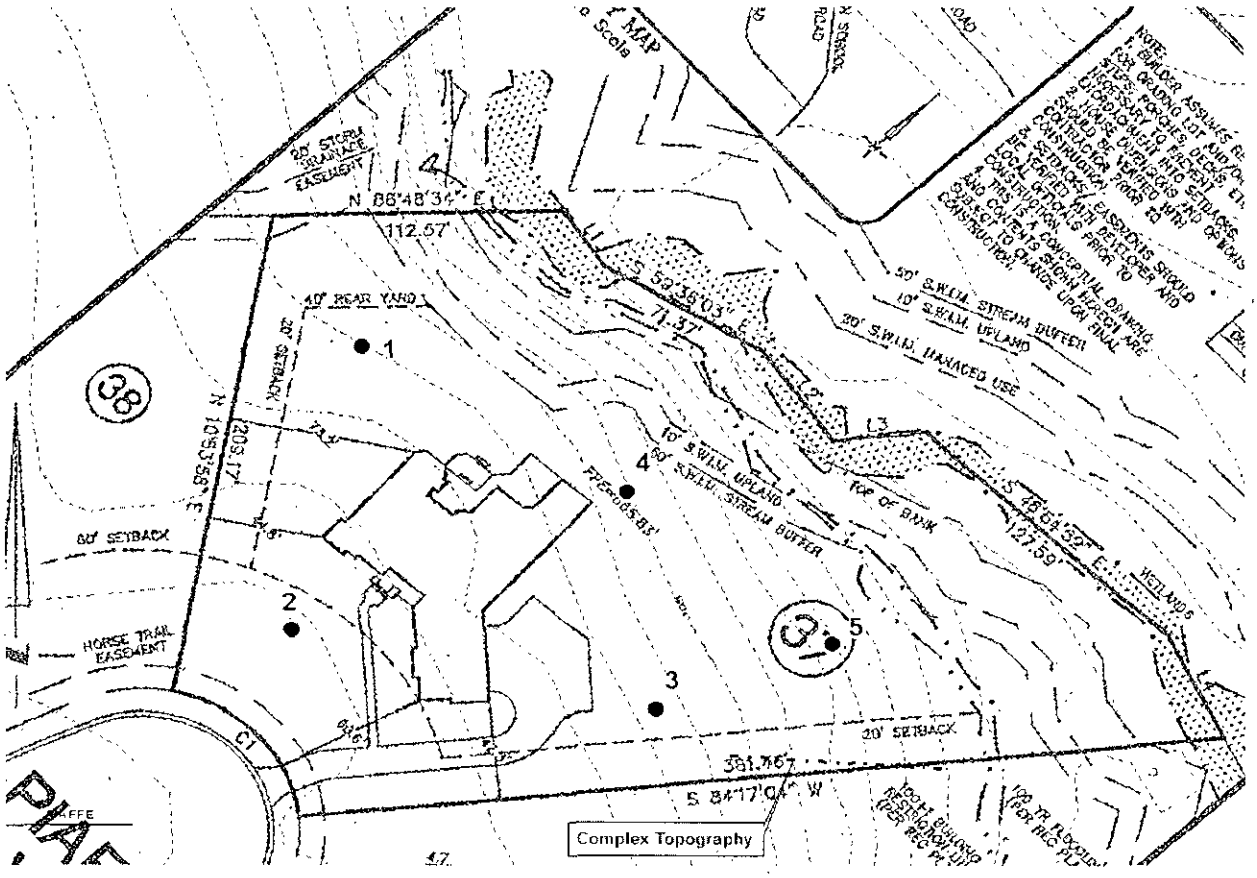

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

## IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30006916 GWS File #: 8979B Tax Parcel #: 195-073-64

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

**I. This Improvement Permit Shall:** Expire in Five (5) Years **Expiration Date (If Applicable):** 7/16/2019

Type of Installation: Residential - New System Lot Number: 37

Structure Type: HOUSE Size ($ft^2$): 3654 # Bedrooms: 4 # Occupants: 2

Building Foundation: Crawl Space Water Supply: Municipal

**II. Initial System Type:** Accepted **System Classification:** IIIg

Initial System Specifications:

| | | | | | | | |
|---|---|---|---|---|---|---|---|
| Design Flow (gpd): | 480 | LTAR ($gpd/ft^2$): | 0.3 | Septic Tank Size (gal): | 1500 | Pump Tank Size (gal): | N/A |
| Trench Width (ft): | 3 | Trench Spacing (ft): | 9 | Absorption Area ($ft^2$): | 1200 | Total Trench Length (ft): | 400 |
| Maximum Trench Depth (in): | 36 | Depth of Media (in): | 12 | Distribution Device: | Distribution Box | | |

**III. Repair System Type:** PPBPS (gravity) **System Classification:** IVa

Repair System Specifications:

| | | | | | | | |
|---|---|---|---|---|---|---|---|
| Design Flow (gpd): | 480 | LTAR ($gpd/ft^2$): | 0.3 | Septic Tank Size (gal): | 1500 | Pump Tank Size (gal): | N/A |
| Trench Width (ft): | 3 | Trench Spacing (ft): | 9 | Absorption Area ($ft^2$): | 800 | Total Trench Length (ft): | 267 |
| Maximum Trench Depth (in): | 36 | Depth of Media (in): | N/A | Distribution Device: | Distribution Box | | |

**IV. Permit Conditions/Comments:**

*(Please See the Following Page for Permit Conditions.)*

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Josh Sellers Owner/Legal Agent: MITCH GENDA

Signature: Joshua R. Sellers R.S Signature: Print Name

Date Issued: 7/16/2014

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

## IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30006916 GWS File #: 8979B

**IV. Permit Conditions/Comments:**

- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All waterlines must be located a minimum of 10 ft. from any part of the septic system.
- All components of the septic system must be located a minimum distance from the normal pool elevation or mean high water mark for the nearby body of water. See plot plan for minimum setback requirements.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- The septic system shall be located at least 10 feet from any foundation drain.
- The septic system shall be located at least 15 feet from any foundation drain.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Josh Sellers Owner/Legal Agent: MITCH GLENDA
Print Name

Signature: Joshua R. Sellers PE Signature:

Date Issued: 7/16/2014

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 195-073-64
Lot #: 37
File #: 8979B
AppID: 6916

# SOIL/SITE EVALUATION
# for ON-SITE WASTEWATER SYSTEM

Property Owner: Bains Farm Inc.
Address: 1111 Metropolitan Ave., Charlotte, NC 28204
Proposed Facility: 4 Bedroom House
Design Flow (.1949): 480 GPD
Location of Site: 3506 Plaffe Ave, Mint Hill, NC 28227
Water Supply: [X] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

Applicant: Paragon Homes of Charlotte
Date Evaluated: 7/11/2014
Property Size: 1.57 ac
Property Recorded: Unknown

| PROFILE # | 1940 Landscape Position/ Slope% | Horizon Depth (IN.) | SOIL MORPHOLOGY 1941 Structure/ Texture | SOIL MORPHOLOGY 1941 Consistence Mineralogy | b PROFILE FACTORS 1942 Soil Wetness/ Color | 1943 Soil Depth (IN.) | 1956 Sapro Class | 1944 Restr Horiz | General Comments | Profile Class & LTAR | Maximum Trench Bottom Depth for 3' Wide Conventional Trench |
|---|---|---|---|---|---|---|---|---|---|---|---|
| Boring #1 | LS 6% | 0 - 13 | wfsbk SCL | FR SEXP | >32" | 32 | NA | NA | 3 auger attempts hit rock around 32" | PS IV 0.3 | 18" |
| | | 13 - 32 | mfsbk C | FR SEXP | | | | | | | |
| | | 32 | Rock | | | | | | | | |
| Boring #2 | LS 6% | 0 - 6 | wfsbk SCL | FR SEXP | >50" | 50 | NA | NA | saprolite inclusions 40 - 50" | PS IV 0.3 | 36" |
| | | 6 - 30 | mmsbk C | FI SEXP | | | | | | | |
| | | 30 - 50 | wfsbk CL | FR SEXP | | | | | | | |
| Boring #3 | LS 10% | 0 - 8 | wfsbk CL | | >52" | 52 | NA | NA | | PS IV 0.3 | 36" |
| | | 8 - 45 | mmsbk C | FI SEXP | | | | | | | |
| | | 45 - 52 | mfsbk CL | FR SEXP | | | | | | | |
| Boring #4 | LS 13% | 0 - 16 | wfsbk CL | FR SEXP | >53" | 53 | NA | NA | | PS IV 0.3 | 36" |
| | | 16 - 53 | mfsbk C | FI SEXP | | | | | | | |
| Boring #5 | LS 13% | 0 - 8 | wfsbk CL | FR SEXP | >53" | 53 | NA | NA | | PS IV 0.3 | 36" |
| | | 8 - 39 | mmsbk C | FI SEXP | | | | | | | |
| | | 39 - 53 | mfsbk SCL | FR SEXP | | | | | | | |
| | | | | | | | | | | | |

| Description | Initial System | Repair System |
|---|---|---|
| Available Space (.1945) | PS | PS |
| System Type(s) | IIIG | IVA |
| Site LTAR (gpd/sq ft) | 0.3 | 0.3 |

Other Factors (.1946):
Soil Evaluation By: Jacob Presley, REHSI, LSS
Others Present:
Site Classification (.1948):Provisionally Suitable
Site Evaluation By: Joshua R. Sellers Joshua R. Sellers
Others Present:

FEE: 200.00
DATE:7/23/2014

**MECKLENBURG COUNTY**
**GROUNDWATER & WASTEWATER SERVICES**

**FILE NUMBER:** 8979B

**PERMIT NUMBER:** 30006916

**PARCEL NUMBER:** 19507364

**JOB LOCATION INFORMATION**

**ADDRESS:** 3506 PIAFFE AVE

**CITY:** CHARLOTTE **STATE: NC** **ZIP:** 28227

**ISSUED TO:** Bains Farm Inc

**CONSTRUCTION AUTHORIZATION ISSUANCE DATE:** 7/16/2014

## CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30006916, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.
   *CONSTRUCTION AUTHORIZATION EXPIRATION DATE: 7/16/2019

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

# IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30006916** GWS File #: **8979B** Tax Parcel #: **195-073-64**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

**I. This Improvement Permit Shall:** Expire in Five (5) Years **Expiration Date (If Applicable):** 7/16/2019

Type of Installation: Residential - New System Lot Number: 37

Structure Type: HOUSE Size ($ft^2$): 3654 # Bedrooms: 4 # Occupants: 2

Building Foundation: Crawl Space Water Supply: Municipal

**II. Initial System Type:** Accepted **System Classification:** IIIg

Initial System Specifications:

| | | | | | | | |
|---|---|---|---|---|---|---|---|
| Design Flow (gpd): | 480 | LTAR ($gpd/ft^2$): | 0.3 | Septic Tank Size (gal): | 1500 | Pump Tank Size (gal): | N/A |
| Trench Width (ft): | 3 | Trench Spacing (ft): | 9 | Absorption Area ($ft^2$): | 1200 | Total Trench Length (ft): | 400 |
| Maximum Trench Depth (in): | 36 | Depth of Media (in): | 12 | Distribution Device: | Distribution Box | | |

**III. Repair System Type:** PPBPS (gravity) **System Classification:** IVa

Repair System Specifications:

| | | | | | | | |
|---|---|---|---|---|---|---|---|
| Design Flow (gpd): | 480 | LTAR ($gpd/ft^2$): | 0.3 | Septic Tank Size (gal): | 1500 | Pump Tank Size (gal): | N/A |
| Trench Width (ft): | 3 | Trench Spacing (ft): | 9 | Absorption Area ($ft^2$): | 800 | Total Trench Length (ft): | 267 |
| Maximum Trench Depth (in): | 36 | Depth of Media (in): | N/A | Distribution Device: | Distribution Box | | |

**IV. Permit Conditions/Comments:**

*(Please See the Following Page for Permit Conditions.)*

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Josh Sellers Owner/Legal Agent: _____
Print Name

Signature: Joshua R. Sellers R.S Signature: _____

Date Issued: 7/16/2014

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

## IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30006916** GWS File #: **8979B**

**IV. Permit Conditions/Comments:**

- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All waterlines must be located a minimum of 10 ft. from any part of the septic system.
- All components of the septic system must be located a minimum distance from the normal pool elevation or mean high water mark for the nearby body of water. See plot plan for minimum setback requirements.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- The septic system shall be located at least 10 feet from any foundation drain.
- The septic system shall be located at least 15 feet from any foundation drain.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.


DENR Authorized Agent: Josh Sellers Owner/Legal Agent: _____
Print Name

Signature: Joshua R. Sellers P.S. Signature: _____

Date Issued: 7/16/2014

Comments: ① 1500 gal. Septic Tank.
② Type III a Initial System
Type IV Repair, four (4) bedroom
Design unit.
③ Install lines level and on contour
④ Stay 7'10" off property line
>3' off bldg foundation

Parcel # 195-073-64
File # 8979B
AppID: 6916

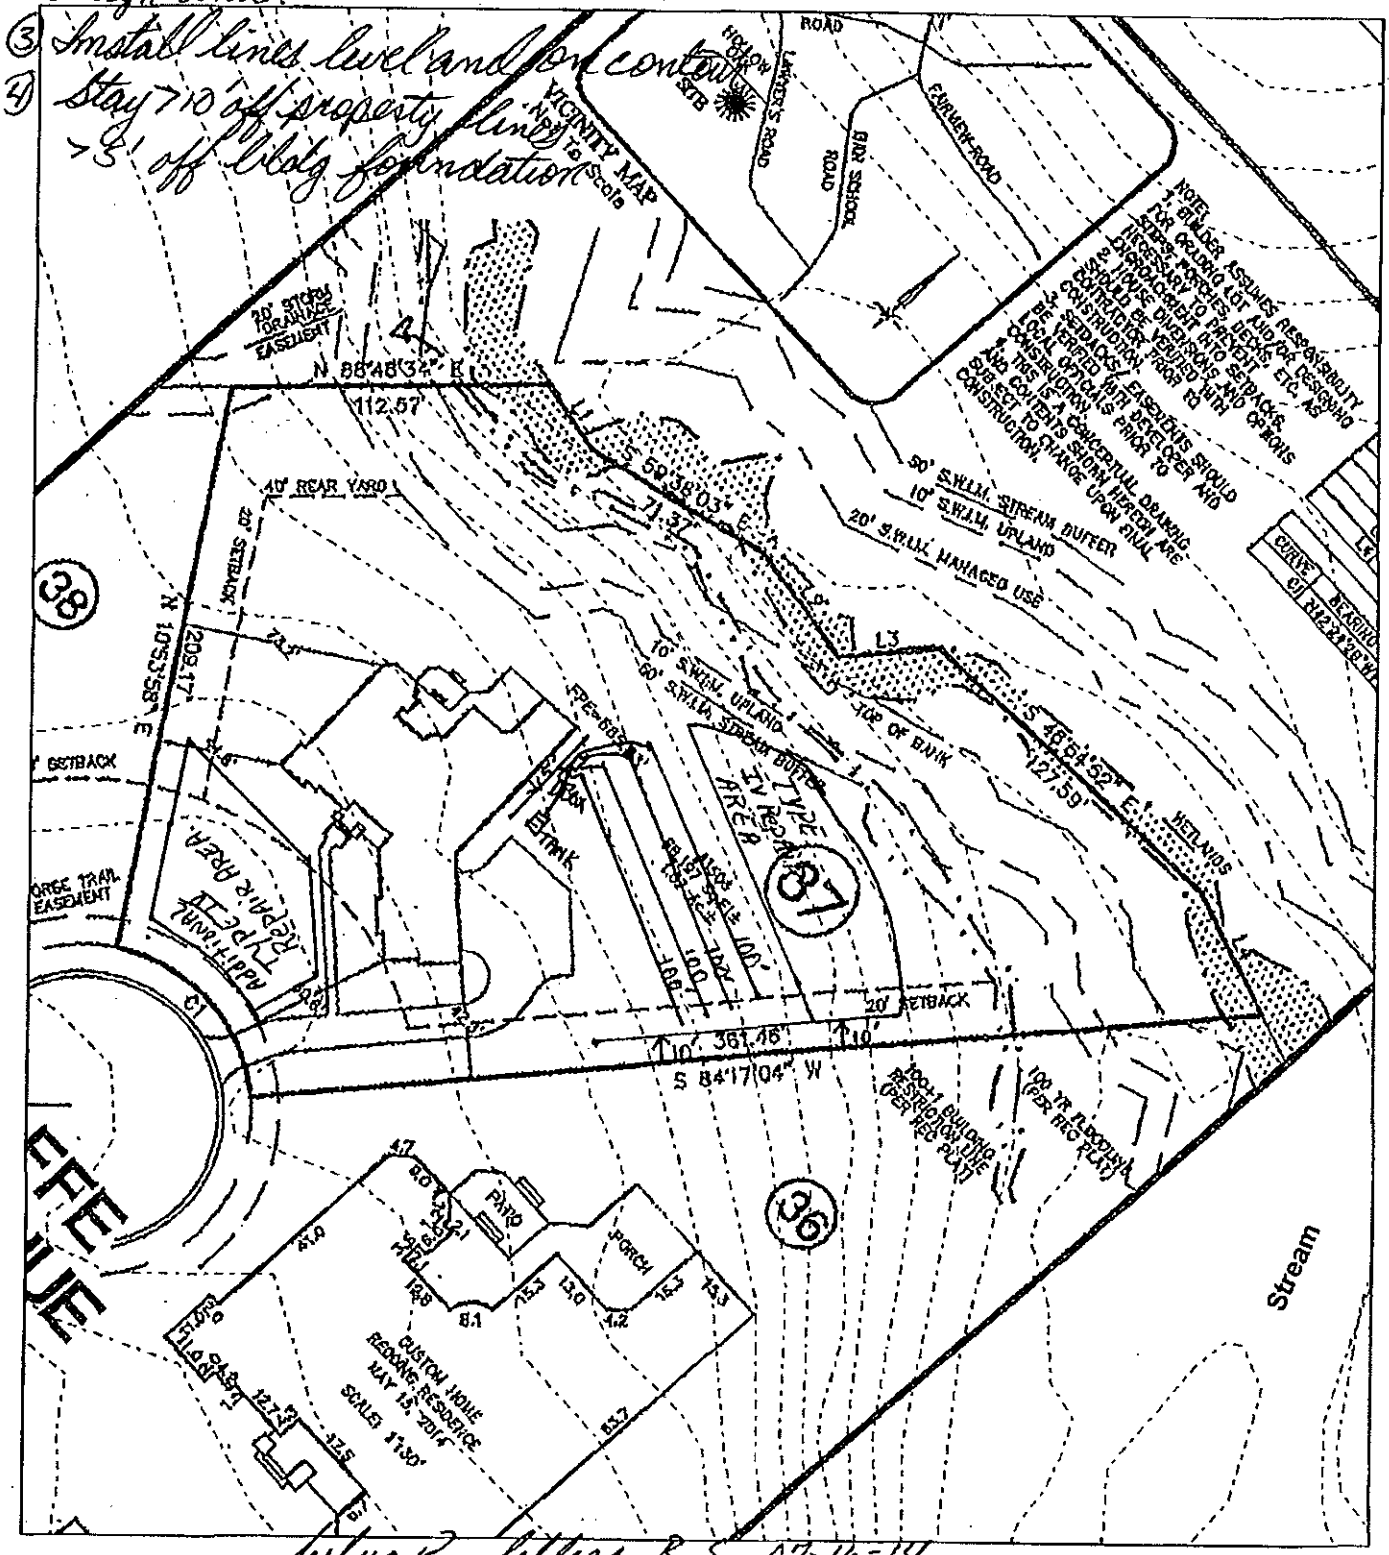


Map Created By: Joshua R. Sellers R.S
Map Created On: 07-16-14

*MECKLENBURG COUNTY*
*LAND USE AND ENVIRONMENTAL SERVICES*
*Payment Receipt*

**Receipt Information**

| | | | |
|---|---|---|---|
| **Date:** | 07/22/14 | **Amount:** | 200.00 |
| **Receipt #:** | 90224 | **Tendered:** | 200.00 |
| **Check / Auth #:** | CHARGE | **Returned:** | 0.00 |
| **Received By:** | SADERLW | | |

**Account Information**

**Account #:** X46329
**Contractor:** PARAGON HOMES OF CLT INC
**Attn:**
**Address:** 600 TOWNE CENTRE BLVD
**Address:** STE 201
**City/State/Zip:** PINEVILLE, NC 28134

| Item | Description | Permit# | Quantity | Unit Price | Total Price |
|---|---|---|---|---|---|
| 0703 | Septic Operational Permit<br>3506 PIAFFE AVE, LOT 37 | | 1 | 200.00 | 200.00 |

**Outstanding Balances**

| Month-To-Date | Prior Month | 30 Days | 60 Days | 90 Days | Balance |
|---|---|---|---|---|---|
| 200.00 | | | | | |

*MECKLENBURG COUNTY*
*LAND USE AND ENVIRONMENTAL SERVICES*
*Payment Receipt*

**Receipt Information**

**Date:** 07/22/14
**Receipt #:** 90225
**Check / Auth #:** CHARGE
**Received By:** SADERLW

**Amount:** 200.00
**Tendered:** 200.00
**Returned:** 0.00

**Account Information**

**Account #:** X46329
**Contractor:** PARAGON HOMES OF CLT INC
**Attn:**
**Address:** 600 TOWNE CENTRE BLVD
**Address:** STE 201
**City/State/Zip:** PINEVILLE, NC 28134

| Item | Description | Permit# | Quantity | Unit Price | Total Price |
|---|---|---|---|---|---|
| 0734 | Septic Construction Authorization<br>3506 PIAFFE AVE, LOT 37 | | 1 | 200.00 | 200.00 |

----------Outstanding Balances----------

| Month-To-Date | Prior Month | 30 Days | 60 Days | 90 Days | Balance |
|---|---|---|---|---|---|
| 400.00 | | | | | |