

8839 KERNS MEADOW LN

01523135

1/9/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 6218B WASPS App #: _____

Primary ES assigned to project: OJ

Secondary ES assigned to project: _____

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☑
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☑
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 10			
	Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR .28	Yes ☑	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☑	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: _____

OP issued date: _____

Review performed by: IR

Date performed: 8/28/07

CONDITIONS OF IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATON

Permit Number: **6218B** *Tax Number:* **01523101 PO**

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

0.25 Long-term acceptance rate (GPD/ft^2)	**480** Max gallons/day wastewater flow	**1440** Absorption Area (ft^2)	**9** Trench spacing (min. on centers) (ft)
Serviced by private well: ☒ Yes ☐ No	**1500** Gallon septic tank	**480** Total trench length (ft)	**24** Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
4 Bedrooms in residence	**1000** Gallon pump tank	**NA** Depth of stone (in)	

Any surface water present: **NO** Type: *Minimum separation distance (ft):*

Additional conditions: **Agreement forms on file before CA release.**
Easement agreement forms on file before CA release.

Repair Area System

Type: ☐ I ☐ II ☐ III ☒ IV ☐ V ☐ VI

☐ Conventional
☒ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

960 Absorption Area (ft^2) **320** Total trench length (ft)	**NA** Depth of stone (in)	**9** Trench spacing (min. on centers) (ft)	**30** Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.

*** This Improvement permit is transferable.

DENR Authorized Agent Date 1/18/06

Owner/Agent Signature Date 1-19-06


MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

File 6218B
Lot 12

22.3 AC.+- TOTAL

- → FOUR BEDROOM HOUSE
- → 1500 Septic Tank
- → 1000 Pump Tank
- → 0.25 LTAR
- → 4 lines x 120' x 3' (480 TLF)
- → PRESSURE MANIFOLD
- → TYPE III6 Pump to Innovative System
- → PANEL BLOCK REPAIR AREA

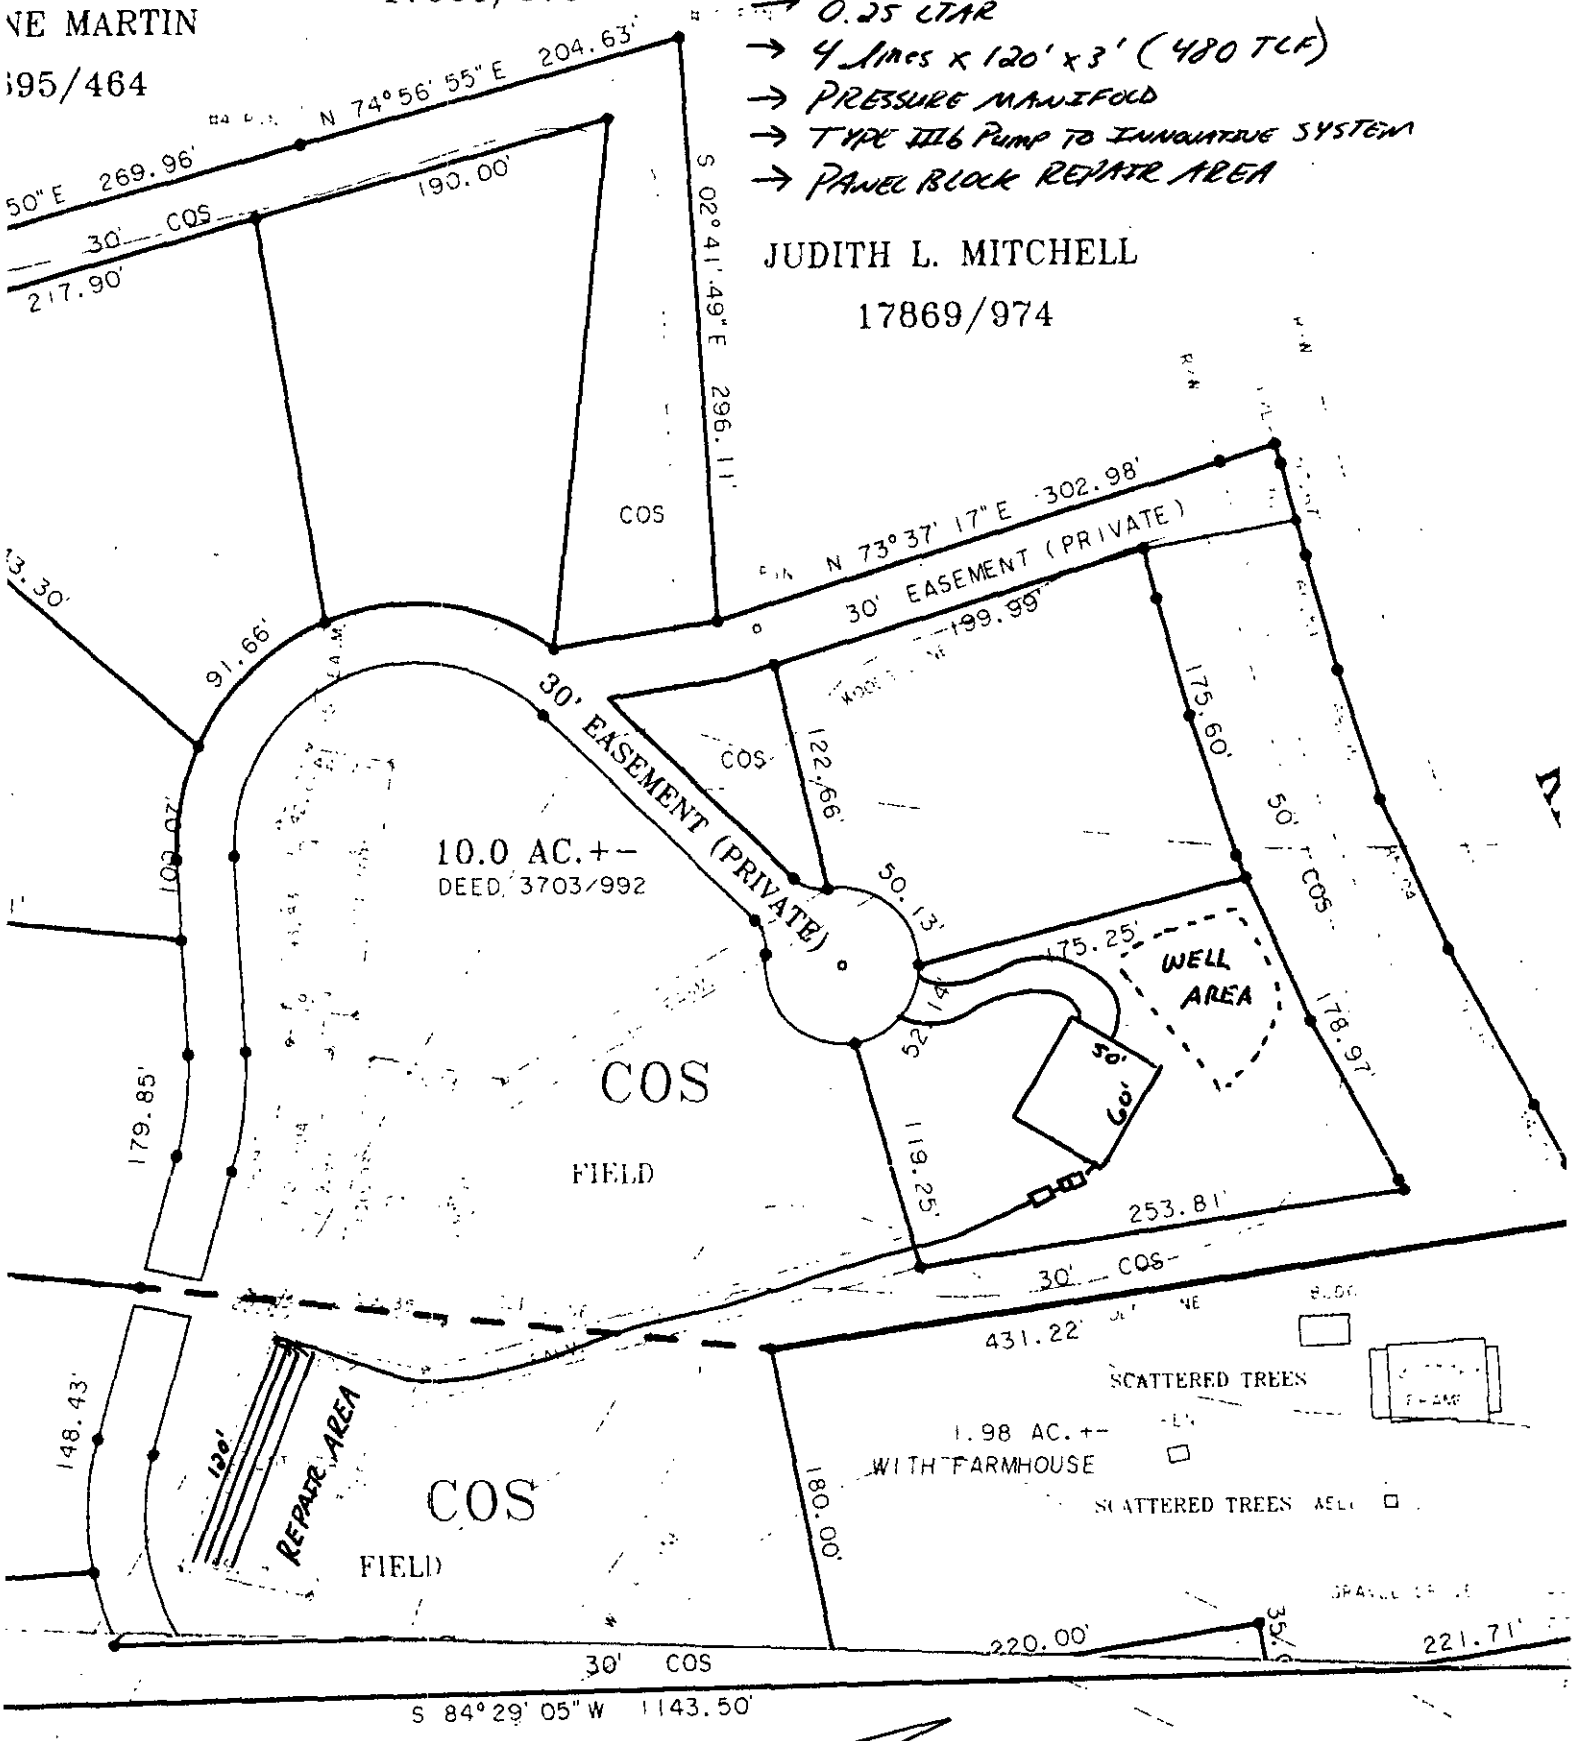

Jerry Mick, PS.

MARY F. MCCOY

FILE # 6218B

LOT #12 KERNS MEADOW

22.3 AC.+- TOTAL

- → FOUR BEDROOM HOUSE
- → 1500 Septic Tank
- → 1000 Pump Tank
- → 0.25 LTAR
- → 4 lines x 120' x 3' (480 TCF)
- → PRESSURE MANIFOLD
- → TYPE III6 PUMP TO INNOVATIVE SYSTEM
- → PANEL BLOCK REPAIR AREA

750'

WAYNE MARTIN
17661/376

WAYNE MARTIN
5695/464

JUDITH L. MITCHELL
17869/974

N 74°56' 55" E 204.63'
N 75°01' 50" E 269.96'
30' COS
217.90'
190.00'
S 02°41' 49" E 296.11'
30.54'
243.30'
91.66'
COS
N 73°37' 17" E 302.98'
30' EASEMENT (PRIVATE)
199.99'
175.60'
50'
COS
122.66'
50.13'
175.25'
WELL AREA
50'
60'
178.97'
119.25'
253.81'
30' COS
431.22'
SCATTERED TREES
1.98 AC.+-
WITH FARMHOUSE
SCATTERED TREES AREA
180.00'
N 09°06' 39" E 491.57'
240.00'
211.91'
100.07'
10.0 AC.+-
DEED/3703/992
30' EASEMENT (PRIVATE)
COS
FIELD
180.00'
179.85'
215.52'
30' COS
183.99'
148.43'
130'
REPAIR AREA
COS
FIELD
216.41'
8.8 AC.+-
DEED 2376/559
220.00'
35.00'
221.71'
COS
BARN
107.59'
42.86'
30' EASEMENT (PRIVATE)
174.15'
132.87'
180.01'
178.62'
N 09°06' 39" E 586.24'
260.00'
358.36'
COS
244.02'
206.61'
199.34'
162.77'
79.85'
180.00'
180.00'
200.00'
30' COS
S 84°29' 05" W 1143.50'

Jimmy Mucklow, PS.
1/18/06

MARY F. MCCOY
8122/164

742' 738' 734' 730' 726'

7 - #12
AC. +-
AC.
Y
MHOUSE

100 0 100 200'
GRAPHIC SCALE - FEET
SCALE 1"= 100'-0"

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: PO 015-231-01
Lot #: 12
File #: 6218B
Code: 3

AC5

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Hecht Properties
Applicant: Danny Edwards
Address: 885 N. Highway 16, Denver, N. C. 28037
Date Evaluated: 11/16/05
Proposed Facility: Residence
Design Flow (.1949): 480gpd
Property Size: .82a
Location of Site: Off Kerns Road
Property Recorded:
Water Supply: [ ] Public [x] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 6	0-7	GR/CL	FR/SEXP/SS/SP	>22" TO SOIL WETNESS	22	N/A	NONE	US, IV
		7-22	SBK/ABK/C	FI/SEXP/S/P					
2	"	0-6	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	48	"	"	PS, IV
		6-48	SBK/ABK/C	FI/SEXP/S/P					.225GPD/FT^2
3	"	0-6	GR/CL	FR/SEXP/SS/SP	>24" TO SOIL WETNESS	24	"	"	US
		6-24	ABK/SBK/C	VFI/EXP/VS/VP					

Description	Initial System	Repair System
Available Space (.1945)	US	
System Type(s)		
Site LTAR		

Other Factors (.1946):
Site Classification (.1948): UNSUITABLE
Evaluated By: W. R. Marlin, LSS, 11/17/2005, W. R. Marlin
Others Present:


Sheet: 2 o0f 2
FILE #: 6218B

COMMENTS:
100% repair

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Food Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

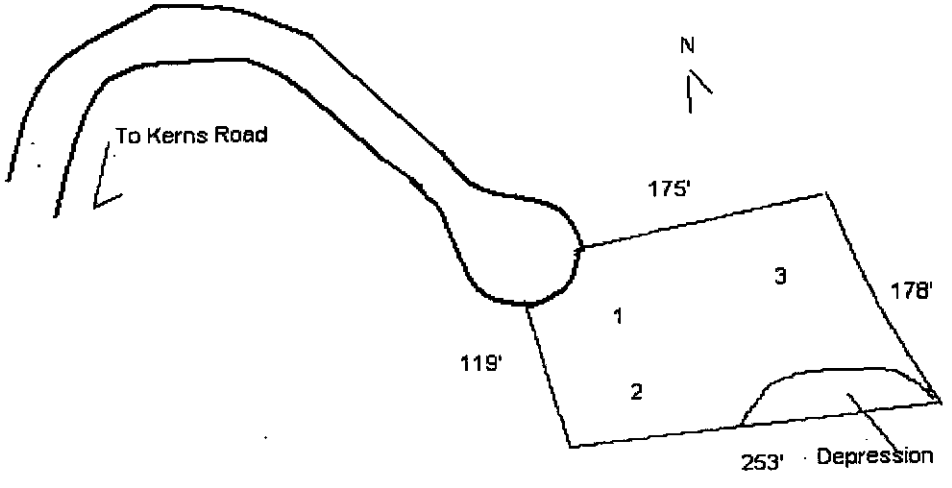

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 3
Property ID: PO 015-231-01
Lot #: COS area, 10, 11, 12
File #:
Code:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Hecht Properties
Applicant: Danny Edwards
Address: 885 N Highway 16, Denver, N. C. 28037
Date Evaluated: 11/16/05
Proposed Facility: Design Flow (.1949): 400 gpd
Property Size: 1.8a
Location of Site: Off Kerns Road
Property Recorded:
Water Supply: [ ] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [ ] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [ ] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence *Mineralogy*	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
A	LS, 6	0-6	GR/CL	FR/SEXP/SS/SP	>39" TO SOIL WETNESS	39	N/A	NONE	PS, IV .25GPD/FT^2
		6-30	SBK/C	FI/SEXP/S/P					
		30-39	SBK/CL	FR/SEXP/SS/SP					
B	"	0-5	GR/CL	"	>42" TO SOIL WETNESS	42	"	"	PS, IV .225GPD/FT^2
		5-42	SBK/C	FI/SEXP/S/P					
C	"	0-4	GR/CL	FR/SEXP/SS/SP	>30" TO SOIL WETNESS	30	"	"	US, IV .225GPD/FT^2
		4-30	SBK/C	FI/SEXP/S/P					
D	"	0-5	GR/CL	FR/SEXP/SS/SP	>22" TO SOIL WETNESS	22	"	"	US, IV
		5-22	SBK/C	FI/SEXP/S/P					
		22+	M/CL	FR/SEXP/SS/SP					
E	"	0-5	GR/CL	"	>48" TO SOIL WETNESS	48	"	"	PS, IV .25GPD/FT^2
		5-30	SBK/C	FI/SEXP/S/P					
		30-48	SBK/CL	FR/SEXP/SS/SP					
F	"	0-4	GR/CL	"	"	"	"	"	"
		4-39	SBK/C	FI/SEXP/S/P					
		39-48	SBK/CL	FR/SEXP/SS/SP					
G	"	0-5	GR/CL	"	>46" TO SOIL WETNESS	46	"	"	"
		5-32	SBK/C	FI/SEXP/S/P					
		32-46	SBK/CL	FR/SEXP/SS/SP					

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	III b	I b a
Site LTAR	0.25	0.25

Other Factors (.1946): Off-site areas for lots 10, 11, 12
Site Classification (.1948):
Evaluated By: W. R. Marlin, LSS, 11/17/2005.
Others Present:

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 2 of 3
File #: Off-site areas, lots 10, 11 ,12

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM
CONTINUED

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
H	LS, 6	0-4	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	48	N/A	NONE	PS, IV
		4-25	SBK/C	FI/SEXP/S/P					.3GPD/FT^2
		25-48	SBK/CL	FR/SEXP/SS/SP					
I	"	0-5	GR/CL	"	"	"	"	"	PS, IV
		5-32	SBK/C	FI/SEXP/S/P					.25GPD/FT^2
		32-48	SBK/CL	FR/SEXP/SS/SP					
J	"	0-4	GR/CL	"	>26" TO SOIL WETNESS	26	"	"	US, IV
		4-26	SBK/C	FI/SEXP/S/P					.1GPD/FT^2

FILE #:


COMMENTS:

Off-site areas for lots 10, 11, 12

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Food Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-*Subangular Blocky*
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	Sl-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace		*CL-Clay Loam*		
FP-Flood Plain		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	*NP-Non-Plastic*	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

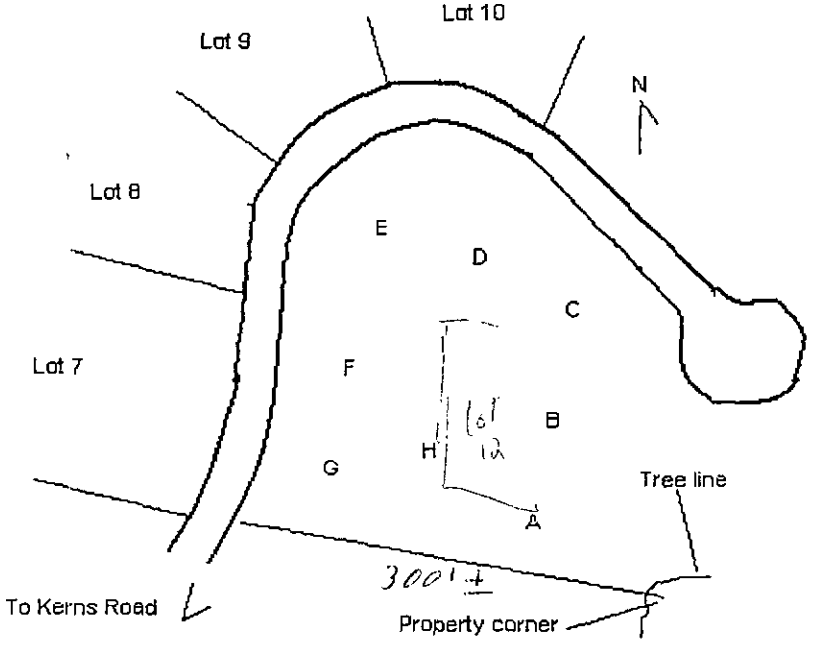

CC # 370875

2659

GWS – RES. APP 07/05

SEPTIC FEE: 200.00
DATE: 11/3/05
CRT [ ]

PERMIT APPLICATION FOR A *RESIDENTIAL* SITE
IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATION
FOR ON-SITE WASTEWATER SYSTEM
NEW WELL INSTALLATION OR REPAIR OF EXISTING WELL
MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES

WELL FEE:
DATE:
CRT [ ]

FILE # 6218B

SEPTIC / TYPE APPLICATION: ☐ NONE ☑ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFY PLOT PLAN

WELL / TYPE APPLICATION: ☐ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

JOB LOCATION INFORMATION:

TAX/PARCEL #: 015-231-01 Lot 12
STREET ADDRESS: Keens Road
CITY: Huntersville
STATE: NC ZIP: 28078
SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #: 12
TOWNSHIP:

☐ 0-MECKLENBURG ☐ 4-PINEVILLE
☐ 1-CHARLOTTE ☐ 5-MATTHEWS
☐ 2-DAVIDSON ☑ 6-HUNTERSVILLE
☐ 3-CORNELIUS ☐ 7-MINT HILL

BUILDING INFORMATION:

TYPE OF BUILDING:

☐ SINGLE MOBILE HOME (S) ☐ MODULAR HOME (M)
☐ DOUBLE WIDE (D) ☐ MULTIPLE FAMILY (U)
☑ HOUSE (H) ☐ OTHER

HEATED SQUARE FOOTAGE:
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS:

FOUNDATION FOR RESIDENCE:

☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☐ CRAWLSPACE ☐ BASEMENT WITH NO PLUMBING

IF PLANNING TO EXPAND/ALTER THE EXISTING SYSTEM INDICATE THE FOLLOWING CHANGES:

NUMBER OF BEDROOMS TO BE ADDED: NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE:
WILL THERE BE A HOME BUSINESS IN THE RESIDENCE? ☐ YES ☑ NO TYPE:

WATER SUPPLY:

☐ MUNICIPAL (M) ☐ PUBLIC (C) ☑ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

ARE ANY OF THE FOLLOWING LOCATED ON THE PROPERTY? IF SO, PLEASE SHOW LOCATION ON SITE PLAN/PLAT.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☑ NO	WELLS, SPRINGS, OR WATER LINES	☐ YES	☑ NO
EXISTING WASTEWATER SYSTEMS	☐ YES	☑ NO	DESIGNATED WETLANDS	☐ YES	☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☑ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☑ NO

PROPERTY OWNER:

NAME: Hecht Properties
ADDRESS: 885 N Hwy 16
CITY: Denver
STATE: ZIP: 28037
HOME PHONE: 704 333-7547 WORK PHONE:
MOBILE PHONE: 704-996-0117 FAX:

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: DANNY Edwards
ADDRESS: 19300 Statesville Rd
CITY: Cornelius
STATE: ZIP: 28031
HOME PHONE: WORK PHONE:
MOBILE PHONE: 704-996-0117 FAX:

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?
WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?

*An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Danny Edwards

Owner's/Agent's Signature Date

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENT & NATURAL RESOURCES DIVISION
OF ENVIRONMENTAL HEALTH ON-SITE
WASTEWATER SECTION

*A Well Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature Date

MECKLENBURG COUNTY HEALTH DEPARTMENT
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202 704-336-5103 / FAX: 704-336-6894

PROPOSED PLOT PLAN


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 6218B

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

Lot #12 . 82 Ac

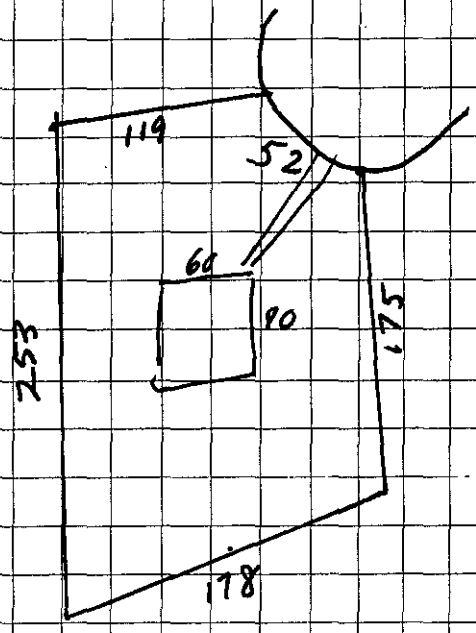

APPROVAL DATE _____

OWNER/AGENT SIGNATURE

DATE

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

owned by Declarant to be used as construction or sales offices. Other construction vehicles (trucks, vans, cars, construction equipment, equipment trailers, etc.) may be left overnight on the Property (including any Lot or Roadway) only in accordance with such rules as may be established by the Architectural Control Committee.

Section 23. Nuisances. It shall be the responsibility of each Owner to prevent the development of any unclean, unhealthy, unsightly, or unkempt condition on his or her property. No Lot shall be used, in whole or in part, for the deposit, storage or burial of any property or thing that will cause such property to appear to be in an unclean or untidy condition or that will be obnoxious to the eye; nor shall any substance, thing, or material be kept that will emit foul or obnoxious odors or that will cause any noise or other condition that will or might disturb the peace, quiet, safety, comfort, or serenity of the occupants of surrounding property. No noxious or offensive activity shall be carried on within any Lot, nor shall anything be done tending to cause embarrassment, discomfort, annoyance, or nuisance to any Person using any property within the Development. No lot nor Common Area shall be used for the operation of four wheelers, dirt bikes or go karts. There shall not be maintained on any Lot any plants or animals or device or thing of any sort whose activity or existence in any way is noxious, dangerous, unsightly, unpleasant, or of a nature as may diminish or destroy the enjoyment of the Development. Without limiting the generality of the foregoing, no speaker, horn, whistle, siren, bell, amplifier or other sound device, except such devices as may be used exclusively for security purposes and grinder pump warning alarm shall be located, installed or maintained upon the exterior on any Lot unless required by law.

Section 24. Diligent Construction. All construction, landscaping or other work which has been commenced on any Lot must be continued with reasonable diligence to completion and no partially completed Dwelling or other Improvements shall be permitted to exist on any Lot, except during such reasonable time period as is necessary for completion. All construction must be completed within one (1) year after the date upon which it commenced, unless a longer time is approved by the Architectural Control Committee. Any damage to the Roadways, curbs or sidewalks or any part of any Common Area or any utility system caused by an Owner or Owner's builder or such builder's contractors or subcontractors shall be repaired by such responsible Owner. Any builder of Improvements (and such builder's contractors and subcontractors) on any portion of the Property shall keep such portion of the Property free of unsightly construction debris, in accordance with the construction rules established by the Architectural Control Committee, and shall similarly keep contiguous public and private areas free from any dirt, mud, garbage, trash, or other debris which is occasioned by the construction of Improvements. The Board may levy a Special Individual Assessment against an Owner's Lot to pay for the cost of repairing any damage to Roadways, curbs or sidewalks or any part of any Roadway, Common Area or utility system, to pay for the cost of cleaning public and private areas, including the roadways, and to pay for the cost of the removal of garbage, trash or other debris, which are occasioned by the activities of an Owner or Owner's builder or such builder's contractors or subcontractors during the construction of Improvements.

Section 25. Individual Wells. Every Dwelling erected on any Lot shall be served by and connected to a private well. All well water systems shall be approved by, and constructed and maintained in accordance with all the regulations and requirements of all governmental authorities and regulatory agencies having jurisdiction. All well locations are shown on Exhibit "C" attached and incorporated hereon by reference. Unless an exception in writing is granted by Declarant or the Association and the neighboring affected Lot Owner, each well shall be located at the sites shown on Exhibit "C." Declarant does not make any representations regarding the future availability of municipal or central water service.

Section 26. Sewage Disposal. Every dwelling erected on every Lot shall be served by a Septic System approved by the appropriate governmental agency for the disposal of sewage, or connected to a private or public sewage system. All Septic Systems or other private sewage disposal systems shall be approved by, and constructed and maintained in accordance with all the regulations and requirements of all governmental authorities and regulatory agencies having jurisdiction. All septic locations are shown on Exhibit "C" attached and incorporated hereon by reference. Unless an exception in writing is granted by Declarant or the Association and the neighboring affected Lot Owner, each septic shall be located at the sites shown on Exhibit "C." Declarant does not make any representations regarding the future availability of municipal or central sewer service.

Section 27. Sewage Disposal; Septic Easements. Every Lot shall either be served by a septic system approved by the appropriate governmental agency for the disposal of sewage to a private or public sewage disposal system. Declarant makes no representations regarding the future availability of municipal sewer service. All septic systems or other private sewage disposal systems shall be approved by, and constructed and maintained in accordance with all the regulations and requirements of all governmental authorities and regulatory agencies having jurisdiction. All owners, by purchasing property subject to the Declaration, acknowledge that any governmental permit or approval allowing for the construction and operation of a septic system or other private sewage disposal system may be limited in duration in accordance with the terms thereof, and neither Declarant, nor the Association nor the officers, directors, members, employees, agents or affiliates or any of them, shall have any liability arising directly or indirectly out of the inability of an Owner to obtain any such permit, or approval (including an extension or continuation) following the initial expiration thereof.

Non-exclusive easements for the purpose of providing septic service and for use as septic drainage fields (the "Septic Easements") are hereby reserved and granted, over, across and under the Septic Easement Lots and the Septic Easement Areas, to and for the benefit of the Association and the Septic Lot Owners, as more particularly provided herein. Each Septic Lot Owner's Off-Site Septic shall be constructed within the Septic Easement Area that is appurtenant to his or her Lot as designated on the Map (for example, the Septic System for Lot 7 shall be located upon septic Easement Area "7-A") Each of the Septic Easements shall be an appurtenance to and run with the title to the Lot it serves and for which it is reserved. Any deed, deed of trust, mortgage, transfer or other conveyance of any of the Septic Lots shall also transfer or convey the Septic Easement appurtenant to such Septic Lot, even if not expressly included therein. Each Septic Easement shall grant to the Septic Lot Owner and the Association and shall reserve in favor of Declarant the right to construct, install, excavate, dig, build, maintain, operate, remove and reinstall a septic system and related lines, equipment and apparatus in and upon the Septic Easement Area over which such Septic Easement is reserved, and to clear (and continue to clear as necessary) all trees, brush and other plants and to remove all rocks if necessary for the proper construction, installation and maintenance of said system and related lines, equipment and apparatus, all at the sole expense of the Owner of the Lot which the septic system is to service; provided, however, that if the need to repair said Septic System is caused by the negligent or willful act of the Association, its successors and assigns, their agents, employees, members, invitees or licensees, then the cost to repair shall be borne by the Association or its successors and assigns. Except for damage caused by the negligent or willful act of the Association, its successors and assigns, their agents, employees, members, invitees or licensees as provided above, the Owner of the Lot which the Septic System is to service shall promptly and reasonably restore any portion of the surface of the Septic Easement Area (but not trees, brush or other plants, except grass) disturbed by the installation or maintenance of said Septic System. Should the Owner of such Lot fail to so restore the surface of such Septic Easement Area, in the sole judgment of Declarant or the Board of Directors, then the Board of Directors shall have the power to specially assess such Owner for the cost of said restoration by Special Individual Assessment pursuant to Article V, Section 6.

Some Septic Easement Areas may not be accessible without crossing portions of other Septic Easement Areas. Therefore, in addition to the above-described rights, the Owners of each of the Septic Lots, their agents, independent contractors, its successors and assigns, are hereby granted the right of ingress, egress and regress over and across those portions of other Septic Easement Areas necessary to obtain access to the Septic Easement Areas benefiting their Septic Lots.

The Owner of the Lot for which an Off-Site System is being installed shall be responsible for obtaining all necessary environmental permits and other permits for the use of said Off-Site Septic System and shall hold the association, its successors and assigns, harmless from any loss, damage or liability relating thereto, except to the extent that such loss, damage or liabilities results from the negligent or willful act of the Association, its successors and assigns, their agents, employees, invitees or licensees. Prior to the installation of an Off-Site Septic System within the Septic Easement Area, the Owner of the lot for which the Off-Site Septic System is being installed shall have the proposed location of such Off-Site Septic System staked and approved by the appropriate governmental authorities, and such Off-Site Septic System shall be approved by, and constructed and maintained in accordance with all regulations and requirements of all

governmental authorities and regulatory agencies having jurisdiction thereof. The owner of the Septic Lot to which a Septic Easement Area is appurtenant shall be responsible to operate and maintain the Off-Site Septic System located thereon at such Owner's sole cost and expense.

Declarant hereby reserves and grants unto itself, its successors in interest, and assigns, a non-exclusive easement benefiting Declarant and burdening each Septic Lot to which a Septic Easement is appurtenant for the purpose of connection any residence(s) upon such Septic Lot(s) to any public or private sewer line providing service accessible to such Septic Lots, including access across the Septic Lots and the right to install any pipes and apparatus as may be necessary to connect any such residence(s) to such sewer line (the "Sewer Connection Easement") By reserving the Sewer Connection Easement, Declarant has not obligated itself or its successors or assigns to connect to any public or private sewer line to the above-described Lots or to make any sewer service available to such Lots and the exercise of such rights and the Sewer Connection Easement shall be at the sole discretion of Declarant, its successors in interest and assigns.

Section 28. Mail and Newspaper Boxes. All Mail and Newspaper Boxes shall be constructed or installed on any Lot in accordance with the applicable provisions of the Guidelines.

Section 29. Animals. No animals, livestock or poultry shall be raised, bred or kept on any portion of the Property except that dogs, cats or other household pets may be kept, but not for any commercial purposes, provided that they do not create a nuisance (in the judgment of the Board) such as, but without limitation, by noise, odor, damage or destruction of property or refuse. The number of household pets kept or maintained outside the Dwelling on a Lot shall not exceed three (3) in number, except for newborn offspring of such household pets which are all under nine (9) months in age. Dogs shall at all times whenever they are outside of a Dwelling be on a leash or otherwise confined in a manner acceptable to the board. Animal control authorities shall be permitted to enter the Development and the Property to patrol and remove pets and wild animals. All pets shall be registered, licensed and inoculated as required by law. No fenced dog enclosure or other structure for pets may be constructed or maintained on any Lot unless the same has been approved in writing by the Architectural Control Committee.

Section 30. Governmental Requirements; Guidelines. Nothing herein contained shall be deemed to constitute a waiver of any governmental requirements applicable to any Lot and all applicable governmental requirements or restrictions relative to the construction of Improvements on and/or use and utilization of any lot shall continue to be applicable and shall be complied with in regard to the Lots. Each Owner shall comply with all laws, regulations, ordinances (including, without limitation, applicable zoning ordinances) and other governmental rules and restrictions in regard to the Lot(s) or other portion of the Property owned by such Owner. Furthermore, each Owner shall comply with the conditions, limitations and restrictions set forth in the Guidelines.

ARTICLE VIII
ARCHITECTURAL AND LANDSCAPE GUIDELINES

Section 1. General. Notwithstanding anything contained in this Declaration to the contrary, no Improvements, including, without limitation, site preparation on any Lot, or erection of buildings or exterior additions or alterations to any building situated upon the Property, or any landscaping or cutting of trees on any Lot, shall be commenced, erected or maintained on any portion of the Property, subject to the provisions of Article VIII hereof, until: (a) the Architectural Control Committee, appointed as hereinafter provided has approved the plans and specifications therefore and the location of such Improvements and has given its written approval for commencement of construction, all in accordance with the terms and requirements in the Guidelines; (b) the fees set forth in or contemplated in this Article VIII have been paid; and (c) the contracts identified in this Article VIII have been executed. The provisions of this Article VIII shall not apply to the construction of any Improvements commenced, erected or maintained by Declarant on any Lot or upon any of the Common Areas.

The Board may delegate to the Architectural Control Committee any powers or authority reserved or granted to the board under this Article VIII.