Serial No.

PTR No. 5522

Date Issued June 7, 1973

T C No 139-115-16

Map Date 4-27-73

Do Not Issue A Building Permit Based On This Form

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION


PERCOLATION TEST REPORT

NAME OF OWNER Investment Land Sales, Inc.
(LAST, FIRST, MIDDLE)

ADDRESS OF OWNER 1740 East Independence Blvd. ZIP 28205

LOCATION OF PROPERTY Friarhurst Place
(STREET OR COUNTY ROAD)

SUBDIVISION Eastside Estates LOT NO 15 BLOCK NO

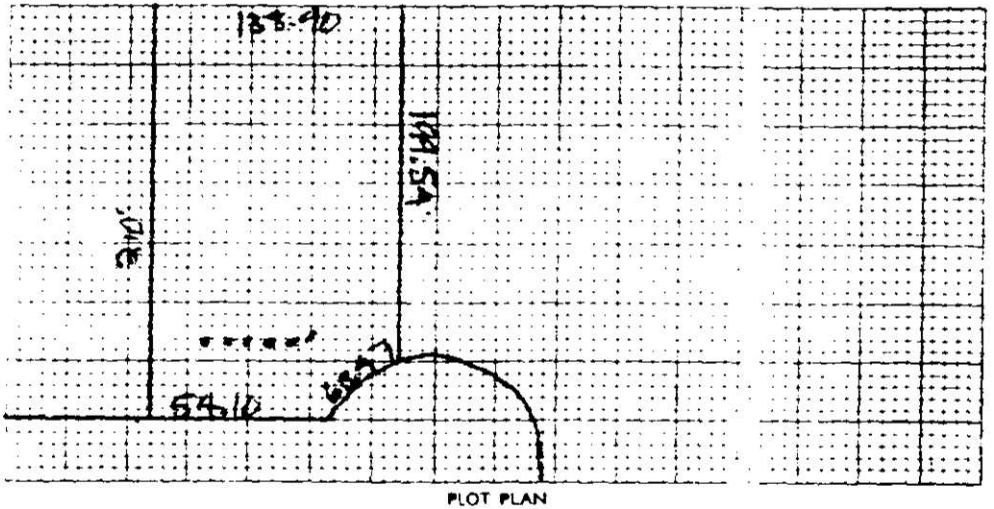

PLOT PLAN

This is to certify that a percolation test has been run and an on-site inspection made by the Mecklenburg County Health Department on the lot described above. The said test was conducted on that portion of the lot as indicated on above plot.

The percolation rate determined by the test was 56 min/in. The said lot is approved for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge subject to the following terms and conditions:

1. A permit to install, construct, alter, or repair the specific system shall be obtained from the Mecklenburg County Health Department prior to the beginning of any construction of buildings, or of the wastewater treatment system on the said lot.
2. The size of the septic tank wastewater treatment system which must be installed will be determined by the Health Department prior to installation based on the percolation rate obtained above, and on the size and type of building constructed thereon.
3. This approval is valid only if the system is installed in the immediate area where the percolation test was run.
4. This approval is void if any grading, filling, or construction (including the drilling of a well) is performed on the lot which, in the opinion of the Health Department, renders the area where the percolation test was run unsuitable for the installation, construction, alteration, and/or repair of such a system.

This approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina State Board of Health and the Mecklenburg County Board of Health which were in effect on the date of issuance and is void if at any time in the future, prior to the completion of the system, these laws, rules, and regulations are changed such that this approval would not have been granted had the new or revised laws, rules, and regulations been in effect on the issue date.

John A. Gibson

Director, Environmental Health Division or
Authorized Section Head

FORM NO. E-2-4-1-71

HEALTH DEPARTMENT'S COPY

SEE INSTRUCTIONS ON BACK

Date Received 8 Sept 76

ICARIS Application No 5522

T C No 139-115-16


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to

1 ✓ Install Septic Tank 2 Alter or Repair an individual septic tank wastewater treatment system without subsurface soil absorption effluent discharge

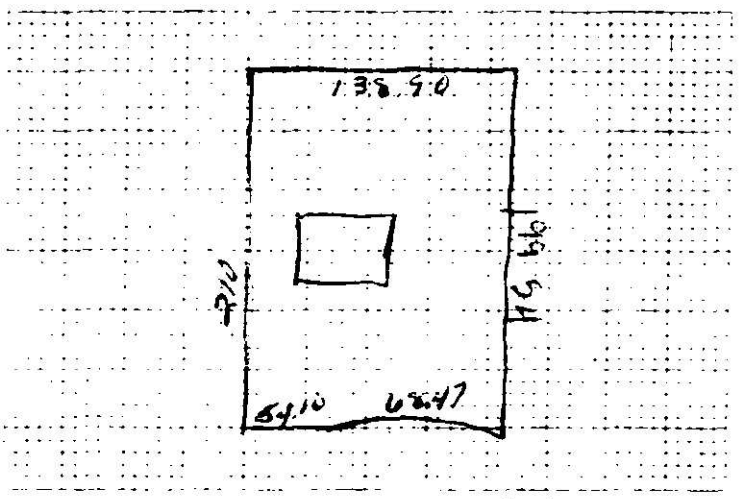

3 PLOT PLAN ACCURATELY DIMENSIONED

Water Borne Yes No
Yes
4 No of Bedrooms 3
5 Business Use Max No Employees
6 Washing Machine ✓ Yes No
7 Garbage Disposal ✓ Yes No
8 Dishwasher ✓ Yes No
9 Water Supply
A Municipal/Public ✓
B Community System
C Individual System
Well
2 Spring/Cistern/Other source
Distance from system
Public water Yes ✓ No
Public sewer Yes No
Yes
FHA Case No
VA Case No

3 NAME OF OWNER Williams & Company (LAST FIRST MIDDLE)

14 ADDRESS OF OWNER P.O. Box 456

15 PHONE NO Home Office 547 8596

16 LOCATION OF SYSTEM Briar Woods Place (STREET OR COUNTY ROAD)

17 SUBDIVISION Pass of Estates No 11 Block No

Map Book No 14 Page No 121

18 DEED REFERENCE — DEED BOOK AT PAGE

19 HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES NO DATE RUN

20 PTR NUMBER (See Instructions) 5522

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

8 Sept 76
DATE OF APPLICATION

Guy E. Williams Jr Pres
OWNER

EHD-5-76

Environmental Health Department's Copy

Date Issued 9/8/76

Serial No. 0135

IMPROVEMENTS PERMIT

LA No. 5822

T. C. No. 139-115-16

Map Date -

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER Wightman & Company
LAST FIRST MIDDLE

ADDRESS OF OWNER P. O. Box 456 ZIP

LOCATION OF LOT Briarhurst Place
STREET OR COUNTY ROAD

SUBDIVISION Eastside Estates LOT NO 15 BLOCK NO.

MAP BOOK NO. PAGE NO

The above specified lot is approved by the Mecklenburg County Department of Environmental Health for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the soil investigation, on an on-site inspection of the said lot, and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 5522
This approval is subject to the following terms and conditions

1. That the nitrification field be installed, constructed, altered and/or repaired in the same area where the soil investigation was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altred, and/or repaired and that the system be installed in accordance with same

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and, or Repair Permit" is not correct or is untrue or that the septic tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration, and/or Repair Permit

Environmentalist

John R Atkinson
Environmental Health Director, or Authorized Section Head

EHD-5-76

Environmental Health Department's Copy

Serial No. 0308

ICAR(S) Permit No. 5522


Date Issued 4-[illegible]-76

T C No. 3Y-115-16

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to X Install or Construct, ___ Alter or Repair the individual septic tank wastewater treatment system with subsurface soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 5522, dated [illegible] and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 11/4/76 after which date this permit shall be null and void.

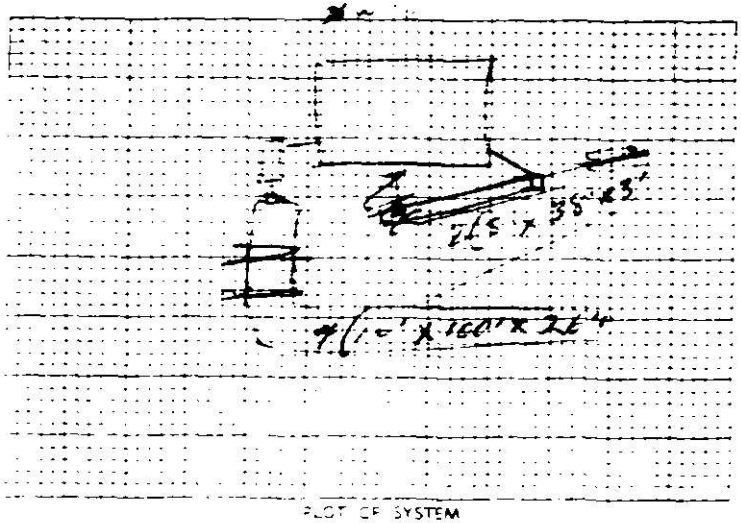

PLOT OF SYSTEM

Permeability Rate 60

Liquid Capacity of Tank 1500 gal

Tank Construction PC

Absorption and Transpiration Lines ST

Total Line Length 600 + 150

Number of Lines 4 + 2

Distance from House 25'

Distance from Property Line 100' 10'

Distance from Well 60

NAME OF OWNER WRIGHT BUILDING CO.

LOCATION OF PROPERTY LOT 15 BELMONT PL

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable before it can be used.

Comments

Assistant Consultant

J P Richardson

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-S-76

Environmental Health Department's Copy

Date Issued 11/2/76

Serial No. 0174

C of A (s) No. 5522

T C No 139-115-16

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF COMPLETION **CERTIFICATE OF APPROVAL**

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner WIGHTMAN & CO. (LAST, FIRST, MIDDLE)

Location of Property Lot 15 BRIARHURST PL

Application Number 5522 Permit Number 5522

Inspection Data:

Liquid Capacity of Tank 1500 gal (ST / WM) Tank Material PC

Total Length of Drain Tile 600 150 Number of Lines 4 2

Depth of Filter Material 26" 3' Cover Depth 18"

Water Supply Source IN DWELL Distance from Water Source 60' GAGE 75' D.

Excavation Inspected 11/2/76 (DATE) Tank Inspected 11/2/76 (DATE)

Nitrification Field Inspected 11/2/76 (DATE)

Washing Machine Line Inspected If Applicable 11/2/76 (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been X installed or constructed altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments

Environmentalist

EHD-S-76

Environmental Health Department's Copy