

5931 MOUNTAIN POINT LN

02325249

1/3/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Post Hold release fee Paid 4/18/11

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 3908B WASPS App #: 2636

Primary ES assigned to project: OJ

Secondary ES assigned to project:

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☑
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☑
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 4 Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR J	Yes ☑	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☑	No ☐	N/A ☐

Operation Permit

.1937(i)	System type as described in table V(a) of rule .1961	Yes ☑	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☑	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

IA issued date: 11-3 08

OP issued date: 11-5 08

Review performed by: 12 Date performed: 9 20 07

JPM

FILE NUMBER: 3988B

SEPTIC FEE: 200.00
DATE: 8/27/07
VISA 248901

Revised On: January 3, 2007

APPLICATION NUMBER: 26360

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: 400.00
DATE: 8/27/07
VISA 248927

1. SEPTIC / TYPE APPLICATION: ☐ NONE ☑ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☐ NONE ☑ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER:
STREET ADDRESS: 5931 MOUNTAIN POINT LANE
CITY: CHARLOTTE
STATE: NC ZIP: 28216
SUBDIVISION NAME: MOUNTAIN POINT ESTATES
LOT #: 11 LOT SIZE (acres): 2.019 ACRES
TOWNSHIP:
☑ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☐ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:

BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☑ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE: 4080 ft2
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
☐ CONCRETE SLAB ☑ BASEMENT WITH PLUMBING
☐ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☑ N/A
NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☐ MUNICIPAL ☐ PUBLIC WELL ☐ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ ANY TYPE

8A. RANK:	☐ CONVENTIONAL	☐ ACCEPTED	☐ INNOVATIVE	☐ ALTERNATIVE	☐ OTHER
	1	4	3	2	5

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☑ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☑ NO
EXISTING WASTEWATER SYSTEMS	☐ YES	☑ NO	JURISDICTIONAL WETLANDS	☐ YES	☑ NO
WELLS, SPRINGS, OR WATER LINES	☐ YES	☑ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES	☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☑ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES	☑ NO

10. PROPERTY OWNER:

NAME: MICHAEL AUSTIN
ADDRESS: 4303 STONEFIELD DR
CITY: CHARLOTTE
STATE: NC ZIP: 28269
HOME PHONE: 704 598 3601 WORK PHONE: 704 941 7807
MOBILE PHONE: 704 941 7807 FAX: 704-896-6228

11. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

12. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____
13 WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? 8/1/08

14. SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

Michael Austin 8/27/07
Property Owner's or Owner's Legal Representative Signature Date

15. WELL PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

Michael Austin 8/27/07
Property Owner's or Owner's Legal Representative Signature Date


☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File # 39888
Date 8/27/07

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

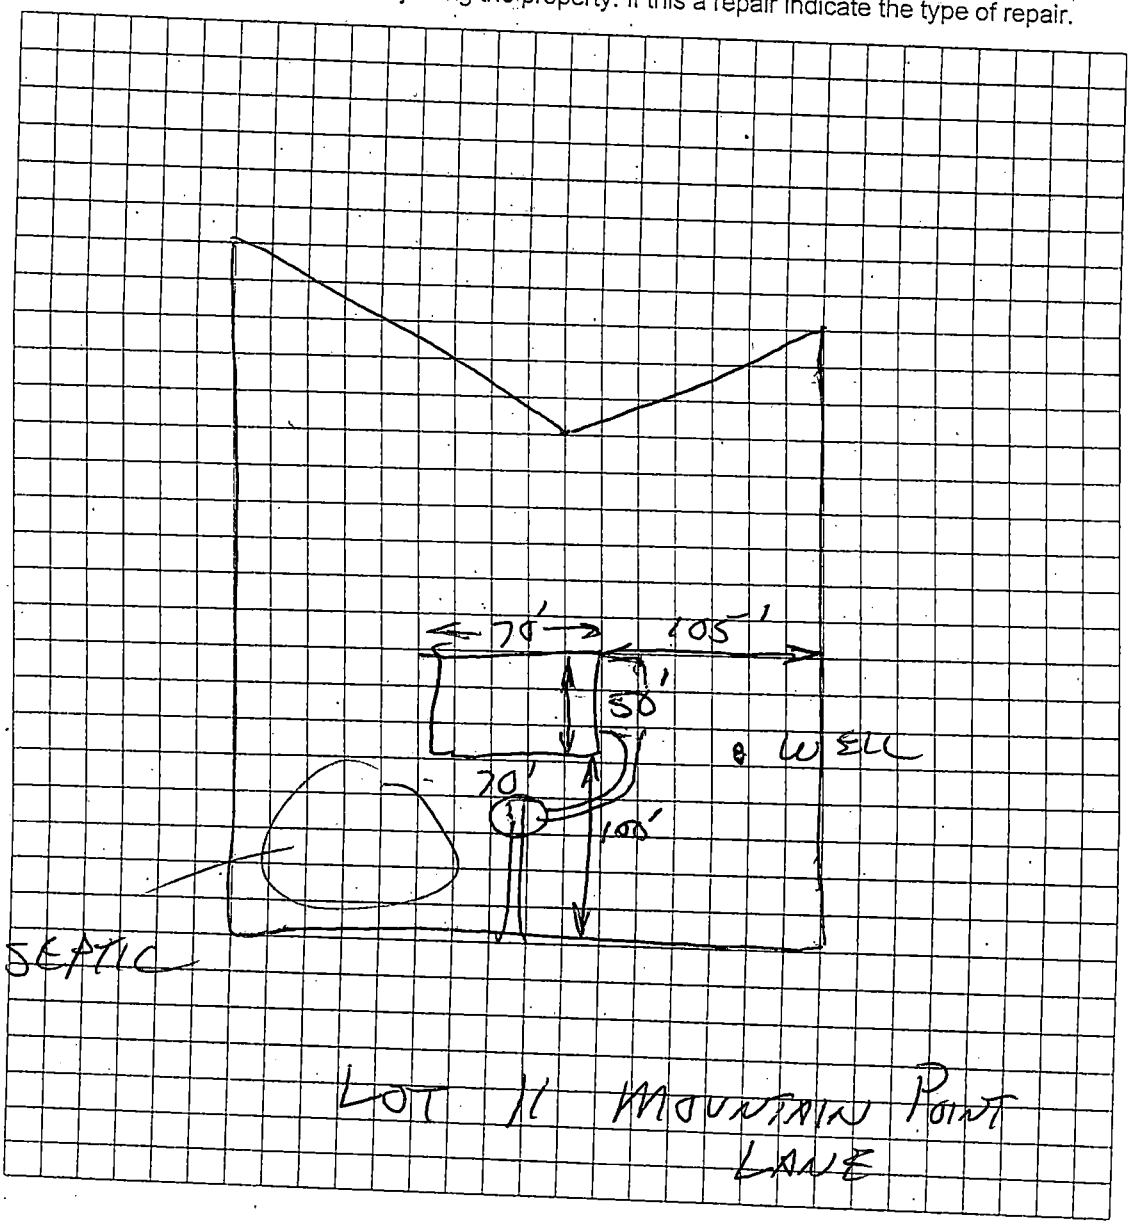

Owner/Agent Signature Michael R Smith
Date 8/27/07

LBC 12/15/04

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30002636** GWS File #: **3988B** Tax Parcel #: **023-252-49**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 9/13/2012

Type of Installation: Residential - New System Lot Number: 11

Structure Type: HOUSE Size (ft^2): 4000 # Bedrooms: 4 # Occupants: 2

Building Foundation: Basement With Plumbing Water Supply: Private Well

II. Initial System Type: Pump to Approved **System Classification:** IIIb

Initial System Specifications:

Design Flow (gpd): 480 LTAR (gpd/ft^2): 0.3 Septic Tank Size (gal): 1500 Pump Tank Size (gal): 1000

Trench Width (ft): 3 Trench Spacing (ft): 9 Absorption Area (ft^2): 1200 Total Trench Length (ft): 400

Maximum Trench Depth (in): 30 Depth of Media (in): 12 Distribution Device: Pressure Manifold

III. Repair System Type: Pump to Approved **System Classification:** IIIb

Repair System Specifications:

Design Flow (gpd): 480 LTAR (gpd/ft^2): 0.3 Septic Tank Size (gal): 1500 Pump Tank Size (gal): 1000

Trench Width (ft): 3 Trench Spacing (ft): 9 Absorption Area (ft^2): 1200 Total Trench Length (ft): 400

Maximum Trench Depth (in): 30 Depth of Media (in): 12 Distribution Device: Pressure Manifold

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone Owner/Legal Agent: _____
Print Name

Signature: _____ Signature: _____

Date Issued: 9/13/2007

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30002636** GWS File #: **3988B**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone

Signature: Jeremy Michelone

Date Issued: 9/13/2007

Owner/Legal Agent: _____
Print Name

Signature: _____

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

9/19/07

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30002636 GWS File #: 3988B Tax Parcel #: 023-252-49

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 9/13/2012

Type of Installation: Residential - New System Lot Number: 11

Structure Type: HOUSE Size (ft^2): 4000 # Bedrooms: 4 # Occupants: 2

Building Foundation: Basement With Plumbing Water Supply: Private Well

II. Initial System Type: Pump to Approved **System Classification:** IIIb

Initial System Specifications:

Design Flow (gpd): 480 LTAR (gpd/ft^2): 0.3 Septic Tank Size (gal): 1500 Pump Tank Size (gal): 1000

Trench Width (ft): 3 Trench Spacing (ft): 9 Absorption Area (ft^2): 1200 Total Trench Length (ft): 400

Maximum Trench Depth (in): 30 Depth of Media (in): 12 Distribution Device: Pressure Manifold

III. Repair System Type: Pump to Approved **System Classification:** IIIb

Repair System Specifications:

Design Flow (gpd): 480 LTAR (gpd/ft^2): 0.3 Septic Tank Size (gal): 1500 Pump Tank Size (gal): 1000

Trench Width (ft): 3 Trench Spacing (ft): 9 Absorption Area (ft^2): 1200 Total Trench Length (ft): 400

Maximum Trench Depth (in): 30 Depth of Media (in): 12 Distribution Device: Pressure Manifold

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)


The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone Owner/Legal Agent: MICHAEL R AUSTIN

Signature: Jeremy Michelone Signature: Michael R Austin (Print Name)

Date Issued: 9/13/2007

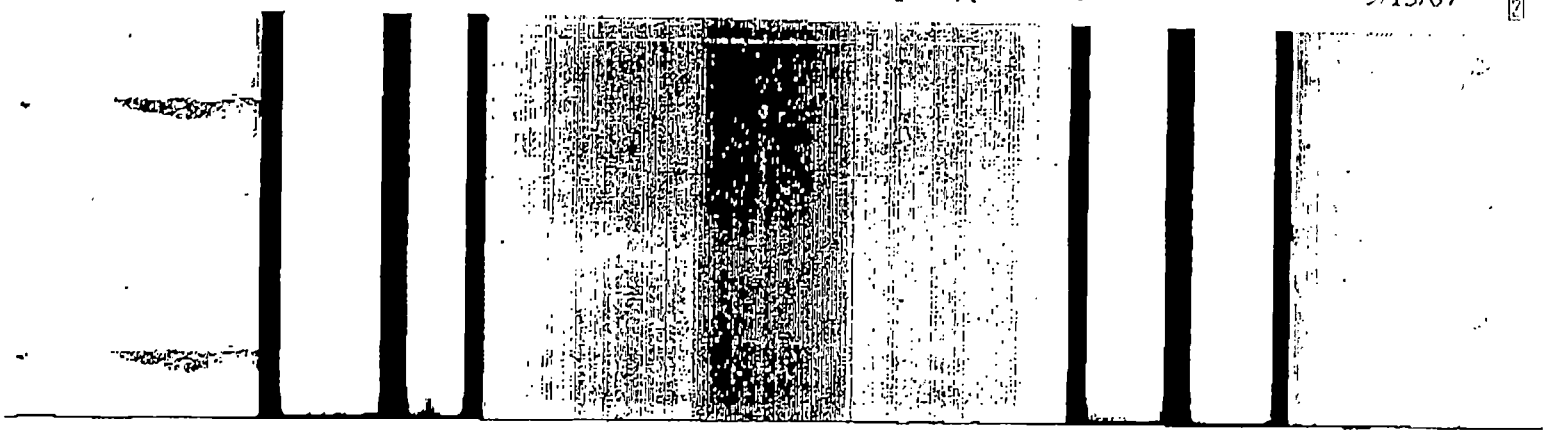

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St. Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30002636 GWS File #: 3988B

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone
Signature: [signature]
Date Issued: 9/13/2007

Owner/Legal Agent: MICHAEL R AUSTIN (Print Name)
Signature: Michael R Austin


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 39888

TC: 023-252-49

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

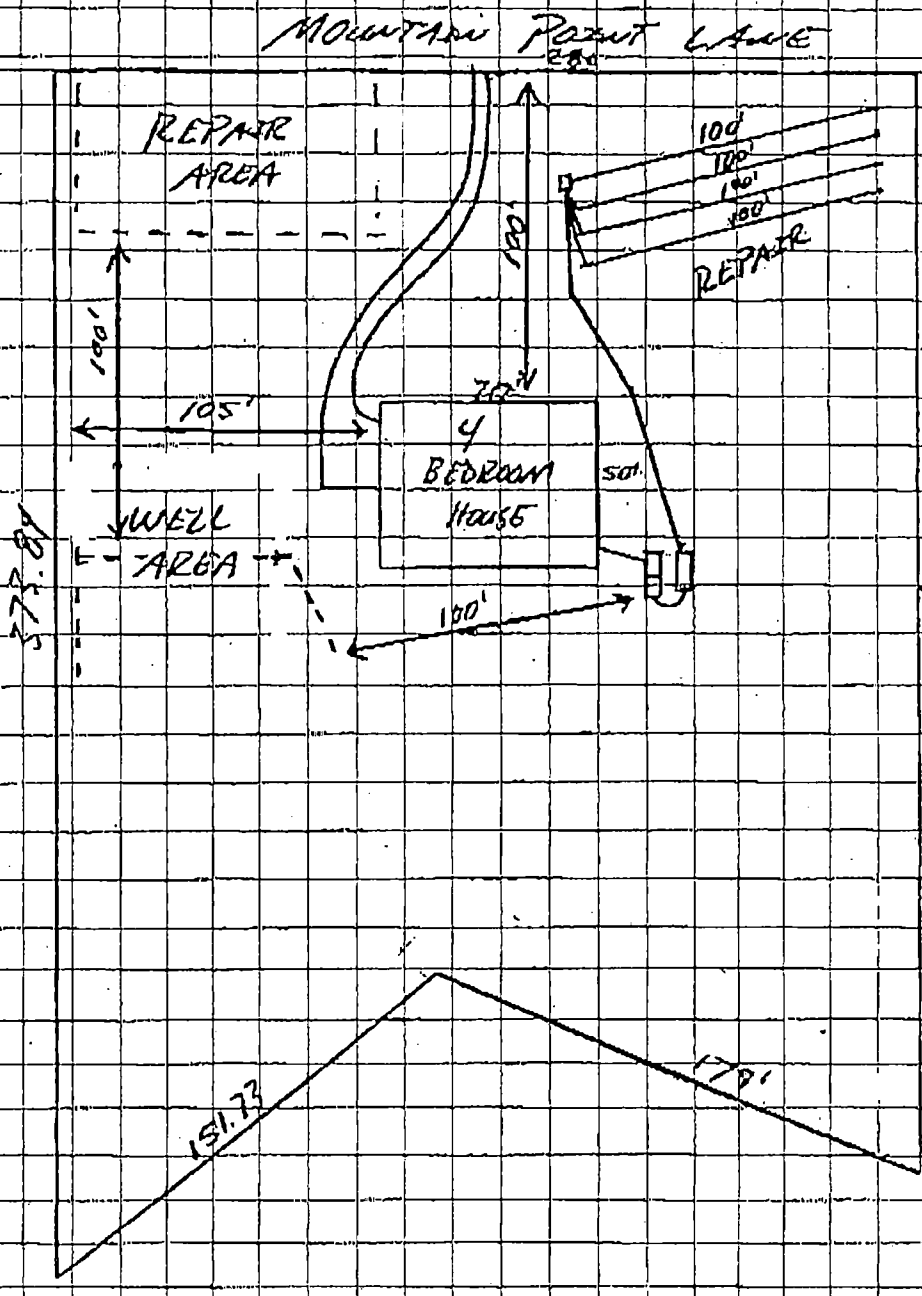

Comments:

- SCALE = 1" = 60'
- 4 Bedroom House
- 1500 SEPTIC
- 1000 Pump
- TYPE III Pump To 25% Red System
- Repair
- Restrict Manhole
- KEEP WELL:
  - >25' from foundation
  - > 10' from property line
  - > 100' from SEPTIC system

OWNER/AGENT SIGNATURE Michael R Rusto

DATE 9/18/07

APPROVAL DATE

FEE: 150.00
DATE: 9/20/2007

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 3988B

PERMIT NUMBER: 30002636

PARCEL NUMBER: E

JOB LOCATION INFORMATION

ADDRESS: 5931 MOUNTAIN POINT LN

CITY: CHARLOTTE **STATE: NC** **ZIP:** 28216

ISSUED TO: MICHAEL AUSTIN

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 9/20/2007

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30002636, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.
   *CONSTRUCTION AUTHORIZATION EXPIRATION DATE: 9/13/2012


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 3988B

TC: 023-252-49

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

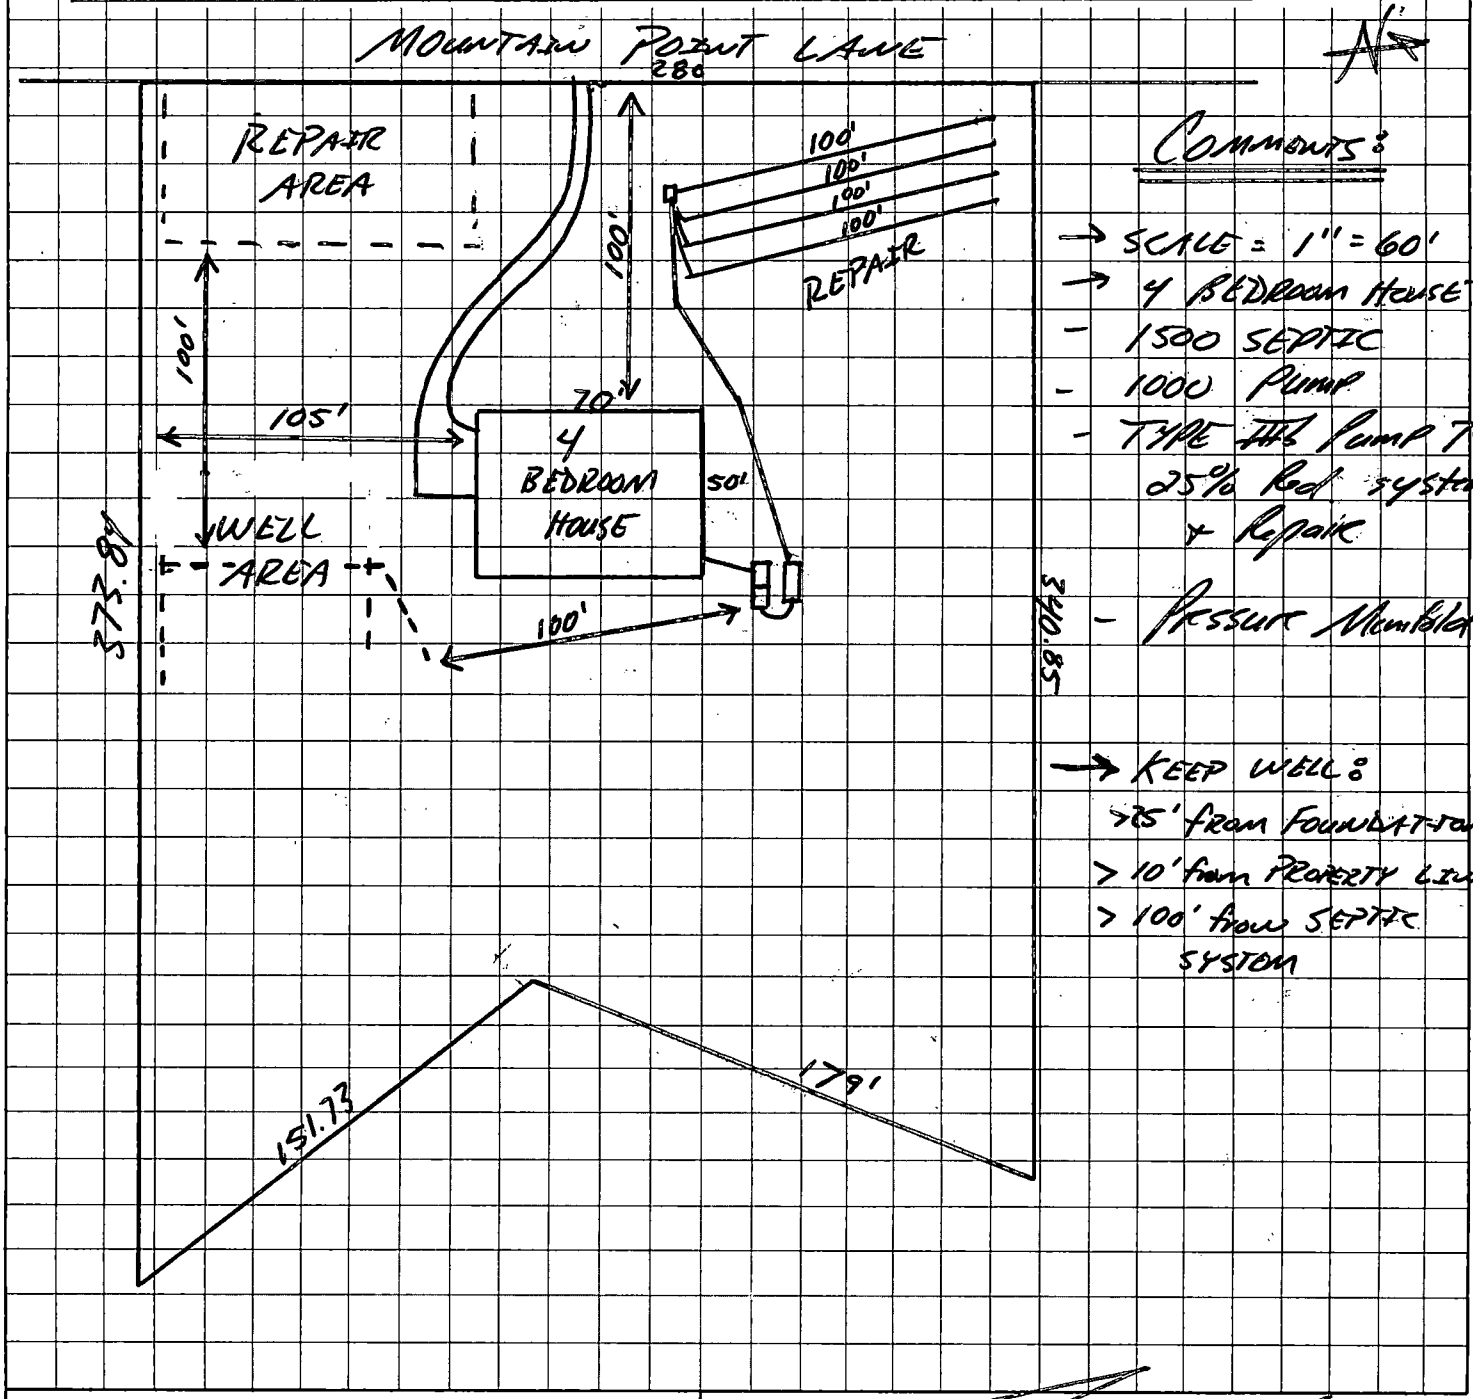

Comments:

- → SCALE = 1" = 60'
- → 4 BEDROOM HOUSE
- - 1500 SEPTIC
- - 1000 PUMP
- - TYPE III PUMP TO 25% Red System & Repair
- - PRESSURE MANIFOLD

→ KEEP WELL:
- > 25' from FOUNDATION
- > 10' from PROPERTY LINE
- > 100' from SEPTIC SYSTEM

OWNER/AGENT SIGNATURE

DATE

APPROVAL DATE

White - Health Department's Copy

Canary - E.H.S. Copy

Pink - Owner's Copy

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 3988B Permit #: 2636 Tax Parcel #: 023-252-47

Property Owner: Mike Austin

Job Location Address: 5931 Mt. Point Lane

City: Charlotte State: NC Zip Code: 28216

Installation Approval Issuance Date: 11/3/08

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before _____, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 480 GPD

Site LTAR: 0.3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 3 @ 133 feet

Depth of Media: 12 inches (Type) 25% Rock

Distribution Device: Drop Boxes

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: >15' feet

Distance from Property Line: 710' feet

Distance from Water Supply Source: >50' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

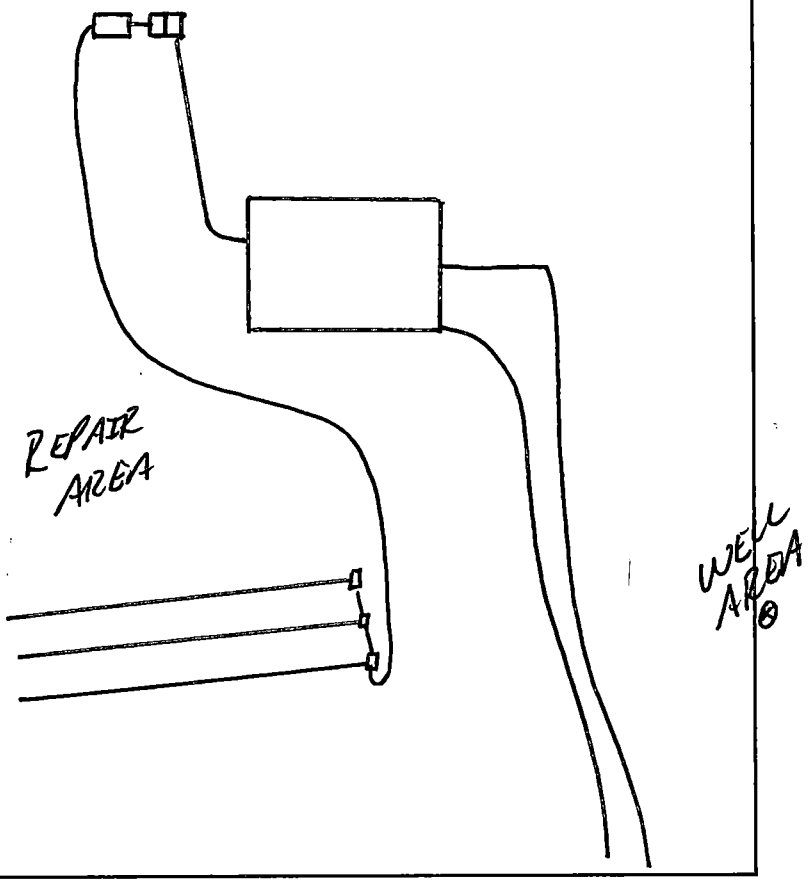

Comments: System Classification & Type: 1111b Pump to 25% Rock System

DENR Authorized Agent: Jeremy Nicholson, R.S. Signature: Jeremy Nicholson, R.S.

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 39888 Permit #: 2636 Tax Parcel #: 023-252-49

Property Owner: Mike Austin

Job Location Address: 5931 Mt. Point Lane

City: Charlotte State: NC Zip Code: 28216

Operation Permit Issuance Date: 11/5/08 Contractor Name: Austroy

Permitted Design Flow: 480 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Effluent Pump Model: 1/2 Horse CHAMPION

Drainfield Installation ☐ N/A

Trench Depth: 36 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 3 @ 133 feet

Depth of Media: 12 inches (Type) E-2 FLOW

Depth of Cover: 24 inches

Distribution Device: DROP BOXES

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 725' feet

Distance from Property Line: 710' feet

Distance from Water Supply Source: NOT DRILLED feet


Inspection Dates

Tank(s) Inspected: 11/4/08

Excavation Inspected: 11/5/08

Pump & Controls Inspected: 11/5/08

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

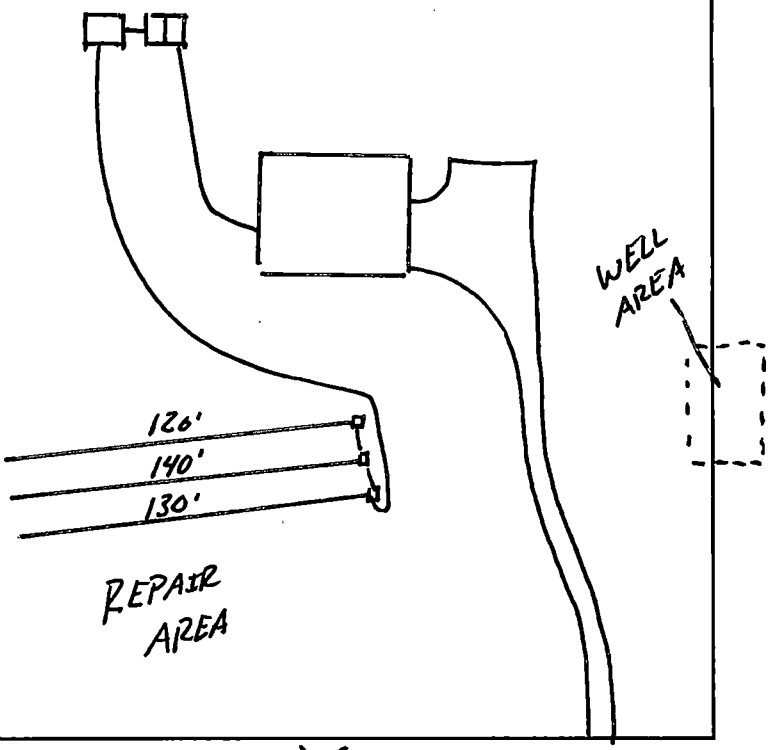

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☒ installed ☐ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIb, E21203H, PRESSURE, NA, NA

DENR Authorized Agent: Jeremy Nicholson R.S. Signature: Jeremy Nicholson R.S.

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 39888 Permit #: 2636 Tax Parcel #: 023-252-49

Property Owner: Mike Austin

Job Location Address: 5931 Mt. Point Lane

City: Charlotte State: NC Zip Code: 28216

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIb

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☒ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Jeremy Nicholas, R.S. Date: 11/5/08

Signature: Jeremy Nicholas, R.S.

FEE: 100.00 CK #2098

DATE: 10/4/00 JC

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: ✓ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM __ REPAIR OF EXISTING SYSTEM

Check for permit processing

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 3988B

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 123-252-33PR

STREET ADDRESS: LOT 11 MOUNTAIN POINT LANE

SUBDIVISION OR MOBILE HOME PARK NAME: MOUNTAIN POINT ESTATES

LOT NUMBER: LOT 11

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
✓ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

HEATED SQUARE FOOTAGE: 3500

NUMBER OF BEDROOMS: 4 NUMBER OF OCCUPANTS:

FOUNDATION FOR RESIDENCE: BASEMENT

__ WITHOUT BASEMENT
__ ON SLAB
__ CRAWL SPACE
✓ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

CLOSING DATE _____

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME-BUSINESS IN THE RESIDENCE: __ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

__ COMMUNITY (C)
__ MUNICIPAL (M)
✓ PRIVATE WELL (P)
__ SHARED WELL (S)
__ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES __ YES ✓ NO
EXISTING WASTEWATER SYSTEMS __ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS __ YES ✓ NO
WELL, SPRINGS OR WATERLINES __ YES ✓ NO
DESIGNATED WETLANDS __ YES ✓ NO

PROPERTY OWNER: MICHAEL R AUSTIN

NAME: AUSTIN (LAST) MICHAEL (FIRST) R (MI)

ADDRESS: 4912 BENTHAVEN LN

CITY: CHARLOTTE STATE: NC ZIP: 28269

DAYTIME PHONE: 704 382-6780

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) —

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Michael R Austin DATE: 10/4/00

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3988B

TC: 023-252-33

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

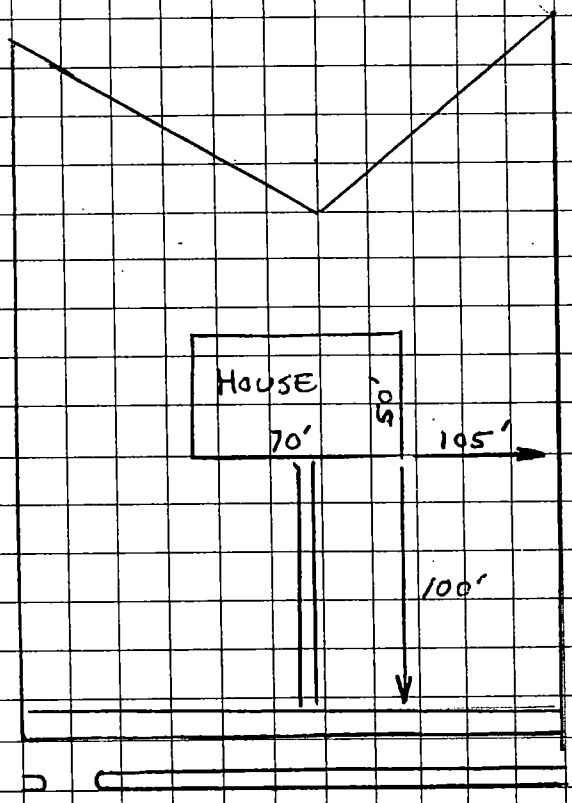

LOT 11 MOUNTAIN POINT LANE

Michael R Austin
OWNER/AGENT SIGNATURE

DATE 10/4/00

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

FEE: _____ **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION**
DATE: _____ **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE**

DATE: 10/10/00 Change of Plot Plan PERMIT NO: 3988B
PARCEL NO: 023 252 33 P0

JOB LOCATION ADDRESS: _____
PROPERTY OWNER: Michael Austin
BUILDING CONTRACTOR: _____
SUBDIVISION NAME: Mountain Point Ln
AUTHORIZATION ISSUED BY: Phil A. Walker RS DATE: _____
DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 3988B, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: _____

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

X _____
SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE DATE

Permit Number: 3988B

CONDITIONS OF IMPROVEMENT PERMIT

Change of Plot Plan

Tax Number: 123 252 33 PO

The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.

CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.

Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	✓ Yes	___ No	___ Partial Basement
Type Primary Wastewater System Type (circle one): I II (III) IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1

.3 Long-term acceptance rate	480 Max gallons/day wastewater flow	1610 Absorption Area (sq ft)	9' Trench spacing (min. on centers)
Yes Serviced by private well	1500 Gallon septic tank	535' Total trench length (ft)	24" Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
4 Bedrooms in residence	1000 Gallon pump tank	12" Depth of stone	

Any surface waters present: NO Type: Minimum separation distance:

Site modifications required:

Additional Conditions: Basement w/ plumbing, Keep the tank > 15' from the house foundation. Keep the septic system > 100' (50' min) from the proposed well, Keep the septic system > 25' from the house foundation. Lift pump required

Repair Area System Type Type (circle one): I II (III) IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1

1610 Absorption Area (Sq ft) 535' Total Trench Length (Ft)	12" Depth of Stone Trench	9' Trench spacing (min. on centers)	24" Maximum Trench Depth

For existing system, enter the year originally installed:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

--- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department

--- This Improvement permit is transferable.

Phillip S. Miller RS. 10/10/00
DEHNR Authorized Agent Date

x Mike Austin 12/22/00
Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPOSED PLOT PLAN

Change of Plot Plan
Lot 11


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3988B

TC: 023-252-33

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

COMMENTS 4 Bedroom Residence, 1500 ST, 1000 DT, Lift pump required, 5 lines x 107' long x 3' wd x 12" stone 535 LF Keep the septic drainfield > 25' from the house foundation, Keep the tanks > 15' from the house foundation Keep the septic system > 100' (50' min) from any wells Type III B - Repair Area 130' from the front right house corner to the front property line 105' from the front right house corner to the right property line

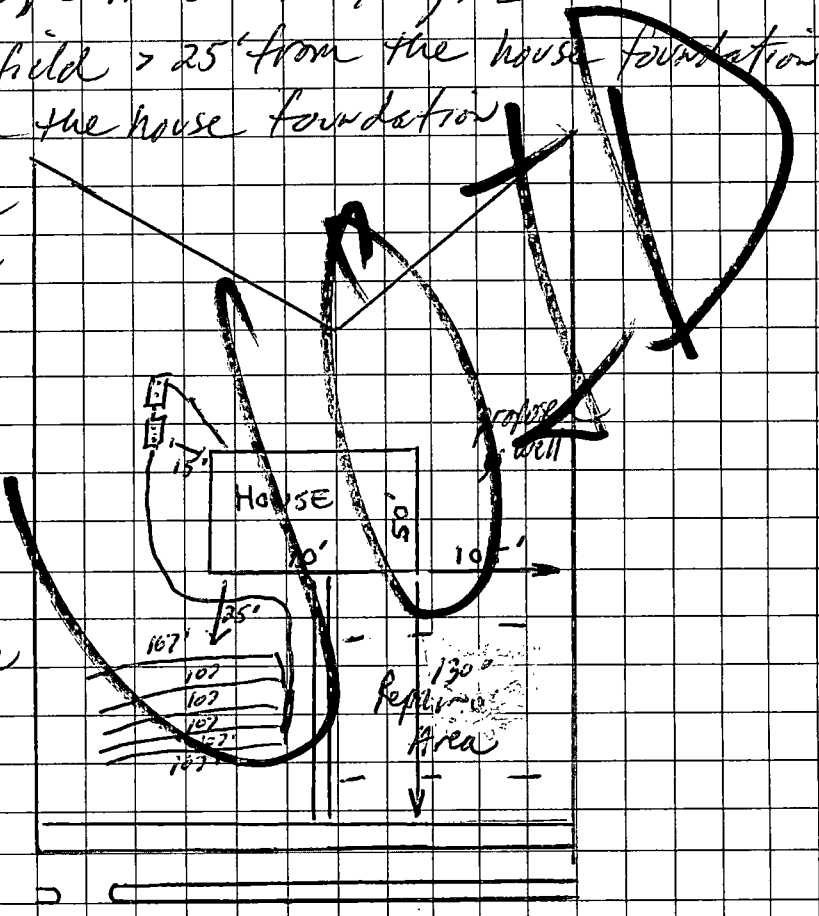

LOT 11 MOUNTAIN POINT LANE

Michael R Austin
OWNER/AGENT SIGNATURE

DATE 10/4/00

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
[redacted]N OF ENVIRONMENTAL HEALTH
[redacted]ASTEWATER SECTION

ACS #2

Sheet: _____
Property ID: PO 023-252-33
Lot #: 11
File #: 3980B

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: F. D. Keith APPLICANT: Kathy Rate
ADDRESS: 5344 Central Ave., Charlotte, N.C. 28212 DATE EVALUATED: 7-29-99
PROPOSED FACILITY: residence PROPOSED DESIGN FLOW (.1949) 480gpd PROPERTY SIZE: 1.8 ±
LOCATION OF SITE: Mountain Point Lane PROPERTY RECORDED: _____
WATER SUPPLY: ☒Private ☐Public ☐Well ☐Spring ☐Other _____
EVALUATION METHOD: ☒Augur Boring ☐Pit ☐Cut
TYPE OF WASTEWATER: ☒Sewage ☐Industrial Process ☐Mixed

PROFILE #	Slopes 6-15% .1940 Landscape Position/ Slope %	Horizon Depth (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS &LTAR
1	LS	0-41"	gr|sr|	Fr|SEXP|SS/SP	748" TO soil wetness	48"	N/A	None	PS .39 F2 IV
		4-37"	SBK|c	Fi|SEXP|SP					
		37-48"	SBK| c|	Fr|SEXP|SS/SP					
2	LS	0-5"	gr|sr|	Fr|SEXP|SS/SP	748" TO soil wetness	48"	N/A	None	PS .39 F2 IV
		5-38"	SBK|c	Fi|SEXP|SP					
		38-48"	SBK|c|	Fr|SEXP|SS/SP					
3	LS	0-4"	gr|sr|	Fr|SEXP|SS/SP	748" TO soil wetness	48"	N/A	None	PS .39 F2 IV
		4-41"	SBK|c	Fi|SEXP|SP					
		41-48"	SBK|c|	Fr|SEXP|SS/SP					
4	LS	0-3"	gr|sr|	Fr|SEXP|SS/SP	748" TO soil wetness	48"	N/A	None	PS .39 F2 IV
		3-48"	SBK|c	Fi|SEXP|SP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	~~LS~~ P.S.
System Type(s)	III b	III b
Site LTAR	0.3	0.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): ~~Unsuitable~~ P.S.
EVALUATED BY: W. R. Marlin - LSS - 7-29-99
OTHER(S) PRESENT: _____

FILE # 3988 B

COMMENTS 1007o Repair

LANDSCAPE POSITION	GROUP	TEXTURE	.1955 LTAR	CONSISTENCE MOIST	CONSISTENCE WET
R-RIDGE	I	S-SAND	1.2-0.8		
S-SHOULDER SLOPE		LS-LOAMY SAND		VFR-VERY FRIABLE	NS-NON-STICKY
L-LINEAR SLOPE				FR-FRIABLE	SS-SLIGHTLYSTICKY
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8-0.6	FI-FIRM	S-STICKY
N-NOSE SLOPE		L-LOAM		VFI-VERY FIRM	VS-VERY STICKY
H-HEAD SLOPE				EFI-EXTREMELY FIRM	NP-NON-PLASTIC
CC-CONCLAVE SLOPE	III	SI-SILT	0.6-0.3		SP-SLIGHTLYSTICKY
CV-CONVEX SLOPE		SICL-SILTY CLAY LOAM			P-PLASTIC
T-TERRACE		CL-CLAY LOAM			VP-VERY PLASTIC
FP-FLOOD PLAIN		SCL-SANDY CLAY LOAM			
	IV	SC-SANDY CLAY	0.4-0.1		
		SIC-SILTY CLAY			
		O-ORGANIC			


STRUCTURE

SG-SINGLE GRAIN
M-MASSIVE
CR-CRUMB
GR-GRANULAR
SBK-SUBANGULAR BLOCKY
ABK-ANGULAR BLOCKY
PL-PLATY
PR-PRISMATIC

MINERALOGY

SLIGHTLY EXPANSIVE

EXPANSIVE

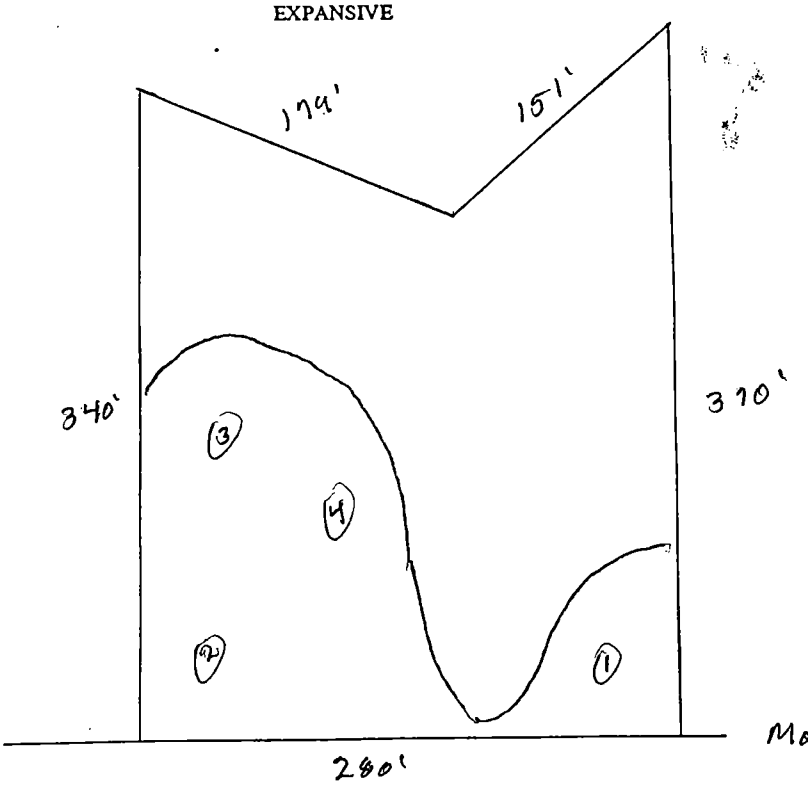

Mountain Point Lane

PROPOSED PLOT PLAN


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3988B

TC: 023-252-33P0 11

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

COMMENTS 4 Bedroom Residence
1500 ST, 5 lines x 111' long x 3' wd x 12" stone 535 LF
Type IIa Repair, Keep the septic system > 100' (50' min)
from the proposed well
30' from the front right house corner to the right property line
40' from the front right house corner to the front property line

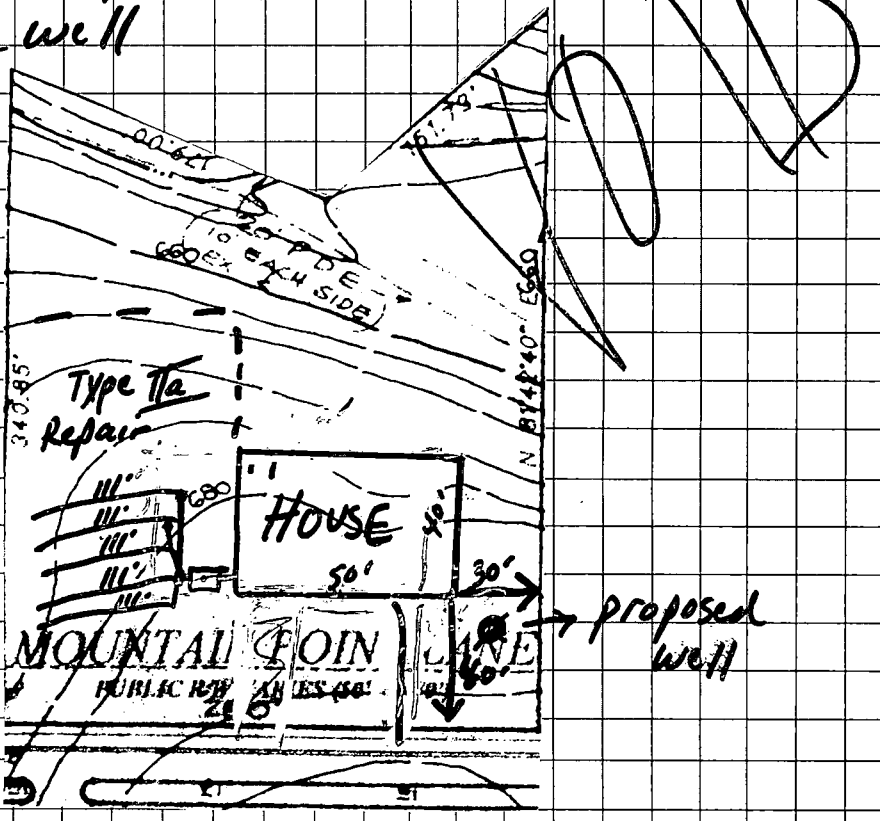

Lot 11
Mountain Point Lane

OWNER/AGENT SIGNATURE

DATE 6-25-99

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

Permit Number: 3988B

CONDITIONS OF IMPROVEMENT PERMIT

Tax Number: 023252 33 P0

The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.

CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.

Lot 11

Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	✓ No	___ Partial Basement	
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1	
.3 Long-term acceptance rate	480 Max gallons/day wastewater flow	1610 Absorption Area (sq ft)	9' Trench spacing (min. on centers)	
YES Serviced by private well	1500 Gallon septic tank	535' Total trench length (ft)	24" Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)	
4 Bedrooms in residence	NA Gallon pump tank	12" Depth of stone		
Any surface waters present: NO Type:		Minimum separation distance:		
Site modifications required:				
Additional Conditions:				

Repair Area System Type Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1	
1610 Absorption Area (Sq ft) 535' Total Trench Length (Ft)	12" Depth of Stone Trench	9' Trench spacing (min. on centers)	24" Maximum Trench Depth	
For existing system, enter the year originally installed:				

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

--- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.

--- This Improvement permit is transferable.

Philo L. Walker RS 6/7/00
DEHNR Authorized Agent Date

x Tommy Clarke OPSS 6/31/00
Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	04/18/11	**Amount:**	200.00
Receipt #:	72374	**Tendered:**	0.00
Check / Auth #:	VISA 829431	**Returned:**	0.00
Received By:	CRAIGGY		

Account Information

Account #: 200000
Contractor: AUSTIN MIHAELC
Attn:
Address: 4303 STONEFIELD DRIVE
Address:
City/State/Zip: CHARLOTTE, NC 28269

Item	Description	Permit#	Quantity	Unit Price	Total Price
0703	Installation/Final Approval 5931 MOUNTAIN POINT LN/FILE 3988B		1	200.00	200.00

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
120.00					

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	09/18/07	**Amount:**	150.00
Receipt #:	52717	**Tendered:**	0.00
Check / Auth #:	VISA 161551	**Returned:**	0.00
Received By:	CRAIGGY		

Account Information

Account #: 200000
Contractor: AUSTIN MICHAEL
Attn:
Address: 4303 STONEFIELD DR
Address:
City/State/Zip: CHARLOTTE, NC 28269

Item	Description	Permit#	Quantity	Unit Price	Total Price
0734	Auth for Waste Wtr Sys Constr 5931 MOUNTAIN POINT LANE/FILE 3988B		1	150.00	150.00

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
[redacted]N OF ENVIRONMENTAL HEALTH
[redacted]ASTEWATER SECTION

ACS #2

Sheet: _____
Property ID: PO 023-252-33
Lot #: 11
File #: 3988B

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: F. D. Heath APPLICANT: Kathy Rael
ADDRESS: 5344 Central Ave., Charlotte, N.C. 28212 DATE EVALUATED: 7-29-99
PROPOSED FACILITY: residence PROPOSED DESIGN FLOW (.1949) 480 gpd PROPERTY SIZE: 1.8 ±
LOCATION OF SITE: Mountain Point Lane PROPERTY RECORDED: _____
WATER SUPPLY: ☑Private ☐Public ☐Well ☐Spring ☐Other _____
EVALUATION METHOD: ☑Augur Boring ☐Pit ☐Cut
TYPE OF WASTEWATER: ☑Sewage ☐Industrial Process ☐Mixed

PROFILE #	Slopes 6-15% .1940 Landscape Position/ Slope %	Horizon Depth (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS &LTAR
1	LS	0-41"	gr|sr|	Fr|SEXP|SS|SP	748" TO soil wetness	48"	N/A	None	PS .39|P2 IV
		4-37"	SBK|c	Fi|SEXP|S|P					
		37-48"	SBK|r|	Fr|SEX P|SS|SP					
2	LS	0-5"	gr|sr|	Fr|SEXP|SS|SP	748" TO soil wetness	48"	N/A	None	PS .39|P2 IV
		5-38"	SBK|c	Fi|SEXP|S|P					
		38-48"	SBK|r|	Fr|SEXP|SS|SP					
3	LS	0-41"	gr|sr|	Fr|SEXP|SS|SP	748" To soil wetness	48"	N/A	None	PS .39|P2 IV
		4-41"	SBK|r	Fi|SEXP|S|P					
		41-48"	SBK|r|	Fr|SEXP|SS|SP					
4	LS	0-3"	gr|sr|	Fr|SEXP|SS|SP	748" To soil wetness	48"	N/A	None	PS .39|P2 IV
		3-48"	SBK|r	Fi|SEXP|S|P					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	~~LPP~~ P.S.
System Type(s)	III b	III b
Site LTAR	0.3	0.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): ~~Unsuitable~~ P.S.
EVALUATED BY: W. R. Martin - LSS - 7-29-99
OTHER(S) PRESENT: _____

FEE: 100.00 CK # 2099

DATE: 6/15/99 VIS

APPLICATION FOR IMPROVEMENT PERMIT
FOR RESIDENTIAL SITE
INDIVIDUAL WATER AND WASTEWATER
SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: ✓ NEW SYSTEM ___ EXPANSION/ ALTERATION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 98588

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 023-252-33 PO11

STREET ADDRESS: LOT 11 Mountain Point Lane

SUBDIVISION OR MOBILE HOME PARK NAME: Mountain Point Estates

LOT NUMBER: LOT 11

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S)
___ DOUBLE WIDE (D)
✓ HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

HEATED SQUARE FOOTAGE: 3500

NUMBER OF BEDROOMS: 4

NUMBER OF OCCUPANTS:

FOUNDATION FOR RESIDENCE: Crawlspace

✓ WITHOUT BASEMENT
___ ON SLAB
✓ CRAWL SPACE
___ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
___ 7 MINT HILL

CLOSING DATE _____

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

___ COMMUNITY (C)
___ MUNICIPAL (M)
✓ PRIVATE WELL (P)
___ SHARED WELL (S)
___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES ✓ NO
EXISTING WASTEWATER SYSTEMS ___ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS ___ YES ✓ NO
WELL, SPRINGS OR WATERLINES ___ YES ✓ NO
DESIGNATED WETLANDS ___ YES ✓ NO

PROPERTY OWNER: F.G. KEITH

NAME: (LAST) KEITH (FIRST) F. (MI) G.

ADDRESS: 5344 Central Avenue

CITY: Charlotte STATE: NC ZIP: 28212

DAYTIME PHONE: 704 568-4195

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) KATE (FIRST) KATHY (MI)

DAYTIME PHONE: 704 399-4848

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: F. G. Keith DATE: 6-15-99

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102