Date Received 1-23-80

APT No 16490

T C No 141-121-14

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER Elite Homes of Charlotte
LAST FIRST MIDDLE

2) ADDRESS OF OWNER Dorcas Ln. P.O. 1522 ZIP 28201

3) PHONE NO Home — Office 373-0138


4) LOCATION OF PROPERTY Off SR 1164 (Dorcas Ln.)
STREET OR COUNTY ROAD

5) SUBDIVISION LOT NO 38 BLOCK NO C

MAP BOOK NO PAGE NO

6) DEED REFERENCE DEED BOOK PAGE NO

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface soil absorption effluent discharge

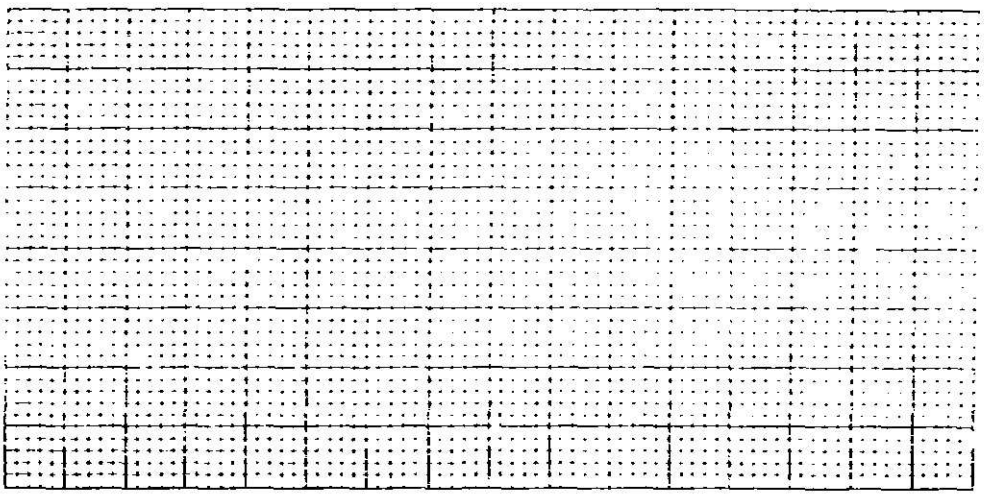

7) ACCURATELY DIAGRAM & DIMENSION LOT

Elite Homes Builders
OWNER Pam D. Tyndall

EHO-5-76

Environmental Health Department's Copy

NORTH CAROLINA
DEPARTMENT OF HUMAN RESOURCES
DIVISION OF HEALTH SERVICES
RALEIGH, NORTH CAROLINA

APPENDIX II
SITE EVALUATION

S. I. R. NO. 16490
T. C. # 141-121-14

(Ground Absorption Sewage Disposal)

OWNER: ELITE HOMEBUILDER OF CHARLOTTE REQUESTED: 1-23-80
ADDRESS: PLAT NO.:
COUNTY: Meck. LOT SIZE: 20,000
LOCATION OF SITE: ON RT. AT END OF DORCAS LN

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	S (PS) 2-10 U	S (PS) 2-10 U	S PS U	S PS U
2. SOIL TEXTURE (12-36 in.) (Sandy, loamy, clayey, Note 2:1 Clay)	S PS (U) Mixed Clayey	S PS (U) Clay 2-1	S PS U	S PS U
3. SOIL STRUCTURE (12-36 in.) (Clayey Soils)	S PS (U) Blocky TO Massive	S PS (U) Massive	S PS U	S PS U
4. SOIL DEPTH (In.)	S PS (U) 48	S PS (U) 48	S PS U	S PS U
5. RESTRICTIVE HORIZONS (In.) (Impervious Strata Rock)	S PS (U) Clays	S PS (U) Clay	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (External & internal)	S PS (U) Slow	S PS (U) Slow	S PS U	S PS U
7. SOIL PERMEABILITY (Percolation Rate)	S PS (U) Slow	S PS (U) Slow	S PS U	S PS U
8. OTHER (Specify)	S PS U	S PS U	S PS U	S PS U
9. SITE CLASSIFICATION	Unsuitable	Unsuitable		
SOIL SERIES	Mixed Clays Transition Area	Iredell		

S - Suitable PS - Provisionally Suitable U Unsuitable


* See Diagram on Back (Include: Soil areas, property lines, roads, streams, gullies wet areas, fill areas, wells, water bodies, slope patterns, etc

Recommendations/Comments:

Described By: W. B. Ramsey
Title: Soil Scientist Date: 1-25-80

DHS Form 2601
Sanitation
EHD 539 (3/79)

2

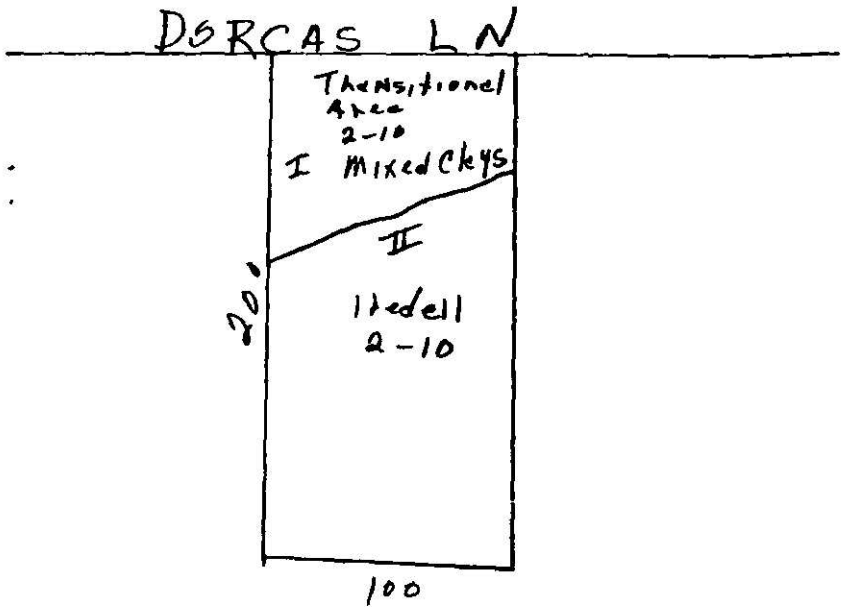
DORCAS LN
Transitional
Area
2-10
I Mixed Clays
II
Redell
2-10
20'
100

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
1200 BLYTHE BOULEVARD
CHARLOTTE NORTH CAROLINA 28203

SITE INVESTIGATION REPORT
INDIVIDUAL SEPTIC TANK SYSTEM
WITH SUBSURFACE,
SOIL ABSORPTION,
EFFLUENT DISCHARGE

S.I.R. # 16490

T.C. # 141-121-14

DATE January 28, 1980

NAME OF OWNER Elite Homebuilders of Charlotte

ADDRESS OF OWNER P O Box 4532, Charlotte, NC 28204

LOCATION OF LOT Dorcas Lane, Lot 8, Block D

As determined under the Rules and Regulations promulgated by the Commission for Health Services, Division of Health Services, North Carolina Department of Human Resources, Raleigh, North Carolina, the soils on the lot described above were found to be unsuitable for the installation of an individual septic tank - soil absorption system, due to the following reason:

Soil Structure Massive

Soil Permeability Unsuitable

John R. Adkisson

John R. Adkisson, Environmentalist

Date Received 1/2/81

APT No 16490

T C No. 141-121-14

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER SOLOMON (LAST), ARLON (FIRST) + MARGARET (MIDDLE)

2) ADDRESS OF OWNER % C-21 Heritage Realty ZIP
2329 Randolph Rd., Charlotte, N C 28207

3) PHONE NO Home 366-2121 Office

4) LOCATION OF PROPERTY DORCAS LANE (Lot 8, Block D)
STREET OR COUNTY ROAD


5) SUBDIVISION Steelberry Acres LOT NO 8 BLOCK NO D

MAP BOOK NO 7 PAGE NO 159

6) DEED REFERENCE DEED BOOK 2975 PAGE NO 059

Tax map reference 141-121-14

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation on and/or in the inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface absorption effluent discharge.

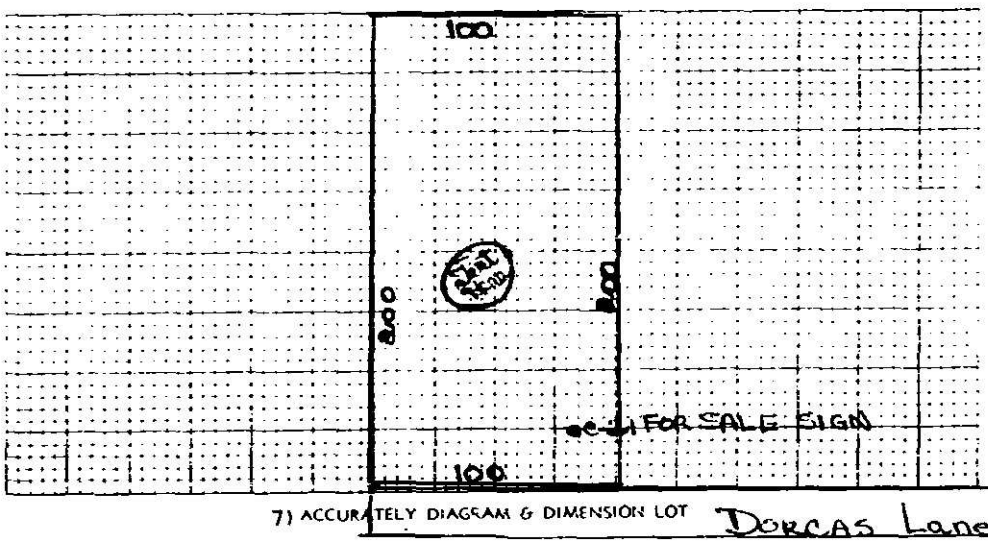

7) ACCURATELY DIAGRAM & DIMENSION LOT Dorcas Lane

J. Allen Stephens, Agent
OWNER

EHD-5-76

Environmental Health Department's Copy

NORTH CAROLINA
DEPARTMENT OF HUMAN RESOURCES
DIVISION OF HEALTH SERVICES
RALEIGH, NORTH CAROLINA

APPENDIX II
SITE EVALUATION

(Ground Absorption Sewage Disposal) 16490

OWNER: ARLON SOLOMON DATE REQUESTED: 1-2-81
ADDRESS: %C-21 Heritage Realty PLAT NO.: 141-121-14
COUNTY: 2329 Randolph Rd. Charlotte LOT SIZE: 20,000
LOCATION OF SITE: DORCAS LANE LOT 8 BLOCK D

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	S (PS) 2-10 U	S (PS) 2-10 U	S PS U	S PS U
2. SOIL TEXTURE (12-36 in.) (Sandy, loamy, clayey, Note 2-1, Clay)	S Mixed PS Clays (U)	S Clay PS 2-1 (U)	S PS U	S PS U
3. SOIL STRUCTURE (12.36 in.) (Clayey Soils)	S Blocky PS To (U) Massey	S PS Massey (U)	S PS U	S PS U
4. SOIL DEPTH (In.)	S PS 48 (U)	S PS 48 (U)	S PS U	S PS U
5. RESTRICTIVE HORIZONS (In.) (Impervious Strata, Rock)	S PS Clays (U)	S PS Clay (U)	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (External & Internal)	S PS Slow (U)	S PS Slow (U)	S PS U	S PS U
7. SOIL PERMEABILITY (Percolation Rate)	S PS Slow (U)	S PS Slow (U)	S PS U	S PS U
8. OTHER (Specify)	S PS U	S PS U	S PS U	S PS U
9. SITE CLASSIFICATION	Unsuitable	Unsuitable		
SOIL SERIES	Mixed Clays Transitional Area	IREDELL		

S - Suitable PS - Provisionally Suitable U - Unsuitable


* See Diagram on Back (Include: Soil areas, property lines, roads, streams, gullies, wet areas, fill areas, wells, water bodies, slope patterns, etc)

Recommendations/Comments:

Described By: W. B. Ramsey

Title: Soil Scientist Date: 1-5-81

DHS Form 2601 (2/77)
Sanitation

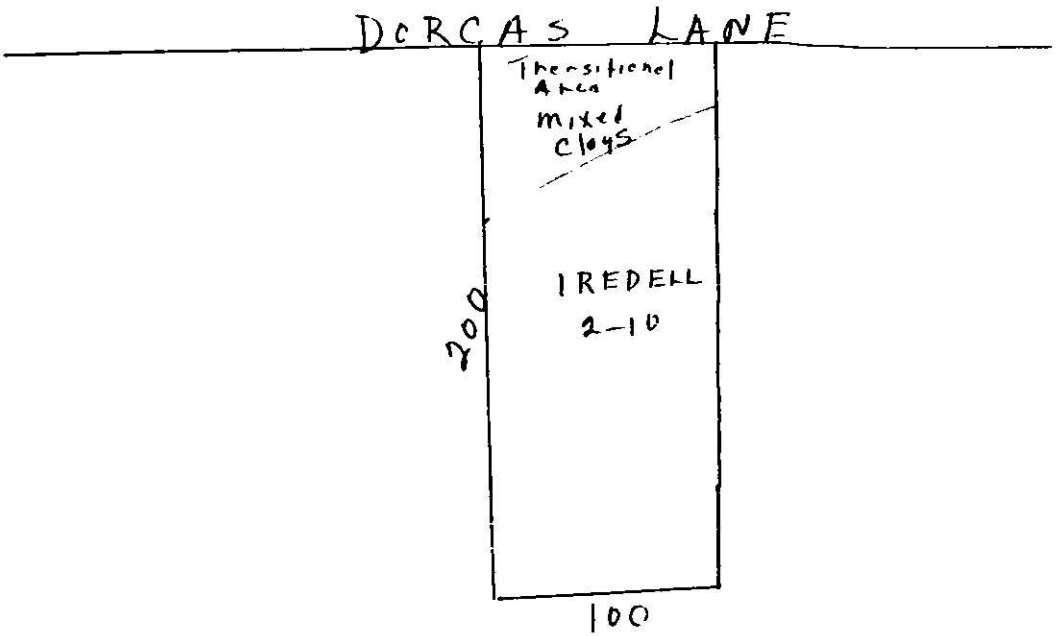
DORCAS LANE
Transitional Area
mixed clays
IREDELL
2-10
200
100

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
1200 BLYTHE BOULEVARD
CHARLOTTE NORTH CAROLINA 28203

SITE INVESTIGATION REPORT
INDIVIDUAL SEPTIC TANK SYSTEM
WITH SUBSURFACE,
SOIL ABSORPTION,
EFFLUENT DISCHARGE

S.I.R. # 16490

T.C. # 141-121-14

DATE Jan. 6, 1981

NAME OF OWNER Solomon, Arlon and Margaret

ADDRESS OF OWNER c/o Heritage Realty, 2329 Randolph Road, Charlotte 28207

LOCATION OF LOT Dorcas Lane (lot 8, block D, Strawberry Acres)

As determined under the Rules and Regulations promulgated by the Commission for Health Services, Division of Health Services, North Carolina Department of Human Resources, Raleigh, North Carolina, the soils on the lot described above were found to be unsuitable for the installation of an individual septic tank - soil absorption system, due to the following reason:

Soil Structure Massive

Soil Permeability Unsuitable

John R. Adkisson

John R. Adkisson, Environmentalist