

1241 HAWFIELD RD

05309333

12/26/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

FEE: 100.00 CK 1534
DATE: 2/18/97

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: ✓ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM __ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 1768B

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 053-093-33 80

STREET ADDRESS: Hawfield Rd

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

CLOSING DATE_____

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
✓ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

HEATED SQUARE FOOTAGE: 1793

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 2

FOUNDATION FOR RESIDENCE:

__ WITHOUT BASEMENT
__ ON SLAB
✓ CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):
__ COMMUNITY (C)
__ MUNICIPAL (M)
__ PRIVATE WELL (P)
✓ SHARED WELL (S)
__ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES __ YES ✓ NO
EXISTING WASTEWATER SYSTEMS __ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS __ YES ✓ NO
WELL, SPRINGS OR WATERLINES __ YES ✓ NO
DESIGNATED WETLANDS __ YES ✓ NO

PROPERTY OWNER:

NAME: Cornwell Scott J
(LAST) (FIRST) (MI)

ADDRESS: 1241 Hawfield Rd

CITY: Charlotte STATE: N.C ZIP: 28214

DAYTIME PHONE: ( ) 704-394-3685

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) –

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? ~~5/19/95~~ 5/19/95

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: [signature] DATE: 2-18-97

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 1768B

TC: 053-053-33

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

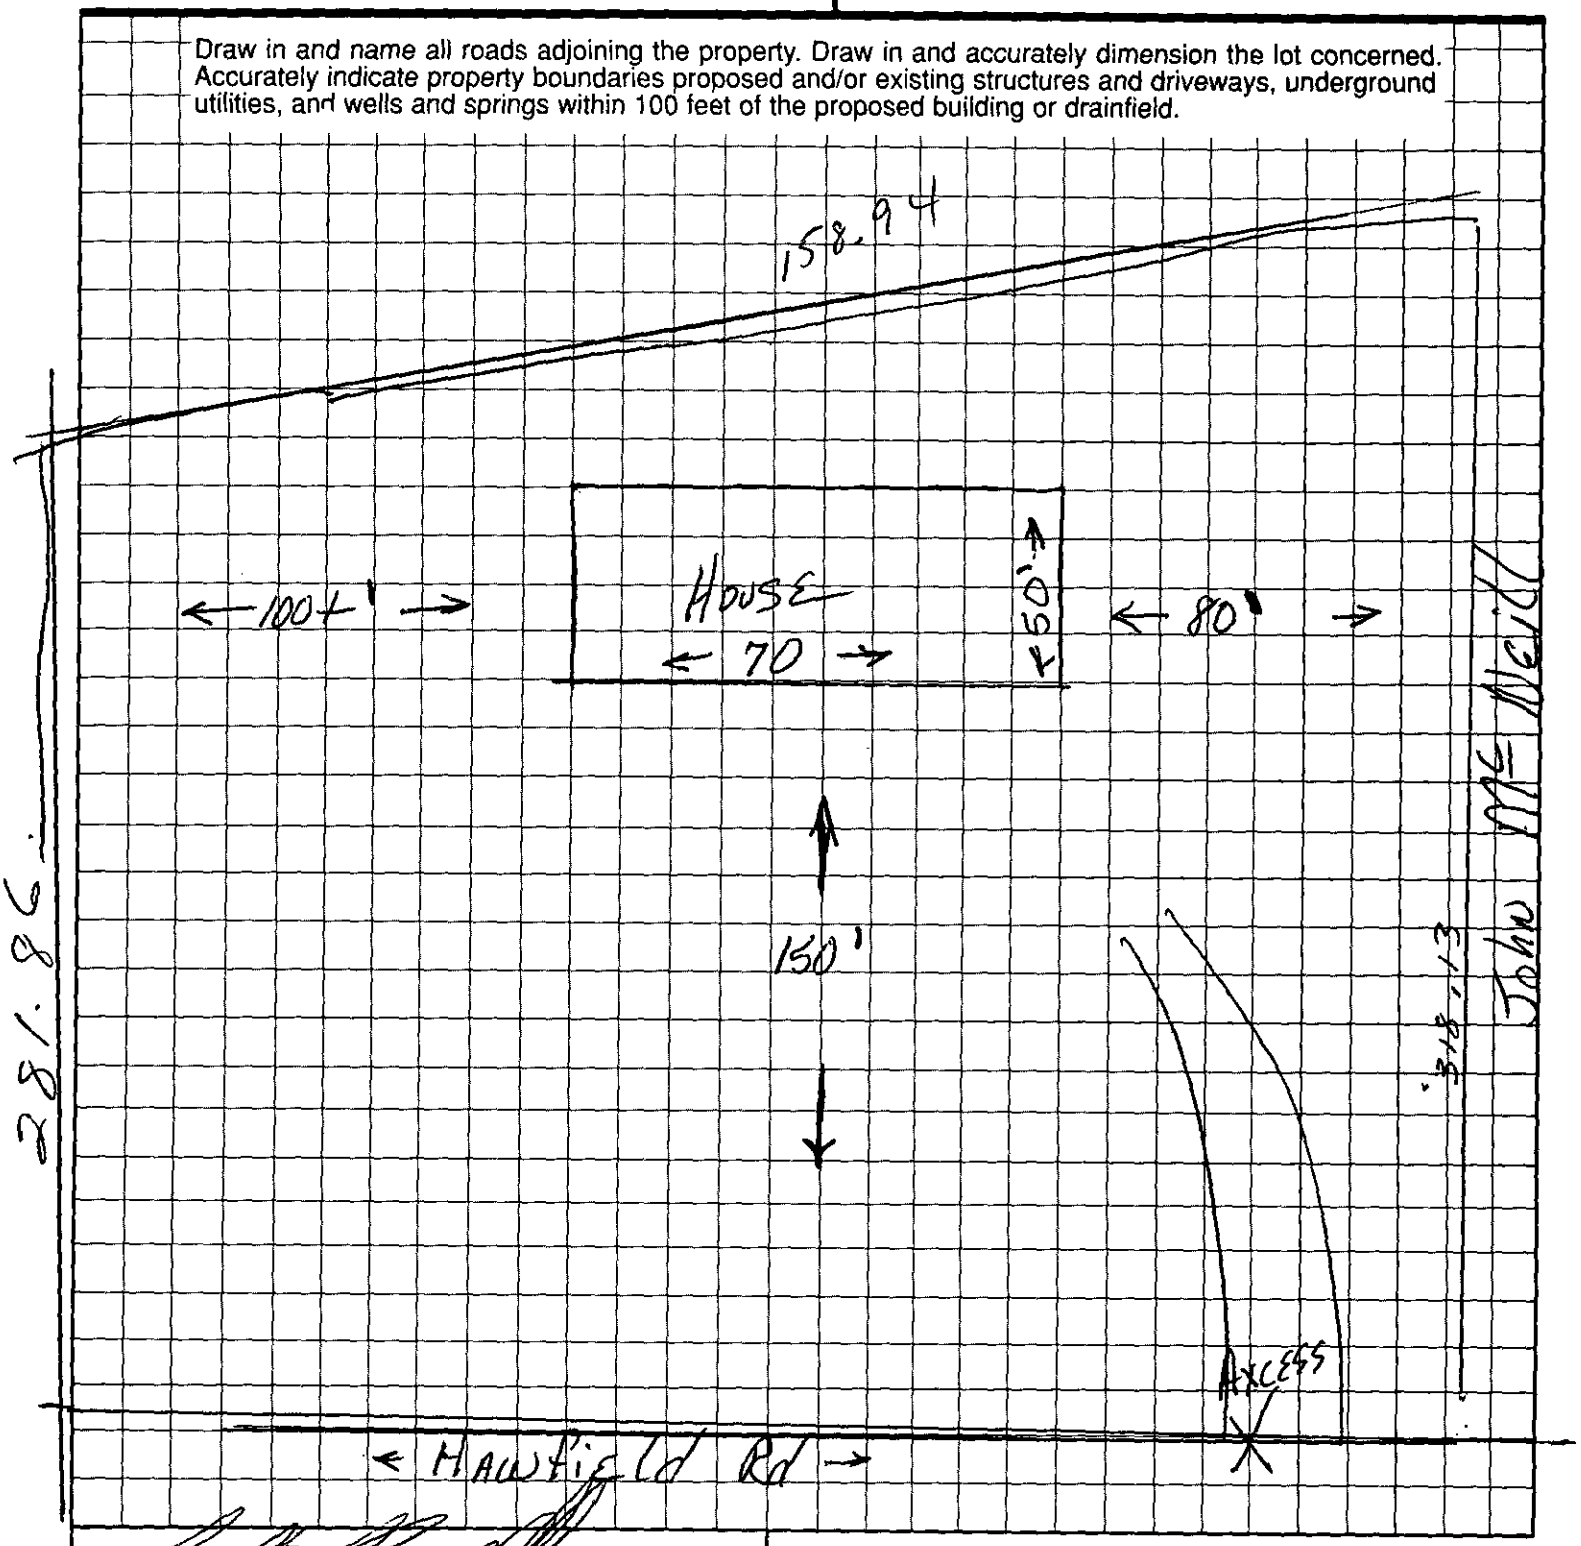

OWNER/AGENT SIGNATURE

DATE 2-18-97

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's

« 2nd Site Evaluation »

PROPOSED PLOT PLAN


$75.00
CK#1555
3-12-97

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 1768B

TC: 053-093-33 PO

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

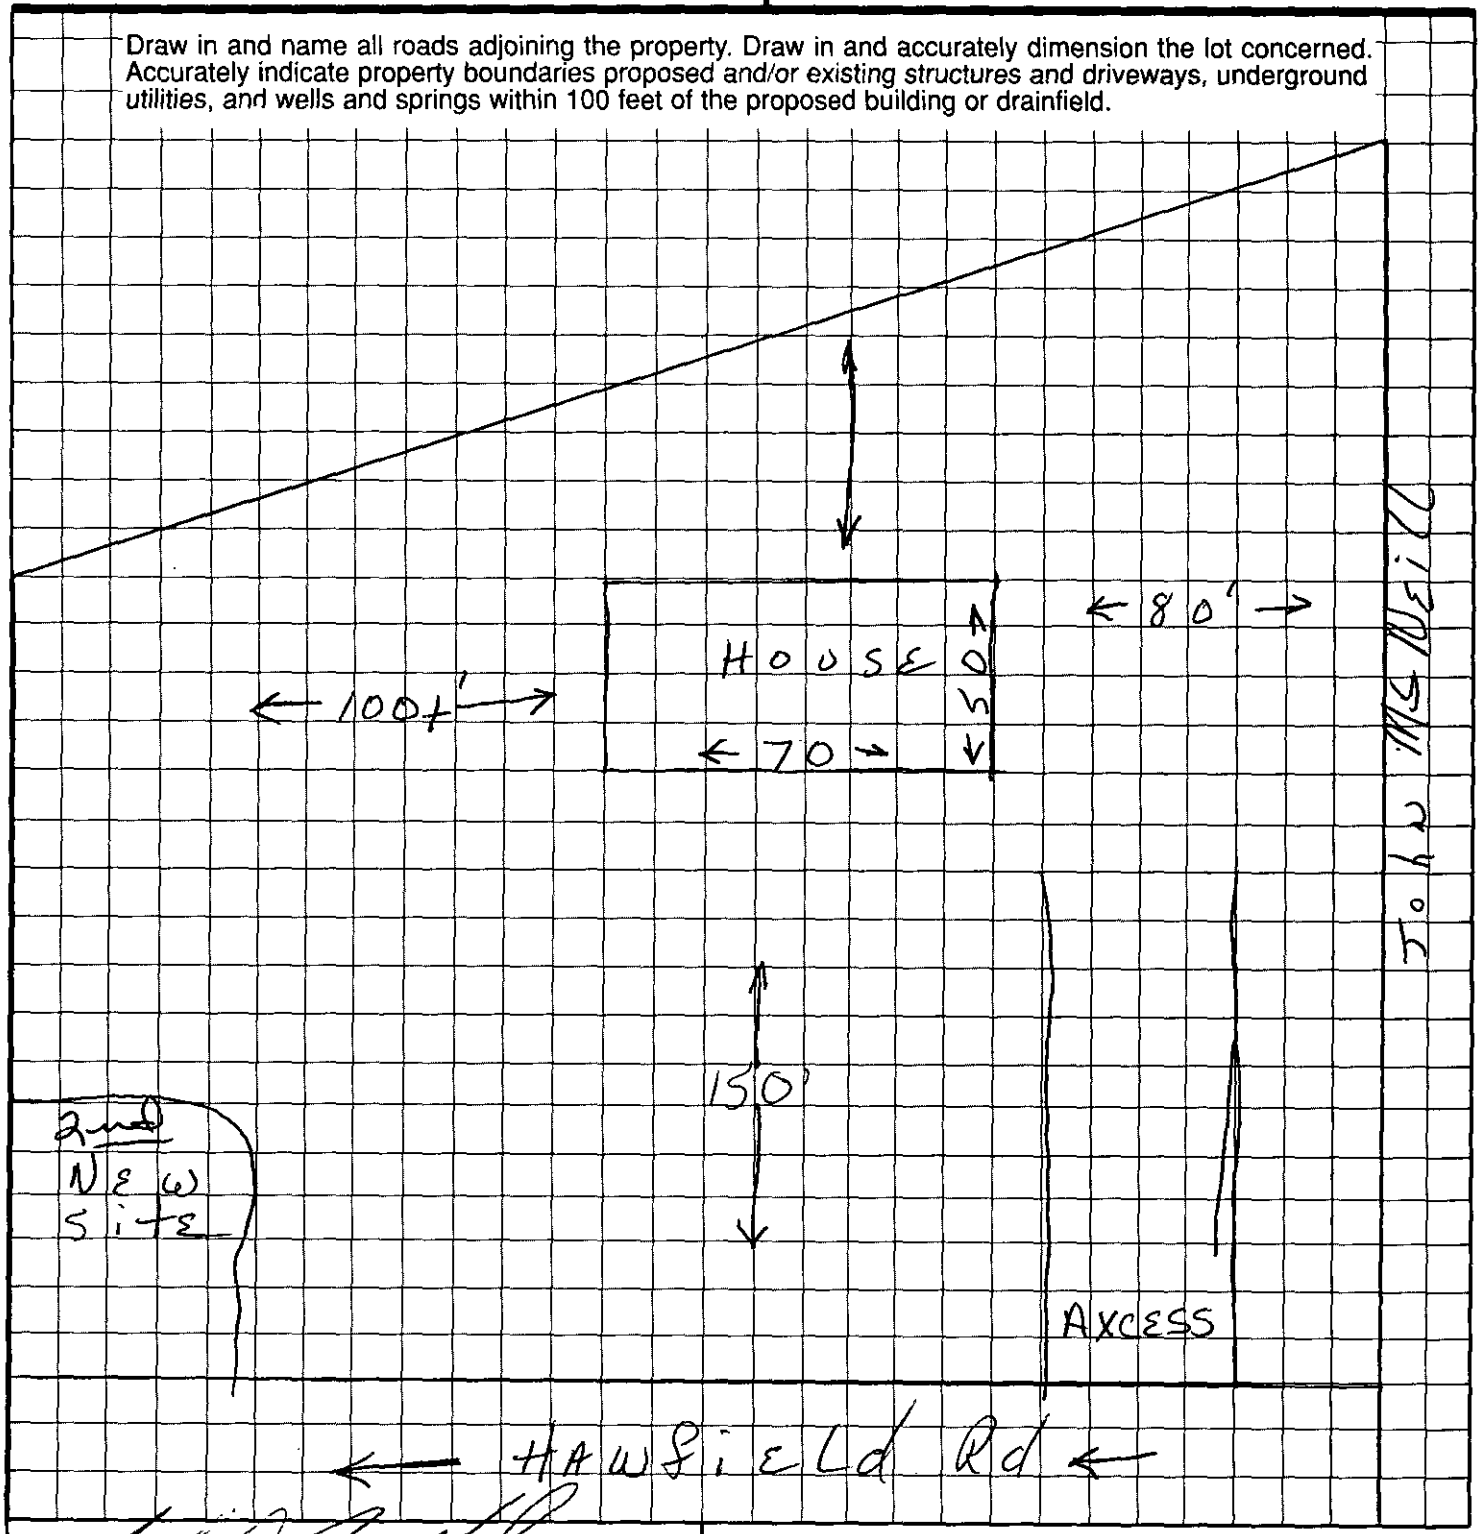

OWNER/AGENT SIGNATURE

DATE 3-12-97

APPROVAL DATE _____

White - Health Department's Copy

Canary - E.H.S. Copy

Pink - Owner's Copy

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

2nd Site Eval #2

SOIL/SITE EVALUATION *for* ON-SITE WASTEWATER SYSTEM

1766 B
PO 053-097-37

OWNER: Scott J. Cornwell
ADDRESS: 1241 Brimfield Rd Akron
PROPOSED FACILITY: residence
LOCATION OF SITE: Brimfield Road
APPLICANT: ___
APPLICATION DATE: ___
PROPOSED DESIGN FLOW (.1949): 360gpd
DATE EVALUATED: ___
PROPERTY SIZE: .22
PROPERTY RECORDED: ___
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	Slopes 5-8% .1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFIL CLASS & LTA
1	LS	0-6"	gr/scl	Fr/SEXP/SS/SP	>46" To soil wetness	46"	N/A	None	.39/PZ IV PS
		6-48"	sBK/C	Fi/SEXP/SP					
2	LS	0-5"	gr/scl	Fr/SEXP/SS/SP	>45" To soil wetness	45"	N/A	None	PS .39/PZ IV
		5-45"	sBK/C	Fi/SEXP/SP					
3	LS	0-6"	gr/scl	Fr/SEXP/SS/SP	>46" To soil wetness	46"	N/A	None	PS .39/PZ IV
		6-46"	sBK/C	Fi/SEXP/SP					
4	LS	0-6"	gr/scl	Fr/SEXP/SS/SP	>46" To soil wetness	46"	N/A	None	PS .39/PZ IV
		6-48"	sBK/C	Fi/SEXP/SP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (1945)	PS	WS
System Type(s)		
Soil LTAR		

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): Unsuitable
EVALUATED BY: W.A. Merlin 3-1997
OTHER(S) PRESENT: LSS

OMMENTS: 100' perc

Boring 1 & 2 ~~is~~ test also used needed

LEGEND

use the following standard abbreviations

ANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	LPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)			MOIST	WET
(Ridge)		SCL (Sandy Clay Loam)				
(Shoulder Slope)		SLC (Silt Loam Clay)			VFR (Very Friable)	NS (Non-sticky)
(Terrace)	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SIC (Silty Clay)			FI (Firm)	S (Sticky)
					VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None		EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)


OTES

ORIZON DEPTH	In inches below natural soil surface
EPTH OF FILL	In inches from land surface
ESTRICTIVE HORIZON	Thickness and depth from land surface
IPROLITE	S(suitable) or U(unsuitable)
OIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designatio
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

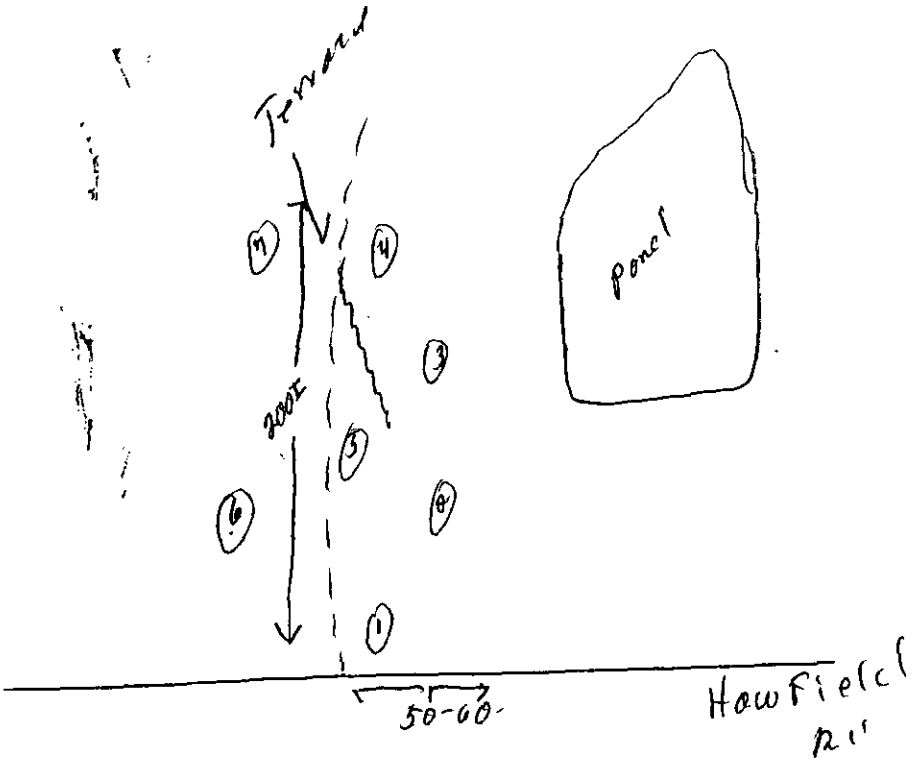

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Lot 10

Street ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION *for* ON-SITE WASTEWATER SYSTEM

#3 1768
PO 033-093-33

OWNER: Scott J. Cornwell
ADDRESS: 241 Deerfield Rd, Ellen
PROPOSED FACILITY: residence
LOCATION OF SITE: Deerfield Road
WATER SUPPLY: ☒ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

APPLICANT:
APPLICATION DATE:
PROPOSED DESIGN FLOW (.1949): 360gpd
DATE EVALUATED:
PROPERTY SIZE: 1.53
PROPERTY RECORDED:

PROFILE #	2-10% 1940 LANDSCAPE POSITION/ SLOPE%	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFI CLAS & LT.
1	LS	0-3"	F:11	—	7/9" TO soil wetness	19"	N/A	None	US
		3-19"	SBK/C	VFi/ EXP/SS/SP					
2	NS	0-2"	gr/cl	Fri/ SEXP/SS/SP	>16" TO soil wetness	16"	N/A	None	US
		2-16"	M/ scl	Fi/ SEXP/SP					
3	LS	0-16"	SBK/ scl	Fri Fi/ SEXP/SP	>20" TO soil wetness	20"	N/A	None	US
		16-20"	M/ scl	Fi/ SEXP/ SP					
4	NS	0-3"	gr/ scl	Fri/ SEXP/ SS/SP	2.5Y 7/1 @ 18"	28"	N/A	None	US
		3-28"	SBK/ sc	Fi-VFi/ EXP/SS/SP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Unsuitable
EVALUATED BY: William A. Marks 3-4-99
OTHER(S) PRESENT: LSS

OMMENTS: 1006 Repair

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	LPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)			MOIST	WET
(Ridge)		SCL (Sandy Clay Loam)				
(Shoulder Slope)		SLC (Silt Loam Clay)			VFR (Very Friable)	NS (Non-sticky)
(Terrace)					FR (Friable)	SS (Slightly Sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FI (Firm)	S (Sticky)
		SIC (Silty Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
					EFI (Extremely Firm)	NP (Non-plastic)
		O (Organic)	None			SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)


OTES

ORIZON DEPTH	In inches below natural soil surface
EPTH OF FILL	In inches from land surface
ESTRICTIVE HORIZON	Thickness and depth from land surface
IPROLITE	S(suitable) or U(unsuitable)
OIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

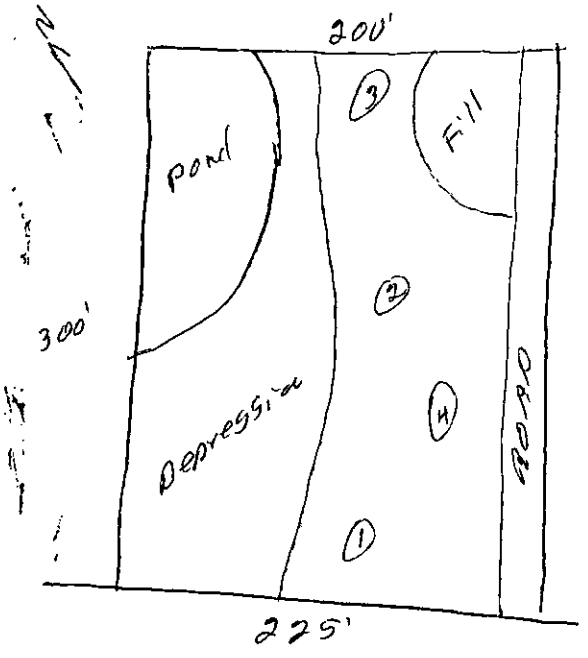

Haw Field Rd

Mecklenburg County
Health Department

March 14, 1997

Mr. Scott Cornwell
1241 Hawfield Road
Charlotte, NC 28214

Re: Hawfield Road
File: 1768B
Parcel: 053-093-33

Dear Mr. Cornwell:

Receipt of your Application for Improvement Permit for the above referenced property is acknowledged. A soil evaluation and a site visit have been conducted. The results of the evaluation indicated that the site is **UNSUITABLE** under Rules .1941 **SOIL CHARACTERISTICS (MORPHOLOGY)**, .1942 **SOIL WETNESS CONDITIONS**, .1943 **SOIL DEPTH** and .1945 **AVAILABLE SPACE**. For these reasons your Application for Improvement Permit is denied. A possible way to develop the site exists under Rule .1948(d) which reads as follows:

> A site classified as **UNSUITABLE** may be used for a ground absorption sewage treatment and disposal system specifically identified in Rules .1955, .1956, or .1957 of this Section or a system approved under Rule .1969 if written documentation, including engineering, hydrogeologic, geologic or soil studies, indicates to the local health department that the proposed system can be expected to function satisfactorily. Such sites shall be reclassified as **PROVISIONALLY SUITABLE** if the local health department determines that the substantiating data indicate that:
> (1) a ground absorption system can be installed so that the effluent will be non-pathogenic, non-infectious, non-toxic, and non-hazardous;
> (2) the effluent will not contaminate ground or surface water; and
> (3) the effluent will not be exposed on the ground surface or be discharged to surface waters where it could come in contact with people, animals, or vectors.

The State shall review the substantiating data if requested by the local health department.

Please be advised that you have the right to an informal review by this department. You also have the right to appeal under G.S. 130A-24, and to have the appeal held in Mecklenburg County.

If you have any questions regarding this matter, please call me at 336-5575.

Sincerely,

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems

Mecklenburg County
Health Department

SCOTT CORNWELL
1241 HANFIELD RD
CHARLOTTE NC 28214

Re: HANFIELD RD
File: 1760 B
Parcel: 053-093-33

Receipt of your Application for Improvement Permit for the above referenced property is acknowledged. A soil evaluation and a site visit have been conducted. The results of the evaluation indicated that the site is **UNSUITABLE** under Rules

For these reasons your Application for Improvement Permit is denied. A possible way to develop the site exists under Rule .1948(d) which reads as follows: case

> A site classified as **UNSUITABLE** may be used for a ground absorption sewage treatment and disposal system specifically identified in Rules .1955, .1956, or .1957 of this Section or a system approved under Rule .1969 if written documentation, including engineering, hydrogeologic, geologic or soil studies, indicates to the local health department that the proposed system can be expected to function satisfactorily. Such sites shall be reclassified as **PROVISIONALLY SUITABLE** if the local health department determines that the substantiating data indicate that:
> (1) a ground absorption system can be installed so that the effluent will be non-pathogenic, non-infectious, non-toxic, and non-hazardous;
> (2) the effluent will not contaminate groundwater or surface water; and
> (3) the effluent will not be exposed on the ground surface or be discharged to surface waters where it could come in contact with people, animals, or vectors.
>
> The State shall review the substantiating data if requested by the local health department.

Please be advised that you have the right to an informal review by this department. You also have the right to appeal under G.S. 130A-24, and to have the appeal held in Mecklenburg County.

If you have any questions regarding this matter, please call me at 336-5575.

Sincerely,

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems

, 1941 SOIC CHARACTERISTICS (MORPHOLOGY)
, 1942 SOIL WETNESS CONDITIONS . 1943 SOIC
DEPTH . and . 1945 AVAICABCE SPACE.

FEE: 100 ck 1534

DATE: 2/18/97

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: ✓ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM __ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

COPY

FILE #: 17688

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 053-093-33 PO

STREET ADDRESS: Hawfield Rd

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

CLOSING DATE _____

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
✓ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

HEATED SQUARE FOOTAGE: 1793

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 2

FOUNDATION FOR RESIDENCE:

__ WITHOUT BASEMENT
__ ON SLAB
✓ CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):
__ COMMUNITY (C)
✓ SHARED WELL (S)
__ MUNICIPAL (M)
__ OTHER 'SPRINGS' (O)
__ PRIVATE WELL (P)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES __ YES ✓ NO
EXISTING WASTEWATER SYSTEMS __ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS __ YES ✓ NO
WELL, SPRINGS OR WATERLINES __ YES ✓ NO
DESIGNATED WETLANDS __ YES ✓ NO

PROPERTY OWNER:

NAME: Cornwell Scott J
(LAST) (FIRST) (MI)

ADDRESS: 1241 Hawfield Rd

CITY: Charlotte STATE: N.C ZIP: 28216

DAYTIME PHONE: ( ) 704-394-3685

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) -

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? ~~6/1/89~~ 5/15/55

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: [signature] DATE: 2-18-97

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

COPY


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 1768B

TC: 053-053-33

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

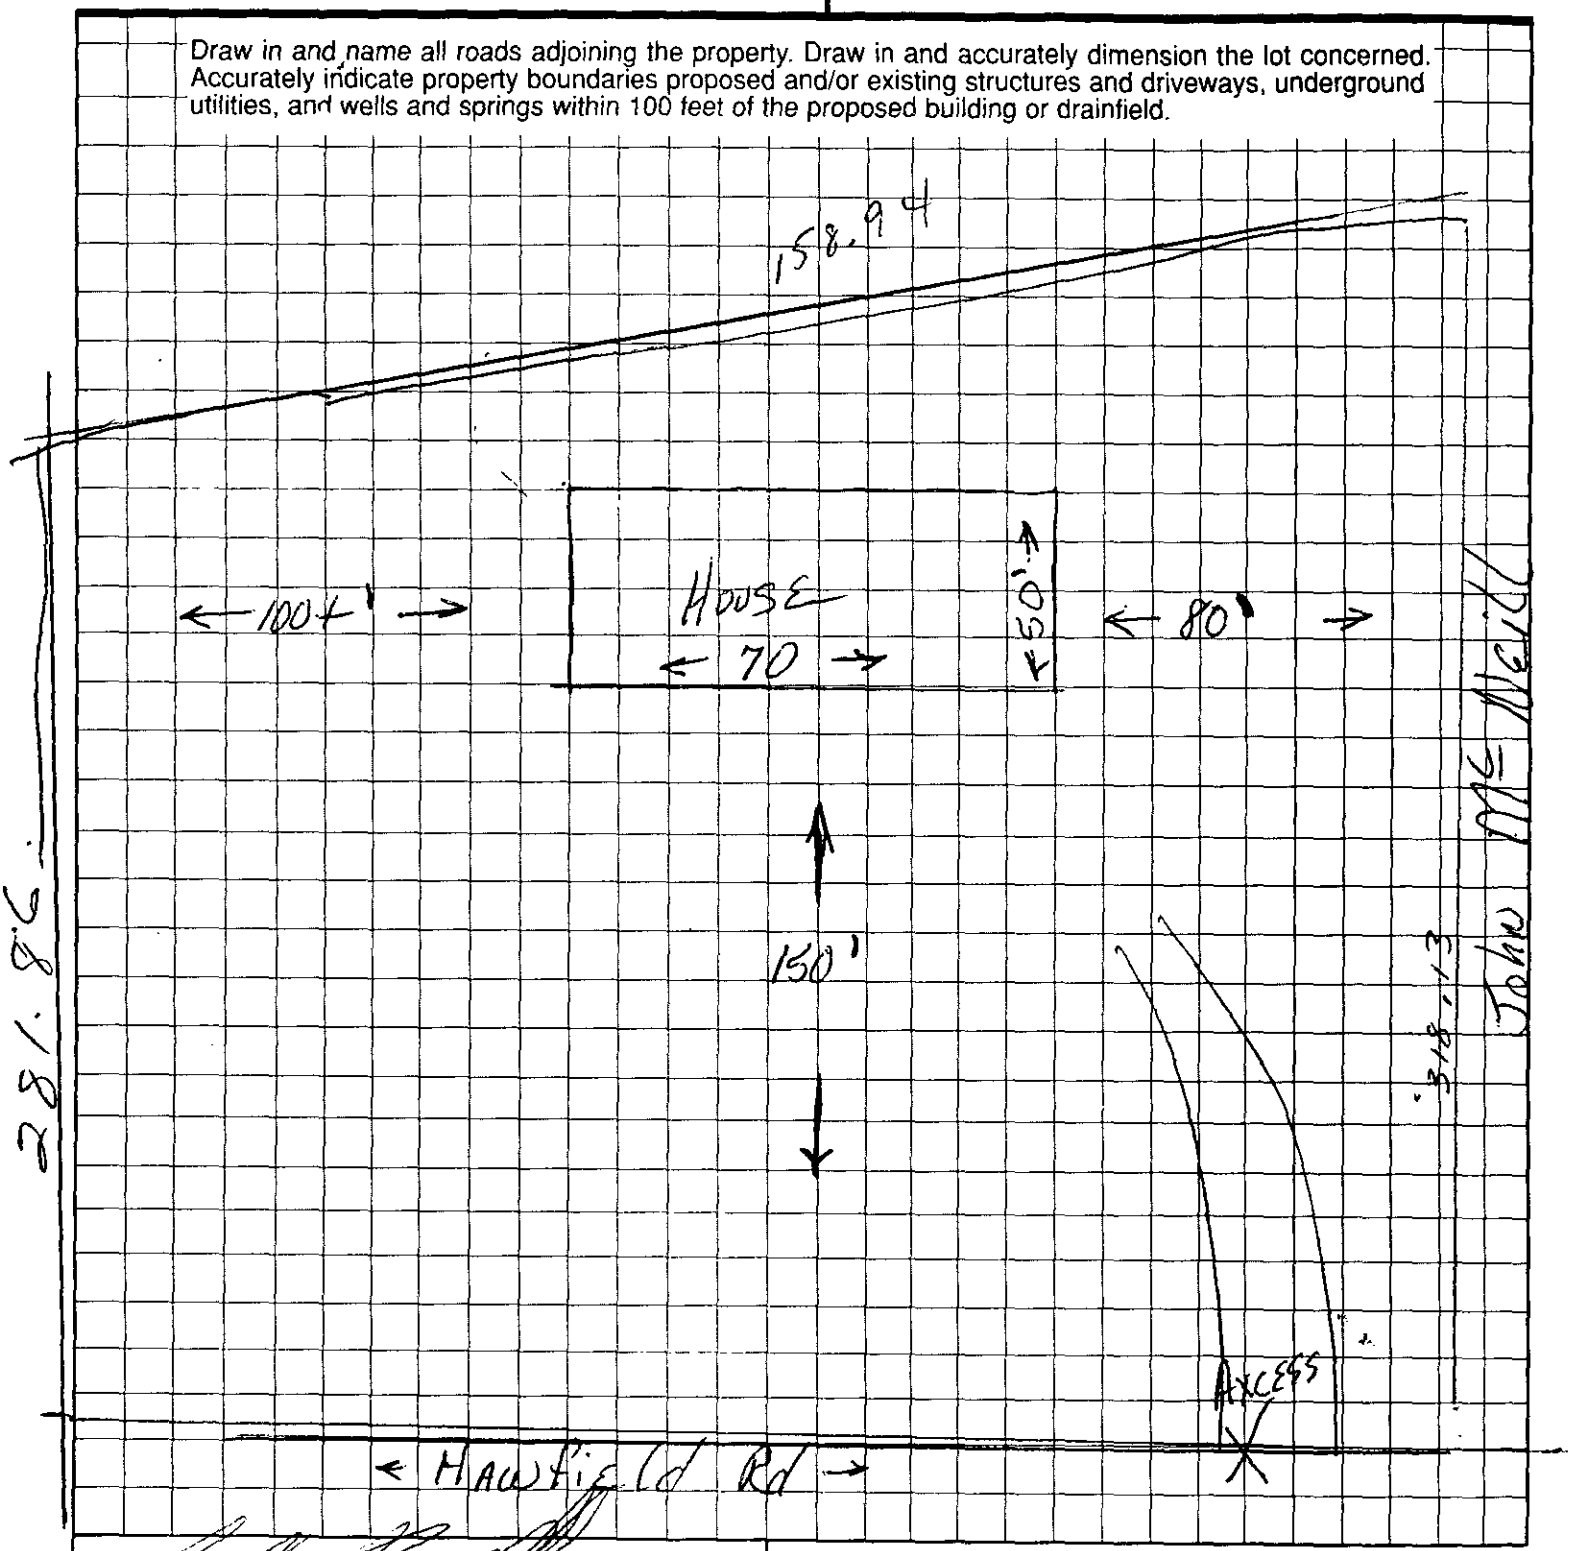


OWNER/AGENT SIGNATURE

DATE 2-12-97

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's

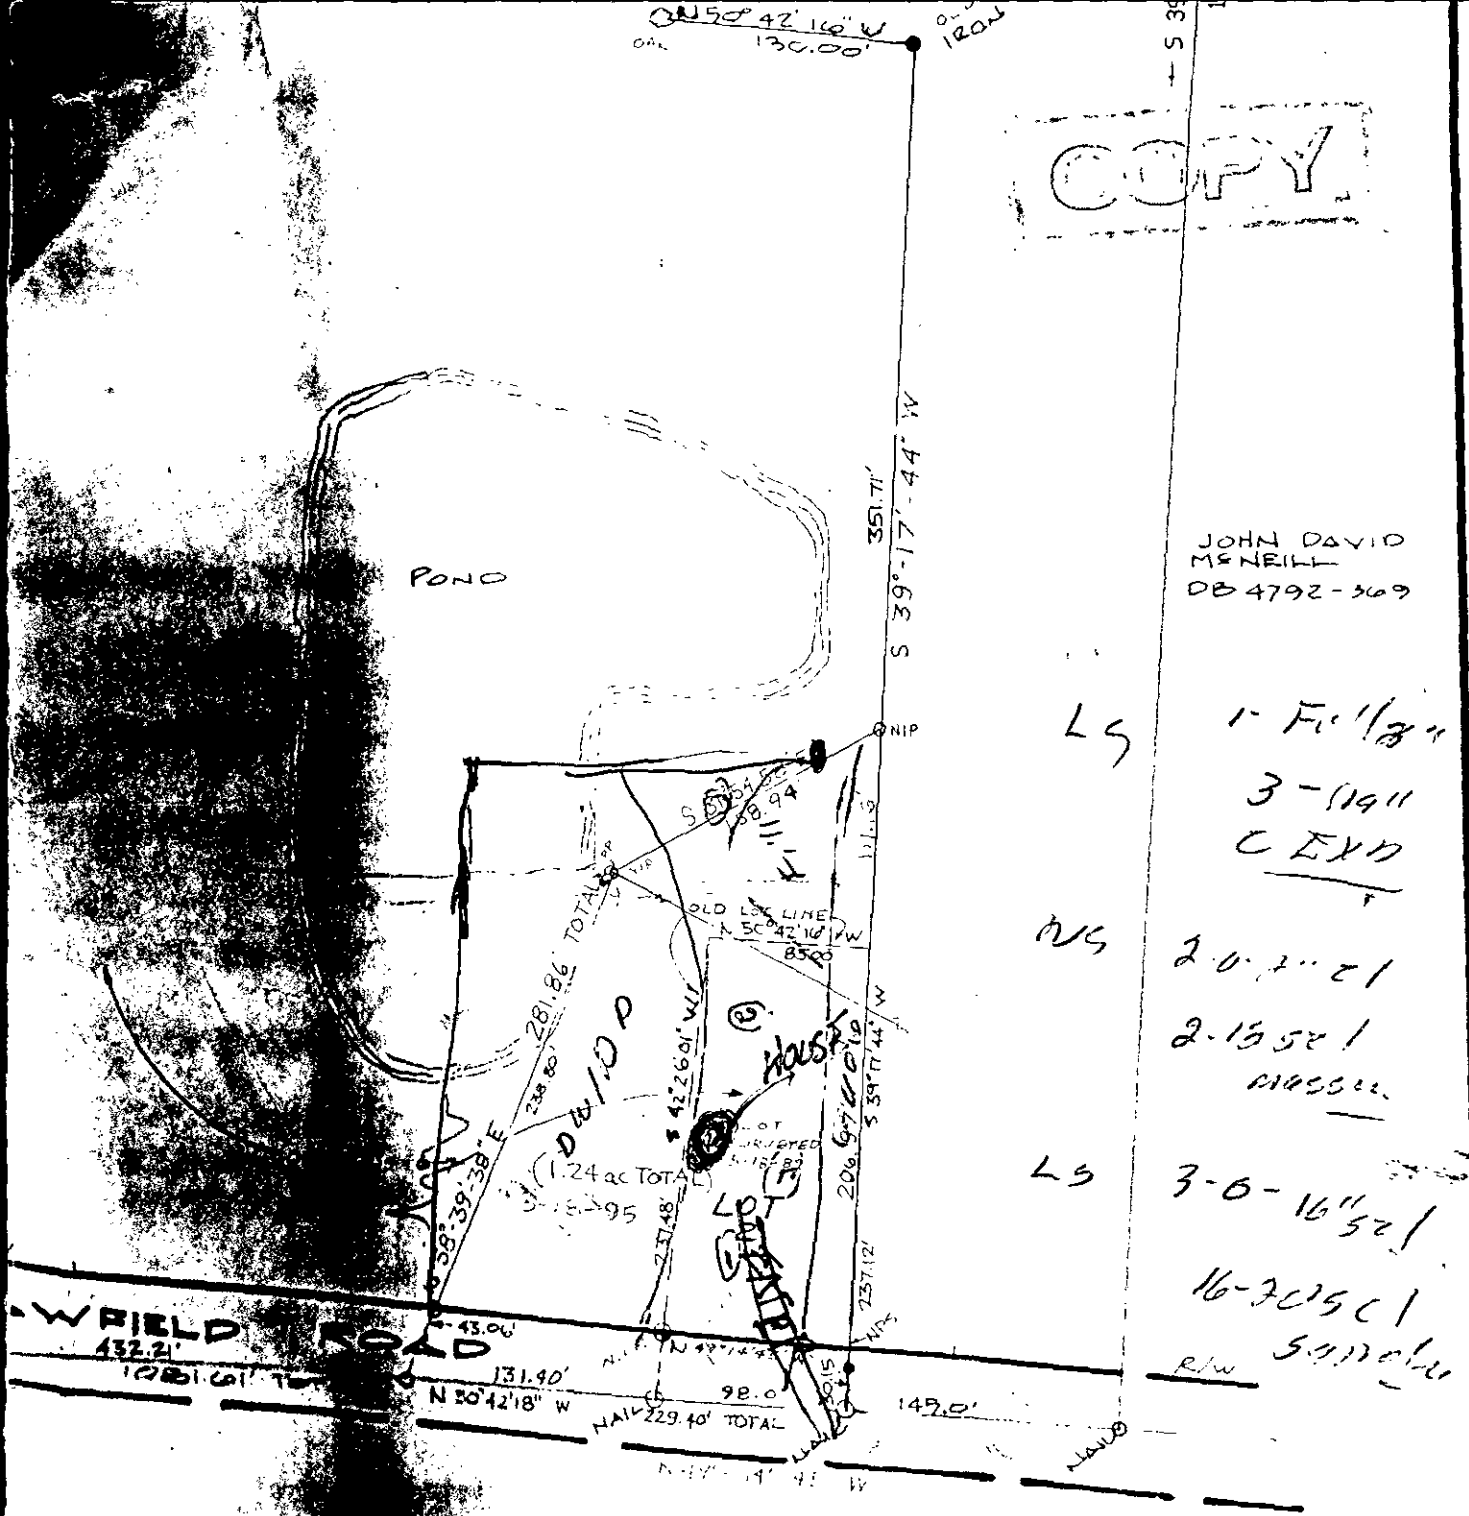

LS 1-F: 1/2"
3-1141
C EXP

RS 2-0-21 C1
2-15 52 1
MASSEY

LS 3-0-16" 52 1
16-20 15 C 1
S.T.T.C.L.L.

4-0-31 52 1
REVISED
3-26 52
EXP
2.54 ac 1
C 16"

RECORD PLAT


PROPERTY OF

SCOTT CORNWELL
PAW CREEK TOWNSHIP
MECKLENBURG COUNTY, N.C.
SCALE: 1"=100'

JUNE 6, 1989

s plat was drawn
vey made under
ed in book ____
daries not surveyed
information found in
as prepared in
itness my original
this ____ day of

s AT ALL PROPERTY
ss OTHERWISE NOTED.

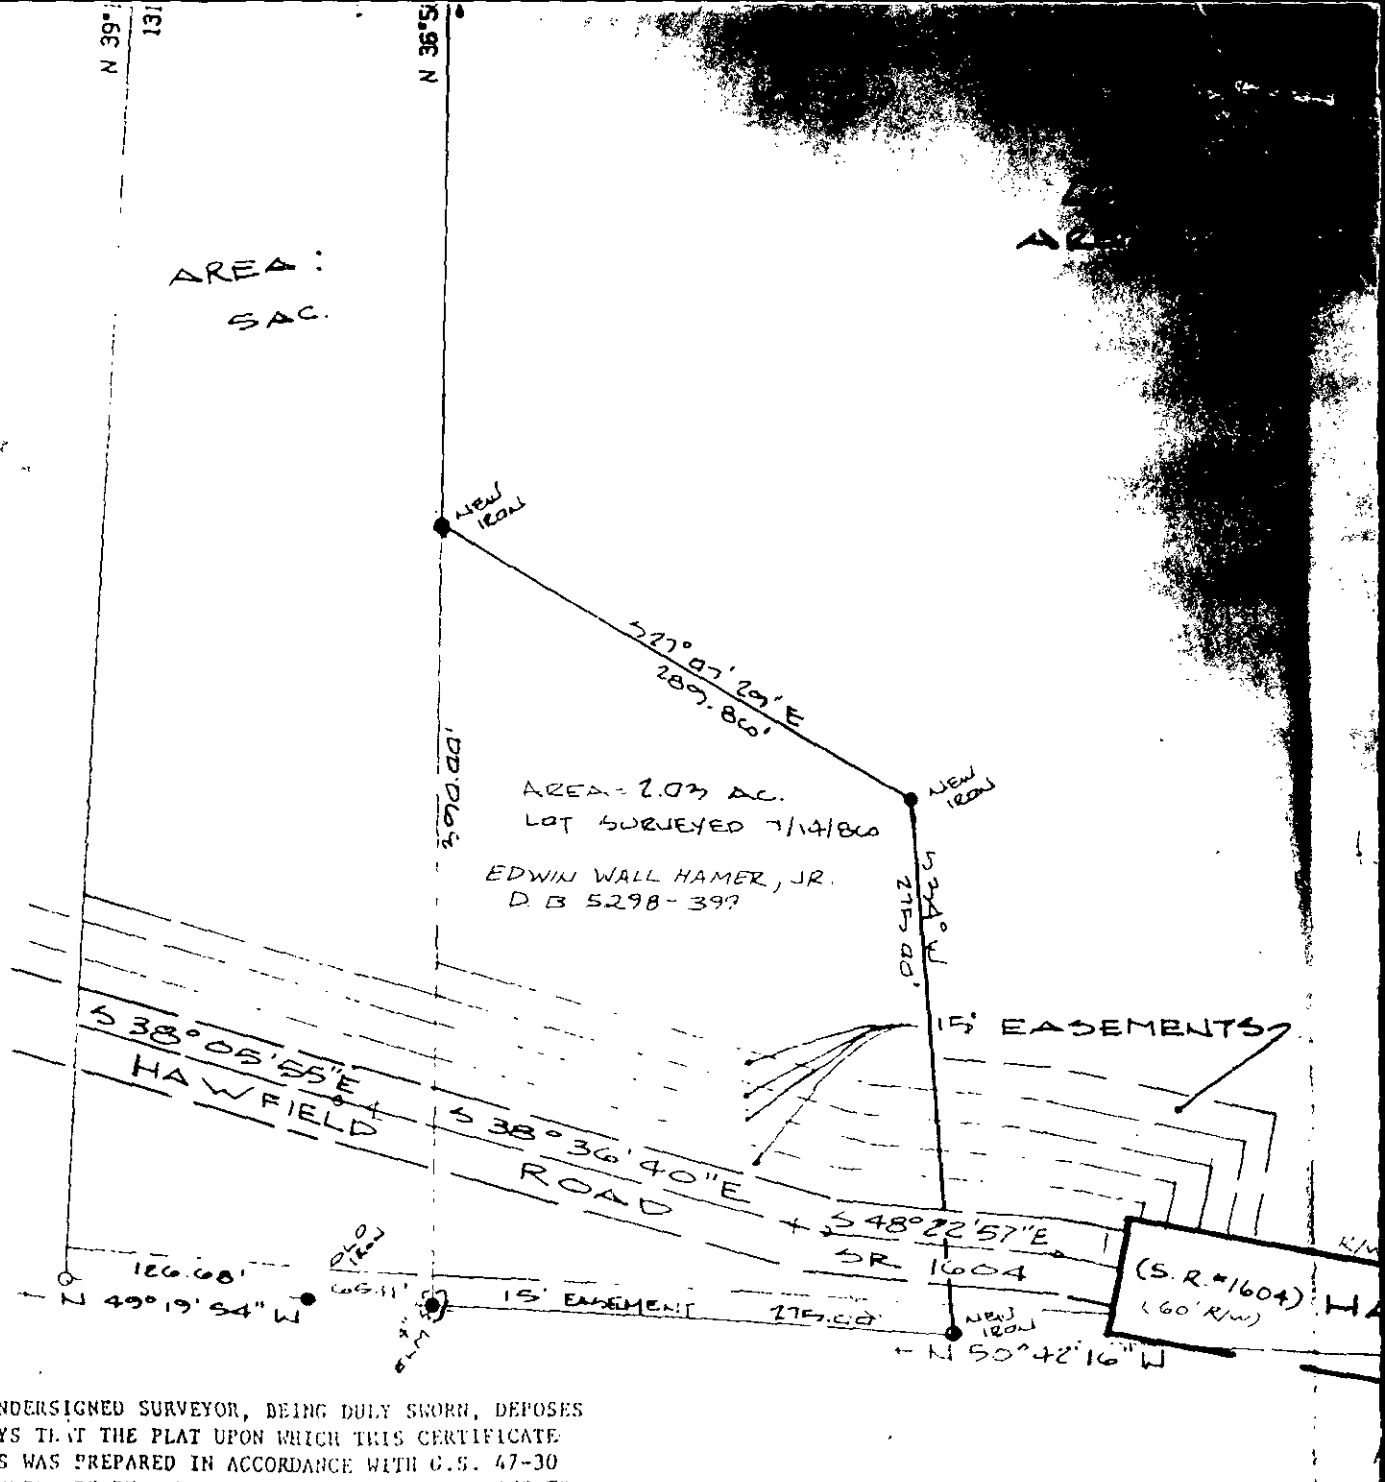

"THE UNDERSIGNED SURVEYOR, BEING DULY SWORN, DEPOSES AND SAYS THAT THE PLAT UPON WHICH THIS CERTIFICATE APPEARS WAS PREPARED IN ACCORDANCE WITH G.S. 47-30 AS AMENDED, IS IN ALL RESPECTS CORRECT ACCORDING TO THE BEST OF HIS KNOWLEDGE AND BELIEF AND WAS PREPARED FROM AN ACTUAL SURVEY MADE BY HIM ON THE _____ DAY OF _____, 19____, WITH A MAXIMUM LINEAR ERROR OF CLOSURE OF _____, AND MAXIMUM FIELD ERROR OF ANGULAR CLOSURE OF _____".

NORTH CAROLINA REGISTERED SEAL L-2689 LAND SURVEYOR RICHARD BOYD BROOKS

I, Richard Boyd Brooks, certify that th
under my supervision from (an actual su
my supervision) (deed description recor
page _____, etc.) (other), that the bou
are shown as broken lines plotted from
book _____, page _____, that this plat
accordance with G.S. 47-30 as amended
signature, registration number and seal
_____, A.D., 19____.

SPRATT & BROOKS
Land Surveying
1200 JENKINS DR.
CHARLOTTE., N.C. 28212

SIGNED: Richard B Brooks
NCRLS L-2689

NOTE : IRON
UNL

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: #3 1766B
COUNTY: PO 033-093-33

SOIL/SITE EVALUATION *for* ON-SITE WASTEWATER SYSTEM

OWNER: Scott T. Cornwell
APPLICANT:
ADDRESS: 1241 Deerfield Rd, Tabor
APPLICATION DATE:
DATE EVALUATED:
PROPOSED FACILITY: residence
PROPOSED DESIGN FLOW (.1949): 360gpd
PROPERTY SIZE: 1.53
LOCATION OF SITE: Deerfield Road
PROPERTY RECORDED:
WATER SUPPLY: ☒ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	2-10% .1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROF CLAY & LT
1	LS	0-3"	F: 11	—	>19" TO soil wetness	19"	N/A	None	US
		3-19"	SBK/C	VFi/ EXP/US/VD					
2	NS	0-2"	gr/c/	Fri/ SEXP/SS/SP	>18" TO soil wetness	18"	N/A	None	US
		2-18"	M/ sc/	Fi/ SEXP/SS/P					
3	LS	0-16"	SBK/ sc/	Fri-Fi/ SEXP/SS/P	>20" TO soil wetness	20"	N/A	None	U.
		16-20"	M/ sc/	Fi/ SEXP/SS/P					
4	NS	0-3"	gr/ sc/	Fri/ SEXP/SS/SP	2.5Y 7/1 @ 18"	28"	N/A	None	U
		3-28"	SBK/ sc	Fi-VFi/ EXP/US/P					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Unsuitable
EVALUATED BY: William A. Marks 3-4
OTHER(S) PRESENT: LSS

COMMENTS: 1006 Repair

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	EPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)				
(Ridge)		SCL (Sandy Clay Loam)			MOIST	WET
(Shoulder Slope)		SLC (Silt Loam Clay)				
(Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SIC (Silty Clay)			FI (Firm)	S (Sticky)
					VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None		EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

OTES

ORIZON DEPTH	In inches below natural soil surface
EPTH OF FILL	In inches from land surface
ESTRUCTIVE HORIZON	Thickness and depth from land surface
APROLITE	S(suitable) or U(unsuitable)
OIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designati
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

