

8381 PROVIDENCE RD

22708131

1/3/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Mecklenburg County
Health Department

January 29, 1997

R. Andrew Cox
David M. Sidbury, Inc.
224 W. 32nd Street
Charlotte, NC 28206

Re: 8381 Providence Road
File: 3734B
Parcel: 227-081-31

Dear Mr. Cox:

At your request an inspection was made at the above referenced property to facilitate the issuance of an Operation Permit for the Sewage Treatment and Disposal system. During the inspection it was found that the following items did not meet the regulations set forth in the "Laws and Rules for Sewage Treatment and Disposal Systems, 15A NCAC 18A .1900;.1952 Septic Tank, Dosing, Dosing Tank and Lift Station Design." Our comments follow:

1) (6) Pump and control circuits shall be provided with manual circuit disconnects within a watertight, corrosion-resistant, outside enclosure (NEMA 4X or equivalent) adjacent to the pump tank, securely mounted at least 12 inches above the finished grade. The pump(s) shall be manually operable without requiring the use of special tools or entrance into the tank for testing purposes. Conductors shall be conveyed to the disconnect enclosure through water proof, gasproof, and corrosion-resistant conduits, with no splices or junction boxes provided inside the tank. Wire grips, duct seal, or other suitable material shall be used to seal around wire and wire conduit openings inside the pump tank and disconnect enclosure.

2) (9) The pump tank shall have a properly functioning high-water alarm. The alarm circuit shall be supplied ahead of any pump overload and short circuit protective devices. The alarm shall be audible and visible by system users and weatherproof if installed outdoors in an enclosure (NEMA 4X or equivalent).

The above mentioned items must be installed and inspected prior to the Operation Permit being issued. The Operation Permit is required for the Certificate of Occupancy and the permanent electric hook-ups. Please schedule the inspections at least five (5) working days in advance to ensure no delays in the Operation Permit issuance.

Please call me at 336-5573 to discuss any question you may have concerning this matter.

Sincerely,

Lisa B. Mialik

Lisa B. Mialik, R.S.
Individual Water and Wastewater Systems

cc: Wardell Curry



DAVID M. SIDBURY, INC.
GENERAL CONTRACTORS

CHRISTOPHER A. BUTLAK
PROJECT ENGINEER

Office Address
224 West 32nd Street
Charlotte, NC 28206
704-332-3513

Mailing Address
P.O. Box 32533
Charlotte, NC 28232
Fax 704-342-0926

Mecklenburg County
Health Department

April 16, 1997

R. Andrew Cox
David M. Sisbury, Inc.
224 W. 32nd Street
Charlotte, NC 28206

Re: 8381 Providence Road
File: 3734B
Parcel: 227-081-31

Dear Mr. Cox:

At your request an inspection was made at the above referenced property to facilitate the issuance of an Operation Permit for the Sewage Treatment and Disposal system. During the inspection it was found that the following items did not meet the regulations set forth in the "Laws and Rules for Sewage Treatment and Disposal Systems, 15A NCAC 18A .1900;.1952 Septic Tank, Dosing, Dosing Tank and Lift Station Design." Our comments follow:

1) (6) Pump and control circuits shall be provided with manual circuit disconnects within a watertight, corrosion-resistant, outside enclosure (NEMA 4X or equivalent) adjacent to the pump tank, securely mounted at least 12 inches above the finished grade. The pump(s) shall be manually operable without requiring the use of special tools or entrance into the tank for testing purposes. Conductors shall be conveyed to the disconnect enclosure through water proof, gasproof, and corrosion-resistant conduits, with no splices or junction boxes provided inside the tank. Wire grips, duct seal, or other suitable material shall be used to seal around wire and wire conduit openings inside the pump tank and disconnect enclosure.

2) (9) The pump tank shall have a properly functioning high-water alarm. The alarm circuit shall be supplied ahead of any pump overload and short circuit protective devices. The alarm shall be audible and visible by system users and weatherproof if installed outdoors in an enclosure (NEMA 4X or equivalent).

The above mentioned items must be installed and inspected prior to the Operation Permit being issued. The Operation Permit is <u>required</u> for the Certificate of Occupancy and the permanent electric hook-ups. Please schedule the inspections at least five (5) working days in advance to ensure no delays in the Operation Permit issuance.

Please call me at 336-5573 to discuss any question you may have concerning this matter.

Sincerely,

Lisa B. Mialik

Lisa B. Mialik, R.S.
Individual Water and Wastewater Systems

cc: Wardell Curry

Mecklenburg County
Health Department

October 24, 1996

Mr. David M. Sidbury
224 W 32ND Street
Charlotte, North Carolina 28206

Dear Mr. Sidbury:

Re: 8539 Providence Road
File: 3734B/(Tax Parcel No. 227-081-31PO)

At your request an inspection was made at the above referenced property to facilitate the issuance of an Operation Permit for the Sewage Treatment and Disposal system. During the inspection it was found that the following items did not meet the regulations set forth in the "Laws and Rules for Sewage Treatment and Disposal Systems, 15A NCAC 18A .1900;.1952 Septic Tank, Dosing, Dosing Tank and Lift Station Design." Our comments follow:

1) (6) Pump and control circuits shall be provided with manual circuit disconnects within a watertight, corrosion-resistant, outside enclosure (NEMA 4X or equivalent) adjacent to the pump tank, securely mounted at least 12 inches above the finished grade. The pump(s) shall be manually operable without requiring the use of special tools or entrance into the tank for testing purposes. Conductors shall be conveyed to the disconnect enclosure through water proof, gasproof, and corrosion-resistant conduits, with no splices or junction boxes provided inside the tank. Wire grips, duct seal, or other suitable material shall be used to seal around wire and wire conduit openings inside the pump tank and disconnect enclosure.

2) (9) The pump tank shall have a properly functioning high-water alarm. The alarm circuit shall be supplied ahead of any pump overload and short circuit protective devices. The alarm shall be audible and visible by system users and weatherproof if installed outdoors in an enclosure (NEMA 4X or equivalent).

The above mentioned items must be installed and inspected prior to the Operation Permit being issued. The Operation Permit is required for the Certificate of Occupancy and the permanent electric hook-ups. Please schedule the inspections at least five (5) working days in advance to ensure no delays in the Operation Permit issuance.

Please call me at 336-5568 to discuss any question you may have concerning this matter.

Sincerely,

Larry B. Thompson, Jr., R.S.
Individual Water and Wastewater Systems

PEOPLE • PRIDE • PROGRESS

Environmental Health Division

700 North Tryon Street • Suite 211 • Charlotte, North Carolina 28202-2236

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

pd 150.00 ck 11746 9/11/95 DT

☐ CRT

3734B

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: DAVID M. SIDBURY, INC. (last) (first) (mi)

ADDRESS: 224 W. 32ND ST PHONE: (704) 332-3513

CITY: CHARLOTTE STATE: NC ZIPCODE: 28206

Date: SEPT. 11, 1995

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: PO 227-081-31

STREET ADDRESS: 8539 PROVIDENCE RD.
CHARLOTTE, NC

ZONING:

PROPERTY OWNER:

NAME: CURRY WARDELL (last) (first) (mi)

ADDRESS: 4407 OGLUKIAN DR. PHONE: (704) 365-9851

CITY: CHARLOTTE STATE: NC ZIPCODE: 28226

SUBDIVISION OR MOBILE HOME PARK NAME: GREENWOOD

Township (check one):
☐ 0 Mecklenburg County ☐ 2 Davidson ☐ 6 Pineville ☐ 6 Huntersville
☒ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

LOT NUMBER: TRACT E LOT SIZE (in acres): 16.02

TYPE APPLICATION (check one):

☒ SOIL TEST - INDIVIDUAL LOT (D)
☒ NEW CONSTRUCTION ON VACANT LOT - 6 BEDROOMS OR LESS (N)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
☐ COMMERCIAL OR INDUSTRIAL (M)
☐ SOIL TEST DEVELOPMENT (P)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☒ MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
☐ REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
☐ SINGLE MOBILE HOME (S) ☒ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 6 NUMBER OCCUPANTS: 5

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☐ Community (C) ☐ Shared Well (S)
☒ Municipal (M) ☐ Other 'spring' (O)
☐ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☒ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☐ None
☐ Garage ☐ Storage Building ☐ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Rodger D. Foreman (DAVID M. SIDBURY, INC.) Date: 9-11-95

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules for Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...11-22-95 Type II 6 - 6 bedroom house
Lot does not require 100% repl.

☒ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Tommy B. Thompson Jr., R.S. 11-22-95
Environmentalist Date

Director or Authorized Section Head Date

WATER 2279

Gwen,
I need to send a OP2 letter
to David A. Sidbury, Inc
ie 3734 B
8539 Providence Rd

#42 LT

Thanks,

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

3734/13

pd 150.00 ck# 17446 9/14/95 DT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: DAVID M. SIDBURY, INC. (last) (first) (mi)

ADDRESS: 224 W. 32ND ST PHONE: (704) 332-3513

CITY: CHARLOTTE STATE: NC ZIPCODE: 28206

Date: SEPT. 11, 1995

PROPERTY OWNER:

NAME: CURRY WARDELL (last) (first) (mi)

ADDRESS: 4407 OGLUKIAN DR. PHONE: (704) 365-9851

CITY: CHARLOTTE STATE: NC ZIPCODE: 28226

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: PO 227-081-31

STREET ADDRESS: ~~8331~~ 8539 PROVIDENCE RD.

CHARLOTTE, NC

ZONING:

Township (check one):
☐ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☒ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

SUBDIVISION OR MOBILE HOME PARK NAME: GREENWOOD

LOT NUMBER: TRACT E LOT SIZE (in acres): 16.02

TYPE APPLICATION (check one):

☐ SOIL TEST - INDIVIDUAL LOT (D)
☒ NEW CONSTRUCTION ON VACANT LOT - X BEDROOMS OR LESS (N)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or N)
☐ COMMERCIAL OR INDUSTRIAL (N)
☐ SOIL TEST DEVELOPMENT (P)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☒ MODIFIED /ALTERNATIVE/ OR RESIDENCE > 6 BEDROOMS (Z)
☐ REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):

☐ SINGLE MOBILE HOME (S) ☒ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 6 NUMBER OCCUPANTS: 5

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:

Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):

☐ Community (C) ☐ Shared Well (S)
☒ Municipal (M) ☐ Other 'spring' (O)
☐ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):

☒ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☐ None
☐ Garage ☐ Storage Building ☐ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Roger D. Foreman (DAVID M. SIDBURY, INC.) Date: 9-11-95

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules for Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...11-22-95 Type III b - 6 bedroom house
Lot does not require 100% repair
if less than 480 gal per day

☒ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Tommy B. Thompson, Jr., R.S. 11-22-95
Environmentalist Date

Director or Authorized Section Head Date

WATER - '22 '91

ALERT

FEE: _____ **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION**
DATE: _____ **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE**

DATE: 11-22-95 PERMIT NO: 3734 B
PARCEL NO: 227-081-31

PROPERTY OWNER: Wardell Curry
BUILDING CONTRACTOR: David M. Sidbury, Inc.
JOB LOCATION ADDRESS: ~~8381~~ 8539 Providence Road
SUBDIVISION NAME: Greenwood Street E
AUTHORIZATION ISSUED BY: Randy B. Monfort, J.S. DATE: 11-22-95
DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 3734B, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUS BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: Diversion ditch required above drainfield area.

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIO OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FO REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

Wm Darrell Ellis 22 Nov. 95

SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE DATE

Permit Number: 3734-B

CONDITIONS OF IMPROVEMENT PERMIT

Tax Number: 227-081-31

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transfer not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	___ No	___ Partial Basement	
Type Primary Wastewater System Type (circle one): I II (III) IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experim ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1	
.3 Long-term acceptance rate	720 Max gallons/day wastewater flow	2400 Absorption Area (sq. ft)	9' Trench spacing (min centers)	
NO Serviced by private well	1500 Gallon septic tank	800' Total trench length (ft)	24" Maximum trench de (At least 12" of provisionally suit must remain between trench botto unsuitable soil conditions)	
6 Bedrooms in residence	1000 Gallon pump tank	12" Depth of stone		
Any surface waters present:	Type:	Minimum separation distance:		
Site modifications required:	Diversion ditch required above drainfield area.			
Additional Conditions:				
Repair Area System Type Type (circle one): I II (III) IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Exper ___ IWWS-93 ___ IWWS-93 ___ IWWS-94	
2400 Absorption Area (Sq ft) 800 Total Trench Length (Ft)	12 Depth of Stone Trench	9' Trench spacing (min. on centers)	24" Maximum Trench	
For existing system, enter the year originally installed:				

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Re Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disp at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this
- This Improvement permit is transferable.

Larry B. Thompson Jr. R.S. 22 Nov 85

DEHNR Authorized Agent Date

Wm. Donald Ellis

Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

IWWS:100195


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 37348

TC: PO 227-081-31

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

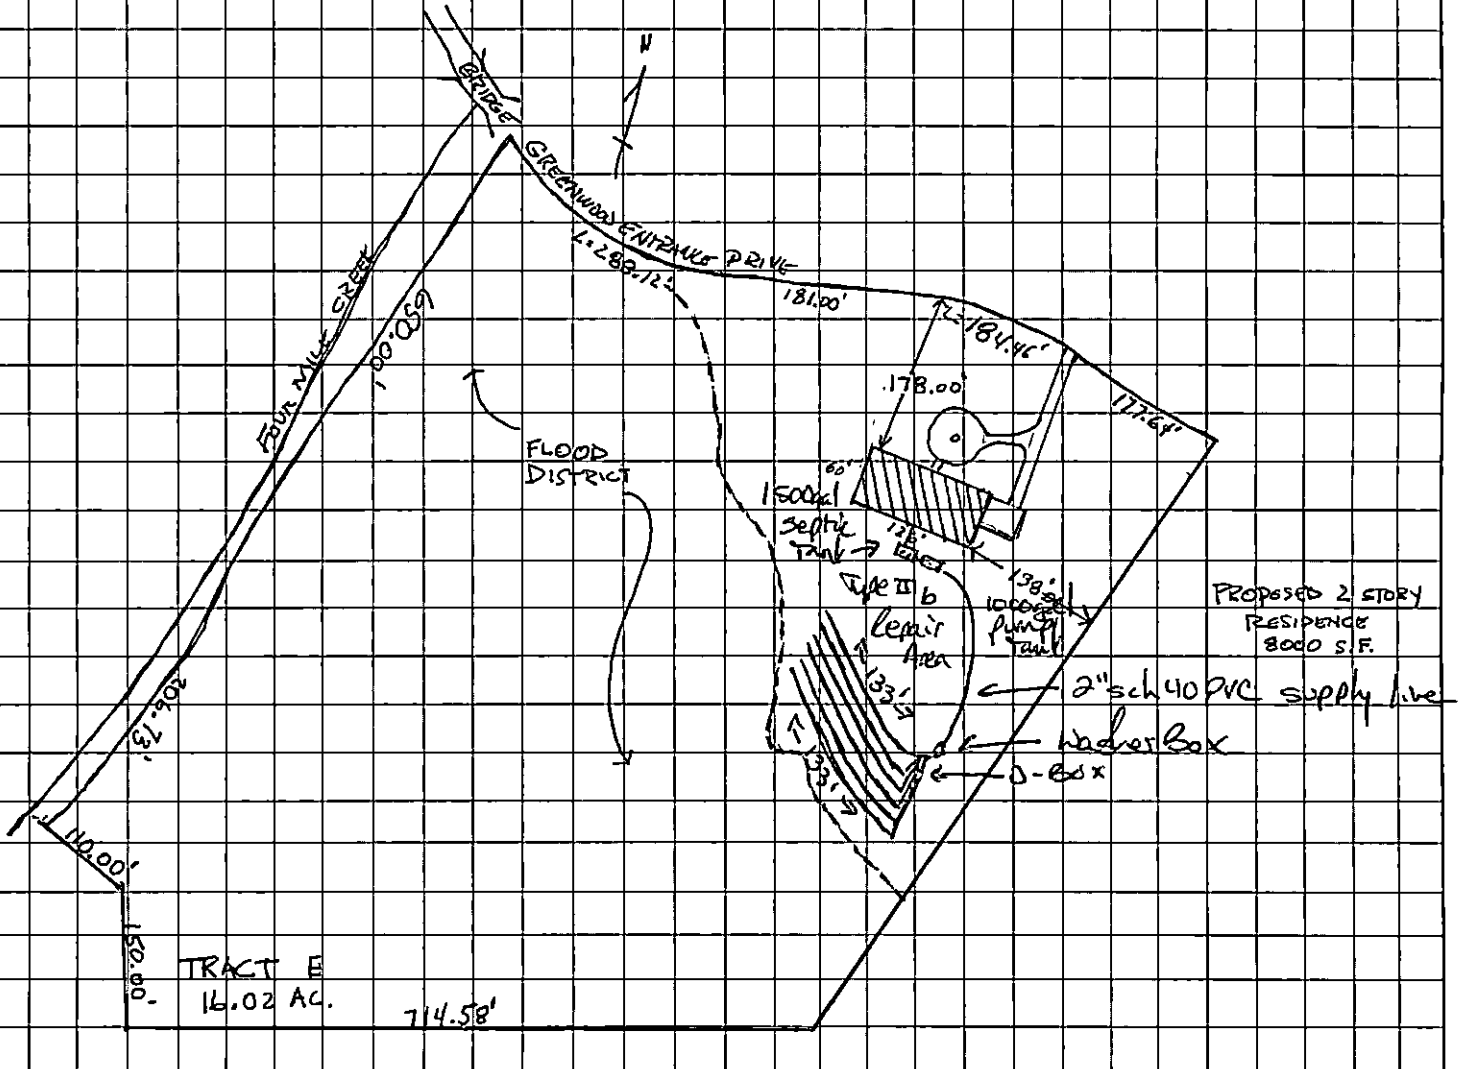

DAVID M. SIDBURY, INC
Rodger D. Foreman
OWNER/AGENT SIGNATURE

DATE 11 SEPT 95

APPROVAL DATE 11-22-95

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

~~CERTIFICATE OF COMPLETION~~/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3734 B DATE: 5/14/97 JBM

TC: 227-081-31 ☐ L · ☒ CRT

SERIAL № 16891

Name of Owner Wardell Curry Juris.:

Address of Property 3381 ~~8539~~ Providence Road

Inspection Data:

Tank Material PCC

Total Length of Drainfield 788'

Number of Lines 6 @ 133'

Cover Depth 12"-14"

Water Supply Source Municipal

Distance to Water Source 710'

Excavation Inspected 10-22

Tank(s) Inspected 10-15

Wash Line Inspected N/A

High Water Alarm Inspected 5/14/97 JBM

PLOT

Design 1996, 1500ST, 1000DT, P1, CON, 2394SF, T, 12G, Cecil-like CTR# 117 McCarver

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

~~☐ Certificate of Completion~~ ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Type III b 6 bedroom residence

(6) 3' wx 133' L x 12" Stone

12/5/96 New S.T. inspected.

Initial S.T. damaged JBM

Jerry G. Thompson Jr. R.S.

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3734 B DATE: 10-14-96

TC: 227-081-31 L

SERIAL Nº 16930

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 9-11-95. All work shall be completed on or before 11-14-96, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

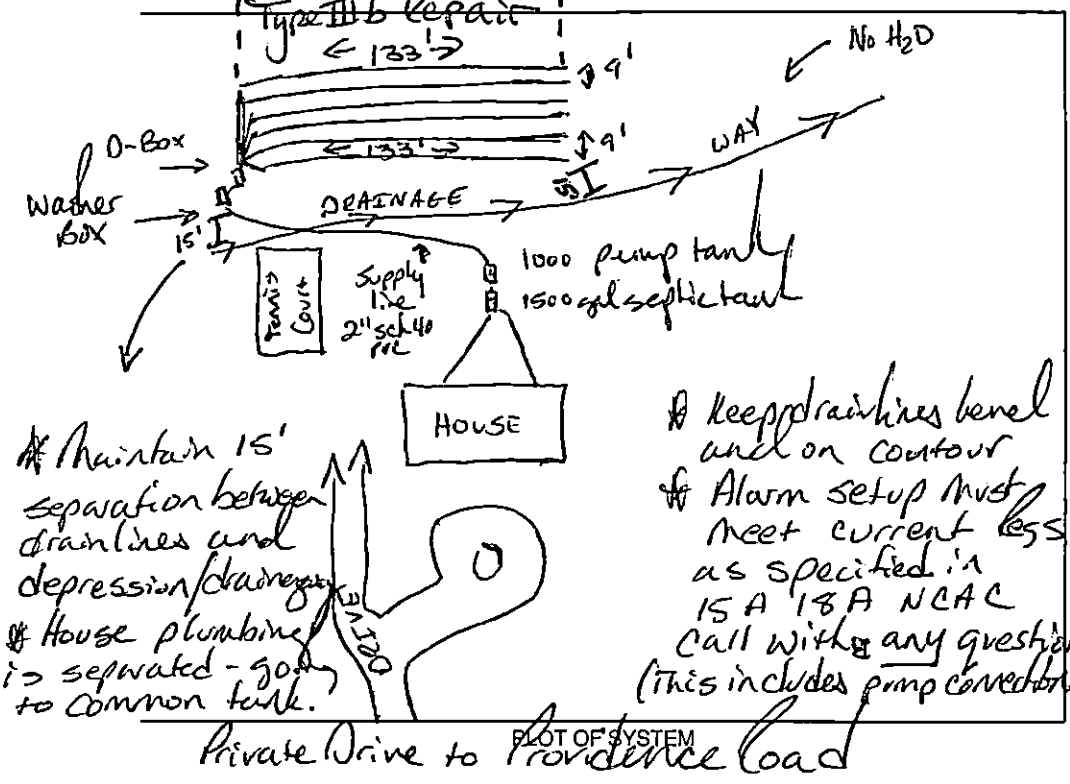

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank 1000 gallons

Tank Construction PVC

Trench Depth 24"

Absorption and/or Nitrification Lines:

Trench Width 3' feet

Trench Walls Scored and Porous Yes

Total Line Length 798 feet

Number of Lines 6

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well N/A municipal feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Wardell Curry

LOCATION OF PROPERTY ~~8539~~ 8381 Providence Road

Comments: Type III b 6 bedroom Esidence
(6) 3'W x 133'L x 12" stone

Larry B. Thompson Jr. E.H.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

File 37348

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION #1 227-061-31
for ON-SITE WASTEWATER SYSTEM

OWNER: Wardell Curry
APPLICANT: David M. Silbey, Jr.
ADDRESS: 4407 Oglethorpe Dr. Charlotte
APPLICATION DATE: ___
DATE EVALUATED: ___
PROPOSED FACILITY: residence
PROPOSED DESIGN FLOW (.1949): ___
PROPERTY SIZE: ___
LOCATION OF SITE: 3336 Providence Road
PROPERTY RECORDED: ___
WATER SUPPLY: ☒ Private ☐ Public ☐ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS 1942 SOIL WETNESS/ COLOR	1943 SOIL DEPTH	1956 SAPRO CLASS	1944 RESTR HORIZ	PROF CLA & LT
1	LS 6%	0-2"	sc / sBK	sExP/Fr/ss/sP	No Chroma 2 observed	40"	N/A	None	.35/F3 dep
		2-34"	sc / sBK	sExP/Fr/s/P					
		34-40"	sc / sBK	sExP/Fr/s/P					
2	LS 4%	0-9"	sc / sBK	sExP/Fr/ss/sP	No Chroma 2 observed	38"	N/A	None	.37/ F17 dep
		9-28"	sc/sc/ sbK	sExP/Fr/s/P					
		28-38"	sc / sbK	sExP/Fr/s/P					
3	LS 4%	0-6	gl / gr	sExP/Fr/ns/nP	No Chroma 2 observed	38"	N/A	None	.39/ F17 dep
		6-26"	sc / sBK	sExP/Fr/s/P					
		26-38"	sc / sBK	sExP/Fr/s/P					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)		

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: W.R. Marks - 11995
OTHER(S) PRESENT: ___

COMMENTS: Recommend surface diversion and subsurface interception drain be placed along downfield, other possible drainfield areas present in front of house site & between driveway and property line (left side as viewed from Road) system may not need repair Area

LEGEND

use the following standard abbreviations


LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR	LPP .1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)				
(Ridge)		SCL (Sandy Clay Loam)			MOIST	WET
(Shoulder Slope)		SLC (Silt Loam Clay)				
(Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SIC (Silty Clay)			FI (Firm)	S (Sticky)
					VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None		EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.
Long-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

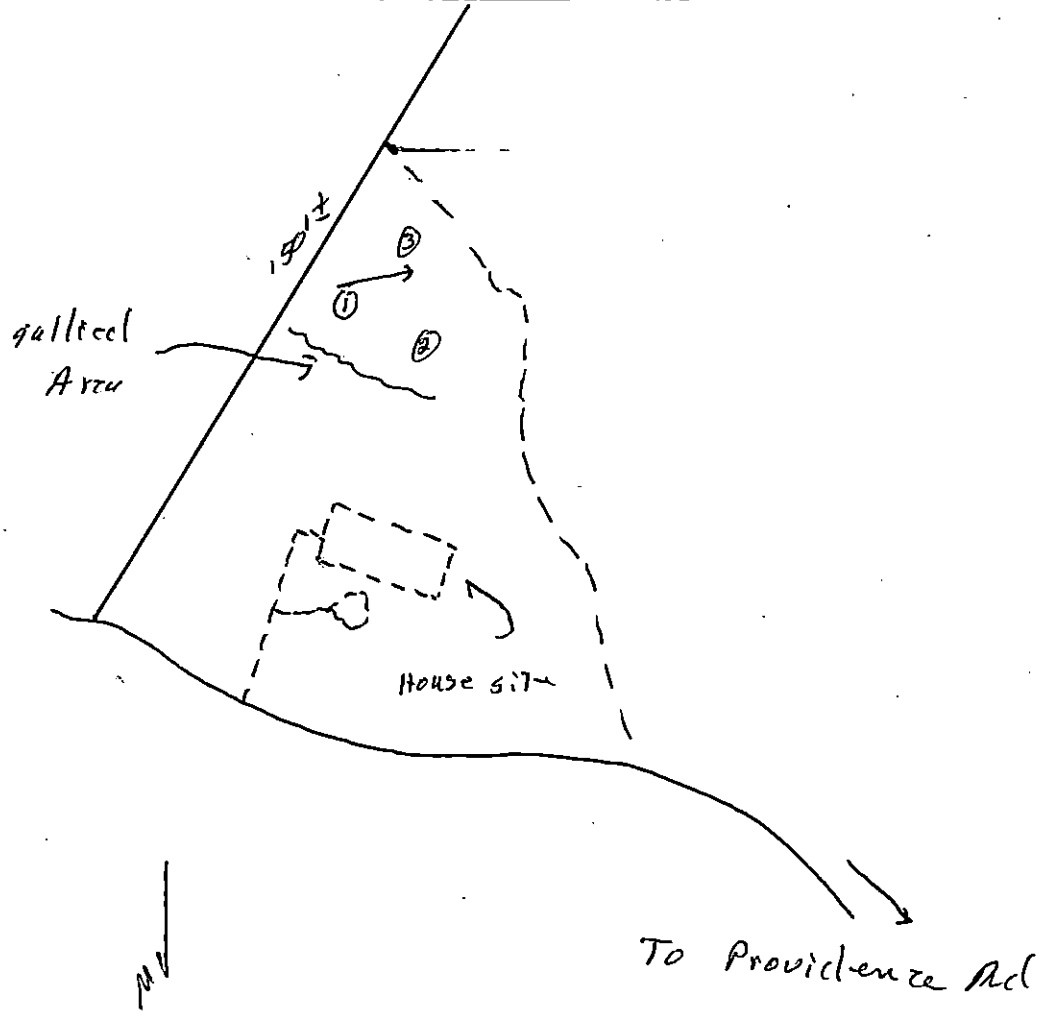

Supervisor/Administrative Professional Checklist

New Septic ☐ **New Well** ☐ **Use Existing** ☐ **Alteration** ☑ **Modified Plot Plan** ☐

New Septic Fees Paid:

IP ($250.00) _____ Initials/Date

CA ($200.00) _____ Initials/Date

OP ($200.00) _____ Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 dwo 1/28/13 Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was paid) dwo 2/13/13 Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. ☐ Reviewed ☑ SAM 2/20/13

This site is served by septic and well. Verify each is complete before final hold is released. ☐

Septic file completed. ☐ _____ Well file completed. ☐ _____

Send permit for signature. ☑ Signature received. ☑ 2/28/13

This septic system requires a certified operator contract before final hold is released. ☐

Certified operator contract is on file. ☐ _____

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 3734B WASPS App #: 6028

Primary ES assigned to project: Eric Bailey

Secondary ES assigned to project: _____

Project Type: New System ☐ Alteration ☑ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law				
Permit Application				
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
Site Evaluation Information				
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☑	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☑	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 2			
	Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR 0.3	Yes ☑	No ☐	N/A ☐
Improvement Permit/Construction Authorization				
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☒	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☒	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☒	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☒	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☒
130A-336(a)(1)	Property line lengths shown?	Yes ☒	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☒ Existing	No ☐	N/A ☐

Operation Permit

.1937(i)	System type as described in table V(a) of rule .1961	Yes ☒	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☒	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: 9/4/13

OP issued date: 9/4/13

Review performed by: JAM

Date performed: 9/5/13

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 373413 Permit #: 6028 Tax Parcel #: 227-081-31

Property Owner: Chuck Davis

Job Location Address: 8381 Providence Rd

City: Charlotte State: NC Zip Code: 28277

Operation Permit Issuance Date: 9/4/13 Contractor Name: 1st Choice

Permitted Design Flow: 540 GPD

Liquid Capacity of Septic Tank: Existing gallons

Liquid Capacity of Dosing Tank: Existing gallons

Effluent Pump Model: Existing

Drainfield Installation ☐ N/A

Trench Depth: 3 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 100 feet => +798 Existing Total 900 L.F.

# of Lines: 1 @ 100 feet

Depth of Media: 12" inches (Type) IIIg

Depth of Cover: 12" inches

Distribution Device: D. Box

Inspection Dates

Tank(s) Inspected: N/A

Excavation Inspected: 9/4/13

Pump & Controls Inspected: N/A

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____


System Installation Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 100 feet

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

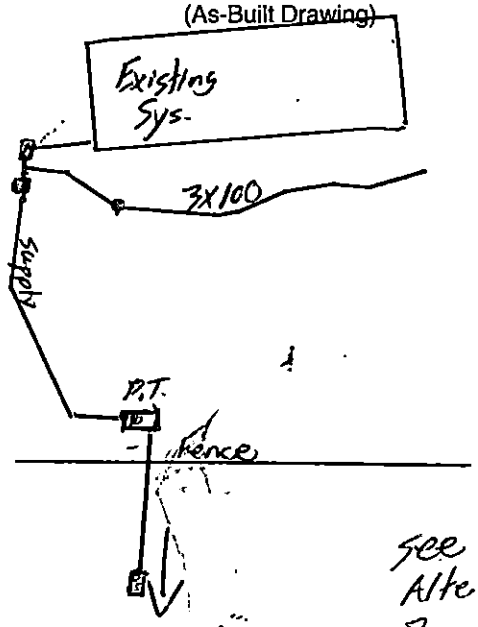

See Alteration Permit for more Deta. Installed as permit & plot plan on file

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☒ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIg, ~~Conv.~~ EZ 1203T6, P, N/A, N/A

DENR Authorized Agent: Bradley W. Hollman Signature: _____

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 3734B Permit #: 6028 Tax Parcel #: 227-081-31

Property Owner: Chuck Davis

Job Location Address: 8351 Providence

City: Charlotte State: NC Zip Code: 28277

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: III

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☑ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Bradley W. Hallman Date: 9/4/13

Signature:

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 3734B Permit #: 6028 Tax Parcel #: 227-081-31

Property Owner: Chuck Davis

Job Location Address: 8381 Providence Rd.

City: Charlotte State: NC Zip Code: 28277

Installation Approval Issuance Date: 9/04/2013

Permission is hereby given to ☐ install ☑ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before _____, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 840 GPD

Site LTAR: 0.3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: Existing gallons

Liquid Capacity of Dosing Tank: Existing gallons

Drainfield Design ☐ N/A

Trench Depth: 36 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 100 feet

# of Lines: 1 @ 100 feet

Depth of Media: 12 inches (Type) 25% Red

Distribution Device: D-Box

Bed Design *(For Repair Installations ONLY.)* ☑ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☑ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

Minimum System Setbacks

Distance from Building Foundation: 157 feet from tennis court

Distance from Property Line: 10+ feet

Distance from Water Supply Source: 10+ feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

Install per permit & plot plan on file with MCHD.

Comments: System Classification & Type: IIIg

DENR Authorized Agent: Jeremy Michael Signature: Jeremy Michael REHS

CONDITIONS OF IMPROVEMENT PERMIT for an ALTERATION TO AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit Number: _ Tax Number: 227-081-31

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☒ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

0.3 Long-term acceptance rate (GPD/ft^2)	840 Max gallons/day wastewater flow	2694 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☐ Yes ☒ No	exis Gallon septic tank	898 Total trench length (ft)	36 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
7 Bedrooms in residence	exis Gallon pump tank	12 Depth of media (in)	

Any surface water present: no Type: Minimum separation distance (ft):

Additional conditions: **Install new d-box if needed. Install 1 line 100' of 25% reduction for bedroom addition.**

Repair Area System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☒ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

2694 Absorption Area (ft^2) 898 Total trench length (ft)	12 Depth of media (in)	9 Trench spacing (min. on centers) (ft)	36 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation Approval is granted by this Department.

*** This Improvement permit is transferable.


Eric Bailey 2-20-13
DENR Authorized Agent Date

Owner/Agent Signature 2/21/13
Date

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

SOIL EVALUATION LOCATIONS FOR
PARCEL #: 227-081-31
WAPSPS APPLICATION #: 6028

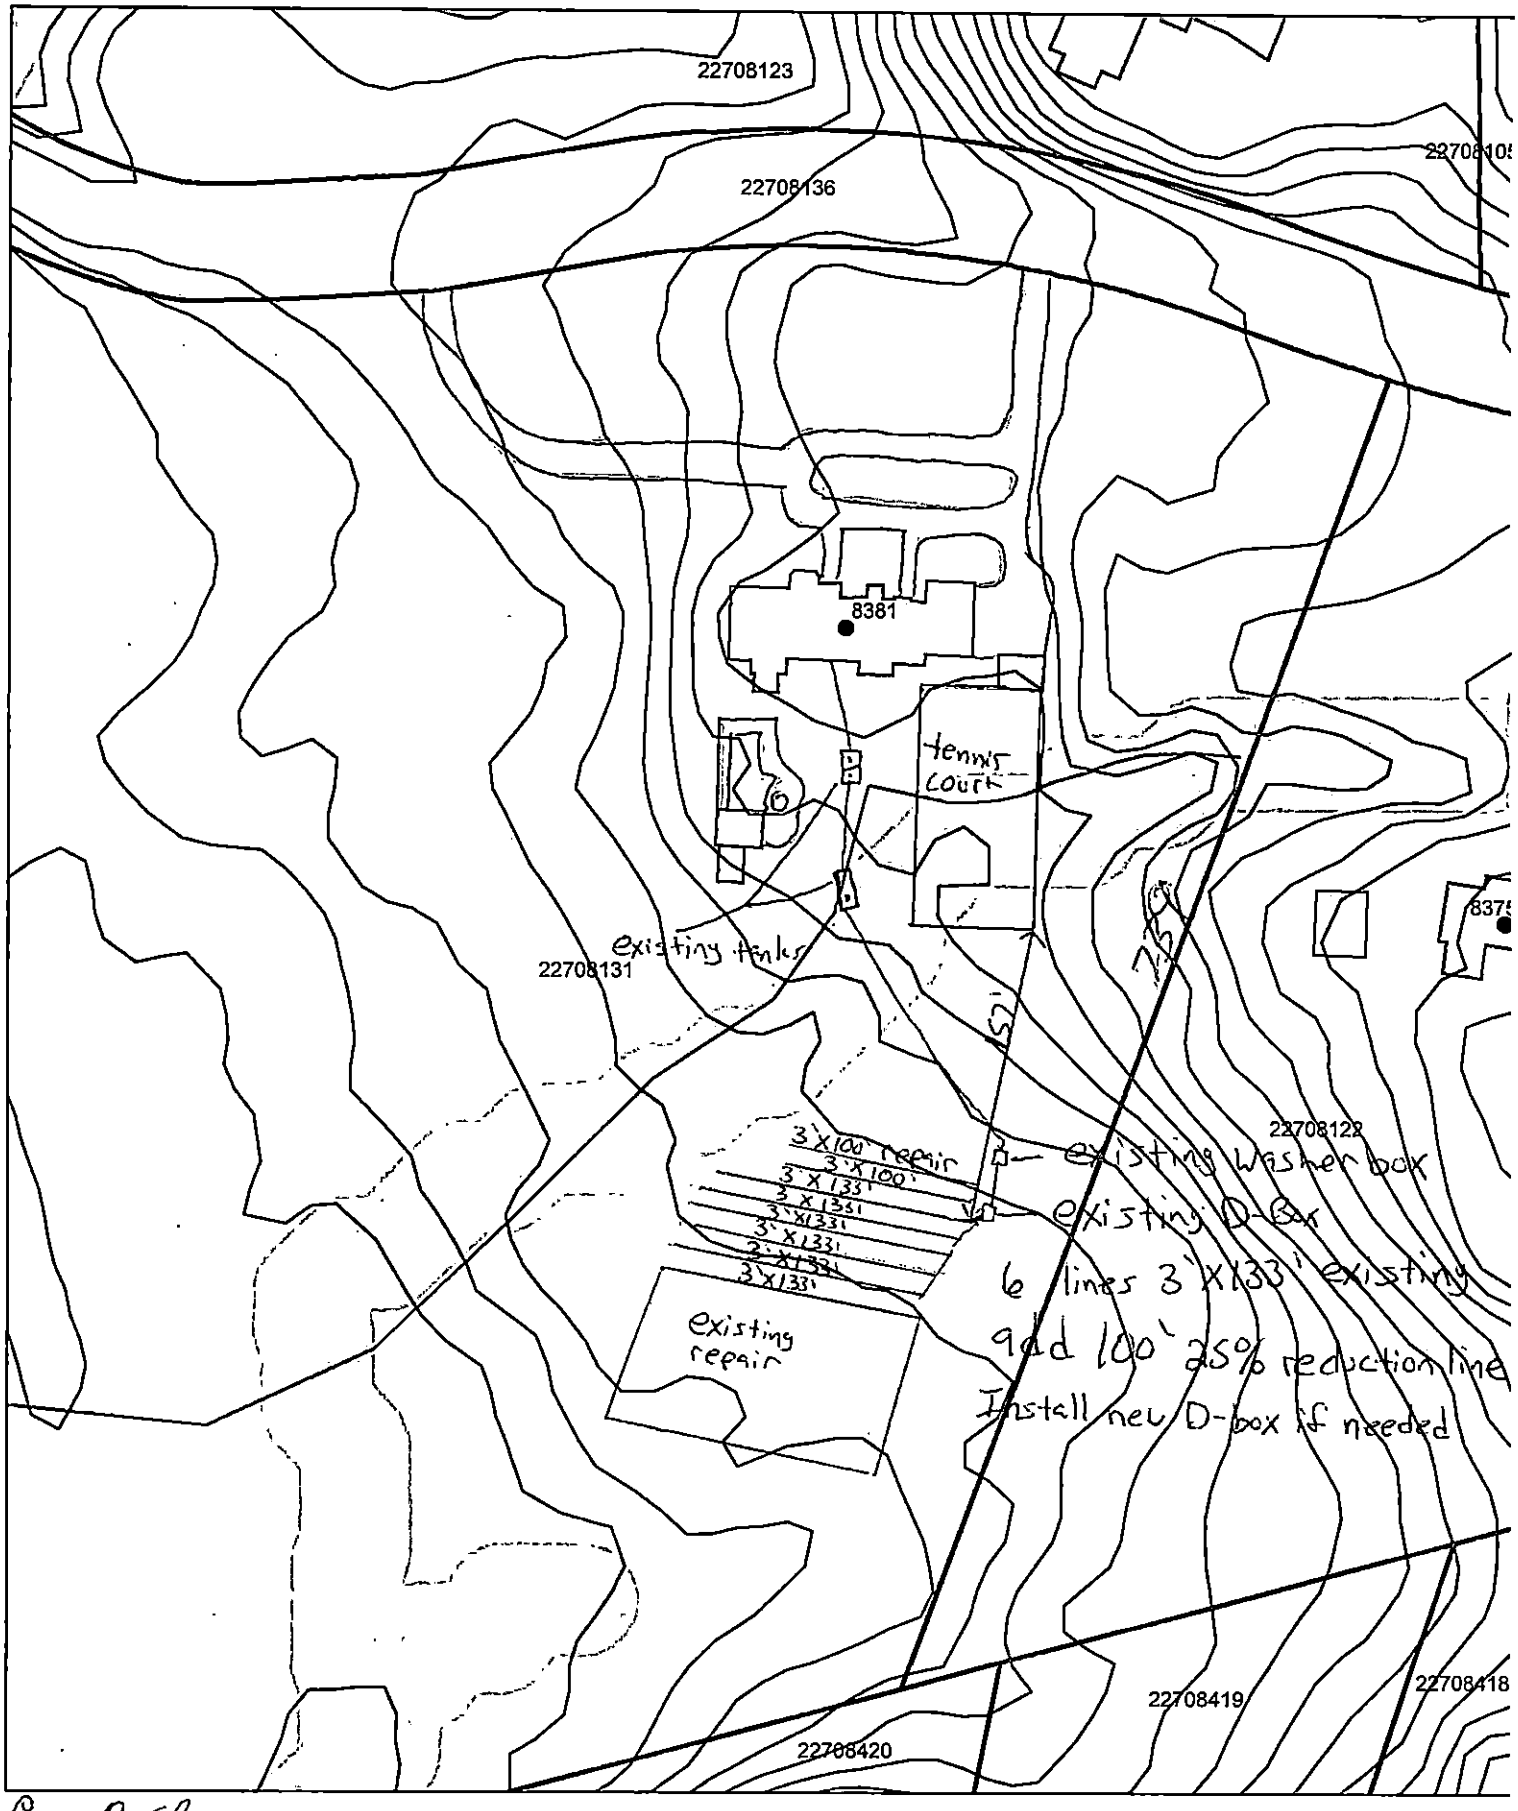

Eric Bailey
Map Created By: Eric Bailey
Map Created On: 02/20/2013

● Auger Boring Locations

0 25 50 100 Feet

N

CONDITIONS OF IMPROVEMENT PERMIT for an ALTERATION TO AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit Number: _ Tax Number: 227-081-31

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☒ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

0.3 Long-term acceptance rate (GPD/ft^2)	840 Max gallons/day wastewater flow	2694 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☐ Yes ☒ No	exis Gallon septic tank	898 Total trench length (ft)	36 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
7 Bedrooms in residence	exis Gallon pump tank	12 Depth of media (in)	

Any surface water present: no Type: Minimum separation distance (ft):

Additional conditions: **Install new d-box if needed. Install 1 line 100' of 25% reduction for bedroom addition.**

Repair Area System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☒ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

2694 Absorption Area (ft^2) 898 Total trench length (ft)	12 Depth of media (in)	9 Trench spacing (min. on centers) (ft)	36 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation Approval is granted by this Department.

*** This Improvement permit is transferable.


Eric Bailey 2-20-13
DENR Authorized Agent Date

[signature] 2/21/13
Owner/Agent Signature Date

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

SOIL EVALUATION LOCATIONS FOR
PARCEL #: 227-081-31
WAPSPS APPLICATION #: 6028

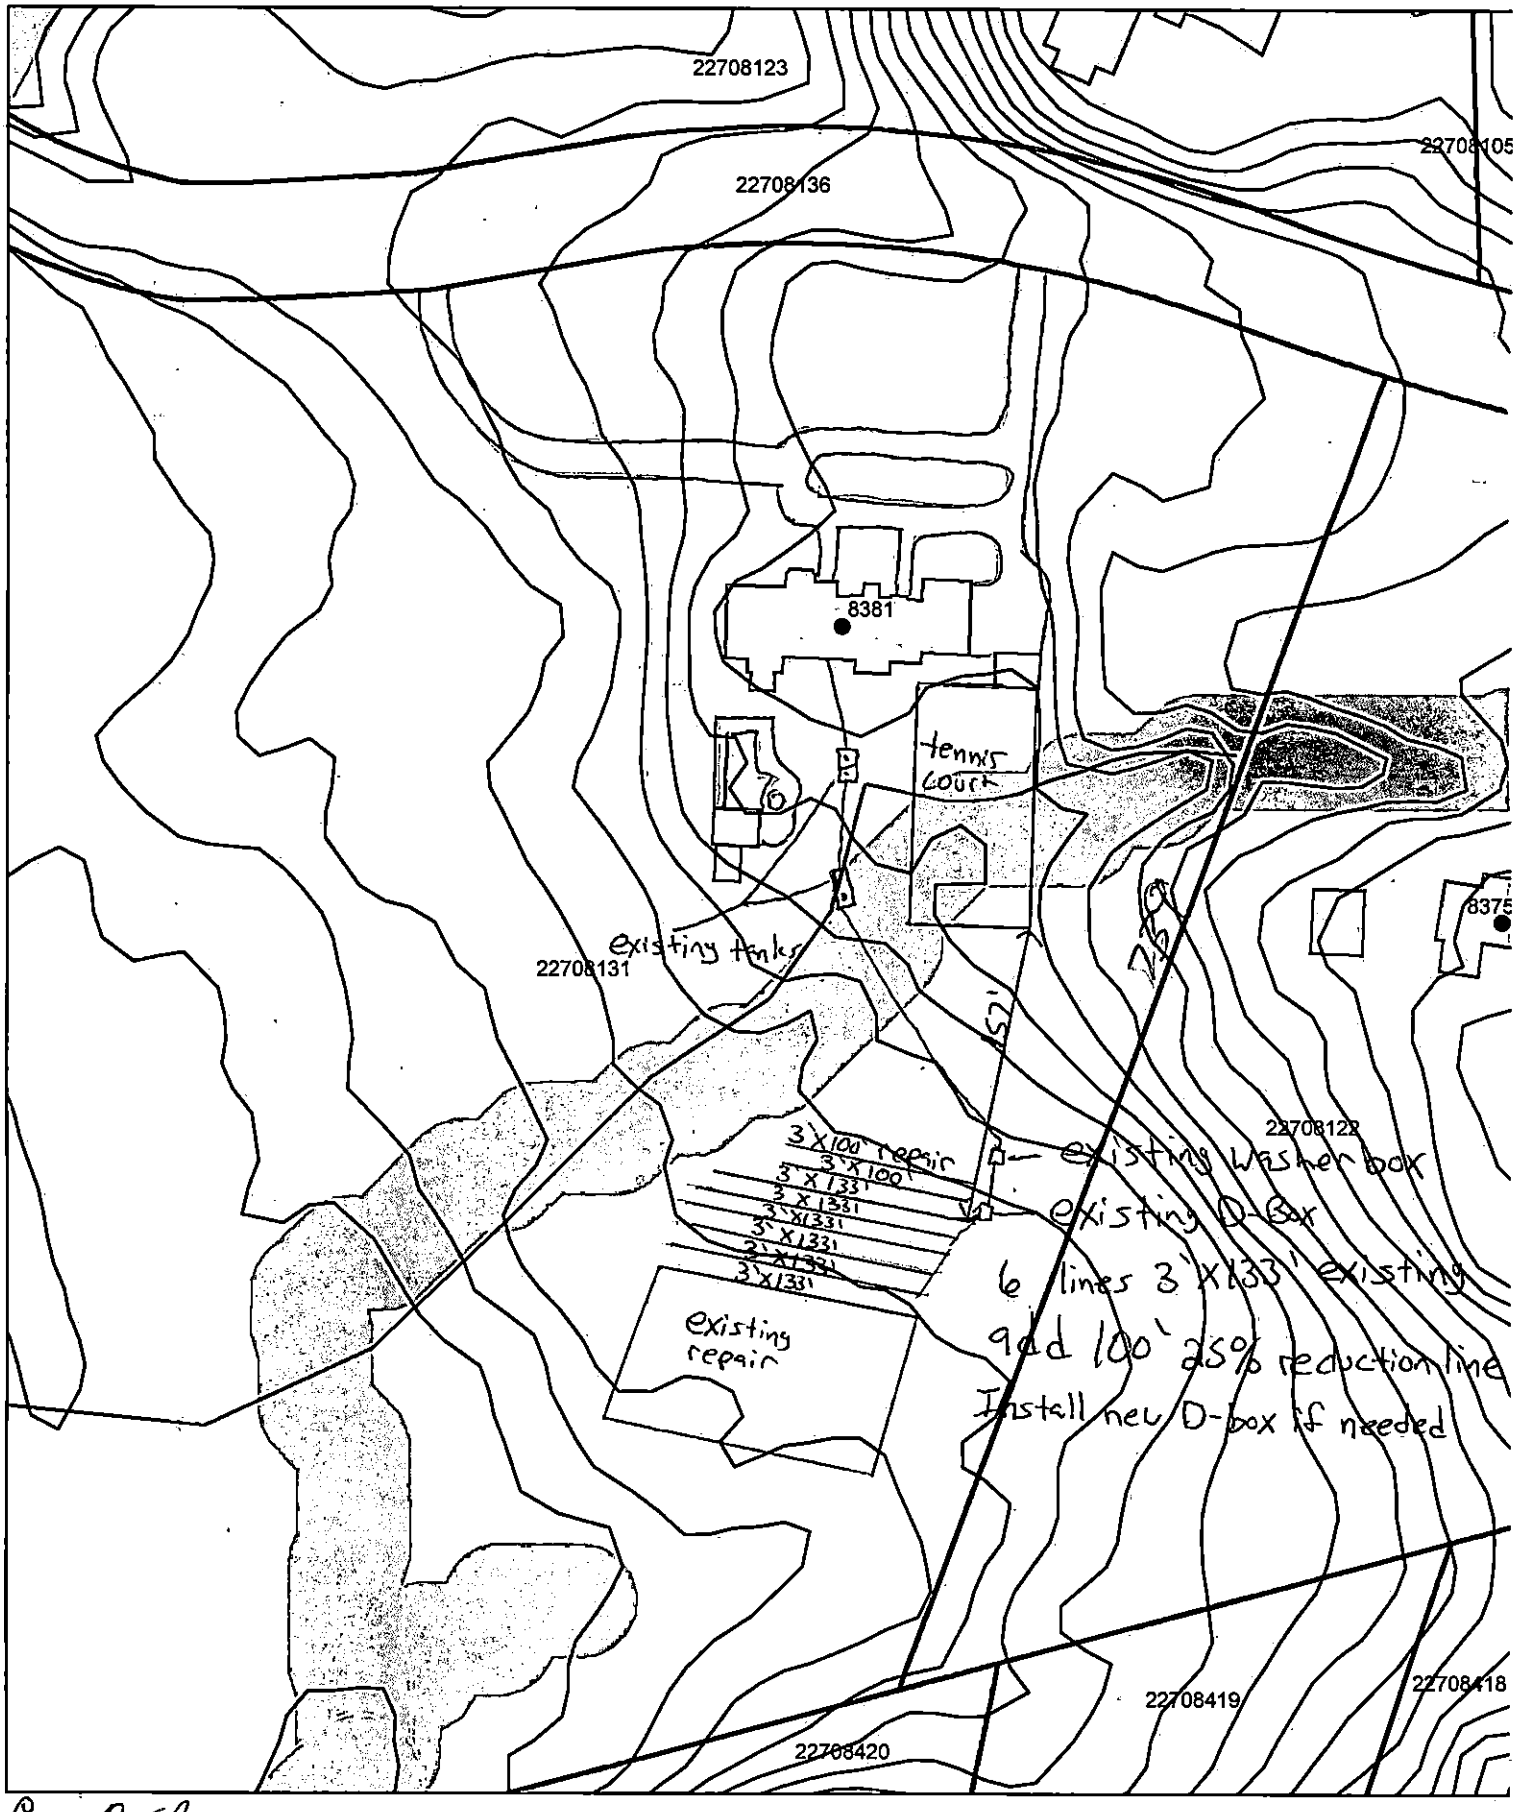

Eric Bailey
Map Created By: Eric Bailey
Map Created On: 02/20/2013

● Auger Boring Locations

0 25 50 100
Feet

N

3734B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

App#6028

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. **SEPTIC / TYPE APPLICATION:** ○ N/A ○ NEW SYSTEM ☒ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ☒ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. **JOB LOCATION INFORMATION:**

TAX PARCEL NUMBER: 227-081-31
STREET ADDRESS: 8381 PROVIDENCE RD
CITY: CHARLOTTE
STATE: NC ZIP: 28277
SUBDIVISION NAME: GREENWOOD
LOT #: _____ LOT SIZE (acres): _____
TOWNSHIP:

○ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ☒ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. **BUILDING INFORMATION:**

BUILDING TYPE:

○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
☒ HOUSE ○ OTHER _____

HEATED SQUARE FOOTAGE: 8000 (+1000 ADDITION)
NUMBER OF BEDROOMS: 5+1
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:

☒ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
○ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: 1 NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: 0

6. **WATER SUPPLY:** ☒ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. **PROPOSED USE OF WELL:** ☒ N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED):*

☐ N/A ☒ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. **RANK:** ___ ___ ___ ___ ___

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ☒ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ☒ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☒ YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ☒ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ☒ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ☒ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ☒ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ☒ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ☒ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ☒ NO
WASTE STORAGE	○ YES ☒ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ☒ NO

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** ± 1996 ☐ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☒ N/A

12. **PROPERTY OWNER:**

NAME: CHUCK DAVIS
ADDRESS: 8381 PROVIDENCE RD
CITY: CHARLOTTE
STATE: NC ZIP: 28277
WORK PHONE: 704.542.8304
MOBILE PHONE: 704.651.3599
FAX: _____
E-MAIL: CDAVIS@CASHORT.COM

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**

NAME: JAMES BENHAM
ADDRESS: 7925 KIELDON CT.
CITY: CHARLOTTE
STATE: NC ZIP: 28277
WORK PHONE: 704.847.3900
MOBILE PHONE: 704.363.2940
FAX: 704.849.9161
E-MAIL: JFB@BENHAMBUILDERS.COM

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

JB (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

Property Owner's or Owner's Legal Representative Signature

2/13/13
Date

OFFICE USE ONLY

O SURVEY PLAT TO SCALE SUBMITTED O SCALED SITE PLAN SUBMITTED O UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: lwa

GWS FILE NUMBER ASSIGNED: 3734B

APPLICATION ID NUMBER ASSIGNED: 6028

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 8381 PROVIDENCE RD Tax Parcel #: _____

Subdivision Name: GREENWOOD Lot #: _____

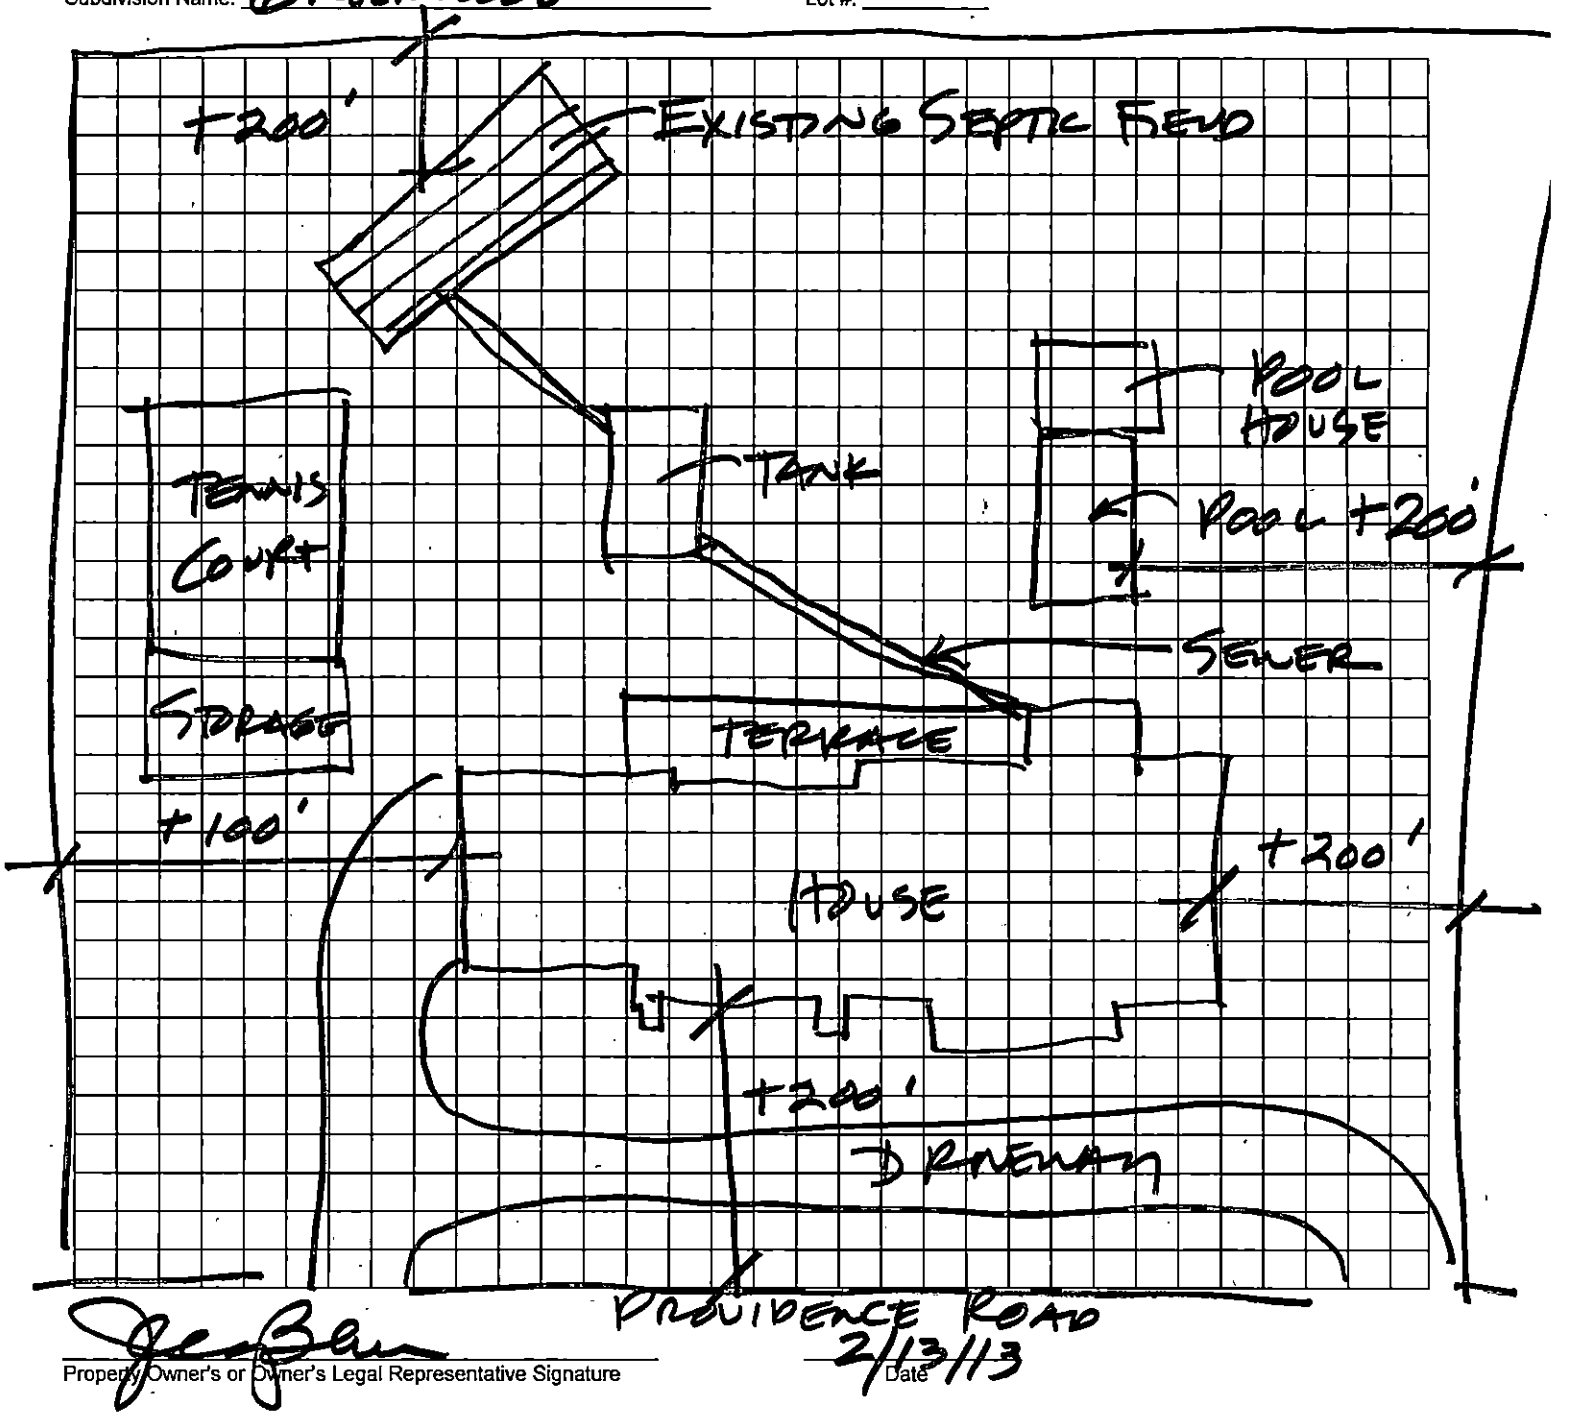

Property Owner's or Owner's Legal Representative Signature Date 2/13/13

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 1
Property ID: 22708131
Lot #:
File #: 3734B
AppID: 6028

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Chuck Davis
Address: 8381 Providence Rd Charlotte, NC
Proposed Facility: Residence
Design Flow (.1949): 840
Location of Site: 8381 Providence Rd Charlotte NC 28227
Water Supply: [X] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

Applicant: James Benham
Date Evaluated: 2-18-13
Property Size:
Property Recorded:

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
1	LS	0-6	wfg SL	ss sp fr sexp	>60	60	NA	S		PS IV	36
	3%	6-60	wfsbk SCL	ss sp fr sexp						0.3	
2	LS	0-4	wfg SL	ss sp fr sexp	>60	60	NA	S		PS IV	36
	3%	4-60	sfsbk SCL	ss sp fr sexp						0.3	

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	IIIb	IIIb
Site LTAR	0.3	0.3

Other Factors (.1946): PS
Soil Evaluation By: Eric Bailey LSS Eric Bailey
Others Present:
Site Classification (.1948):PS
Site Evaluation By:
Others Present:

COMMENTS:

Landscape Position
R-Ridge
SS-Shoulder Slope
LS-Linear Slope
FS-Foot Slope
NS-Nose Slope
HS-Head Slope
CC-Concave Slope
CV-Convex Slope
T-Terrace
FP-Flood Plain
D-Drainage Way

Group	Texture	.1955 LTAR
I	S-Sand	1.2 - 0.8
	LS-Loamy Sand	
II	SL-Sandy Loam	0.8 - 0.6
	L-Loam	
III	Si-Silt	0.6 - 0.3
	SiCL-Silty Clay Loam	
	CL-Clay Loam	
	SCL-Sandy Clay Loam	
	SiL-Silt Loam	
IV	SC-Sandy Clay	0.4 - 0.1
	SiC-Silty Clay	
	C-Clay	

Structure
sg-Single Grain
mass-Massive
cr-Crumb
gr-Granular
sbk-Subangular Blocky
abk-Angular Blocky
pl-Platy
pr-Prismatic

Structure Prefixes
w-weak
m-moderate
s-strong
f-fine
m-medium
c-coarse


Consistence
Moist
VFR-Very Friable
FR-Friable
FI-Firm
VFI-Very Firm
EFI-Extremely Firm

Consistence
Wet
SS-Slightly Sticky
S-Sticky
VS-Very Sticky
NP-Non-Plastic
SP-Slightly Plastic
P-Plastic
VP-Very Plastic

Mineralogy
SEXP-Slightly Expansive
EXP-Expansive

Classification
US-Unsuitable
PS-Provisionally Suitable
S-Suitable
NA-Not Applicable

Sketch of Soil Evaluation Locations

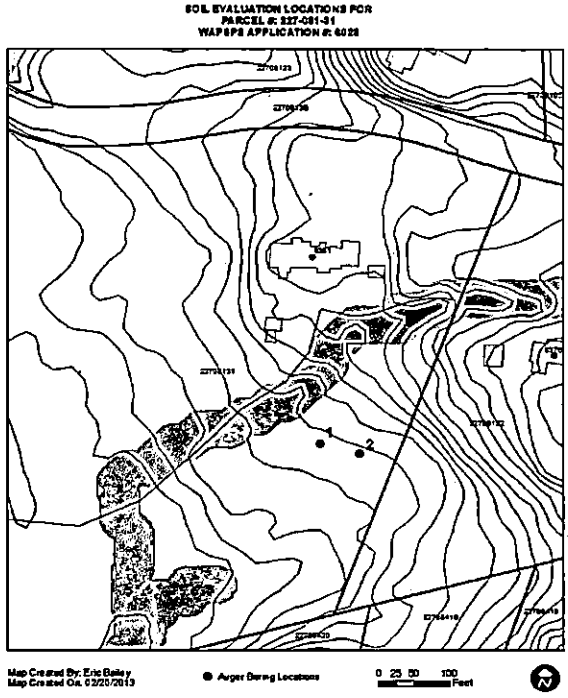

MECKLENBURG COUNTY
Health Department

E. Winters Mabry, MD
Director

(704) 432-3199

Febuary 13, 2013

James Benham
7925 Kieldon Ct
Charlotte, NC 28227

Re: Application for approval to use an existing on-site wastewater treatment & disposal system.
Property Location: 8381 Providence Road Charlotte, NC 28227
Health Department File Number: **3734B**

Dear Property Owner or Owner's Agent:

On Febuary 5, 2013 the Mecklenburg County Health Department, Groundwater & Wastewater Services Section, evaluated the above-referenced property to determine if approval to use an existing on-site wastewater treatment & disposal system could be granted for your proposed project. This evaluation was done in accordance with the laws and rules governing wastewater systems in North Carolina General Statute 130A-333 and related statutes, Title 15A, Subchapter 18A, of the North Carolina Administrative Code, Rule .1900 and related rules, and the Mecklenburg County Groundwater Well Regulations.

Based on the information provided in the application, dated January 28, 2013, and findings from the site evaluation conducted by our office, your request for approval to use an existing on-site wastewater treatment & disposal system is **not** being granted. This decision is based on the following conditions that were identified during the site visit:

- ☐ The existing on-site wastewater treatment & disposal system was not functioning properly at the time the site evaluation was conducted.
- ☐ The proposed plans do not meet the required setbacks for the on-site wastewater treatment & disposal system serving the property.
- ☐ The proposed plans do not meet the required setbacks for the reserved repair area for an on-site wastewater treatment & disposal system.
- ☐ The proposed plans do not meet the required setbacks for water supply wells.
- ☒ The proposed project will exceed the permitted daily design flow for the existing on-site wastewater treatment & disposal system. System alteration will be required in order to accommodate your proposed project.

If you need any additional information or assistance please contact our office at (704) 336-5103.

Sincerely,

Eric Bailey

Eric Bailey, REHSI
Environmental Specialist

X34132

3734B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

App # 5993

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM / WATER SUPPLY WELL

APPLICATION TYPE: ○ SEPTIC ONLY ○ WELL ONLY ☒ SEPTIC & WELL
○ ADDITION OR RENOVATION WITH OCCUPANCY INCREASE ○ EXCHANGE MOBILE HOME (SAME # BEDROOMS)
☒ ADDITION OR RENOVATION WITH NO OCCUPANCY INCREASE ○ COMMERCIAL OR INDUSTRIAL

PERSON FILING APPLICATION:
NAME: JAMES BENHAM
ADDRESS: 7925 FIELDEN CT.
CITY: CHARLOTTE
STATE: NC ZIP: 28277
PHONE: 704.363.2940
ALTERNATE PHONE: 704.847.3900
E-MAIL: JFB@BENHAMBUILDERS.COM

PROPERTY OWNER: ☐ SAME AS PERSON FILING APPLICATION
NAME: CHUCK DAVIS
ADDRESS: 8381 PROVIDENCE RD.
CITY: CHARLOTTE
STATE: NC ZIP: 28279
PHONE: 704-363-2940
ALTERNATE PHONE: 704.847.3900
E-MAIL: JFB@BENHAMBUILDERS.COM

JOB LOCATION INFORMATION
TAX PARCEL #: 227-081-31
STREET ADDRESS: 8381 PROVIDENCE RD.
CITY: CHARLOTTE
STATE: NC ZIP: 28270

SUBDIVISION OR MOBILE HOME PARK NAME: GREENWOOD
LOT #:

WATER SUPPLY:
○ MUNICIPAL ☒ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER

RESIDENTIAL PROPERTY TYPE: ○ N/A
☒ HOUSE ○ MODULAR HOME ○ MULTIPLE FAMILY
○ SINGLE MOBILE HOME ○ DOUBLE WIDE
○ OTHER

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 6
NUMBER OF OCCUPANTS:

COMMERCIAL / INDUSTRIAL PROPERTY TYPE: ☒ N/A
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ○ YES ○ NO
UNDERGROUND STORAGE TANKS? ○ YES ○ NO

ADDITION/RENOVATION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☒ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☒ GARAGE ☐ SUNROOM ☒ PORCH ☐ DECK ☒ OTHER FOYER

ADDITION/RENOVATION TYPE DETACHED FROM EXISTING STRUCTURE:
☐ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
☐ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature — Date: 1/28/13

A PROPOSED PLOT PLAN (see page 2) is required to be submitted with each application.

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


Revised on: 01/03/11

File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 8381 PROVIDENCE RD 28270 Tax Parcel #: _____

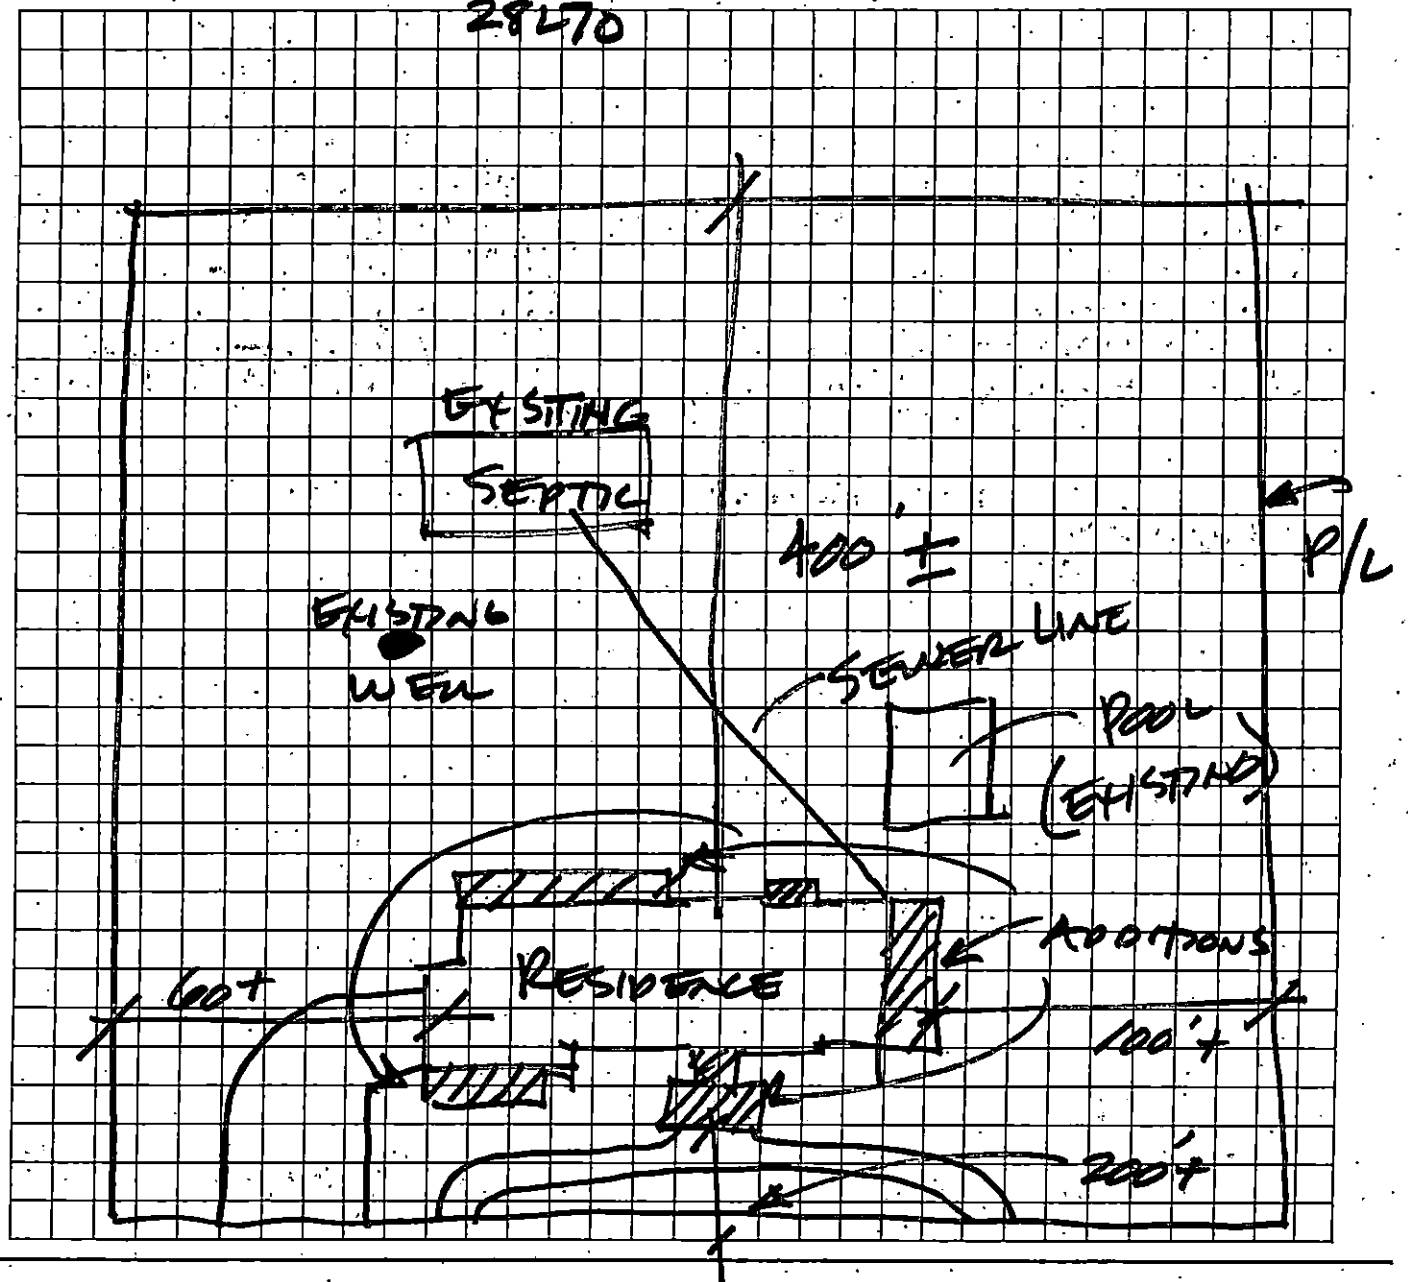

"The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the "Job Location" contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted by this Department.
- This permit is not transferable.
- Addition/Renovation approval valid 1 year from issuance date
- Mobile home exchange approval valid 6 months from issuance date

Used existing not approved, need alteration

Eric Bailey
REHS Signature

2-13-13
Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	02/13/13	**Amount:**	200.00
Receipt #:	81939	**Tendered:**	200.00
Check / Auth #:	MC 18693Z	**Returned:**	0.00
Received By:	SADERLW		

Account Information

Account #: 200000
Contractor: BENHAM JAMES
Attn:
Address: 7925 KEILDON CT
Address:
City/State/Zip: CHARLOTTE, NC 28277

Item	Description	Permit#	Quantity	Unit Price	Total Price
0706	MH Exc/Add/Repl w/System Mod 8381 PROVIDENCE RD		1	200.00	200.00

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
380.00	2,100.00	177.15			

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 01/28/13
Receipt #: 81375
Check / Auth #: CHARGE
Received By: SADERLW

Amount: 100.00
Tendered: 100.00
Returned: 0.00

Account Information

Account #: X34132
Contractor: BENHAM GROUP INC THE
Attn:
Address: 7925 KIELDON COURT
Address:
City/State/Zip: CHARLOTTE, NC 28277

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	MH Exc/Add/Repl w/o System Mod 8381 PROVIDENCE RD		1	100.00	100.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
464.37					

3734B
13160.
16 MAY '22 AM10:29

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR APPROVAL TO USE AN EXISTING
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM / WATER SUPPLY WELL

APPLICATION TYPE: ☒ SEPTIC ONLY ○ WELL ONLY ○ SEPTIC & WELL
○ ADDITION OR RENOVATION WITH OCCUPANCY INCREASE
☒ ADDITION OR RENOVATION WITH NO OCCUPANCY INCREASE
○ EXCHANGE MOBILE HOME (SAME # BEDROOMS)
○ COMMERCIAL OR INDUSTRIAL

PERSON FILING APPLICATION:
NAME: JAMES BENHAM
ADDRESS: 6920 SHINNECOCK HILL LN.
CITY: CHARLOTTE
STATE: NC ZIP: 28277
PHONE: 704.363.2940
ALTERNATE PHONE: N/A
E-MAIL: JFB@BENHAMBUILDERS.COM

PROPERTY OWNER: ☐ SAME AS PERSON FILING APPLICATION
NAME: CHUCK DAVIS
ADDRESS: 8381 PROVIDENCE RD
CITY: CHARLOTTE
STATE: NC ZIP: 28277
PHONE: 704.363.2940
ALTERNATE PHONE: N/A
E-MAIL:

JOB LOCATION INFORMATION
TAX PARCEL #: 22708131
STREET ADDRESS: 8381 PROVIDENCE RD.
CITY: CHARLOTTE
STATE: NC ZIP: 28277

SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #:

WATER SUPPLY:
☒ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER

RESIDENTIAL PROPERTY TYPE: ○ N/A
☒ HOUSE ○ MODULAR HOME ○ MULTIPLE FAMILY
○ SINGLE MOBILE HOME ○ DOUBLE WIDE
○ OTHER

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 5
NUMBER OF OCCUPANTS: 2

COMMERCIAL / INDUSTRIAL PROPERTY TYPE: ☒ N/A
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ○ YES ○ NO
UNDERGROUND STORAGE TANKS? ○ YES ○ NO

ADDITION/RENOVATION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☐ GARAGE ☐ SUNROOM ☐ PORCH ☐ DECK ☐ OTHER

ADDITION/RENOVATION TYPE DETACHED FROM EXISTING STRUCTURE:
☒ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
☐ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owners/Agent's Signature

5/9/22
Date

A PROPOSED PLOT PLAN (see page 2) is required to be submitted with each application.

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
3205 Freedom Dr. Suite 8000, Charlotte, NC 28208 OFFICE: (980) 314-1680, FAX: 704-336-6894

Revised on: 03/27/19


1010

File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 8381 PROVIDENCE RD. CHCT. NC 28277 Tax Parcel #: _____

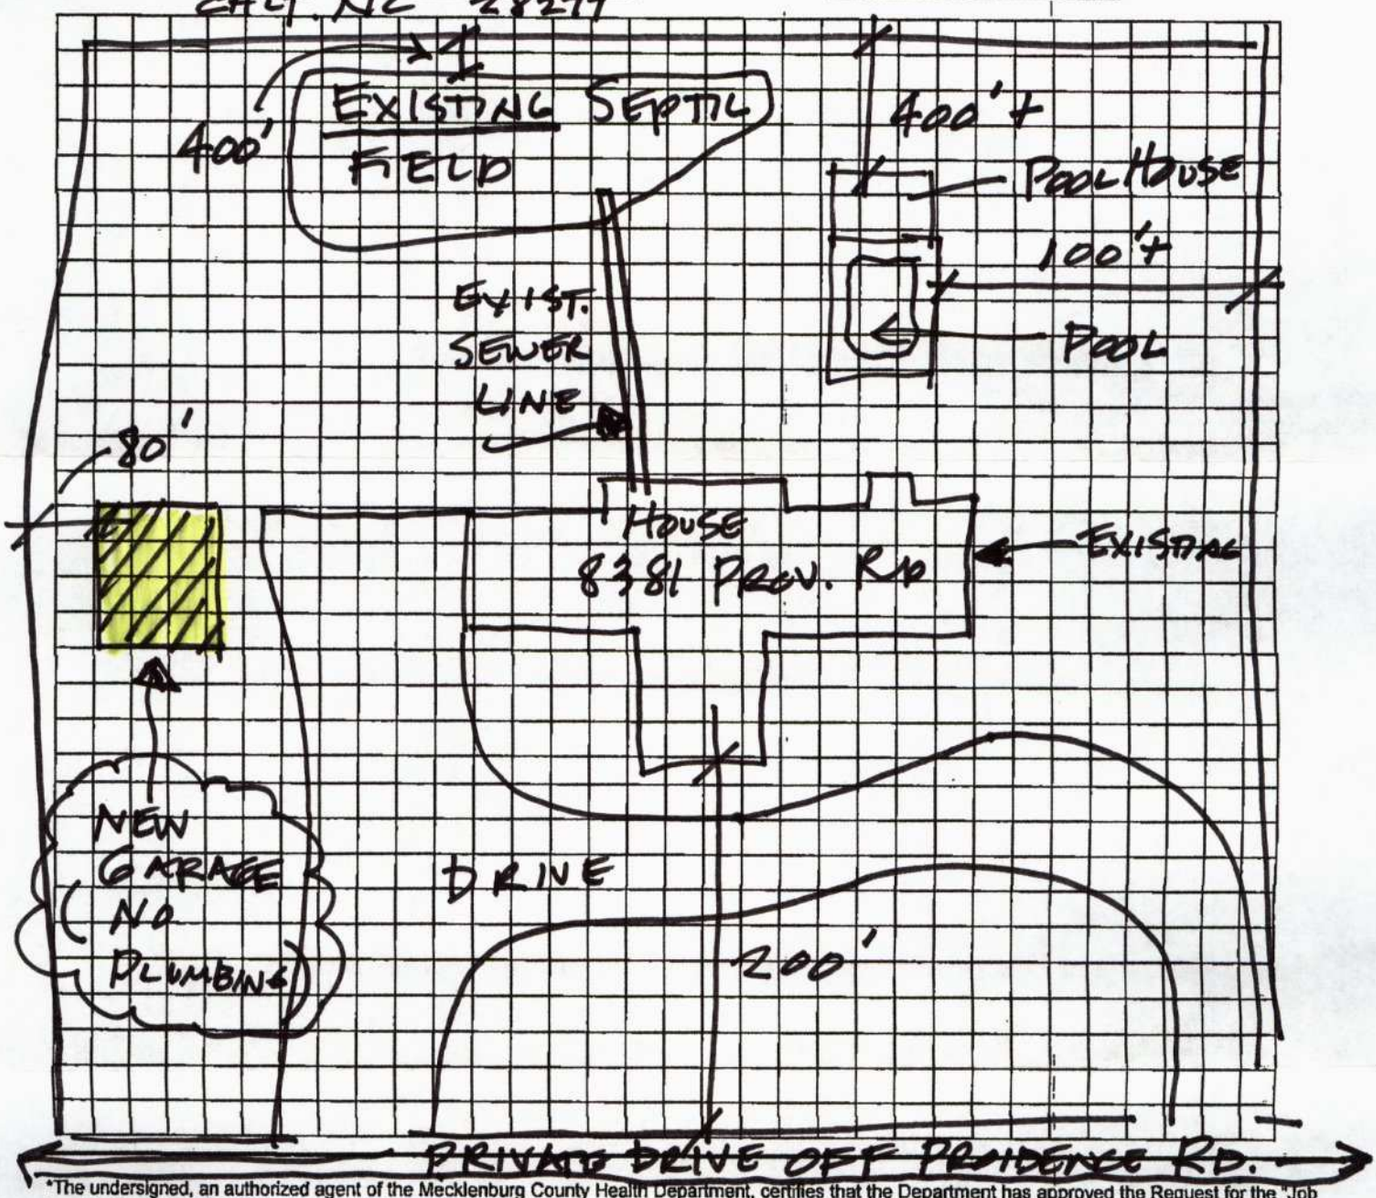

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the "Job Location" contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted by this Department.
- Addition/Renovation approval valid 1 year from issuance date
- Mobile home exchange approval valid 6 months from issuance date

Customer meets required set backs

Bryan Dayak 5/25/22
REHS Signature Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
3205 Freedom Dr. Suite 8000, Charlotte, NC 28208 OFFICE: (980) 314-1680, FAX: 704-336-6894

Revised on: 03/27/19

Date: 05/16/22
Receipt #: 135859
Check / Auth #: CHECK 1945
Received By: ELLISLW

Amount: 100.00
Tendered: 100.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: BENHAM, JAMES
Attn:
Address:
Address:
City/State/Zip: ,

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	Use Existing System 8381 PROVIDENCE RD		1	100.00	100.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

MECKLENBURG COUNTY
Health Department

Gibbie Harris, MSPH, BSN
Director

(980) 314-9020

Addendum to Application for
New Well or Septic System Installation
Abandonment or Repair of Existing Well or Septic System

Your signature below confirms the following:

1. The information on the application is true, complete and accurate.
2. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliances with applicable laws and rules.
3. I acknowledge that Jim Benham is acting as my legal representative (agent) in the submittal of the application for a water supply well or septic permit located at 8381 Providence Rd.
   Number Street Town
   (Or Parcel Number)

Charles R. Davis
Property Owner (print name)

Property Owner (signature)

5/16/22
Date