Date Received 4-25-83

MECK COUNTY DEPARTMENT OF
RECEIVED
APR 25 1983
ENVIRONMENTAL HEALTH

SIR No. 19563

T. C. No. 027-011-18

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER Carter (LAST) Evelyn (FIRST) ~~Yvonne~~ Potts (MIDDLE)

2) ADDRESS OF OWNER 3216 Carmen Place ZIP 28213

3) PHONE NO. Home 598 9395 Office _____


4) LOCATION OF PROPERTY ~~Wilkinson~~ ~~Morgan Road~~ 3902 Hubbard Rd. (STREET OR COUNTY ROAD)

5) SUBDIVISION _____ LOT NO. _____ BLOCK NO. _____

MAP BOOK NO. _____ PAGE NO _____

6) DEED REFERENCE DEED BOOK 4138 PAGE NO. 223

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge.

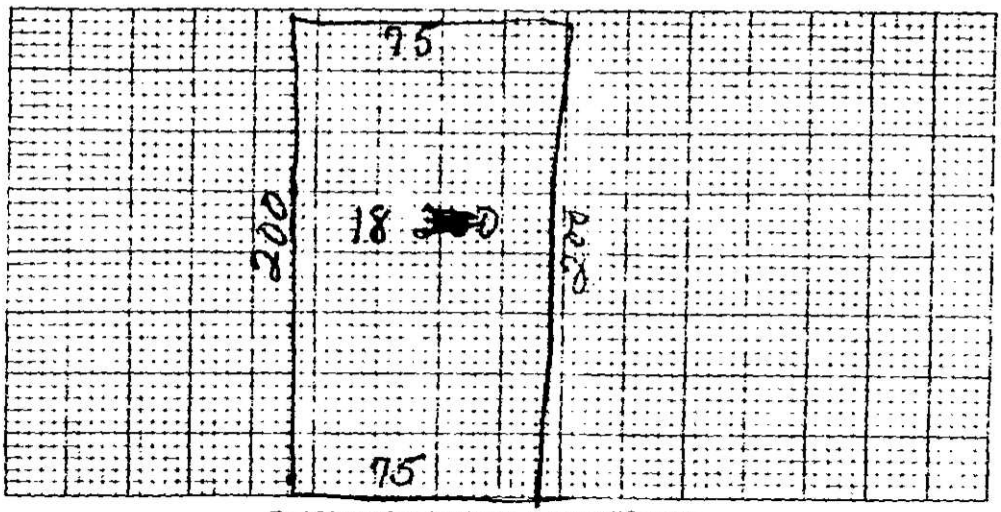

7) ACCURATELY DIAGRAM & DIMENSION LOT

Evelyn Potts Carter
OWNER

EHD-5-76

Environmental Health Department's Copy

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

SER. NO. 19563
T. C. NO. 027-011-18
DATE: 5-3-83

Ms. Evelyn P. Carter
3216 Carver Place
Charlotte, NC 28213

Re: Property located at Off Morgan Road

Dear Ms. Carter:

At your request, a field investigation was conducted on the property designated above and was classified unsuitable for the installation of a ground absorption sewage disposal system. A copy of the site evaluation report is enclosed for your information.

Sites classified as unsuitable may be utilized for soil absorption disposal systems provided engineering, hydrogeologic, soil and environmental studies indicate that a suitable septic tank system or a suitable alternate system can be reasonably expected to function satisfactorily.

Should you desire to file for permission to install an alternate system, please submit your proposals, in the form of plans and specifications, to this office. They will be reviewed and if it is found that the system may be reasonably expected to function satisfactorily, approval will be given upon the execution by you of a "Septic Tank Agreement Form" provided by this office.

If I may be of assistance, please feel free to call at any time.

Sincerely,

Michael A. Sexton
Environmentalist
On Premises Waste Disposal Section

Enclosure

EHD #37 (11-82)

DEPARTMENT OF ENVIRONMENTAL HEALTH
MECKLENBURG COUNTY, NORTH CAROLINA

SITE EVALUATION

S.I.R. NO. 19563

T.C. NO. 027-011-18

(Ground Absorption Sewage Disposal)

OWNER: Evelyn Carter
ADDRESS: 3218 Carma Place 28213

PLAT NO:
LOT SIZE: 15,000

LOCATION OF SITE: Morgan Rd

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	S (PS) U — 2-6	S PS (U) — Complex Slopes	S PS U	S PS U
2. SOIL TEXTURE (12-36 inches) Sandy, Loamy, Clayey (Note 2-1 Clay)	S PS (U) — mixed Clay	S PS (U) — mixed Clays	S PS U	S PS U
3. SOIL STRUCTURE (12-36 inches)	S PS (U) — weak Blocky	S PS (U) — weak Blocky	S PS U	S PS U
4. SOIL DEPTH (inches)	S PS (U) — 10"	S PS (U) — 6-10"	S PS U	S PS U
5. RESTRICTIVE HORIZONS (Inches) (Impervious strata, Rock)	S PS (U) — clay saprolite	S PS (U) — clay d saprolite	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (external and internal)	S PS (U) — slow	S PS (U) — slow	S PS U	S PS U
7. OTHER (Specify)	S PS (U) — inadequate Area	S PS U	S PS U	S PS U
8. SOIL GROUP	IVb	IVb		
9. SITE CLASSIFICATION	unsuitable	unsuitable		
10. SOIL SERIES	Wilkes	Complex Slopes		

S - Suitable PS - Provisionally Suitable U - Unsuitable

**See Diagram on Back (includes: soil areas, property lines, roads, streams, gullies, wet areas, fill areas, wells, water bodies, slopes)


Recommendations/Comments:

Described by: W. B. Ramsey
Title: Soil Scientist

Date: 4-27-83

EHD 539 (Revised: 6/82)

2/

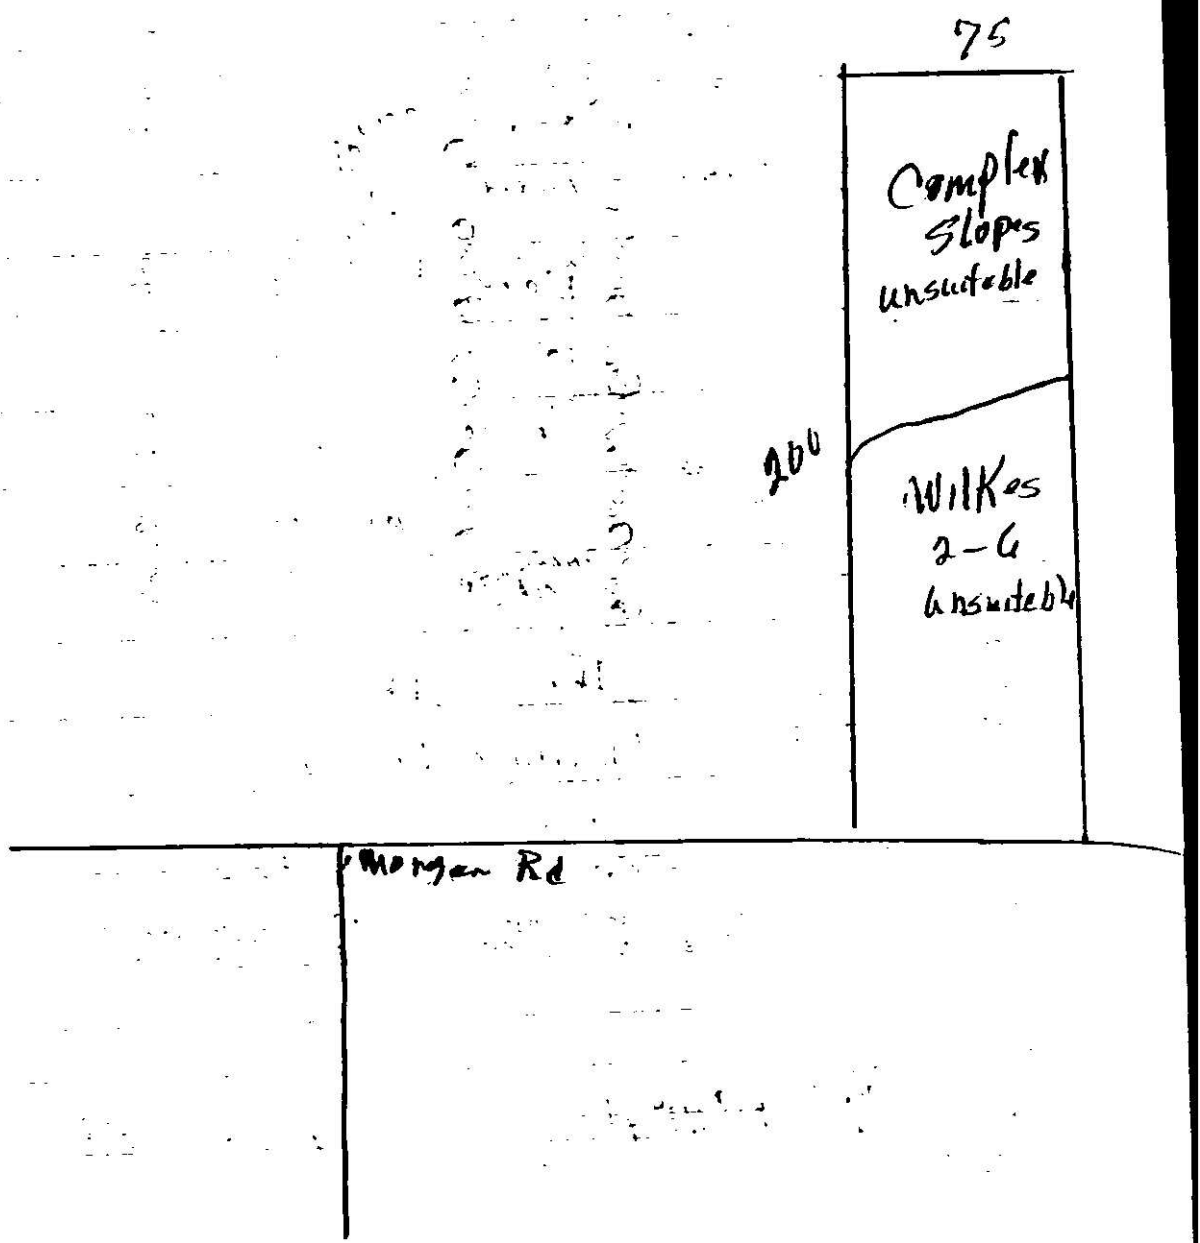
75
Complex Slopes unsuitable
200
Wilkes 2-G unsuitable
Morgan Rd

Date Received 4-25-83

RECEIVED

ICAR(S) Application No. 19563

T. C. No 027-011-18


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ✓ Install or Construct 2) _____ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

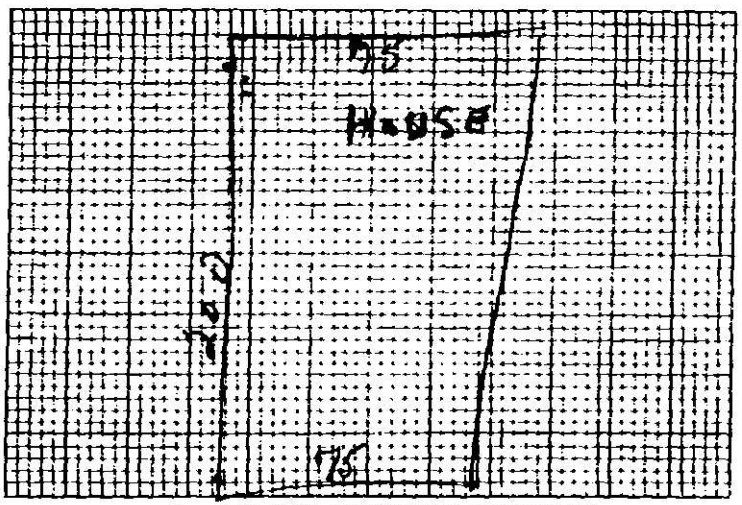

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes ___ No
Residence ✓ Yes ___ No

4) No of Bedrooms 3
5) Business Use — Max No Employees ___
6) Washing Machine ✓ Yes ___ No
7) Garbage Disposal ___ Yes ✓ No
8) Dishwasher ✓ Yes ___ No
9) Water Supply
A) Individual Well ✓
B) Governmental System ___
C) Community System
1. Well source ___
2 Governmental source ___
10) Sewage System
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ___ No
11) FHA Case No ___
12) VA Case No. ___

13) NAME OF OWNER Carter (LAST) Evelyn (FIRST) ~~Yvonne~~ Potts (MIDDLE)

14) ADDRESS OF OWNER 3216 Carver Pl. 28213

15) PHONE NO. Home 5989395 Office ___

16) LOCATION OF SYSTEM 3902 Hutland Rd. (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No. ___ Block No. ___

Map Book No ___ Page No. ___

18) DEED REFERENCE — DEED BOOK 4138 AT PAGE 223

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ✓ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

Evelyn Potts Carter — April 25 - 83
DATE OF APPLICATION — OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY