

15532 YOUNGBLOOD RD

21702150

8/25/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

SERVICE REQUEST/WORK ORDER

Log No.: 1938 Section: IwWS Hazard? [ ] Yes [ ] No
Date: 03-22-94 Parcel: 217-021-50 <60 Days? [ ] Yes [ ] No

REQUESTING PERSON: Lynn Lathan Phone
Address City Zip

PROPERTY CONCERNED: Facility Name Larry & Karen Harmon Residence
Address 15532 Youngblood Road City Charlotte Zip 28278

SERVICE REQUESTED: PLEASE ADVISE WHETHER OR NOT THE WASTE WATER DISPOSAL SYSTEM OR REPAIR SPACE WILL BE AFFECTED ADVERSELY BY ADDITION OF A SWIMMING POOL AS PROPOSED IN ATTACHED PLAN


ASSIGNED TO: Judy Kiser TAKEN BY: Bowers/Lathan

DATE	ACTIVITY REPORT
	Cartridge filter to be installed w/ no backwash /Lathan
3/30	Site visited (after receiving this request on 3/29 no one home. Unable to reach by phone - Dogs would not let me out of house.
3/31	Phoned Karen Harmon. We'll meet on Tuesday 4/5/94
4/5	Site revisited. Area staked for pool is approved. This will not impact the Septic System. (our file # 17259)

NOTIFICATION TO REQUESTING PERSON: (✓) Written ( ) Verbal ( ) Not Applicable

COMPLETED BY: Judy Kiser R.S. 4/5/94

REVIEWED BY:

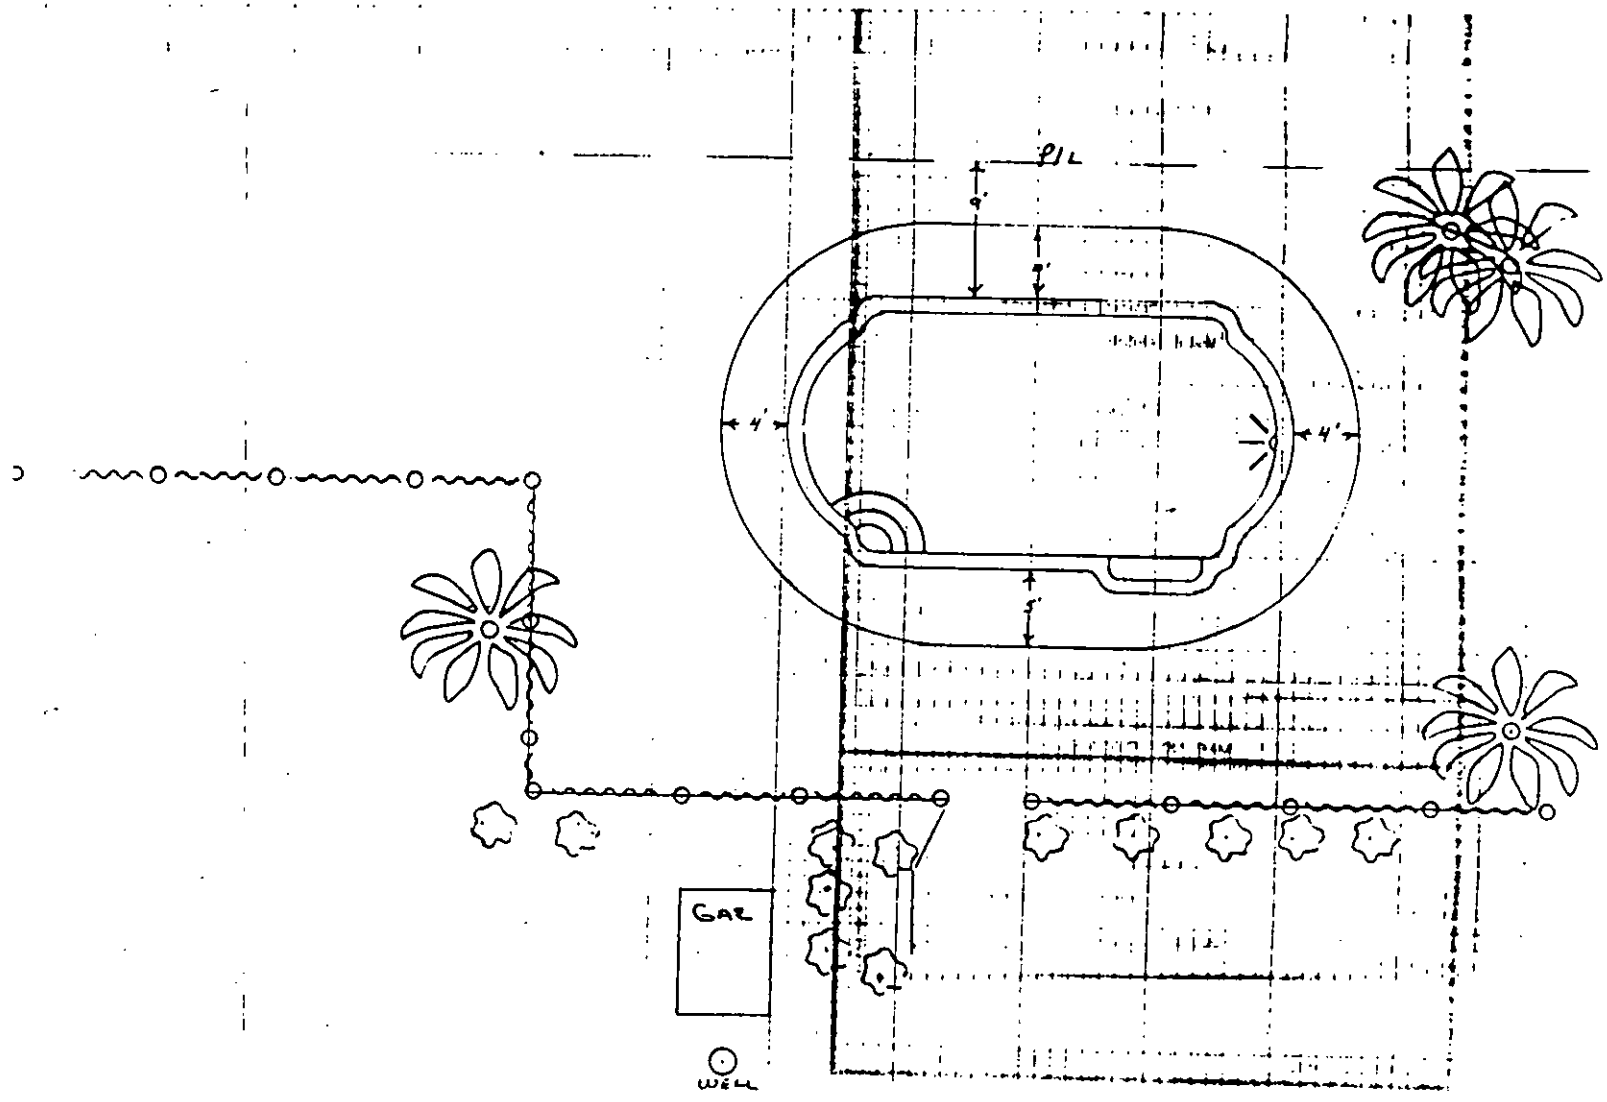
P/L
4'
4'
GAS
WELL


Date Received 3-21-94 Application No. 5647

(101181) QS T.O. No. 217-021-50

MECKLENBURG COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH

Application to Construct, Install, Extend or Modify a Bathing Facility

The owner of that property described hereinafter hereby applies to the Mecklenburg County Health Department for a permit to:
1) ✓ Install or Construct 2) ___ Extend or Modify a Bathing Facility.

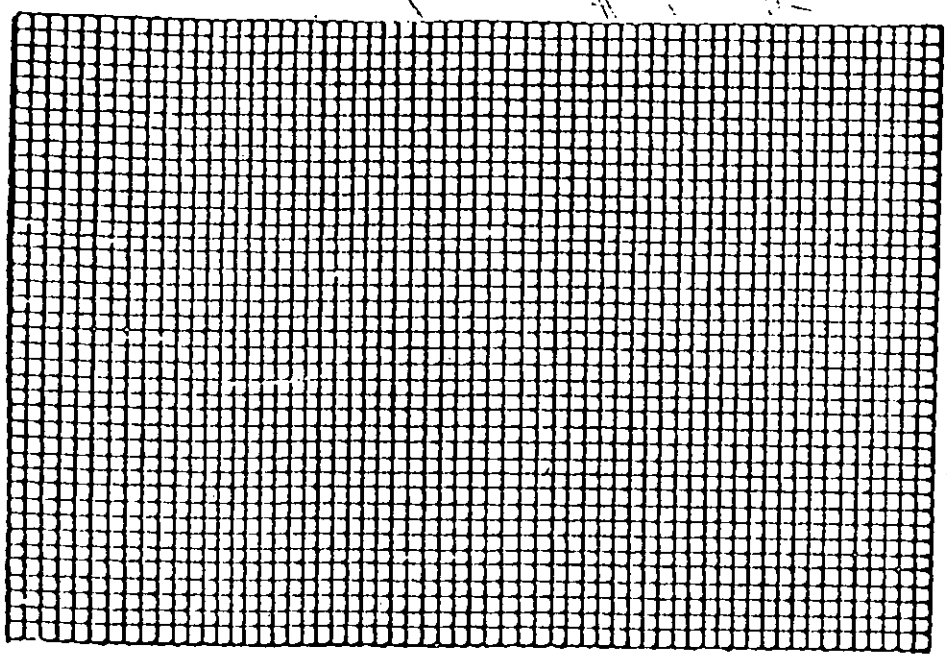

PLOT PLAN (ACCURATELY DIMENSIONED)

3) Public ___ 4) Residential ✓
5) Community Served:
___ Fitness/Athletic Club
___ Single Family Homes
___ Institution
___ Swim Club
___ Apartments
___ Condominium
___ Hotel/Motel
6) Type of Pool:
✓ Swimming Pool
___ Diving Pool
___ Spa (Whirlpool)
___ Wading (Baby) Pool
Other (Spec.) ___
7) Number of people served ___
8) Pool surface 410 Ft²
Deck surface 440 Ft²
Average Depth 4 Ft.
9) Volume 12,600 Gallons
10) Water: ___ Municipal ✓ Well
Other (Spec.) ___
11) Sanitary Sewerage:
___ Municipal sewer
Other (Spec.) Septic
12) Backwash wastewater:
___ Sanitary sewer
___ Settling tanks
Other ___
13) Barrier: Type WOOD
Height of barrier 4 Ft.
14) ✓ Self-closing Gates
15) Drawings provided:
✓ Site layout
___ Surface view of pool
___ Cross-section of pool
___ Equipment room
___ Equipment schematic
___ Toilet/Restroom
___ Bathhouse

16) NAME OF OWNER LARRY W. & KAREN J. HARMON
17) ADDRESS OF OWNER 15532 Youngblood Rd., Charlotte NC 28278
18) PHONE: HOME (704) 588-3080 OFFICE (704) 588-6538

19) FACILITY LOCATION 15532 YOUNGBLOOD RD CHARLOTTE NC
street address
20) NAME OF CONTRACTOR STAR POOL & SPA, INC.
21) ADDRESS OF CONTRACTOR 3327 BLUE JAY PASS FORT MILL, SC 29715
22) PHONE: HOME 800-526-7827 OFFICE 548-5534

23) SUBDIVISION ___ LOT NO. ___
24) NAME OF COMPLEX (PUBLIC) ___

The undersigned person hereby agrees that the contents of this application are true. It is understood that a permit applied for herein shall be void and of no effect if any of the above facts are not true.

3-21-94
date of application

OWNER Karen J. Harmon

Rev 7/89


Date Issued 19850 8/23/83 Serial No. 6549 ICAR(S) Permit No. 19850

T.C No 217-021-50

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, ____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 19850, dated 8/23/83 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 9/23/83, after which date this permit shall be null and void.

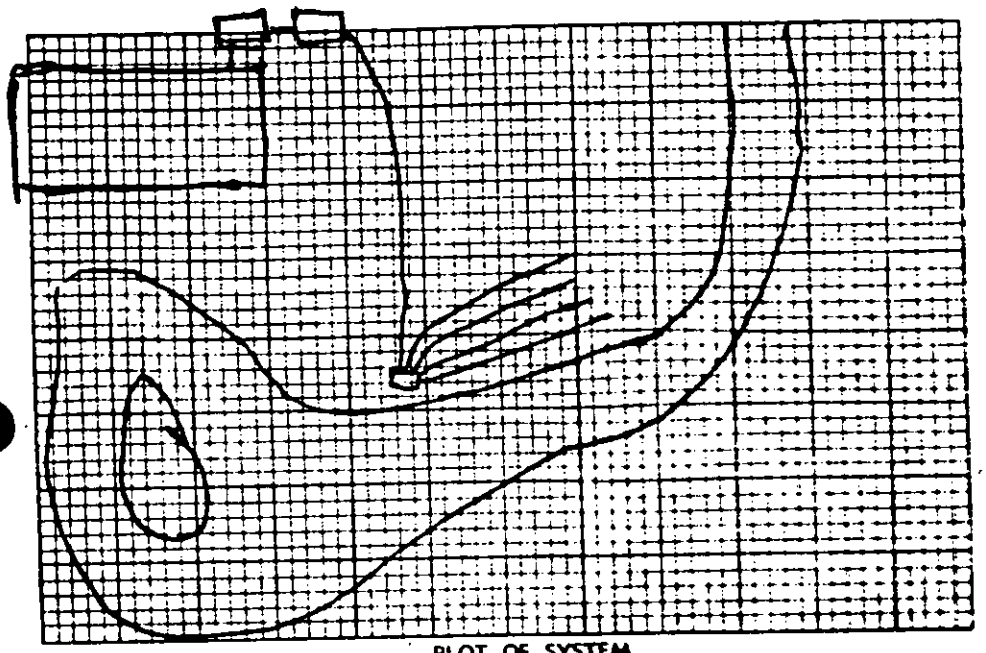

PLOT OF SYSTEM

Permeability Rate PS

Liquid Capacity of Tank 1500 + 1000 gal

Tank Construction RC concrete

Absorption and/or Nutrification Lines:

Total Line Length 400'

Number of Lines 4

Distance from House >10 >5'

Distance from Property Line >10'

Distance from Well 100'

NAME OF OWNER Price John A.

LOCATION OF PROPERTY ~~3532~~ Sandy Porter 15532 Youngsville Rd

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

Comments: 4 3' wide x 100' long 12" stone trench lines 2 feet effluent pipes 20' below x 2 stops

Division or Section Head

Environmentalist Sandy C Poole RS

* If this permit is for the installation or construction of a new system, it must be signed by the division or section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.