C of A (s) No. 21866

Date Issued 10/21/05 **Serial** 7984 T. C. No. 135-321-06 PO OK T

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Outen (LAST) Billy (FIRST) Jack (MIDDLE)

Location of Property 11215 Idlewild Road

Application Number 21866 Permit Number 21866

Inspection Date:

Liquid Capacity of Tank 1500 Gal Tank Material RCC

Total Length of Drain Tile 400' Number of Lines 4

Depth of Filter Material 12" Cover Depth 3'-4'

Water Supply Source well Distance from Water Source stay 100'

Excavation Inspected 10/18/05; 10/21/05 (DATE) Tank Inspected 10/18/05 (DATE)

Nitrification Field Inspected 10/18/05; 10/21/05 (DATE)

Washing Machine Line Inspected, If Applicable _____ (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ✓ installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments 1965, 1000ST, CN 120 x T, 120, LOG

Cynthia G Bass
Environmentalist

EHD-5-76

Environmental Health Department's Copy

Serial No. 08434

Date Issued 8/27/85


ICAR(S) Permit No. 21866

T.P.C. No. 135-521-06

Map Date L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, ___ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 21866, dated 2/25/85 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 9/28/85, after which date this permit shall be null and void.

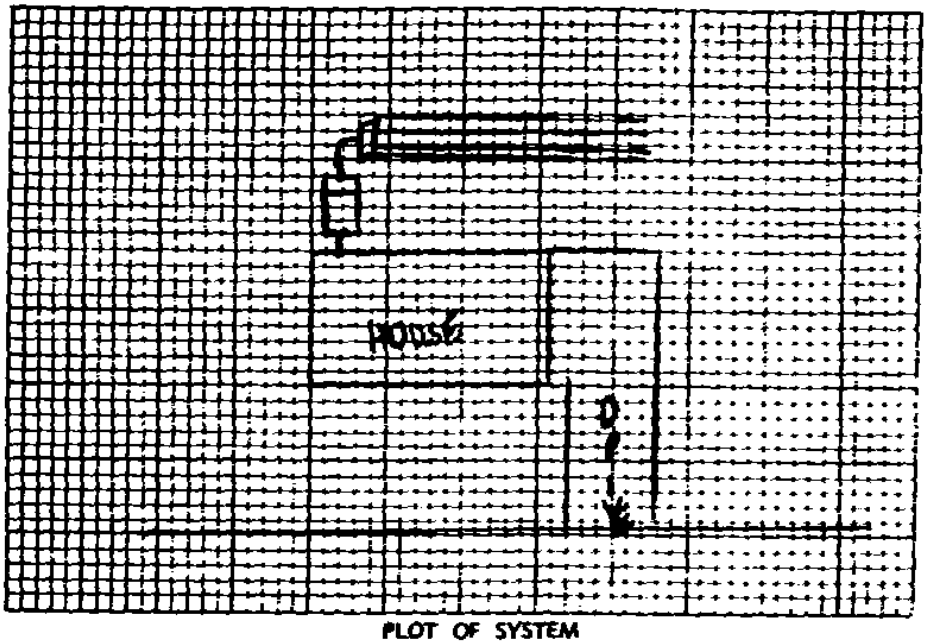

PLOT OF SYSTEM

Permeability Rate PS

Liquid Capacity of Tank 1500 gal

Tank Construction PCC

Absorption and/or Nitrification Lines

Total Line Length 400'

Number of Lines 4

Distance from House 5'

Distance from Property Line 10'

Distance from Well Stay 100'

NAME OF OWNER Outen Billy Zack

LOCATION OF PROPERTY 11215 Idlewild Road

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

4 Trenches 3'x 100'x 12" stone with gradeboards, straw as cover

Comments:

B Hamilton
Division or Section Head

Cynthia G. Bass
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

Serial No. 8245

SIR No. 21866

Date Issued 3-4-85

T. C. No. PO 135-321-06

Map Date L CRT

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

[redacted]

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER Outen, (LAST) Billy (FIRST) Zack (MIDDLE)

ADDRESS OF OWNER 3218 Valley Grove Rd., Charlotte, NC ZIP 28212

LOCATION OF LOT 11215 Idlewild Road (STREET OR COUNTY ROAD)

SUBDIVISION _____ LOT NO. _____ BLOCK NO. _____

MAP BOOK NO. _____ PAGE NO. _____

The above specified lot is approved by the Mecklenburg County Department of Environmental Health for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the soil investigation, on an on-site inspection of the said lot; and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 21866. This approval is subject to the following terms and conditions:

1. That the nitrification field be installed, constructed, altered and/or repaired in the same area where the soil investigation was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altered, and/or repaired and that the system be installed in accordance with same.

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic-tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration, and/or Repair Permit.

Cynthia G Sass
Environmentalist

[redacted]
Environmental Health Director, or Authorized Section Head

BHD-5-74

Environmental Health Department's Copy

Date Received 9-25-85

RECEIVED
FEB 1985

Application No. 31866

PO T.C. No. 135-321-06


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ✓ Install or Construct 2) Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge

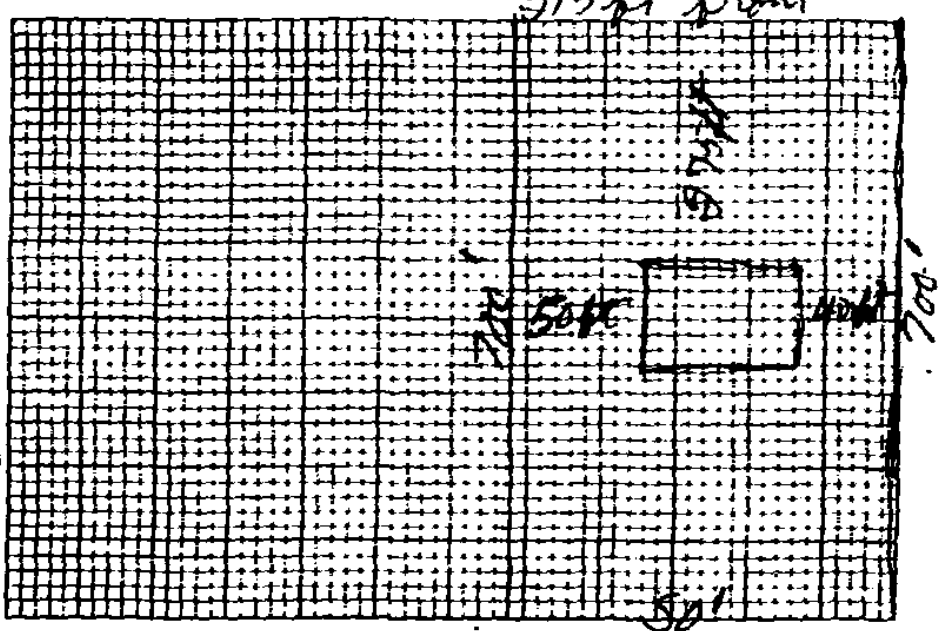

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes ✓ No
Residence ✓ Yes ___ No
4. No of Bedrooms 3
5. Business Use — Max No Employees ___
6. Washing Machine ✓ Yes ___ No
7. Garbage Disposal ___ Yes ✓ No
8. Dishwasher ✓ Yes ___ No
9. Water Supply
A. Individual Well ✓
B. Governmental System ___
C. Community System
1 Well source ___
2 Governmental source ___
10. Sewage System
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No
11. FHA Case No ___
12. VA Case No. ___

13) NAME OF OWNER Oates (LAST) Billy (FIRST) Zack (MIDDLE)

14) ADDRESS OF OWNER 3918 Valley Grove Rd

15) PHONE NO. Home 537-6561 Office ___

16) LOCATION OF SYSTEM 11315 Derrington Rd (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No ___ Block No. ___

Map Book No. ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

DATE OF APPLICATION

Billy Jack Oates
OWNER

EHD-5-76

SIR No. [illegible]

T. C. No. PO 135-321-0[illegible]

Map Date [illegible]

Serial No. 6110

Date Issued 3-4-85


MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
SOIL INVESTIGATION REPORT

NAME OF OWNER Outen, (LAST) Billy (FIRST) Zack (MIDDLE)

ADDRESS OF OWNER 3218 Valley Grove Rd., Charlotte, NC ZIP 28212

LOCATION OF PROPERTY 11215 Idlewild Road (STREET OR COUNTY ROAD)

SUBDIVISION LOT NO. BLOCK NO.

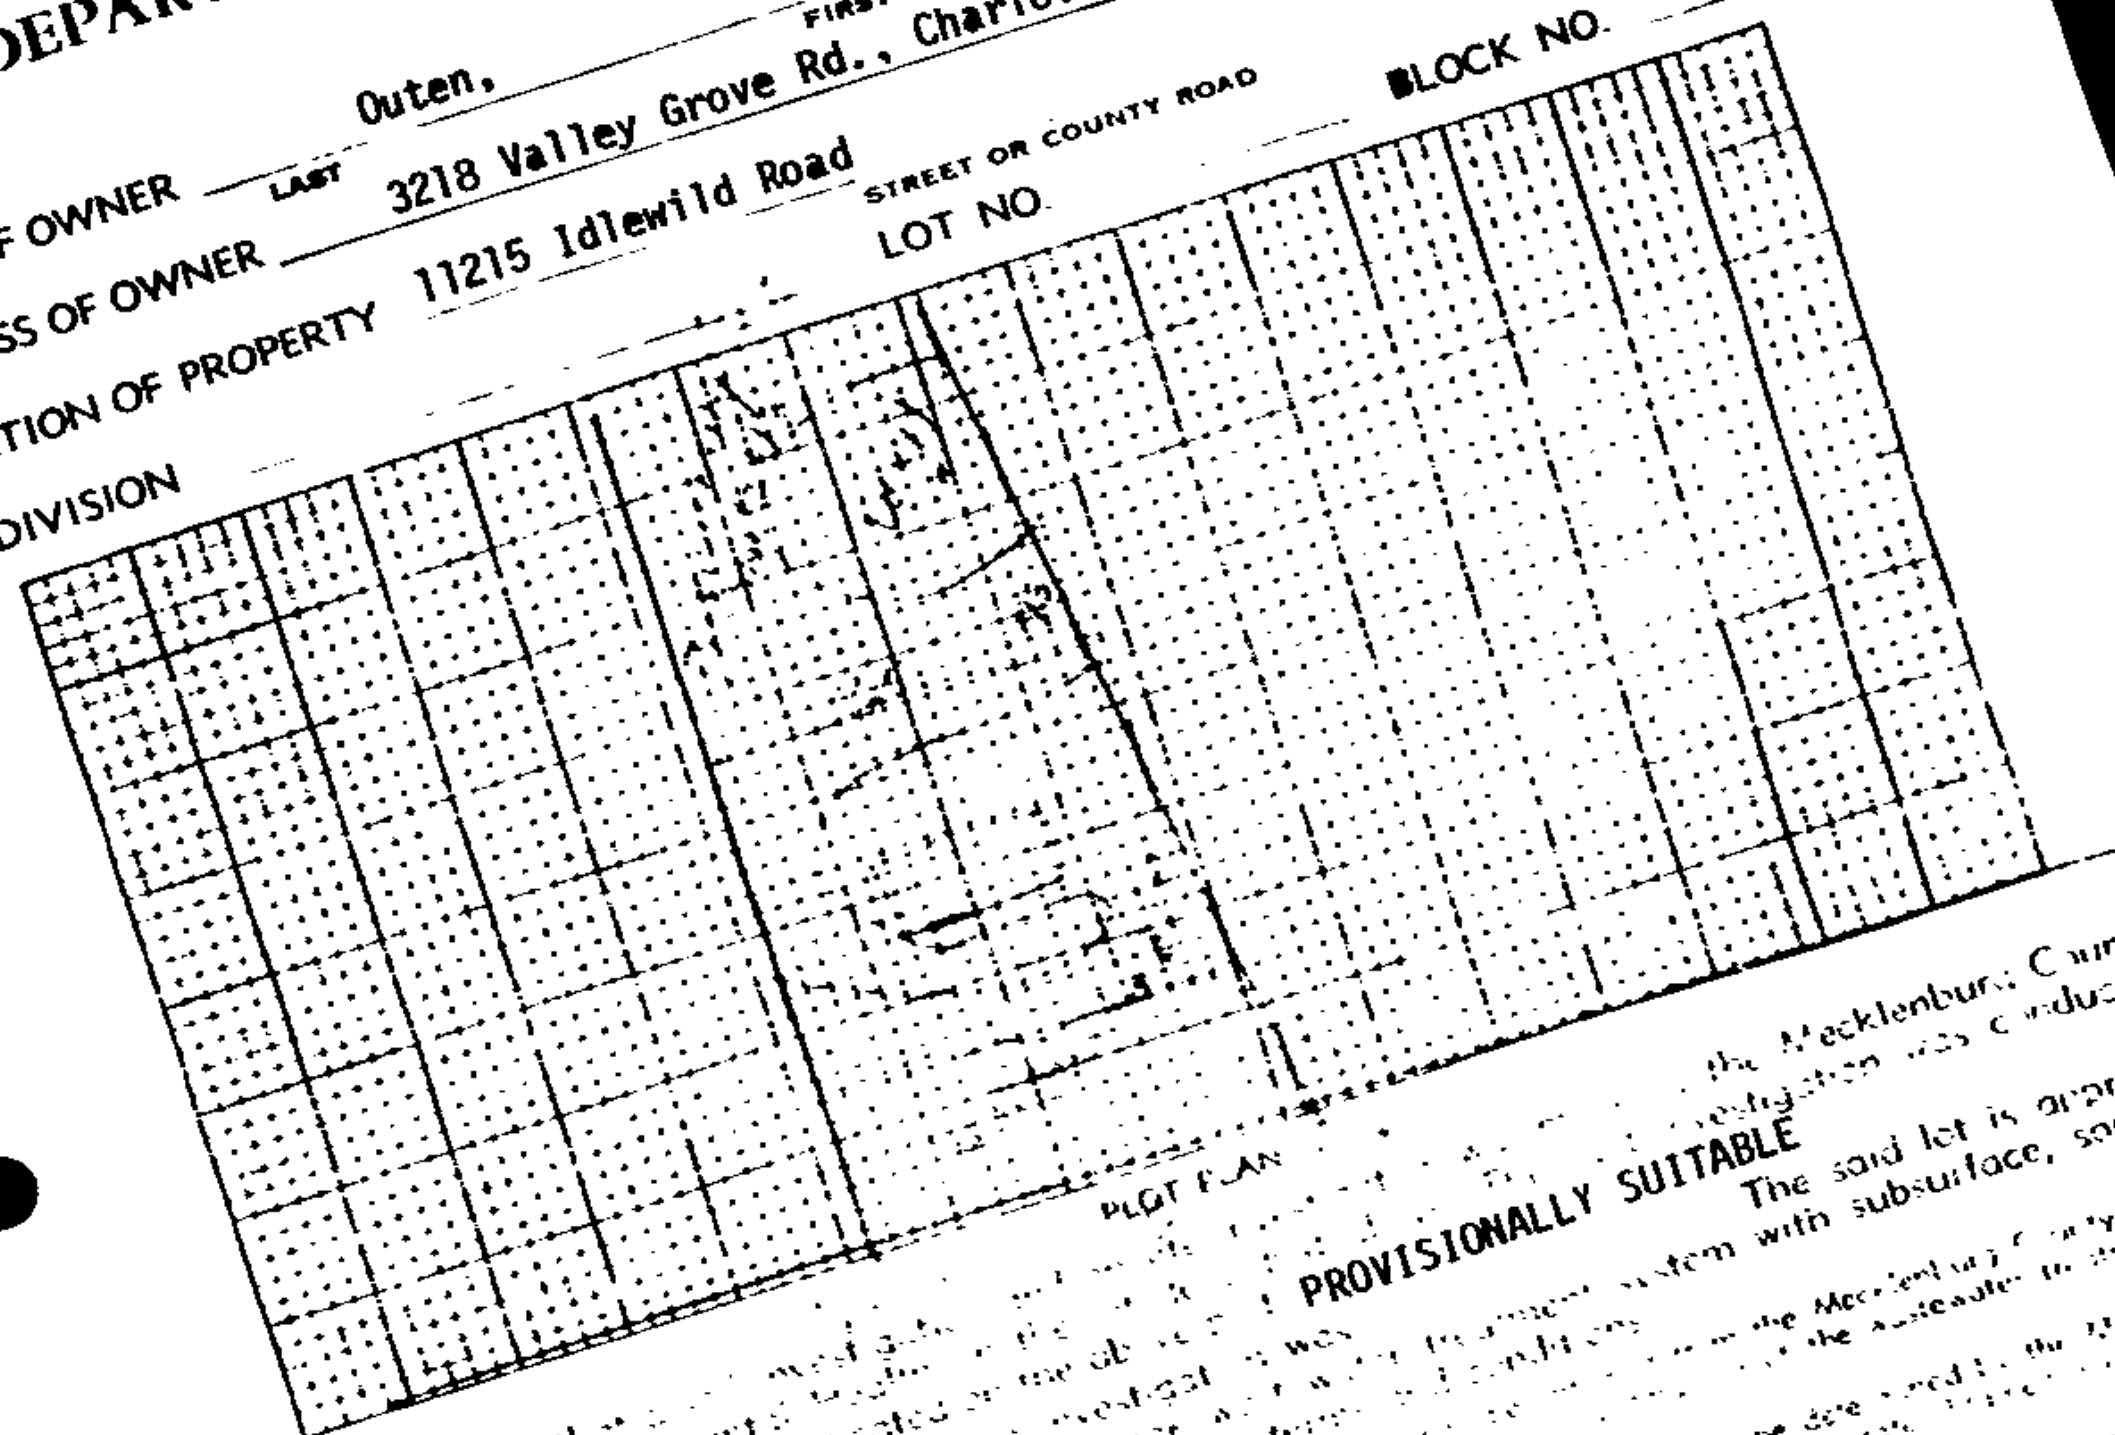

PLOT PLAN

This is to certify that [illegible] the Mecklenburg County Department of Environmental Health [illegible] investigation was conducted on that portion of the lot as indicated on the above [illegible] was **PROVISIONALLY SUITABLE**. The said lot is approved. The permeability rate determined by [illegible] system with subsurface, soil ab[sorption] [illegible] for the installation of an individual [illegible] the Mecklenburg County Department [illegible] effluent discharge subject to [illegible]

[illegible]

This approval is granted based on [illegible] rules and regulations of the North Carolina [illegible] Department of Health Services and the Mecklenburg County Health Commission [illegible] void if at any time in the future, prior to completion of the system, these [illegible] regulations are changed such that this approval would not have been granted had the new rules and regulations been in effect on the issue date.

[signature] Soil Scientist

[signature] Environmental Health Director or Authorized Section Head

Environmental Health Department's Copy

EHD-5-76

DEPARTMENT OF ENVIRONMENTAL HEALTH
MECKLENBURG COUNTY, NORTH CAROLINA

SITE EVALUATION

S.I.R. NO. 21766

T.C. NO. P. 0 135-321-06

(Ground Absorption Sewage Disposal)

OWNER: [illegible]
ADDRESS: [illegible]

PLAT NO:
LOT SIZE: 2 A

LOCATION OF SITE: [illegible]

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	S PS 2-6 U	S PS 2-6 U	S PS U	S PS U
2. SOIL TEXTURE (12-36 inches) Sandy, Loamy, Clayey (Note 2-1 Clay)	S PS U	S PS U	S PS U	S PS U
3. SOIL STRUCTURE (12-36 inches)	S PS U	S PS U	S PS U	S PS U
4. SOIL DEPTH (inches)	S PS U	S PS U	S PS U	S PS U
5. RESTRICTIVE HORIZONS (Inches) (Impervious strata, Rock)	S PS U	S PS U	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (external and internal)	S PS U	S PS U	S PS U	S PS U
7. OTHER (Specify)	S PS U	S PS U	S PS U	S PS U
8. SOIL GROUP				
9. SITE CLASSIFICATION				
10. SOIL SERIES				

S - Suitable PS - Provisionally Suitable U - Unsuitable

**See Diagram on Back (includes: soil areas, property lines, roads, streams, gullies, wet areas, fill areas, wells, water bodies, slopes)

Recommendations/Comments:

Described by: [illegible]
Title: Soil Scientist

Date: 3-1-85

4

Date Received 9-1-85

RECEIVED
SEP - 1985
ENVIRONMENTAL HEALTH

SIR No. 21866
TPO No. 135-321-06
Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER Outen (LAST) Billy (FIRST) Zack (MIDDLE)

2) ADDRESS OF OWNER 3218 Valley Grove Rd ZIP 28214

3) PHONE NO. Home 537-6561 Office Wages office 11- 554-2012


4) LOCATION OF PROPERTY Idlewild Rd (STREET OR COUNTY ROAD)

5) SUBDIVISION _____ LOT NO. _____ BLOCK NO. _____

MAP BOOK NO. _____ PAGE NO. _____

6) DEED REFERENCE DEED BOOK _____ PAGE NO. _____

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge

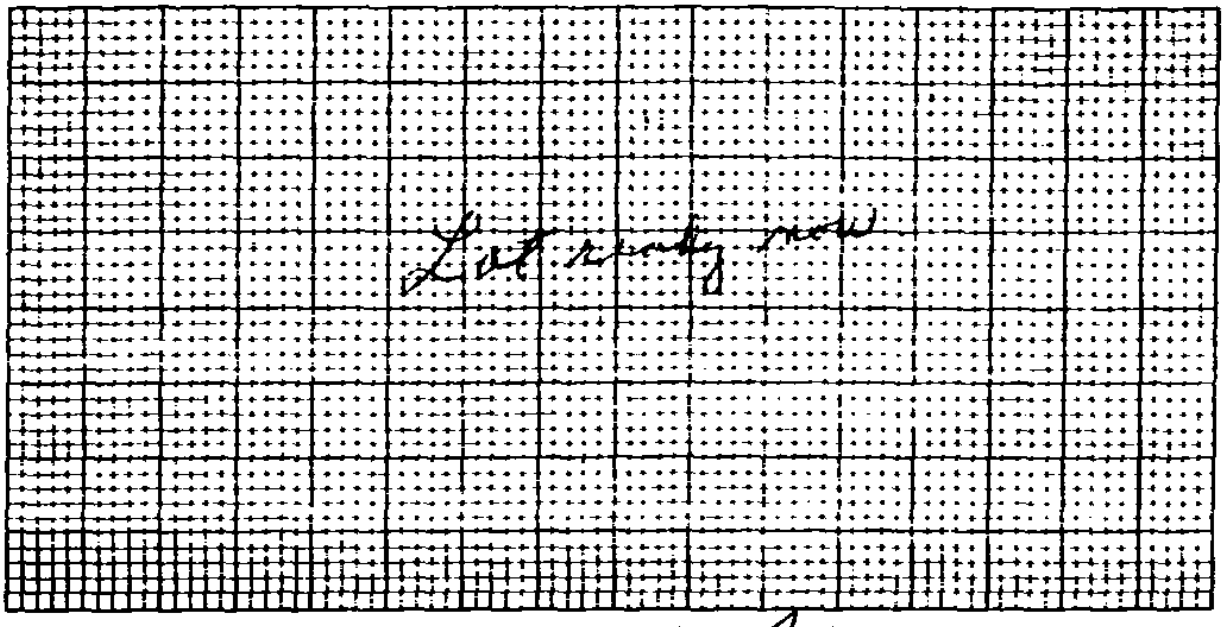

7) ACCURATELY DIAGRAM & DIMENSION LOT

Billy Jack Outen
OWNER

EHD-5-76

Environmental Health Department's Copy