Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

2007 Anderson BK

GWS File #: 30093 WASPS App #: 4150

Primary ES assigned to project: DJ

Secondary ES assigned to project:

Project Type: New System ☐ Alteration ☑ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☐	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: _____

OP issued date: _____

Review performed by: _____ Date performed: _____

JPM

8009B

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

4150

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. **SEPTIC / TYPE APPLICATION:** ☐ N/A ☐ NEW SYSTEM ☒ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ☐ N/A ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. **JOB LOCATION INFORMATION:**

TAX PARCEL NUMBER: 033-103-03
STREET ADDRESS: 6510 PLEASANT GROVE
CITY: CHARLOTTE
STATE: NC ZIP: 28216
SUBDIVISION NAME:
LOT #: LOT SIZE (acres):
TOWNSHIP:

☒ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☐ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. **BUILDING INFORMATION:**

BUILDING TYPE:

☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☒ HOUSE ☐ OTHER _____

HEATED SQUARE FOOTAGE: 1800
NUMBER OF BEDROOMS: 2
NUMBER OF OCCUPANTS: 3
FOUNDATION TYPE:

☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☒ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: 1 NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: NONE

6. **WATER SUPPLY:** ☐ MUNICIPAL ☒ PRIVATE WELL ☐ PUBLIC WELL ☐ SHARED WELL ☐ OTHER _____

7. **PROPOSED USE OF WELL:** ☐ N/A ☐ IRRIGATION ☐ POTABLE (DRINKING WATER) ☐ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED):*

☐ N/A ☐ ANY TYPE ☑ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. **RANK:** 1 3 4 2 5

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☑ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☑ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☑ YES	☐ NO	JURISDICTIONAL WETLANDS	☐ YES	☑ NO
WELLS, SPRINGS, OR WATER LINES	☑ YES	☑ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES	☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☑ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES	☑ NO
CHEMICAL/PETROLEUM STORAGE TANKS	☐ YES	☑ NO	KNOWN UNDERGROUND CONTAMINATION	☐ YES	☑ NO
WASTE STORAGE	☐ YES	☑ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	☐ YES	☑ NO

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____ ☐ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☐ N/A

12. **PROPERTY OWNER:**

NAME: RICHARD ROLLINS
ADDRESS: 6510 PLEASANT GROVE
CITY: CHAR
STATE: N.C. ZIP: 28216
HOME PHONE: ~
WORK PHONE:
MOBILE PHONE: 704-281-5048
FAX:

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**

NAME: J. SHOAF
ADDRESS: 6032 JIM KIDD RD
CITY: HUNTERSVILLE N.C.
STATE: N.C. ZIP: 28078
HOME PHONE: 704-895-1413
WORK PHONE: 704-201-2260
MOBILE PHONE: 201-2260
FAX:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 7/1/08

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring. J.L.B. (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below.

Jerry L. Blake
Property Owner's or Owner's Legal Representative Signature

4-14-2009
Date

OFFICE USE ONLY

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEES RECEIVED: $ 200.00 / chk 1094 DATE FEE RECEIVED: 4/14/09

WELL APPLICATION FEES RECEIVED: $ _____ DATE FEE RECEIVED: _____


APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: 80096

APPLICATION ID NUMBER ASSIGNED: 4150

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

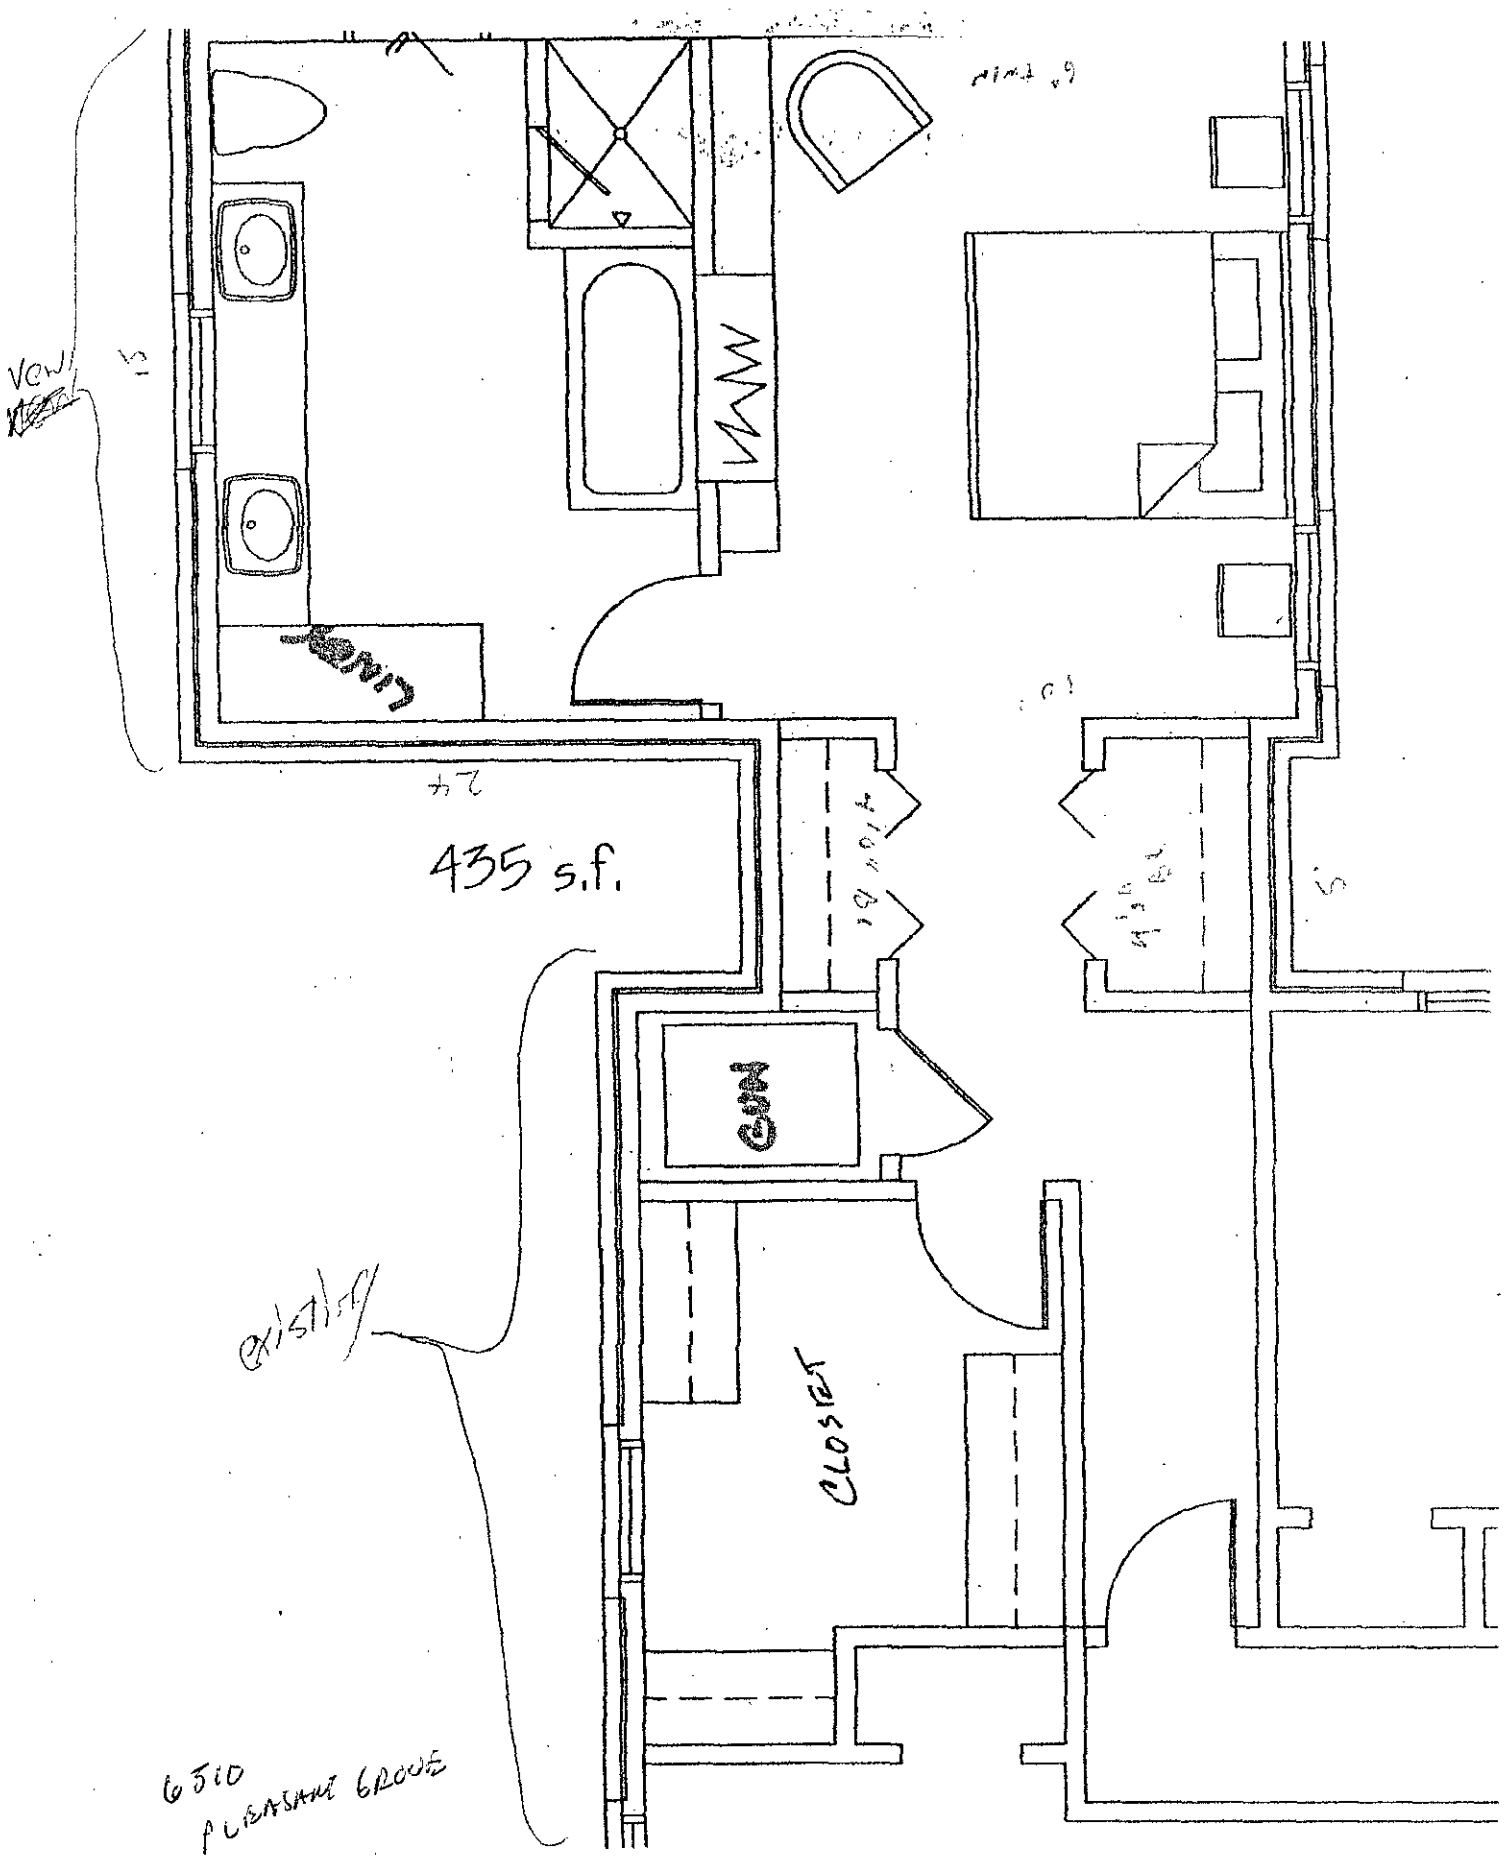

1/4" = 1'-0"

Richard Rollins
(704) 281-5048

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Page 1
Property ID: 3310303
Lot #:
File #: 8009B
AppID: 4150

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Richard N. Rollins
Applicant: J.L. Shope Construction
Address: 6510 Pleasant Grove Road
Date Evaluated: 4/16/09
Proposed Facility: residence
Design Flow (.1949) 360 GPD
Property Size: 1.57 acre
Location of Site: 6510 Pleasant Grove Road
Property Recorded:
Water Supply: [ ] Public [x] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [ ] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941 1941 Structure/ Texture	1941 Consistence, Mineralogy	PROFILE FACTORS b 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
1	LS	0-2	GR/SCL	FR/SS/SP/SEXP	>30" TO SOIL WETNESS	30	NA	NONE	US
	6%	2-15	ABK/SBK C	FI/S/P/SEXP					
		15-30	M/C	FI/VS/VP/EXP					
2	LS	0-3	GR/SCL	FR/SS/SP/SEXP	>43" TO SOIL WETNESS	>43	NA	NONE	PS, IV
	7	3-43	SBK/C	FI/S/P/SEXP	BORING TERMINATED				0.3 GPD/FT2
					BY A ROOT @ 43"				
3	LS	0-4	GR/SCL	FR/SS/SP/SEXP	>44 TO SOIL WETNESS	44	NA	NONE	PS, IV
	7	4-44	SBK/C	FI/S/P/SEXP					0.3 GPD/FT2

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	III g	III g
Site LTAR	0.3	0.3


Other Factors (.1946):
Soil Evaluation By: Jeremy Michelone, R.S.
Others Present:
Site Classification (.1948): PS
Site Evaluation By: Jeremy Michelone, R.S
Others Present:

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

6510 Pleasant Grove Road
File #6510 B
Permit #4150

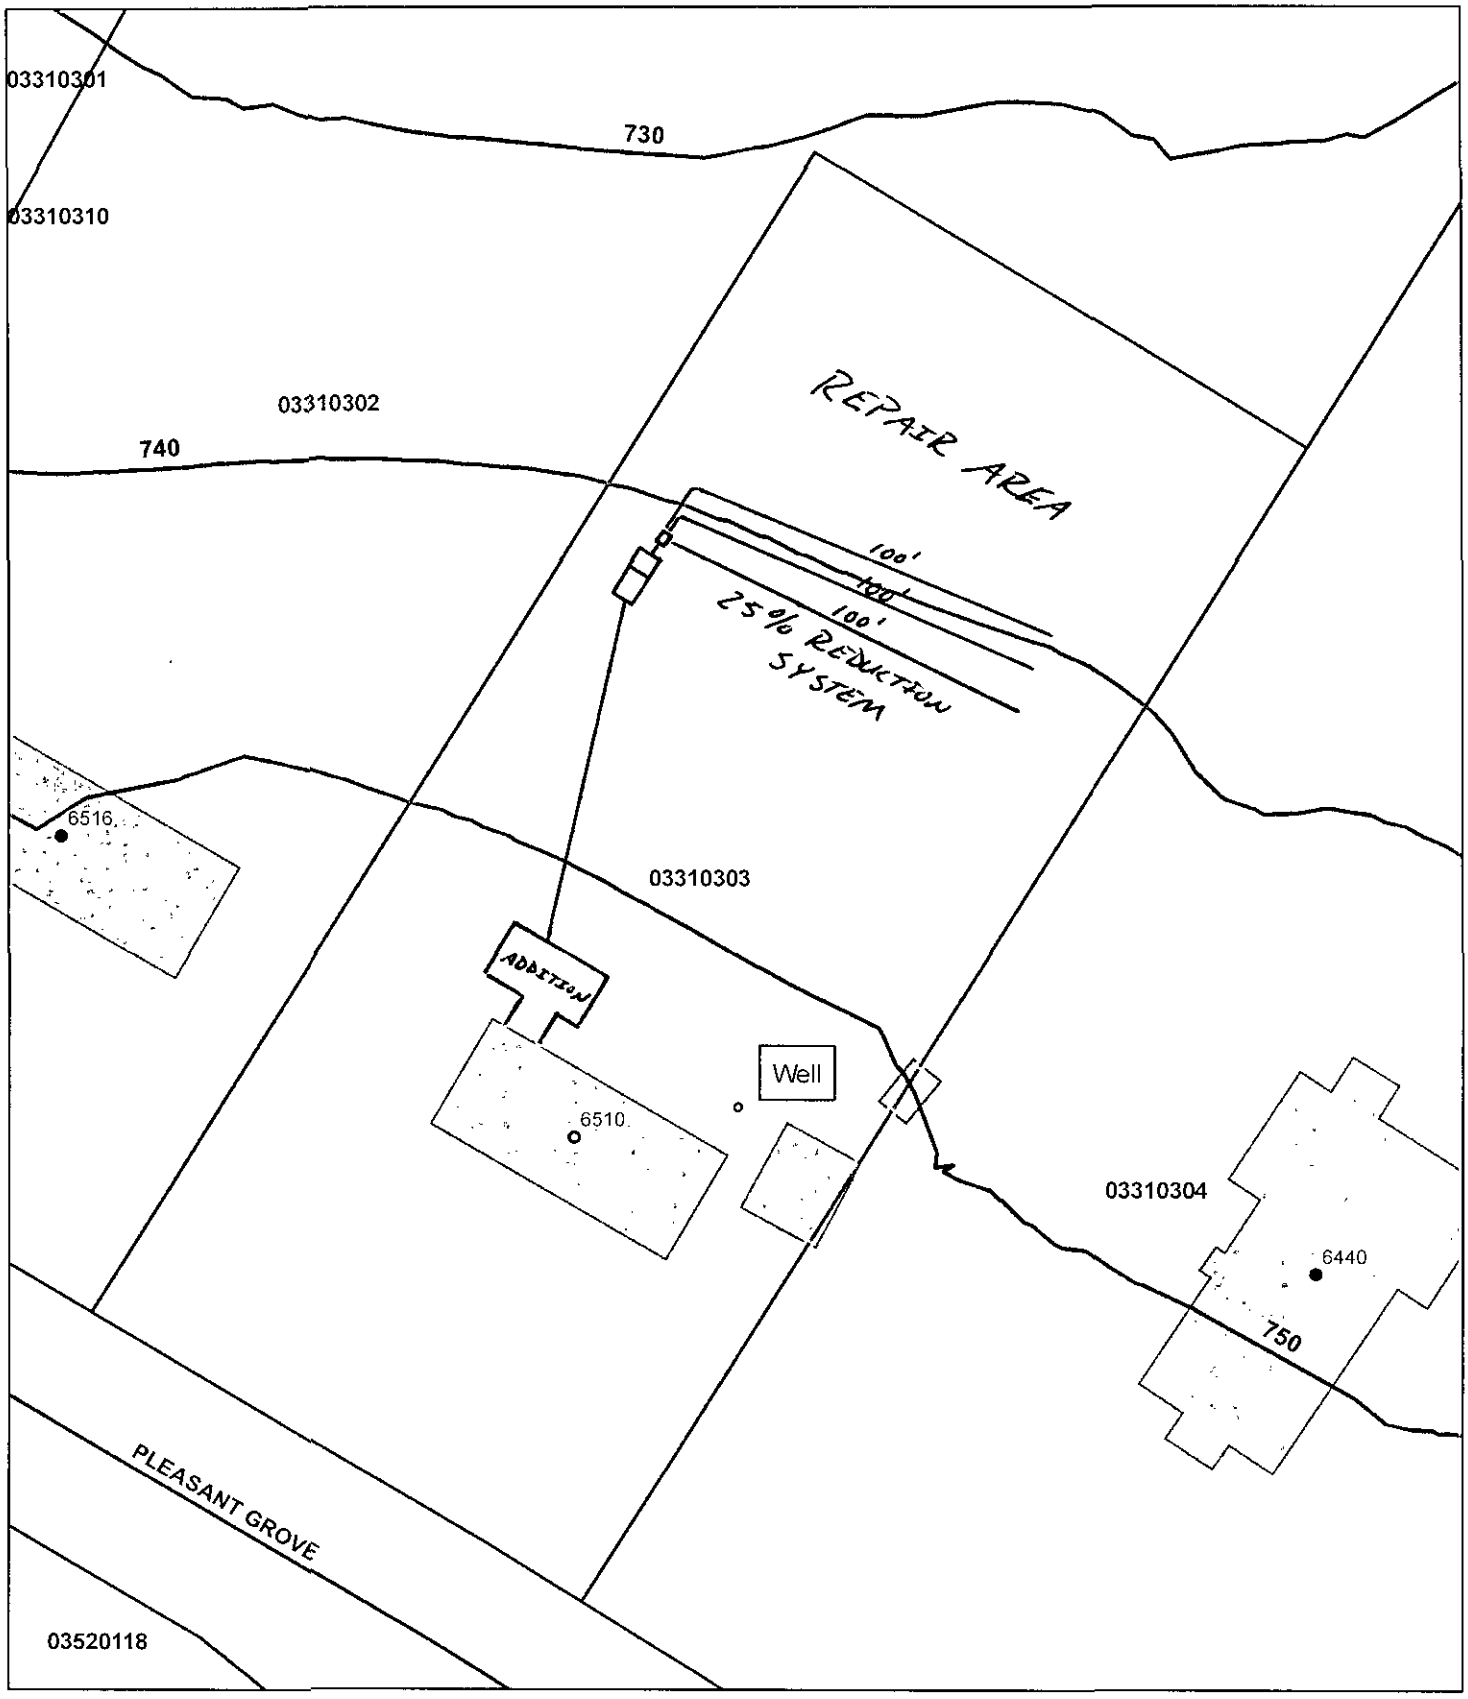

Jeremy Michelone, R.S.
4/17/09

0 25 50 100 Feet

CONDITIONS OF IMPROVEMENT PERMIT for an ALTERATION TO AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit Number: 8009B Tax Number: 03310303

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

0.3 Long-term acceptance rate (GPD/ft^2)	360 Max gallons/day wastewater flow	900 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☒ Yes ☐ No	1500 Gallon septic tank	300 Total trench length (ft)	27 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
3 Bedrooms in residence	NA Gallon pump tank	12 Depth of media (in)	

Any surface water present: NO Type: Minimum separation distance (ft):

Additional conditions: **Properly abandon existing septic system. Install a new 1500 gallon septic tank and 300 TLF drain field**

Repair Area System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

900 Absorption Area (ft^2) 300 Total trench length (ft)	12 Depth of media (in)	9 Trench spacing (min. on centers) (ft)	27 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation Approval is granted by this Department.

*** This Improvement permit is transferable.

DENR Authorized Agent Date 4/17/09

Owner/Agent Signature Date

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FEE: 100.00
DATE: 4/9/09
CRT [ ]

556579

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM
MECKLENBURG COUNTY - GROUNDWATER & WASTEWATER SERVICES
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

GWS – UES.APP 06/07

FILE #: 8009B

JPM

TYPE APPLCATION:
- [X] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A / M)
- [ ] ADDITION - RENOVATION OR GARAGE WITH NO MAJOR CHANGES (X)
- [ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
- [ ] COMMERCIAL OR INDUSTRIAL (N)

PERSON FILING APPLICATION:
NAME: J.L. SHOPE CONST
ADDRESS: 6032 JIM KIDD RD
CITY: HUNTERSVILLE
STATE: N.C ZIP: 28078
PHONE: 201-2240
ALTERNATE PHONE: 704-875-1443

PROPERTY OWNER:
NAME: RICHARD ROLLINS
ADDRESS: 6510 PLEASANT GROVE RD
CITY: CHAR
STATE: N.C ZIP: 28213
PHONE: 704- 281-5048
ALTERNATE PHONE:

JOB LOCATION INFORMATION
TAX/PARCEL #: 033-103-03
STREET ADDRESS: 6510 PLEASANT GROVE RD
CITY: CHARLOTTE
STATE: NC ZIP: 28213
SUBDIVISION OR MOBILE HOME PARK NAME:

TOWNSHIP:
- [ ] 0-MECKLENBURG
- [x] 1-CHARLOTTE
- [ ] 2-DAVIDSON
- [ ] 3-CORNELIUS
- [ ] 4-PINEVILLE
- [ ] 5-MATTHEWS
- [ ] 6-HUNTERSVILLE
- [ ] 7-MINT HILL

LOT #: BLT 1956 # of bedrooms to remain the same

WATER SUPPLY:
- [ ] MUNICIPAL (M)
- [ ] COMMUNITY (C)
- [x] PRIVATE WELL (P)
- [ ] SHARED WELL (S)
- [ ] OTHER 'SPRINGS' (O)

RESIDENTIAL PROPERTY TYPE:
- [X] HOUSE (H)
- [ ] MODULAR HOME (M)
- [ ] MULTIPLE FAMILY (U)
- [ ] SINGLE MOBILE HOME (S)
- [ ] DOUBLE WIDE (D)
- [ ] OTHER (O)

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 3

COMMERCIAL / INDUSTRIAL PROPERTY TYPE:
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? [ ] YES [ ] NO
UNDERGROUND STORAGE TANKS? [ ] YES [ ] NO

ADDITION TYPE ATTACHED TO EXISTING STRUCTURE:
- [X] BEDROOM
- [X] BATHROOM
- [ ] KITCHEN
- [ ] DINING ROOM
- [ ] LIVING ROOM
- [ ] DEN
- [ ] GARAGE
- [ ] SUNROOM
- [ ] PORCH
- [ ] DECK
- [ ] OTHER

ADDITION TYPE DETACHED FROM EXISTING STRUCTURE:
- [ ] DETACHED GARAGE
- [ ] DETACHED GARAGE WITH PLUMBING
- [ ] POOL HOUSE
- [ ] SHOP
- [ ] BARN
- [ ] STORAGE SHED
- [ ] DETACHED PORCH / DECK
- [ ] OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Jerry L. Shope
Owner's/Agent's Signature

4-9-2009
Date

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted y this Department.
- This permit is not transferable.

- [ ] ADDITION / RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE
- [ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE

Use existing system denied.
Alternative permit needed
to be approved

EHS Signature

Date 4/15/09


Jerry Shope, RS.

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File # 8009B
Date_____

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

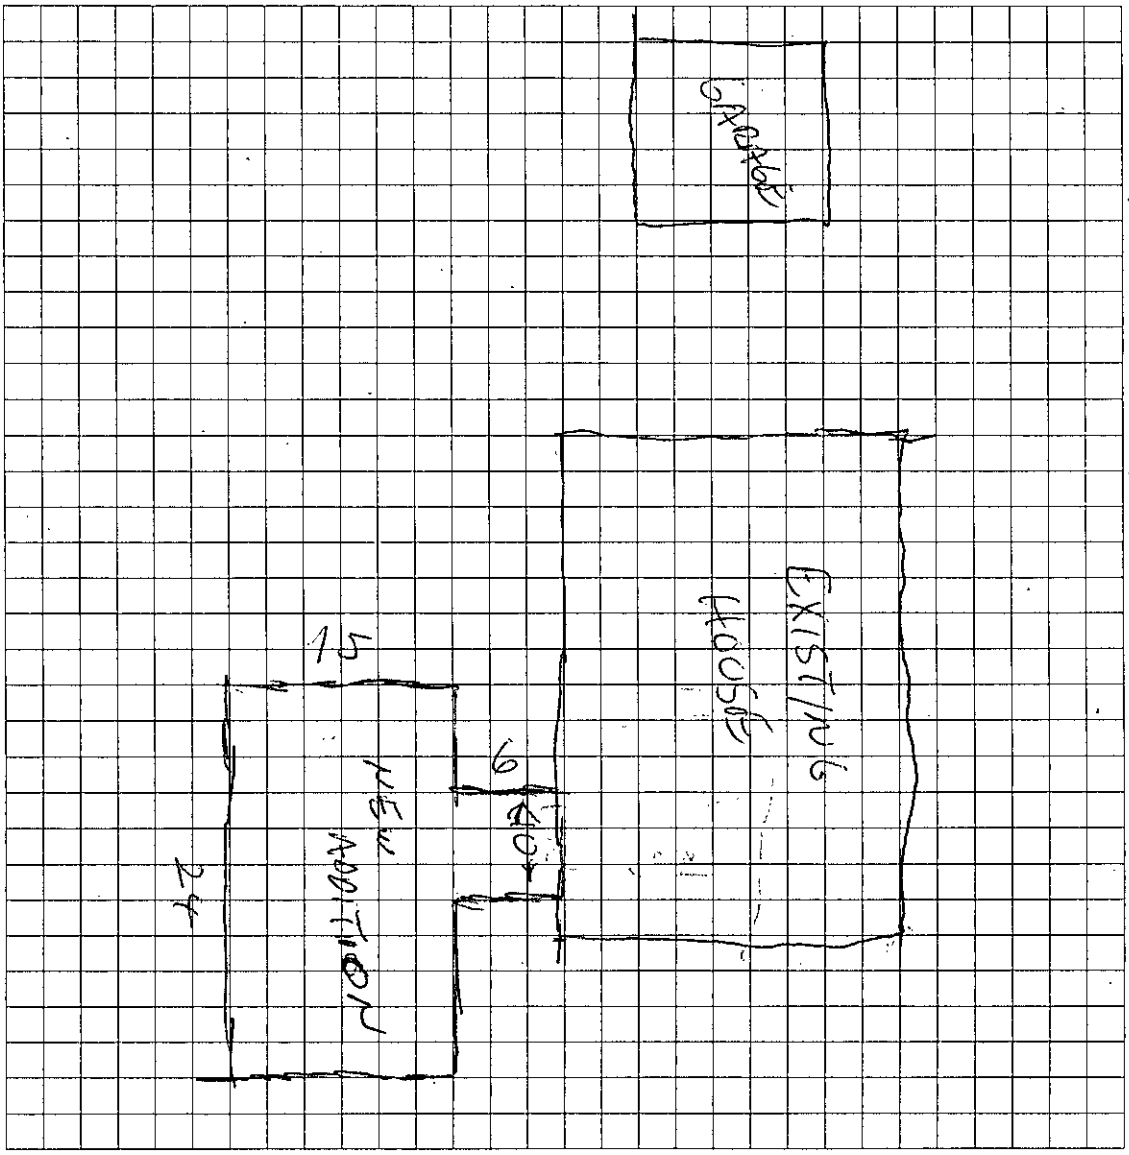

Owner/Agent Signature	J. T. Hope
Date	4 – 9 – 2009

LBC 12/15/04

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	04/09/09	**Amount:**	100.00
Receipt #:	62313	**Tendered:**	0.00
Check / Auth #:	VISA 556549	**Returned:**	0.00
Received By:	CRAIGGY		

Account Information

Account #: 200000
Contractor: JERRY SHOPE CONSTRUCTION
Attn:
Address: 6082 JIM KIDD RD
Address:
City/State/Zip: HUNTERSVILLE, NC 28078

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	MH Exc/Add/Repl w/o System Mod 6510 PLEASANT GROVE ROAD		1	100.00	100.00

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
1,250.00	10.00				