

4928 TUCKASEEGEE RD

05903111

5/29/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 6987 DATE: 4/11/00

TC: 059-031-11 ☒ L ☐ CRT

SERIAL Nº 18133

Name of Owner William Preston Hayes Juris.: _____

Address of Property 4928 Tuckaseegee Road

Inspection Data:

Tank Material existing

Total Length of Drainfield 250'

Number of Lines 2 @ 125'

Cover Depth 12"

Water Supply Source well


Distance to Water Source >50'

Excavation Inspected 4/11/00

Tank(s) Inspected existing

Wash Line Inspected NA

High Water Alarm Inspected NA

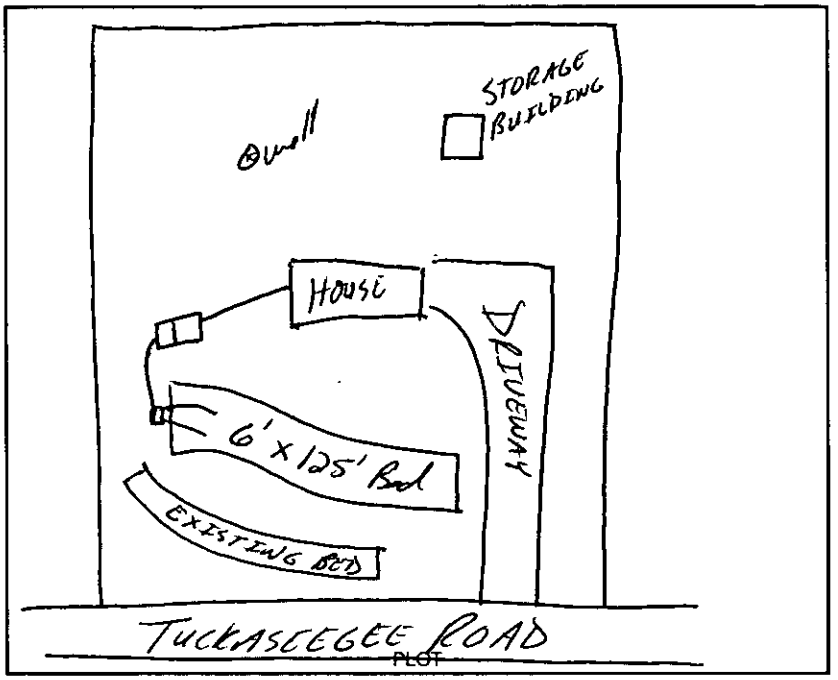

Design 2000, Repair, existing tank, 750 SFB, Type II CTR# Steve Autrey

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☒ altered or repaired

☐ in accordance with the permit issued ☒ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Repairs to existing system
Type II Conventional System
6' x 125' Bed (250 TLF)

Jimmy P. Nicholson
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 6987 DATE: 6/7/00

TC: 059-031-11 L

SERIAL Nº 18228

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 6/7/00. All work shall be completed on or before 7/7/00, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

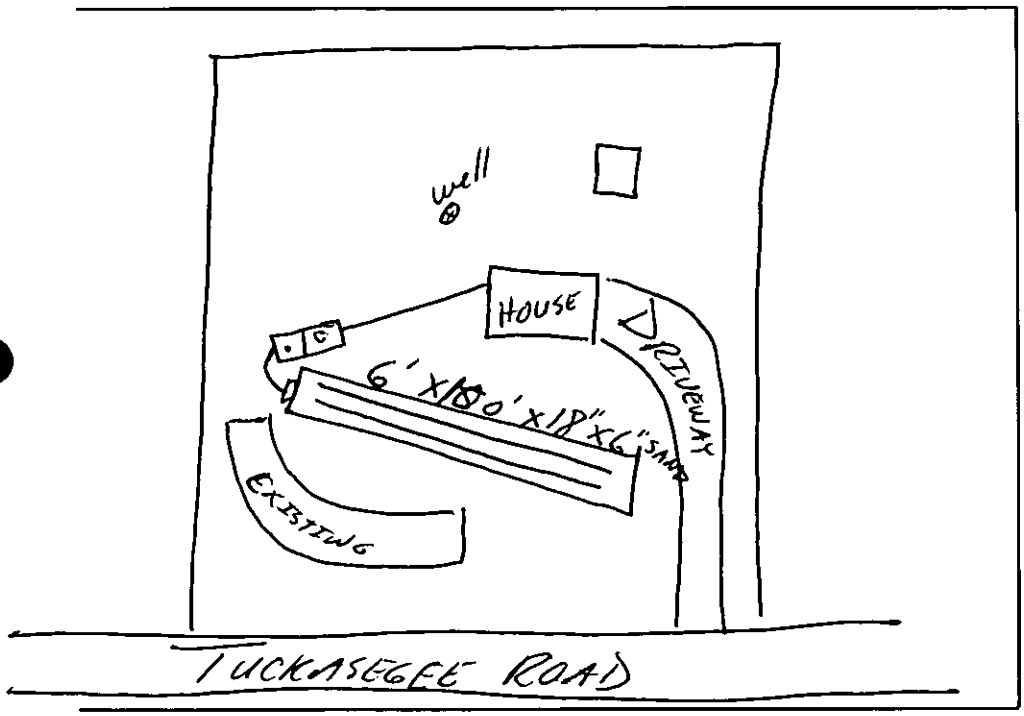

PLOT OF SYSTEM

Liquid Capacity of Septic Tank Existing gallons

Liquid Capacity of Dosing Tank NA gallons

Tank Construction existing

Trench Depth 36"

Absorption and/or Nitrification Lines:

Trench Width 6' x 100' feet

Trench Walls Scored and Porous yes

Total Line Length 200' feet

Number of Lines 2 lines x 100'

Depth of Stone 18" inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well >50' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Preston Hayes

LOCATION OF PROPERTY 4928 Tuckaseegee

Comments: Repair to Existing system.
Install 6'x100'x18" ston x 6" Sand (200 TLF).
Type II Conventional System

Kevin for Kelly Randall

Jeremy P. Mecklenburg
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 6987 DATE: 6/7/00

TC: 059-031-11 ☒ L

SERIAL Nº 18228

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 6/7/00. All work shall be completed on or before 7/7/00, after which date this permit shall be null and void. The system shall meet all of the construction requirements of I5A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

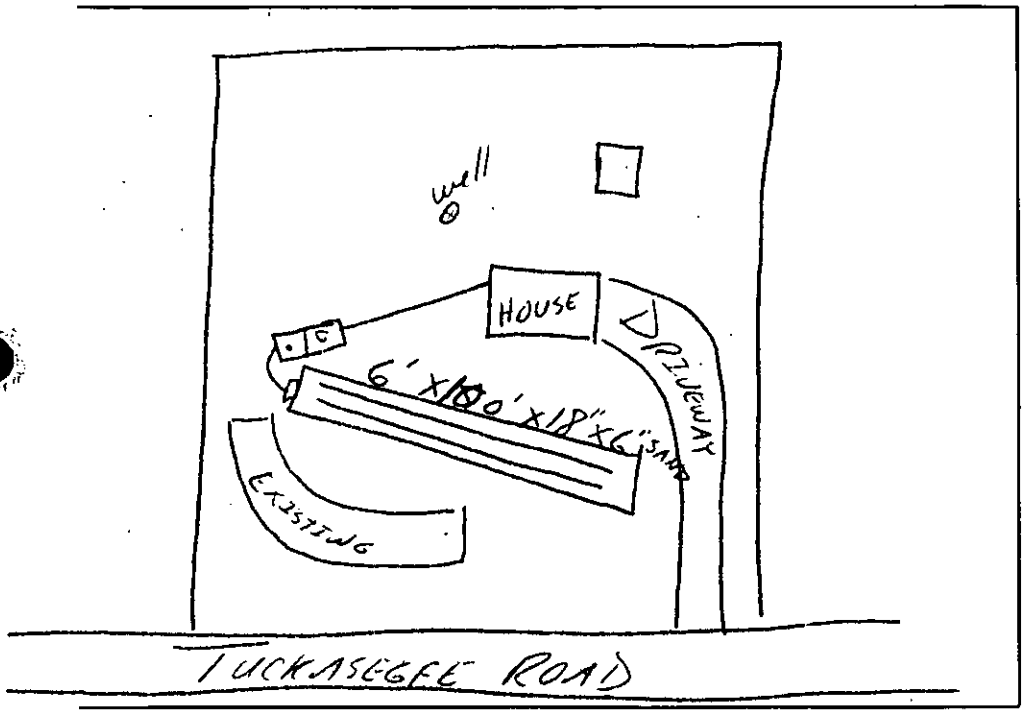

PLOT OF SYSTEM

Liquid Capacity of Septic Tank Existing gallons

Liquid Capacity of Dosing Tank NA gallons

Tank Construction existing

Trench Depth 36"

Absorption and/or Nitrification Lines:

Trench Width 6'x100' feet

Trench Walls Scored and Porous yes

Total Line Length 200' feet

Number of Lines 2 lines x 100'

Depth of Stone 18" inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well >50' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Preston Hayes

LOCATION OF PROPERTY 4928 Tuckasegee

Comments: Repair to Existing System

Install 6'x100'x18" stone x 6" Sand (200 TLF).

Type II Conventional System

Karen Jo Rollins Randall

Jeremy P. Mulkey
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

FEE: _____

DATE: _____

APPLICATION FOR IMPROVEMENT PERMIT
FOR RESIDENTIAL SITE
INDIVIDUAL WATER AND WASTEWATER
SYSTEMS PROGRAM

(Yes) 1 CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION/ ALTERATION OF EXISTING SYSTEM X REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 6987

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 4928 Tuckaseege Road

STREET ADDRESS: 059-031-11

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: 1900

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S)
___ DOUBLE WIDE (D)
X HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

TOWNSHIP (CHECK ONE):

X 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
___ 7 MINT HILL

HEATED SQUARE FOOTAGE: 2,000

NUMBER OF BEDROOMS: 3

NUMBER OF OCCUPANTS: 2

CLOSING DATE_____

FOUNDATION FOR RESIDENCE:

___ WITHOUT BASEMENT
\ ON SLAB
X CRAWL SPACE
___ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES X NO TYPE: _____

WATER SUPPLY (CHECK ONE):

___ COMMUNITY (C)
___ MUNICIPAL (M)
X PRIVATE WELL (P)
___ SHARED WELL (S)
___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES X YES ___ NO
EXISTING WASTEWATER SYSTEMS X YES ___ NO
EASTMENTS OR RIGHT-OF-WAYS ___ YES X NO
WELL, SPRINGS OR WATERLINES X YES ___ NO
DESIGNATED WETLANDS ___ YES X NO

PROPERTY OWNER:

NAME: Hayes (LAST) William (FIRST) Preston (MI)

ADDRESS: 4928 Tuckaseege Road

CITY: Charlotte STATE: NC ZIP: 28208

DAYTIME PHONE: (704) 394 - 8807

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) ---

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 1840

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: William Preston Hayes DATE: 4/11/00

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102