Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 456 A WASPS App #: 4053

~~2007 DENIAL~~ 2007 ALTERATION OTC POSSE 4/30/08

Primary ES assigned to project: DJ

Secondary ES assigned to project:

Project Type: New System ☐ Alteration ☑ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☐	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☐	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: ____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☐	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☐

FILE NUMBER: 456A

Revised On: August 31, 2007

APPLICATION NUMBER: 3094

SEPTIC FEE: 200.00
DATE: 12/11/07

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: _____
DATE: _____

1. SEPTIC / TYPE APPLICATION: ☐ NONE ☐ NEW SYSTEM ☒ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN JPM

2. WELL / TYPE APPLICATION: ☒ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER: 023-112-19
STREET ADDRESS: 4321 Eagle Chase Dr
CITY: Charlotte
STATE: NC **ZIP:** 28216
SUBDIVISION NAME:
LOT #: 6 **LOT SIZE (acres):** 1.5
TOWNSHIP:
☒ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☐ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:

BUILDING TYPE:
☐ SINGLE MOBILE HOME ☒ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☐ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE:
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 4
FOUNDATION TYPE: Brick
☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☒ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: 1 NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☒ MUNICIPAL ☐ PUBLIC WELL ☐ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED):*

	☐ ANY TYPE	☐ CONVENTIONAL	☐ ACCEPTED	☐ INNOVATIVE	☐ ALTERNATIVE	☐ OTHER _____
8A. RANK:	____	____	____	____	____	____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☒ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☒ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☐ YES	☒ NO	JURISDICTIONAL WETLANDS	☐ YES	☒ NO
WELLS, SPRINGS, OR WATER LINES	☐ YES	☒ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES	☒ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☒ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES	☒ NO

10. PROPERTY OWNER:

NAME: Allie Randy Martin
ADDRESS: 640 OAKDALE Rd.
CITY: Charlotte
STATE: NC ZIP: 28216
HOME PHONE: 704 399-2376 WORK PHONE: 704 979-6073
MOBILE PHONE: 704 458-8795 FAX:

11. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME:
ADDRESS: ← Same
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

12. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

13 WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____

14. SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

Randy Martin

Property Owner's or Owner's Legal Representative Signature Date

15. WELL PERMIT APPLICATION SIGNATURE SECTION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

Property Owner's or Owner's Legal Representative Signature Date

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: 4-1-08

OP issued date: 4-2-08

Review performed by: _____ Date performed: 12/7/07

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 12/11/07
Receipt #: 54069
Check / Auth #: CASH
Received By: CRAIGGY

Amount: 200.00
Tendered: 200.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: MARTIN ANDY
Attn:
Address: 640 OAKDALE RD
Address:
City/State/Zip: CHARLOTTE, NC 28216

Item	Description	Permit#	Quantity	Unit Price	Total Price
0706	MH Exc/Add/Repl w/System Mod 4321 EAGLE CHASE DR/FILE 456A		1	200.00	200.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance



Print

Close

2017

Parcel Information

Parcel ID	Account	Parent	Previous
14108211	INDIVIDUAL		

Owner(s)

Owner Name	Mailing Address	City/State
BOOZER LYNDA B	4231 EAGLE LAKE DR	CHARLOTTE NC 28217

Legal Information

Legal	Municipality	Date Annexed	Special District	Fire District	Acreage
L47 M4-465	MECKLENBURG COUNTY-UNINCORPORATED		FIRE SERVICE A	STEELE CREEK #1	0

Total Parcel Assessment

Building	Land	Features	Total
117200	96200	1500	214900

Exemptions

Exemption	Year Approved	Review Date	Amount

Sales Information

Sale	Price	Stamps	Qualify	VI	Type	Legal Ref.	Grantor
Oct 1 1996	160000			IMP	DEED STAMPS	08761-791	PARKER JAMES A &WF J

Land Use

Use	Units	Type	Neighborhood	Assessment
R100	0.63	AC	O101	96200

Building Information

Bldg	Description	Type	Year	Property Location
1	Single-Fam	RES	1960	4231 EAGLE LAKE DR NORTH UNINC

Bldg	Story	Units	Total SqFt	Heated SqFt	Foundation	Ext. Wall	Grade	Value
1	1 STORY	1	3276	2352	CRAWL SPACE	FACE BRICK -	AVERAGE 01	117200

Bldg	Heat	Fuel	Fire Place	AC	Fixtures	Bedrooms	Full Baths	3/4 Baths	1/2 Baths
1	HEAT PUMP	ELECTRIC	1 - FP3	AC-CENTRAL	0	4	3	0	0

Sub Area

Bldg	Description	Size
1	CARPORT - FINISHED	420
1	BASE (FIRST FLOOR)	2352
1	PORCH - SCREENED - FINISHED	304
1	BASEMENT - UNFINISHED	200

Depreciation

Bldg	Physical	Functional	Economic	Special	Override
1	AV - 26.00%	- 0.00%	- 0.00%	- 0.00%	- 0.00%

Special Features & Yard Items

Bldg	Built	Type	Quantity	Units	Value
1	1960	TERRACE	1	300.00000	1500

Notes

Tax Year	Notes	Note Date


Value Changes

Notice Date	Tax Year	Reason	Changed To	Deferred
Apr 15 2014	2014	Remodeled and/or New Addition	214900	0
Apr 15 2014	2014	Remodeled Improvements and/or New Additi	214900	0
Feb 8 2011	2011	Countywide Revaluation	215500	0
Jan 17 2003	2003	Countywide Revaluation	184500	0
Feb 20 1998	1998	Countywide Revaluation	152770	
Jan 2 1991	1991	Countywide Revaluation	118050	

House

Polaris 3G Map – Mecklenburg County, North Carolina

Date Printed: 9/8/2017 8:12:35 AM

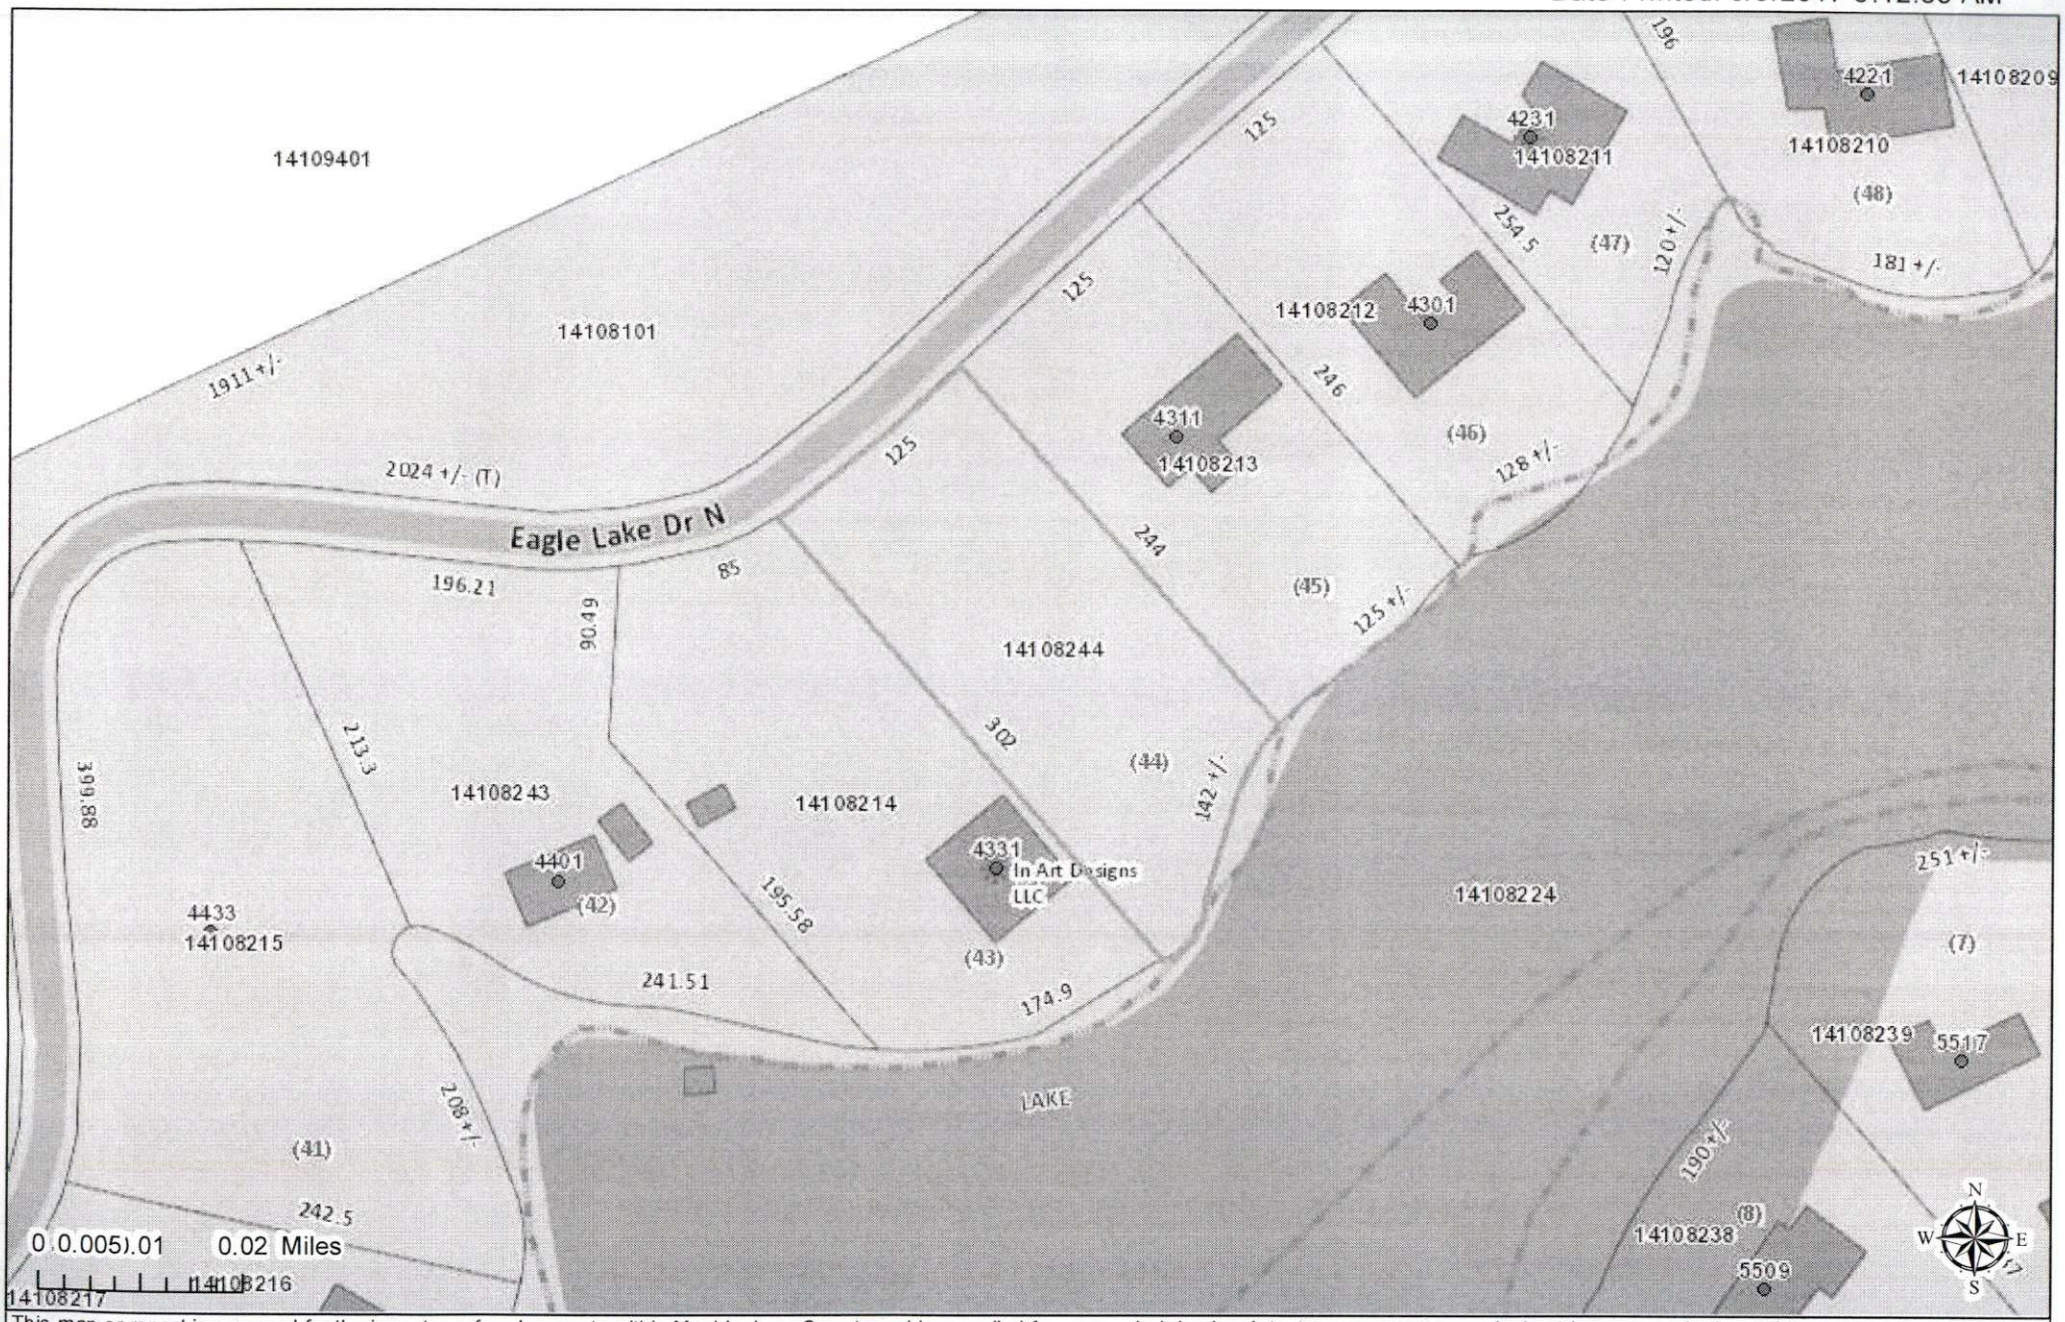

This map or report is prepared for the inventory of real property within Mecklenburg County and is compiled from recorded deeds, plats, tax maps, surveys, planimetric maps, and other public records and data. Users of this map or report are hereby notified that the aforementioned public primary information sources should be consulted for verification. Mecklenburg County and its mapping contractors assume no legal responsibility for the information contained herein.



4321 EAGLE CHASE DR

02311219

4/14/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CONDITIONS OF IMPROVEMENT PERMIT for an ALTERATION TO AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit Number: **456A** Tax Number: **023-112-19**

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☐ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

0.3 Long-term acceptance rate (GPD/ft^2)	**360** Max gallons/day wastewater flow	**300** Absorption Area (ft^2)	**9** Trench spacing (min. on centers) (ft)
Serviced by private well: ☐ Yes ☒ No	**exis** Gallon septic tank	**100** Total trench length (ft)	**30** Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
3 Bedrooms in residence	**exis** Gallon pump tank	**18** Depth of media (in)	

Any surface water present: **NO** Type: Minimum separation distance (ft):

Additional conditions: **Add 6' x 50' x 18" stone bed to existing system.**
Property does not require 100% repair area.

Repair Area System

Type: ☐ I ☐ II ☐ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

____ Absorption Area (ft^2) ____ Total trench length (ft)	__ Depth of media (in)	__ Trench spacing (min. on centers) (ft)	__ Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation Approval is granted by this Department.

*** This Improvement permit is transferable.

Jerry Mucha, RS 12/13/07
DENR Authorized Agent Date

Randy Martin 12-18-07
Owner/Agent Signature Date

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 456A

TC: 023-112-19

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

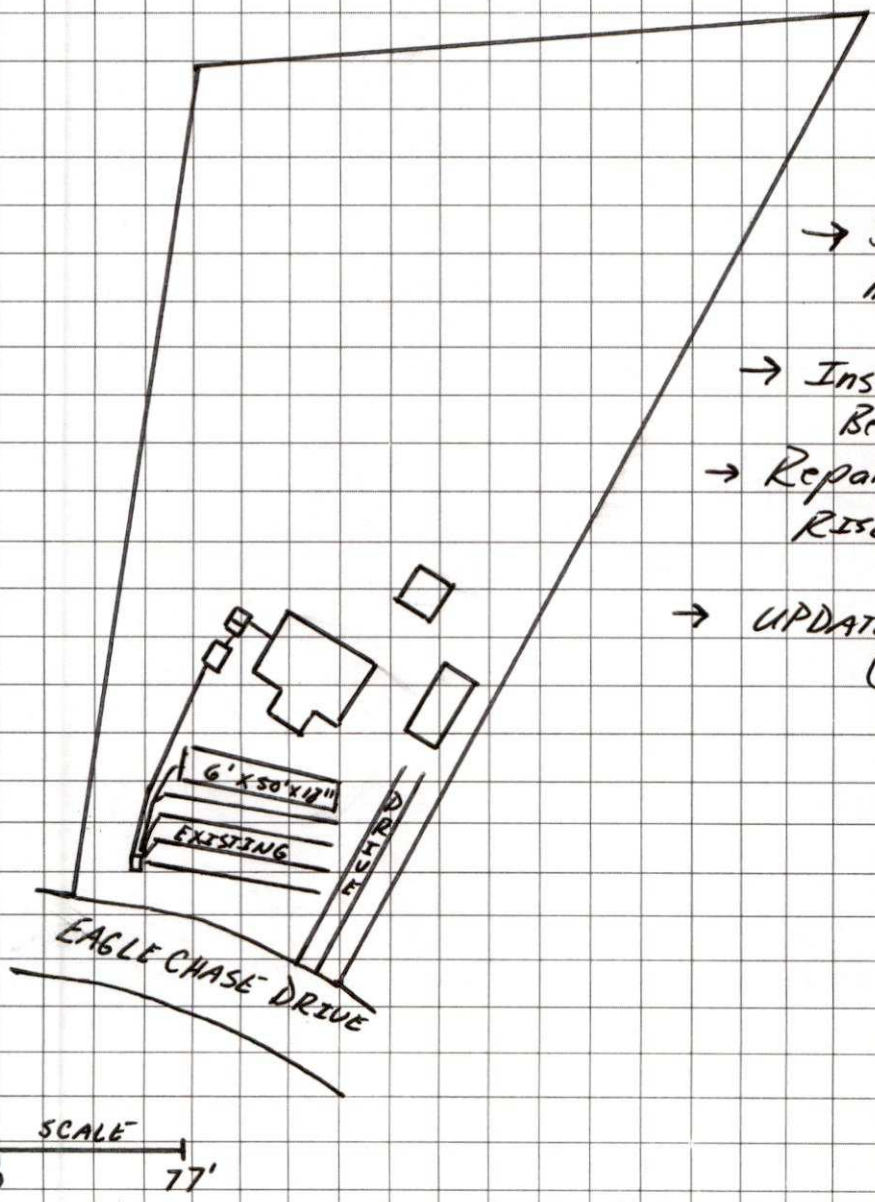

COMMENTS:

→ System alteration for a new 3 BEDROOM Home

→ Install 6'x50'x18" Stone Bed

→ Repair or replace pump tank RISER LID

→ UPDATE Pump alarm (NEMA 4X)

Randy Martin
OWNER/AGENT SIGNATURE

DATE 12-18-07

APPROVAL DATE Jenny Hunt, R.S.
12/13/07

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 456A Permit #: 3094 Tax Parcel #: 023 112 19

Property Owner: Randy Morgan

Job Location Address: 4321 Eagle Chase Dr

City: Charlotte State: NC Zip Code: 28116

Operation Permit Issuance Date: 4/2/08 Contractor Name: Hildreth Septic

Permitted Design Flow: 360 GPD

Liquid Capacity of Septic Tank: Existing gallons

Liquid Capacity of Dosing Tank: existing gallons

Effluent Pump Model: existing

Drainfield Installation ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Inspection Dates

Tank(s) Inspected: Existing

Excavation Inspected: 4/2/08

Pump & Controls Inspected: 4/2/08 updated Alarm system

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

See installation approval

Bed Installation *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 36 inches

Bed Width: 6 feet

Total line length: 100 feet

# of Lines: 2 @ 50 feet

Depth of Media: 12 inches (Type) Chamber

Depth of Cover: 24 inches

Distribution Device: Existing pressure manifold

Water Supply Source

☐ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10 feet

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☒ altered ☐ repaired ☐ as detailed in the plot above ☒ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: Type IIIb Pump to Existing gravel system with 100' chamber alteration

DENR Authorized Agent: Philo Walker Signature: Philo S. Walker RS

Type III 6g, IQ4W, Pressure, NA, NA

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 456A Permit #: 3094 Tax Parcel #: 023-112-19

Property Owner: Randy Moerau

Job Location Address: 4321 Eagle Chase Drive

City: Charlotte State: NC Zip Code: 28116

Installation Approval Issuance Date: 4/1/08

Permission is hereby given to ☐ install ☒ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 5/1/08 after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD Site LTAR: 0.3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: Existing gallons Liquid Capacity of Dosing Tank: existing gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 6 feet

Line Spacing: 9 feet (O.C.)

Total line length: 100 feet

# of Lines: 2 @ 50 feet

Depth of Media: 12 inches (Type) 25%

Distribution Device: existing

Bed Design *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 30 inches

Bed Width: 6 feet

Total line length: 100 feet

# of Lines: 2 @ 50 feet

Depth of Media: 12 inches (Type) 25%

Distribution Device: Existing

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other

Minimum System Setbacks


Distance from Building Foundation: >5' feet

Distance from Property Line: 710' feet

Distance from Water Supply Source: >50' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

* REPAIR TANK LID RISER
* UPDATE PUMP ALARM TO NEMA 4X BOX

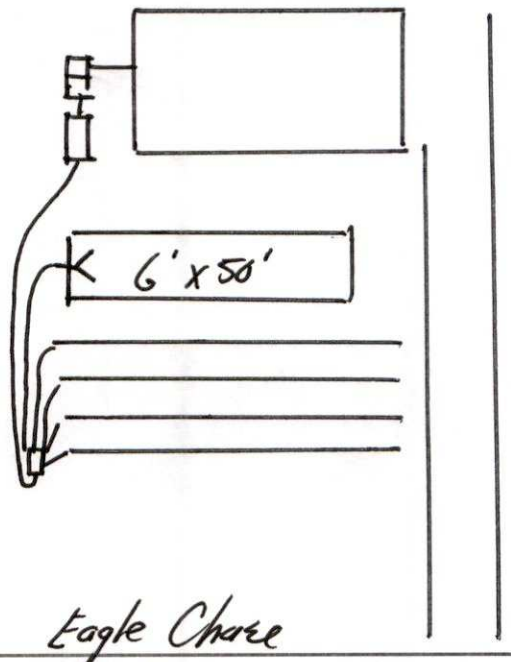

Comments: System Classification & Type: III.b Pump to 25% Reduction Alternative

DENR Authorized Agent: Jeremy Michaels R.S. Signature: Jeremy Michaels, RS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 456A Permit #: 3094 Tax Parcel #: 023 112 19

Property Owner: Randy Morgan

Job Location Address: 4321 Eagle Chase Dr

City: Charlotte State: NC Zip Code: 28116

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: Type IIIb

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☐

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☒ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: Alteration addition, Pump to Gravel System w/ 100' chamber alteration

DENR Authorized Agent: Philo Walker RS Date: 4/2/08

Signature: Philo Walker RS

FEE: 100.00 CASH
DATE: 12/4/07
CRT [ ]

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM
MECKLENBURG COUNTY - GROUNDWATER & WASTEWATER SERVICES
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

GWS – UES.APP 06/07

FILE #: 456A

TYPE APPLCATION:

- ☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A / M)
- ☐ ADDITION - RENOVATION OR GARAGE WITH NO MAJOR CHANGES (X)
- ☑ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y) 3053
- ☐ COMMERCIAL OR INDUSTRIAL (N)

PERSON FILING APPLICATION:

NAME: ALLIE RANDY Martin
ADDRESS: 640 oakdale Road
CITY: Charlotte
STATE: NC ZIP: 28216
PHONE: 704.4583795
ALTERNATE PHONE: 704.399.2370

PROPERTY OWNER:

NAME: ALLIE Randy Martin
ADDRESS: 4321 Eaglechase DR.
CITY: Charlotte
STATE: NC ZIP: 28216
PHONE: 704.458.3795
ALTERNATE PHONE: 704.399.2370

JOB LOCATION INFORMATION

TAX/PARCEL #: 023-112-19
STREET ADDRESS: 4321 Eaglechase DRive
CITY: Charlotte
STATE: NC ZIP: 28216
SUBDIVISION OR MOBILE HOME PARK NAME: N/A
LOT #: 6 N/A 1995

TOWNSHIP:

- ☑ 0-MECKLENBURG
- ☐ 1-CHARLOTTE
- ☐ 2-DAVIDSON
- ☐ 3-CORNELIUS
- ☐ 4-PINEVILLE
- ☐ 5-MATTHEWS
- ☐ 6-HUNTERSVILLE
- ☐ 7-MINT HILL

WATER SUPPLY:

☑ MUNICIPAL (M) ☐ COMMUNITY (C) ☐ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

RESIDENTIAL PROPERTY TYPE:

- ☐ HOUSE (H)
- ☑ MODULAR HOME (M)
- ☐ MULTIPLE FAMILY (U)
- ☐ SINGLE MOBILE HOME (S)
- ☐ DOUBLE WIDE (D)
- ☐ OTHER (O)

OCCUPANCY (both fields are required):

NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 4

COMMERCIAL / INDUSTRIAL PROPERTY TYPE:

TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:

INDUSTRIAL WASTES? ☐ YES ☐ NO
UNDERGROUND STORAGE TANKS? ☐ YES ☐ NO

NA →

ADDITION TYPE ATTACHED TO EXISTING STRUCTURE:

NA →

- ☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
- ☐ GARAGE ☐ SUNROOM ☐ PORCH ☐ DECK ☐ OTHER

ADDITION TYPE DETACHED FROM EXISTING STRUCTURE:

- ☐ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
- ☐ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature — Date: 11/27/07

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted y this Department.
- This permit is not transferable.

☐ ADDITION / RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE

UXS Denied. Needs to apply for a Modification I.P. to proceed.


EHS Signature — Date: 12/11/07

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File #_____
Date_____

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

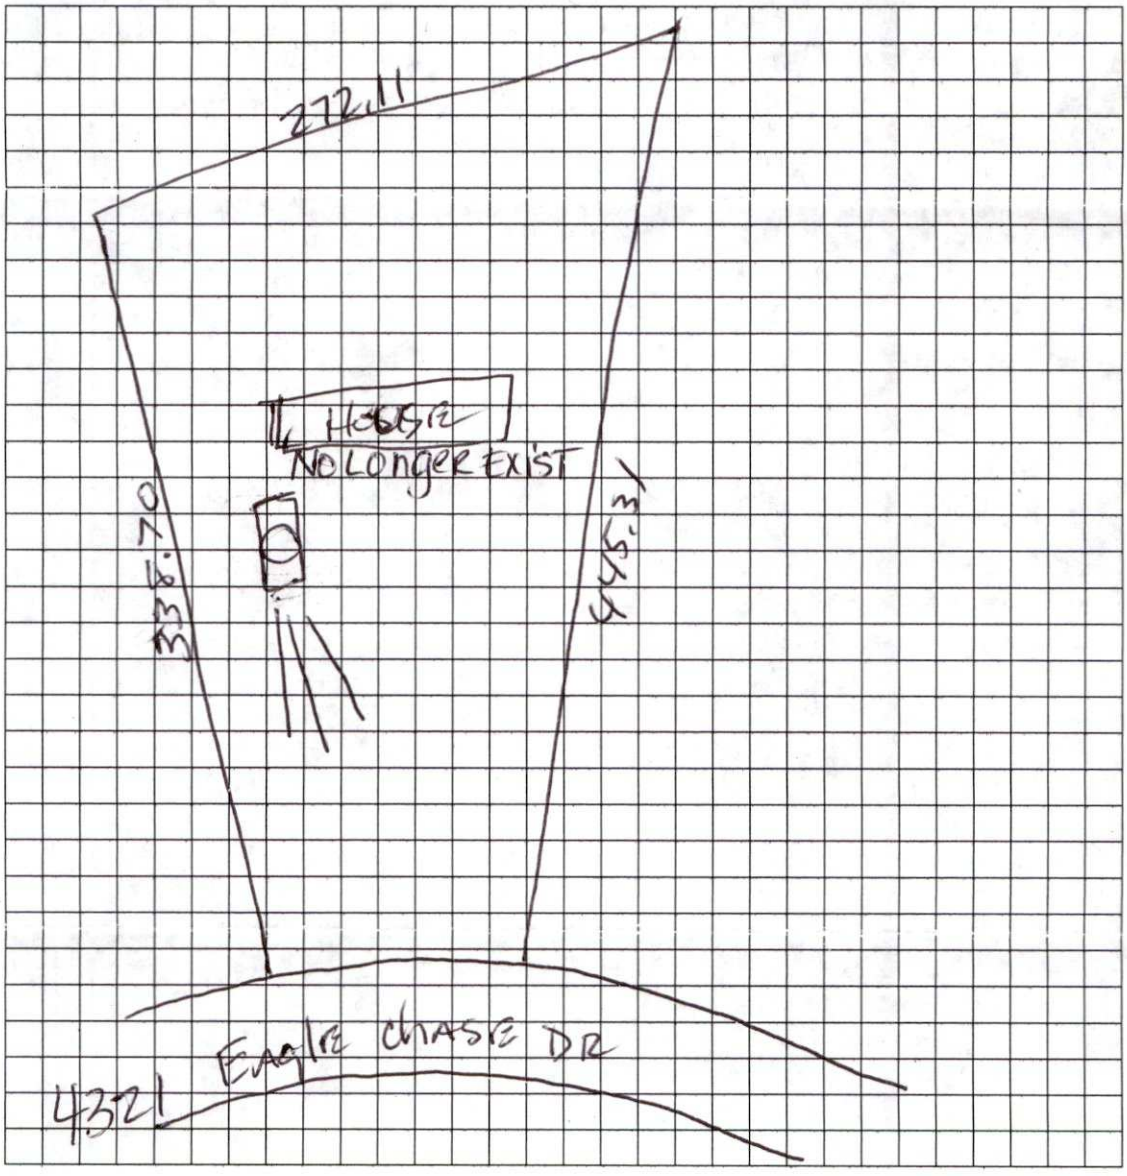

Owner/Agent Signature	Randy Martin
Date	11-27-07

LBC 12/15/04

@ 500

6/15/95

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

456A

Cash $50.00 ☐ CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date:

PERSON FILING APPLICATION:
NAME: MARTIN (last) GLORIA (first) J (mi)
ADDRESS: 4321 Eagle Chase Dr PHONE: 704 399-1047
CITY: Charlotte STATE: NC ZIPCODE: 28216

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 023-112-19
STREET ADDRESS: 4321 Eagle Chase Dr
ZONING:

PROPERTY OWNER:
NAME: SAME (last) (first) (mi)
ADDRESS: PHONE: (__) __
CITY: STATE: ZIPCODE:

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
☐ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☐ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: 6 LOT SIZE (in acres):

☐ SOIL TEST - INDIVIDUAL LOT (D)
☐ NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
☒ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
☐ COMMERCIAL OR INDUSTRIAL (N)
☐ SOIL TEST DEVELOPMENT (P)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☐ MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
☐ REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
☐ SINGLE MOBILE HOME (S) ☐ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☒ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS: 2

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☐ Community (C) ☐ Shared Well (S)
☐ Municipal (M) ☐ Other 'spring' (O)
☒ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☐ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☐ None
☐ Garage ☐ Storage Building ☐ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Gloria J. Martin Date: 6-15-95

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules for Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

... Use existing system. Approved for two-bedroom home only. Keep min. 5' from any part of septic tank system

☐ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☒ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Susan Satterwhite R.S. 6-19-95
Environmentalist Date

Director or Authorized Section Head Date

WATER : 12291


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 456A

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

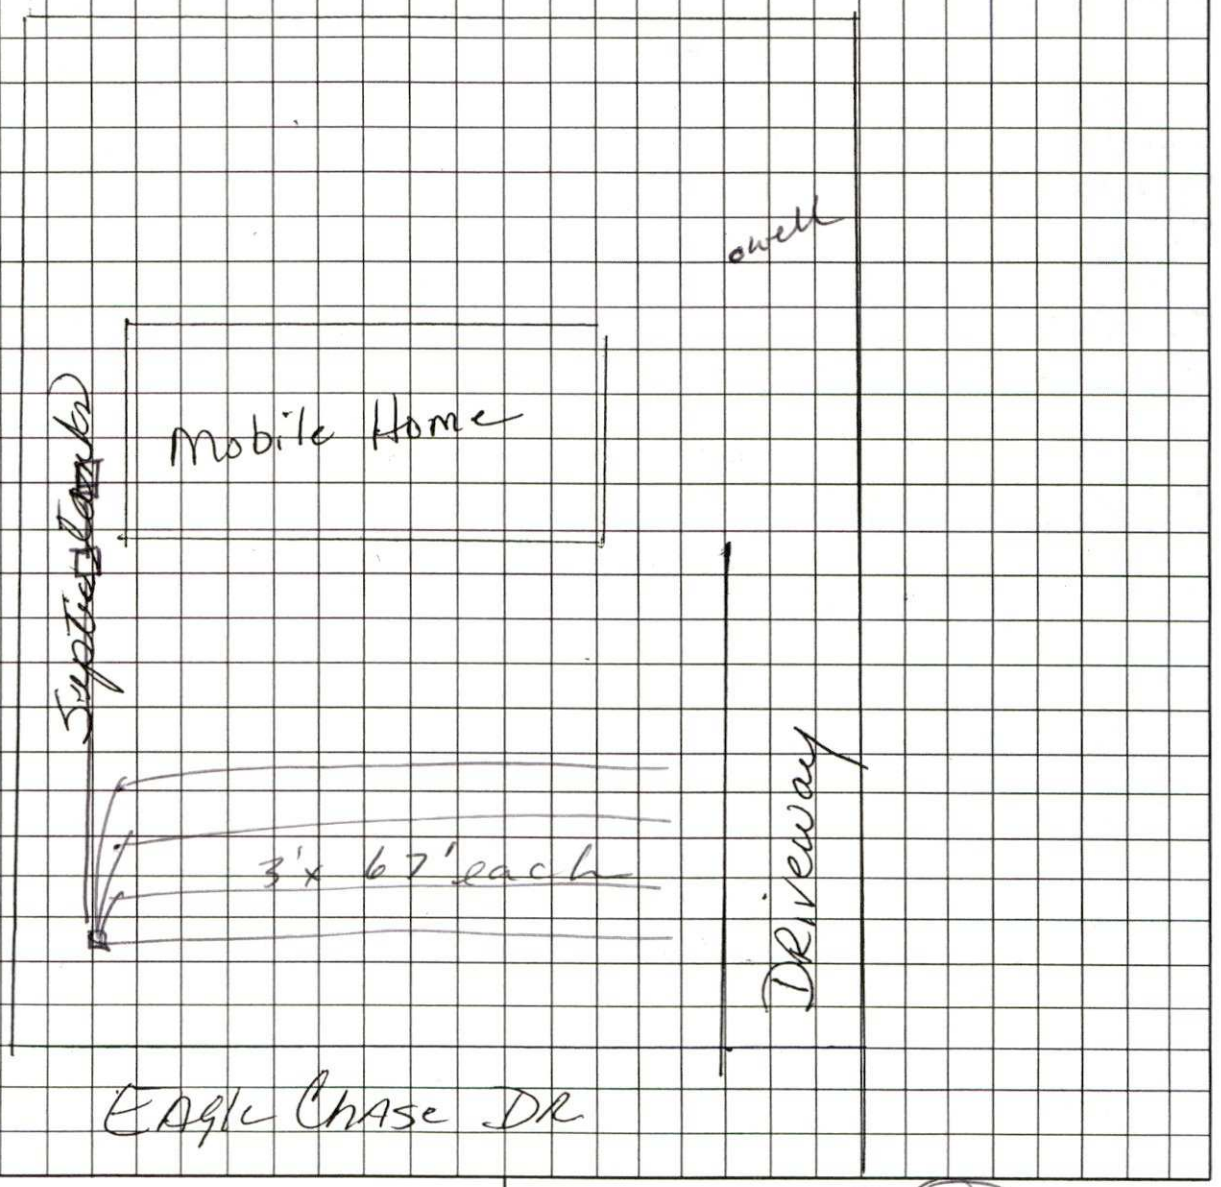

APPROVAL DATE 6-19-95 SR

OWNER/AGENT SIGNATURE

DATE

White - Health Department's Copy

Canary - E.H.S. Copy

Pink - Owner's Copy

Mecklenburg County
Health Department

June 21, 1995

Ms. Gloria Martin
4321 Eaglechase Drive
Charlotte, NC 28216

Dear Ms. Martin:

Re: 4321 Eaglechase Drive
File: 456A
Parcel: 023-112-19

A site visit was made to the above property to determine whether a new three bedroom mobile home can be connected to the existing septic tank system. The proposed new home would replace the existing home. Our files indicate that the septic system was designed for a two bedroom residence. Therefore, this request is disapproved.

You may want to consider replacing the existing home with a new two bedroom home or make an application for services requesting an upgrade to the existing system. If you wish to consider an upgrade, an additional fee would need to be paid.

If you have any questions concerning this matter, please contact me at 336-5569.

Sincerely,

Susan M. Bateman, R.S.
Individual Water and Wastewater Systems

SB:gf

Environmental Health Division
700 North Tryon Street • Suite 211 • Charlotte, North Carolina 28202-2236