Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7944B Permit #: 3693 Tax Parcel #: 195 213 09

Property Owner: Farrington Oaks / True Homes

Job Location Address: 13203 Farrington Oaks Dr

City: Charlotte State: NC Zip Code: 28227

Operation Permit Issuance Date: 11/22/11 Contractor Name: Chris Stevens

Permitted Design Flow: 480 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: NA gallons

Effluent Pump Model: NA

Drainfield Installation ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 4 @ 100 feet

Depth of Media: 12 inches (Type) BIOS Chambers

Depth of Cover: 18 inches

Distribution Device: chamber fed

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10 feet


Inspection Dates

Tank(s) Inspected: 11/22/11

Excavation Inspected: 11/22/11

Pump & Controls Inspected: NA

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

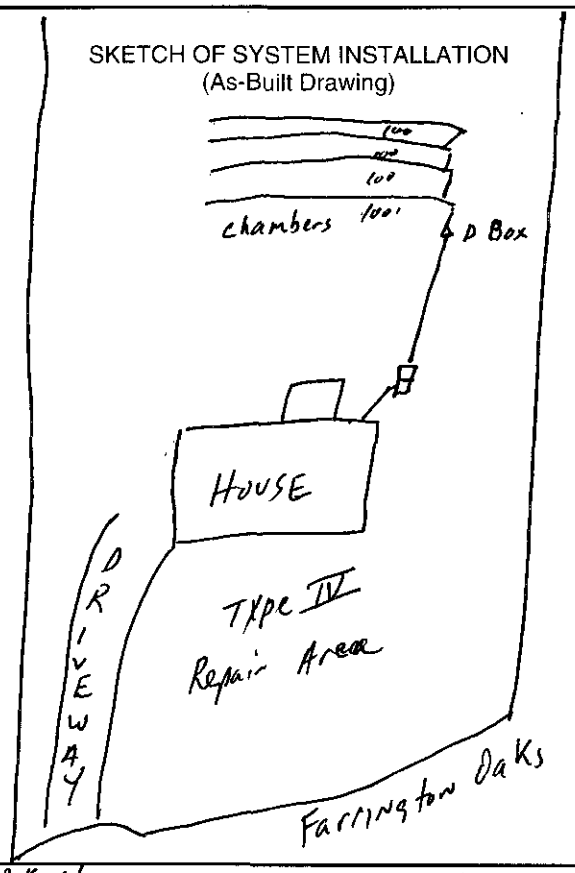

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☒ installed ☐ altered ☐ repaired ☐ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: Type IIIg Gravity chamber BIOS / G / NA / NA

DENR Authorized Agent: Philo Walker REHS Signature: Philo Walker REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7844B Permit #: 3693 Tax Parcel #: 195 213 09

Property Owner: Farrington Oaks

Job Location Address: 13203 Farrington Oaks LN

City: Charlotte State: NC Zip Code: 28227

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIg

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: Gravity chamber

DENR Authorized Agent: Philo Walker REHS Date: 11/22/11

Signature: Philo Walker REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30005222** GWS File #: **7844B** Tax Parcel #: **195-213-09**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be ***NO*** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 9/9/2016

Type of Installation: Residential - New System Lot Number: 130

Structure Type: HOUSE Size (ft^2): 3889 # Bedrooms: 4 # Occupants: 6

Building Foundation: Crawl Space Water Supply: Municipal

II. Initial System Type: Approved **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1200	Total Trench Length (ft):	400
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

III. Repair System Type: PPBPS (pressurized) **System Classification:** IVa

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	800	Total Trench Length (ft):	267
Maximum Trench Depth (in):	36	Depth of Media (in):	22	Distribution Device:	Manifold (LPP Distri		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michael Owner/Legal Agent: Michael Cron

Print Name

Signature: A. Jeremy Michael REHS Signature: Michael Cron

Date Issued: 9/9/2011

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30005222** GWS File #: ***7844B***

IV. Permit Conditions/Comments:

- This type of repair system requires the installation of a pump tank and all associated components. This type of system will require routine inspections by our office. The system owner is responsible for all fees associated with these inspections.
- This type of repair system requires the property owner to obtain a contract with a Certified Operator to perform routine inspections and maintenance on the system.
- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All waterlines must be located a minimum of 10 ft. from any part of the septic system.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michael

Signature: Jeremy Michael REHS.


Date Issued: 9/9/2011

Owner/Legal Agent: Michael Cross

Print Name


Signature: Michael Cross

File # 7844B

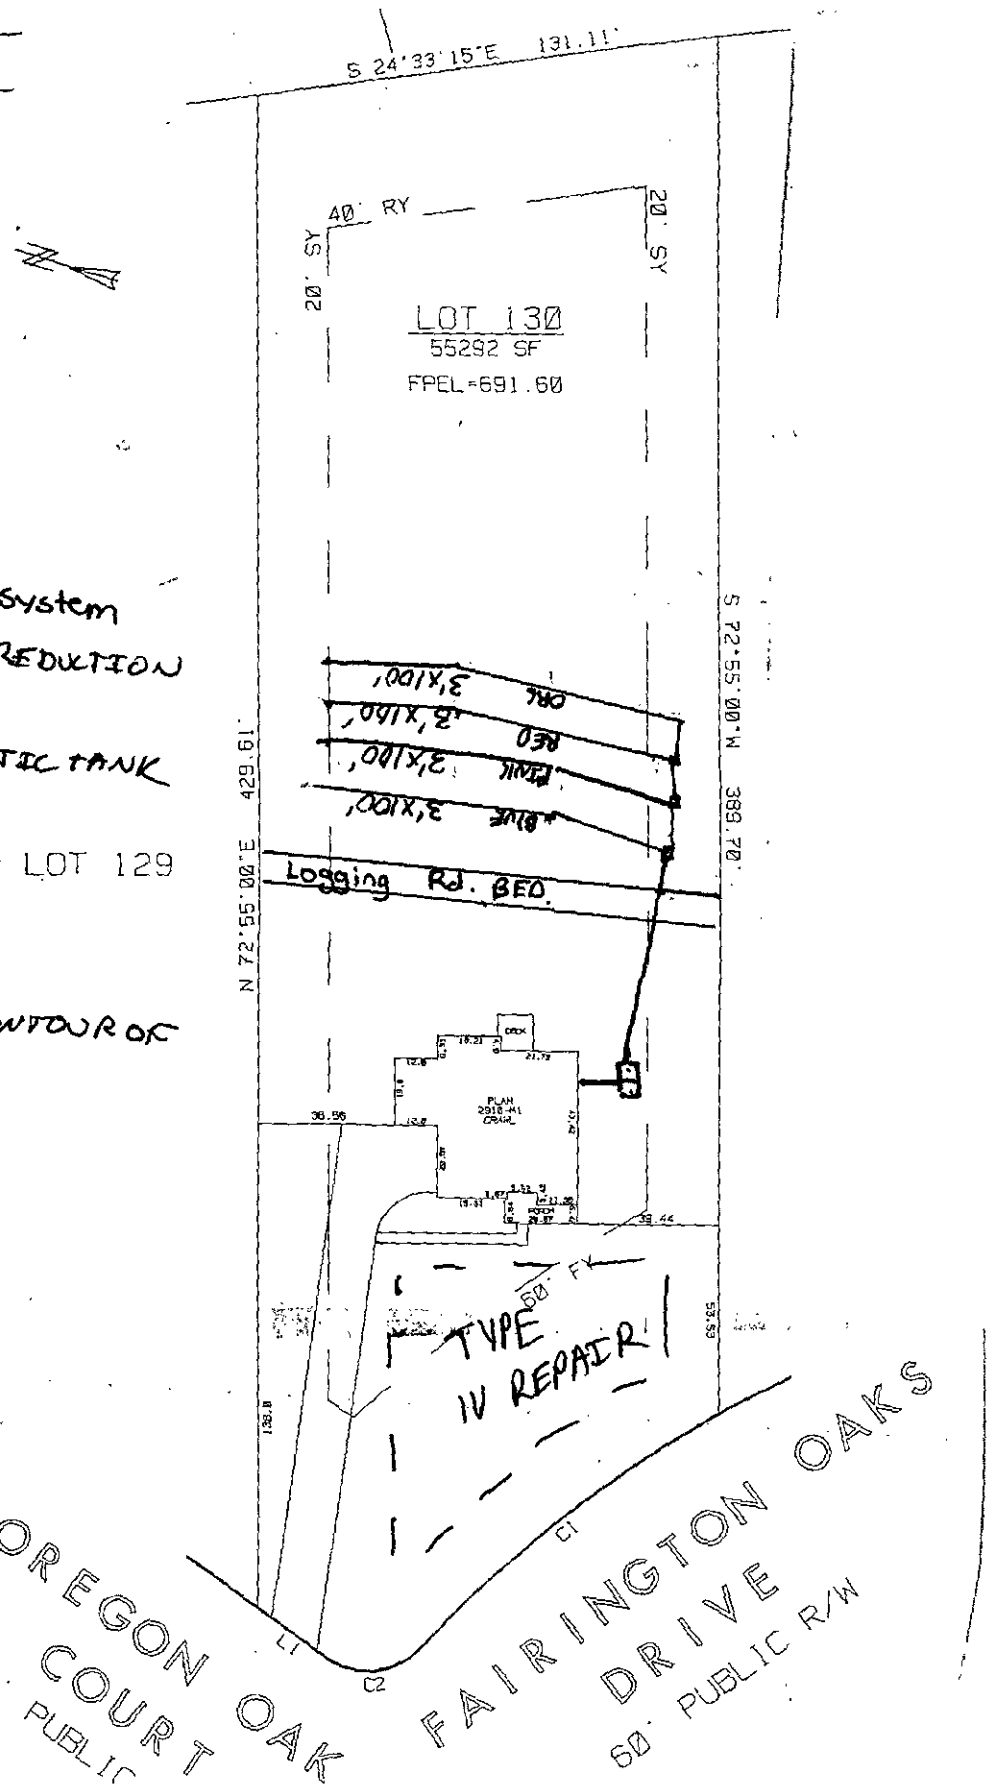

4 BEDROOM RESIDENCE
0.3 GPD/FT² TYPE III G SYSTEM
INSTALL 400 L.F OF 25% REDUCTION
DROP BOX DISTRIBUTION
INSTALL 1500 GAL SEPTIC TANK
SETBACKS
10' OFF ALL PROPERTY LINES LOT 129
5' OFF ANY FOUNDATIONS
36" MAX TRENCH DEPTH
INSTALL LINES LEVEL W/ CONTOUR OF LAND

7-23-11
Jeremy Mustard REHS
09/09/2011

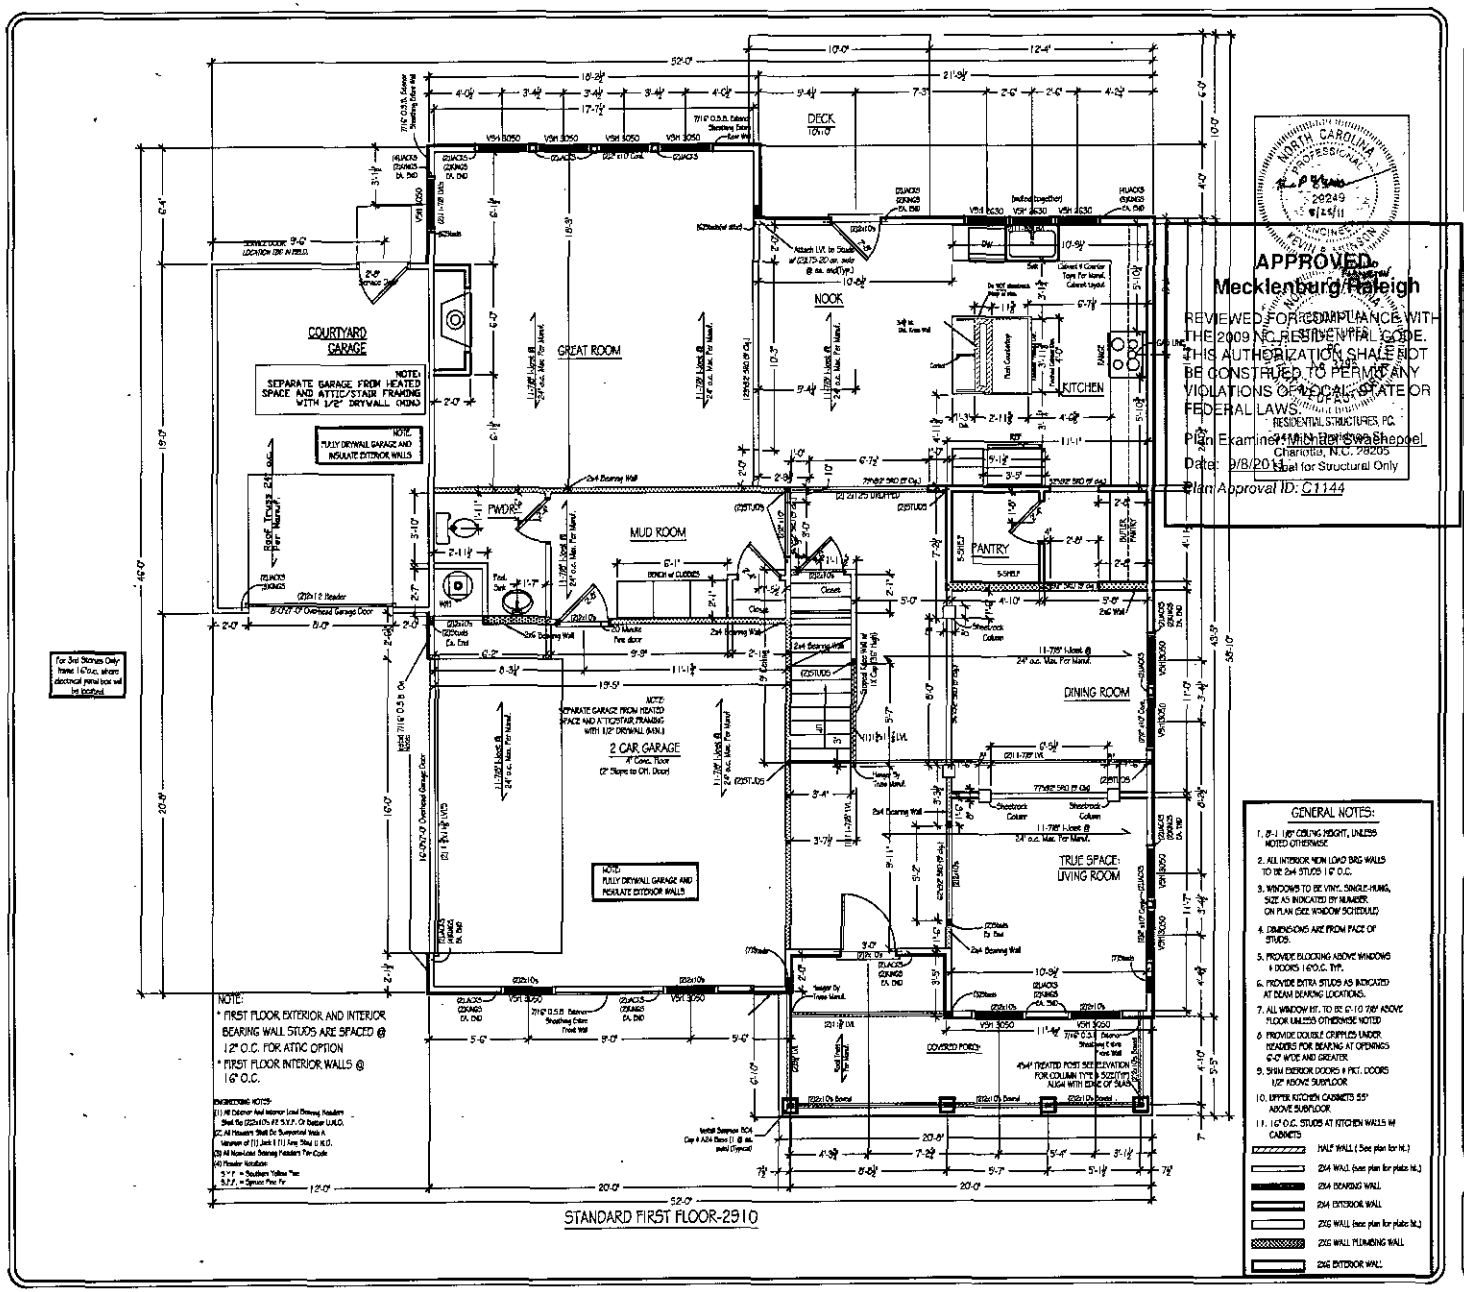

TRUE HOMES L.L.C.
2649 Brekon Ridge Centre Dr.
Suite 104
Monroe, N.C. 28110
704-226-9486

Fairington Oaks
Lot #130

FIRST FLOOR PLAN

2910 - RILEY

Copyright True Homes L.L.C. All rights reserved. The duplication, reproduction, copying, sale, rental, licensing, or any other distribution or use of these drawings, any portion there of, or the plans depicted hereon is strictly prohibited.

DRAWN BY: MWH


DATE: 8.24.11

SCALE: 1/4" = 1'-0"


REVISION:

JOB: Lot Specific

SHEET: 4 / 10

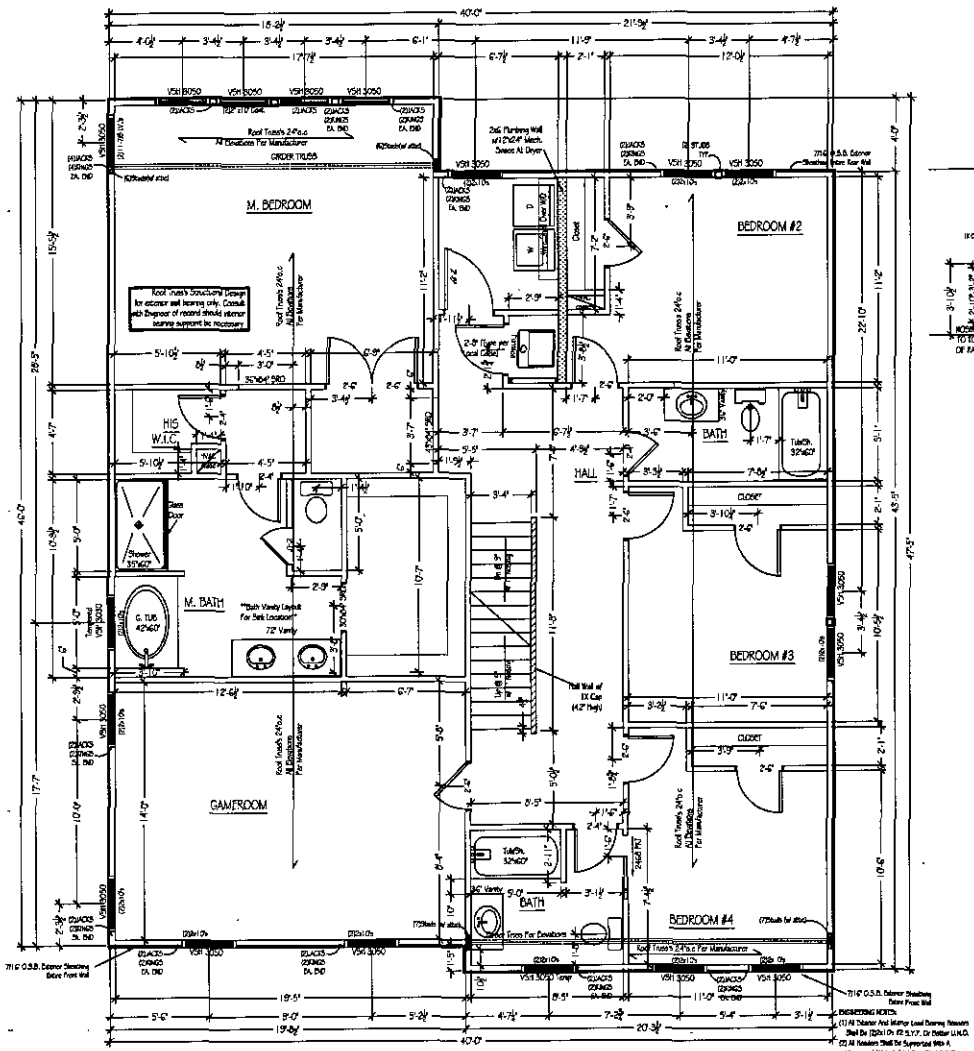

SECOND FLOOR OPT. 2 (MASTER BEDROOM REAR)

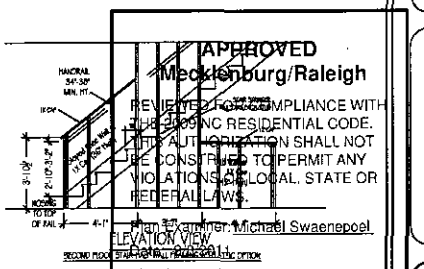

APPROVED
Mecklenburg/Raleigh
REVIEWED FOR COMPLIANCE WITH THE 2009 NC RESIDENTIAL CODE. THIS AUTHORIZATION SHALL NOT BE CONSTRUED TO PERMIT ANY VIOLATIONS OF LOCAL, STATE OR FEDERAL LAWS.
Plan Examiner: Michael Swaenepoel
Plan Approval ID: C1144

NORTH CAROLINA PROFESSIONAL 29249 ENGINEER KEVIN P. JOHNSON NORTH CAROLINA RESIDENTIAL STRUCTURES PC No. 3295 CERTIFICATE OF AUTHORIZATION
RESIDENTIAL STRUCTURES, P.C.
3440 N. Davidson St.
Charlotte, N.C. 28205
Seal for Structural Only

TRUE HOMES L.L.C.
2649 Brekon Ridge Centre Dr.
Suite 104
Monroe, N.C. 28110
704-226-9486

Fairington Oaks
Lot #130

SECOND FLOOR PLAN

2910 - RILEY

Copyright True Homes L.L.C. All rights reserved. The duplication, reproduction, copying, sale, resale, licensing, or any other distribution or use of these drawings, any portion there of, or the plans depicted hereon is strictly prohibited.

DRAWN BY: MWE
DATE: 8.24.11
SCALE: 1/4" = 1'-0"
REVISION:
JOB: Lot Specific

SHEET: 5 / 10

7844B

CK # 21906 $250.00
Mail Receipt # 73986

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

0701

1. **SEPTIC / TYPE APPLICATION:** ○ N/A ◉ NEW SYSTEM ○ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ○ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. **JOB LOCATION INFORMATION:**

TAX PARCEL NUMBER: 19521309
STREET ADDRESS: 13203 Fairington Oaks
CITY: Charlotte
STATE: NC ZIP: 28227
SUBDIVISION NAME: Fairington Oaks
LOT #: 130 LOT SIZE (acres): .55292
TOWNSHIP:
○ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ◉ MINT HILL

4. **BUILDING INFORMATION:**

BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
◉ HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 3889
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 6
FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
◉ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. **WATER SUPPLY:** ◉ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. **PROPOSED USE OF WELL:** ○ N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED):*

☐ N/A ☒ ANY TYPE ☒ CONVENTIONAL ☒ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☒ OTHER modified

8A. **RANK:** 1 2 ___ ___ 3

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ◉ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ◉ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	○ YES ◉ NO	JURISDICTIONAL WETLANDS	○ YES ◉ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ◉ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ◉ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ◉ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ◉ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ◉ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ◉ NO
WASTE STORAGE	○ YES ◉ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ◉ NO

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____ ☑ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☐ N/A

12. **PROPERTY OWNER:**

NAME: True Homes
ADDRESS: 2649 Bretonridge Centre Dr
CITY: Monroe
STATE: NC ZIP: 28110
WORK PHONE: 704 238 1229
MOBILE PHONE: 704 2015315
FAX: 910 401 1410
E-MAIL: rwhite@truehomesusa.com

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**

NAME: _____
ADDRESS: _____
CITY: _____
STATE: _____ ZIP: _____
WORK PHONE: _____
MOBILE PHONE: _____
FAX: _____
E-MAIL: _____

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

ME (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

ME (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

Property Owner's or Owner's Legal Representative Signature — Date: 7-23-11

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ⊘ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ 250.00 DATE FEE RECEIVED: 8/31/11

WELL APPLICATION FEE RECEIVED: $ NA DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: L. CORRITT

GWS FILE NUMBER ASSIGNED: 7844B

APPLICATION ID NUMBER ASSIGNED: 5222

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 13203 Fairington Oaks Tax Parcel #: 19521309

Subdivision Name: Fairington Oaks Lot #: 130

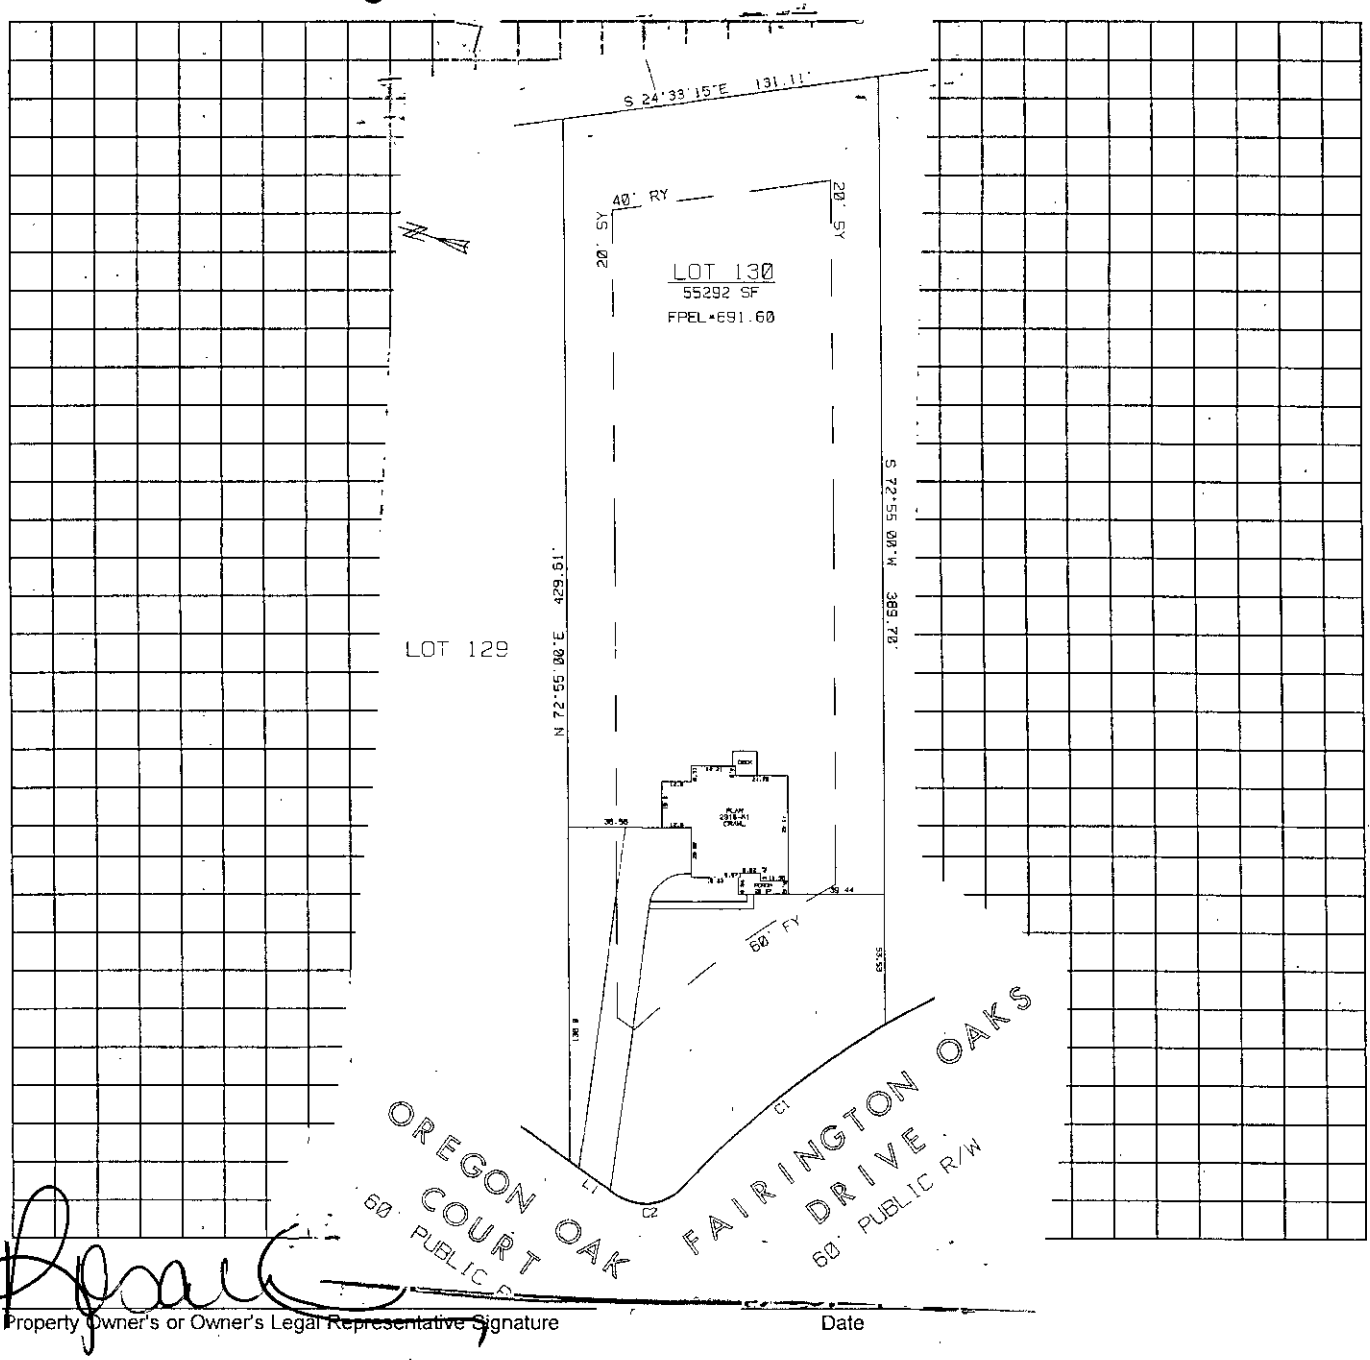

Property Owner's or Owner's Legal Representative Signature Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 19521309
Lot #: 130
File #: 7844B
AppID: 5222

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: True Homes
Applicant: Same
Address: 2649 Brekonridge Centre Dr. Monroe, NC 28110
Date Evaluated: 9/8/2011
Proposed Facility: Residence
Design Flow (.1949): 480 GPD
Property Size:
Location of Site: 13203 Fairington Oaks Dr. Charlotte, NC 28227
Property Recorded: n/a
Water Supply: [X] Public [] Individual [] Well [ ] Spring [ ] Other
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Mixed

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941 Structure/ Texture	SOIL MORPHOLOGY 1941 Consistence Mineralogy	b PROFILE FACTORS 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
1	LS 8%	0-6	GR/SCL	NS/NP/FRI/SEXP		48"			PS, IV 0.3 GPD/FT^2
		6-48	GR/SCL	S/P/FI/SEXP					
2	LS 8%	0-8	GR/SCL	NS/NP/FRI/SEXP		48"			PS, IV 0.3 GPD/FT^2
		8-48	SBK/C	S/P/FI/SEXP					
3	LS 8%	0-6	GR/SCL	NS/NP/FRI/SEXP		48"			PS, IV 0.3 GPD/FT^2
		6-48	GR/SCL	S/P/FI/SEXP					
4	R 6%	0-48	SBK/C	S/P/FI/SEXP		48"			PS, IV 0.3 GPD/FT^2

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	IIIg	Iva
Site LTAR	0.3	0.3


Other Factors (.1946):
Soil Evaluation By: Jeremy Michael Jeremy Michael REHS
Others Present:
Site Classification (.1948):
Site Evaluation By: Jeremy Michael
Others Present:

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

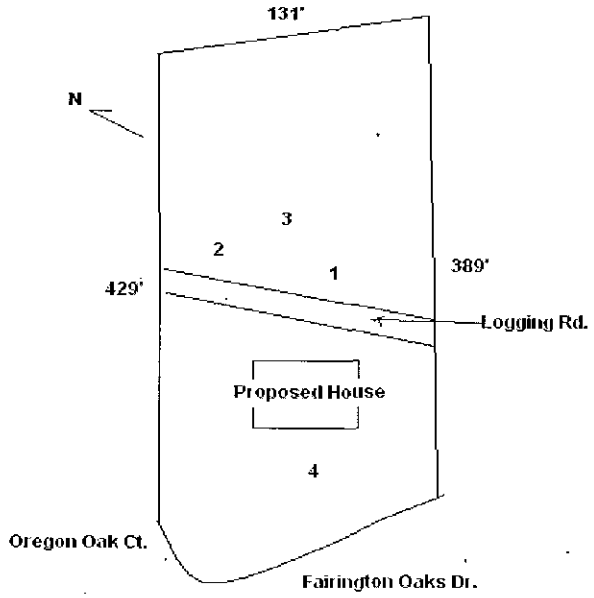

S&EC

Soil & Environmental Consultants, PA

248 LePhillip Court • Concord, North Carolina 28025 • Phone: (704) 720-9405 • Fax: (704) 720-9406
www.SandEC.com

Attached is a proposed design for a innovative Septic System for a 5 bedroom single family residence on lot 130 Fairington Oaks Mecklenburg County, North Carolina.

Contents: **Page**

Information for the Installer---------- 1

Design Information
- Layout Specifications---------- 2
- Repair ---------- 3

Site Plan/System Plan---------- 4

Septic Tank Diagram---------- 5

Maintenance---------- 6-9

June 30, 2008
S & EC Project No. 5-1553
Design By: E. Bailey

Greensboro Office:
3817-E Lawndale Drive
Greensboro, NC 27455
Phone: (336) 540-8234
Fax: (336) 540-8235

Raleigh Office:
11010 Raven Ridge Road
Raleigh, NC 27614
Phone: (919) 846-5900
Fax: (919) 846-9467

INFORMATION FOR THE INSTALLER:

- The permit should be read very carefully prior to bidding. The following are details that must be considered along with all other considerations.
- Tanks shall be approved by DEHNR, and certification supplied by the manufacturer.
- Tanks shall be water tested prior to installation.
- The installer shall be responsible to the owner for placement of the tanks and to insure that final grades are returned to the original natural grade, with exception of added structural features.
- The supply trench shall be compacted to eliminate cavities left during initial fill placement.
- Installation of the system shall be during dry conditions in order to protect the soil structure.
- All fittings shall be pressure rated fittings.
- All joints shall be cleaned with PVC pipe cleaner and a heavy bodied glue applied to weld all joints.
- Where required by the county health department, post installation inspections by the designer must be scheduled 5 week days in advance.
- Trenches shall be carefully excavated so the bottom is within 2" from the highest to the lowest points of elevation within the trench. If the bottom elevation needs adjusting after it has been trenched, it will be done by removing high points rather than filling low points. It is extremely important to insure that trenches are not over excavated during initial trenching. All fine grading within the trench will be hand done with a shovel. No loose material will be left in the trench
- All pipe openings in the tanks shall be properly grouted. This also applies to the joints around the riser.
- All tanks shall be properly back filled and compacted to prevent slump at a later date.
- Earth dams, constructed of relatively impervious material, shall be installed at the beginning and end of each lateral.
- Elevations at pinflag locations should be checked by the installer prior to beginning trenches.
- Septic tank riser shall be a minimum of 6" above finished grade.
  System is specified as a innovative installation
- Repair is specified as a PPBPS with low pressure distribution
- Trench bottom to be 24" on system and 30+ on repair

Fairington Oaks Lot 130

Project No. 5-1553

LAYOUT FOR 5 BEDROOM HOME

June-08

LINE #	FLAG COLOR	BS	HI	FS	ELEVATION	FLAGGED LINE LENGTH
TBM		2.5			100.00	
INSTR. 1			102.50			
			Repair			
1	Yellow			1.60	100.90	33
2	Blue			2.20	100.30	45
3	Pink			3.20	99.30	55
4	Red			4.00	98.50	67
5	Orange			5.00	97.50	86
6	Yellow			5.40	97.10	47
					Total	**333**
			System			
7	Blue			7.40	95.10	110
8	Pink			8.30	94.20	110
9	Red			9.20	93.30	105
10	Orange			10.60	91.90	105
11	Yellow			11.50	91.00	105
						535

	LINE LENGTH	Soil LTAR	SYSTEM TYPE	Innovative Type	DISTRIBUTION	Trench Depth
SYSTEM	535	0.3	Innovative	25%	Drop Box	24
REPAIR	333	0.3	PPBPS	50%	Low Pressure	30"+

Notes:

**TBM is top of house corner

**Nitrification lines are demonstrated on contour via colored pin flags

**BS, HI, and FS indicate rod readings


**Lines may be longer in field than design requires

**Repair lines longer than 70' are to be center distributed

Fairington Oaks lot 130

REPAIR

Line #	Color	Length	# Panels	Hole Size	Flow
1	Yellow	33	7	5/32"	2.87
2	Blue	45	10	5/32"	4.1
3	Pink	55	12	5/32"	4.92
4	Red	67	15	5/32"	6.15
5	Orange	86	20	5/32"	8.2
6	Yellow	47	11	5/32"	4.51
		333	75		30.75

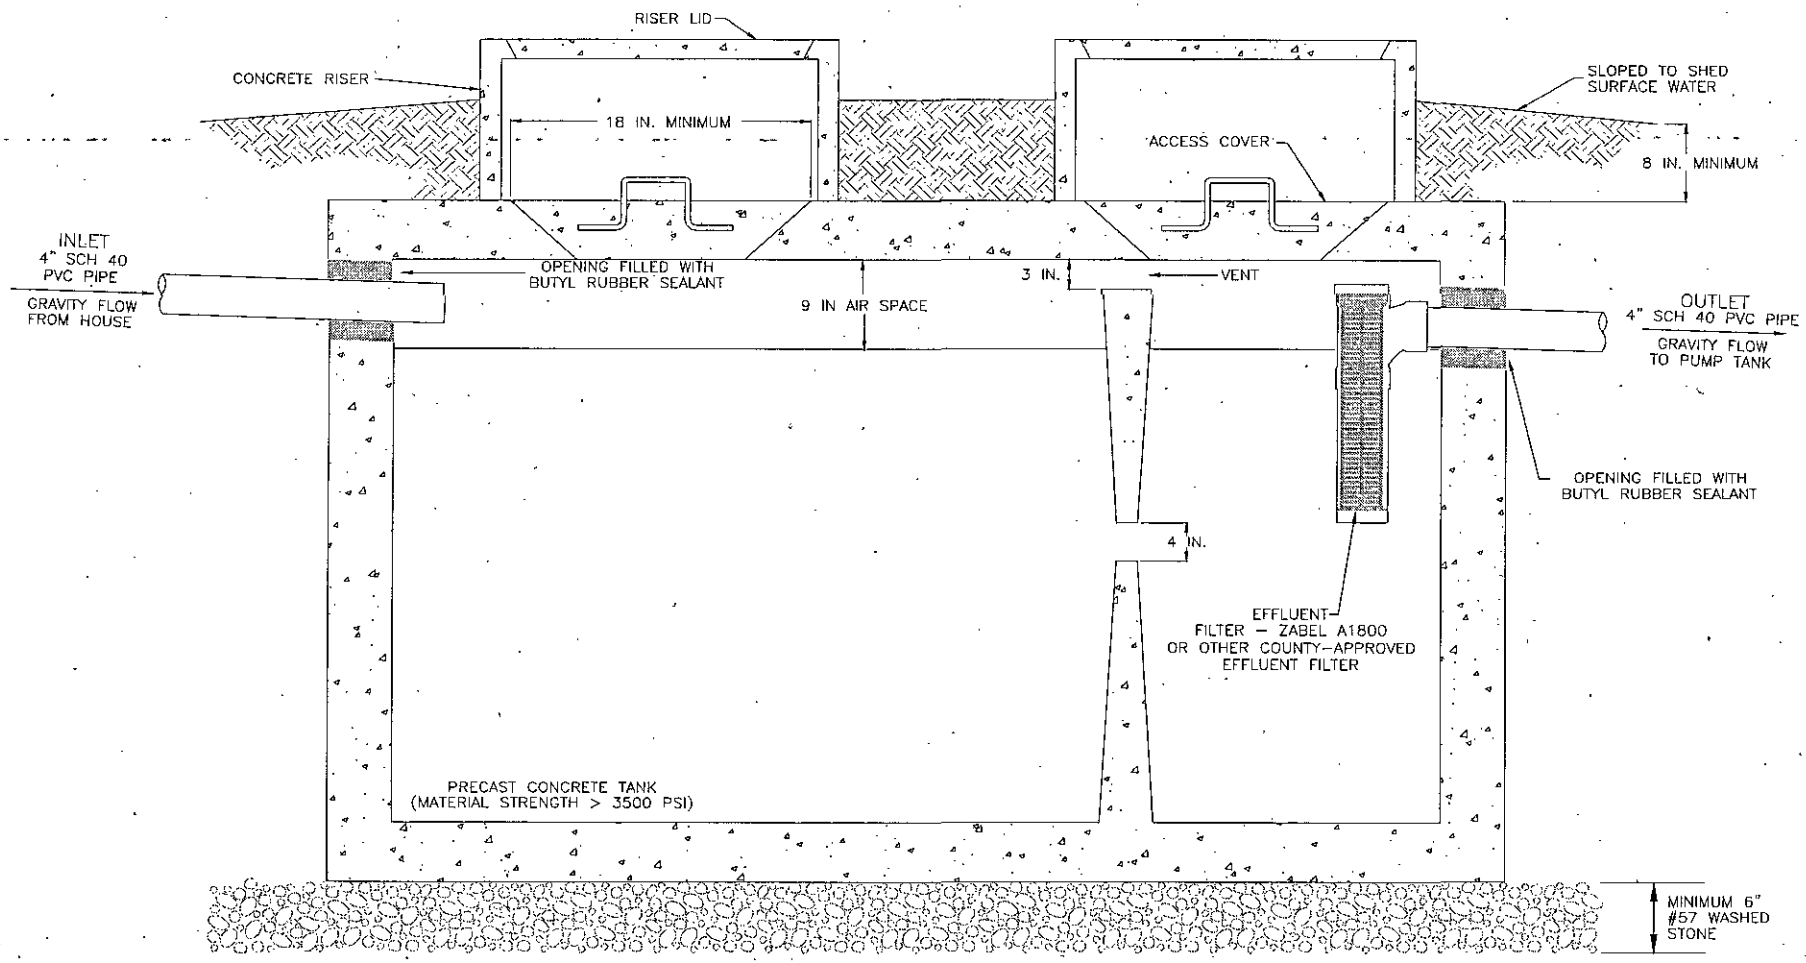

NOTES

1. TANK DIMENSIONS VARY BY MANUFACTURER.

1500 GALLON SEPTIC TANK

PROJECT NO. 4591	PROJECT NAME: **Fairington Oaks Lot 130**
PROJECT MGR.	
SCALE NTS	SHEET TITLE: SEPTIC TANK DIAGRAM

S&EC
Soil & Environmental Consultants, Inc.
11010 Raven Ridge Road Raleigh, North Carolina 27614 Phone: (919) 846-5900 Fax: (919) 846-9467
Web Page: www.SandEC.com

5

(1) The pit shall consist of an excavation at least 42 inches square and in no case shall the bottom of an excavation be closer than one foot from the seasonally high water table or rock.

(2) The pit shall be properly curbed to prevent caving. In sandy or loose soil, the curb should extend the full depth of the pit. In tight soils, partial curbing is acceptable if it prevents caving.

(3) The privy floor slab shall be constructed of reinforced concrete. Where it is impractical to secure or construct reinforced concrete floor assemblies, wood construction shall be acceptable provided the floor slab is made of rough sub-flooring and covered with tight tongue-and-groove flooring or other type flooring materials to provide strength and prevent entrance of flies and mosquitoes to the privy pit. Where wood construction is used, floors shall be anchored to at least four-inch by four-inch sills.

(4) Wood used for riser, seat assemblies, and the floor slab shall be tongue-and-groove or plywood (exterior or marine) material.

(5) Privies shall not be used for the disposal of water-carried sewage.

History Note: *Authority G.S. 130A-335(e);*
Eff. July 1, 1982;
Amended Eff. December 1, 1990.

15A NCAC 18A .1960 MAINTENANCE OF PRIVIES

(a) Any person owning or controlling the property upon which a privy is located shall be responsible for these requirements:

(1) The privy building shall afford a reasonable degree of protection from bad weather conditions.

(2) When the pit becomes filled to within 18 inches of the top of the ground, the privy building shall be moved to a new pit and the old pit completely covered with earth.

(3) If the pit caves in, a new pit shall be provided.

(b) The tenant or person occupying the property shall be responsible for these requirements:

(1) The walls, floors, and seat of the privy and grounds immediately adjacent to the building shall be kept in a clean and decent condition.

(2) Fowl and other animals shall not be harbored in the privy building.

(3) Seat cover shall be hinged and closed at all times when the privy is not in use.

(4) Flies shall be excluded from the pit at all times.

(5) Ashes, garbage, and trash shall be kept out of the pit.

History Note: *Authority G.S. 130A-335(e) and (f);*
Eff. July 1, 1982;
Amended Eff. January 1, 1990.

15A NCAC 18A .1961 MAINTENANCE OF SEWAGE SYSTEMS

(a) Any person owning or controlling the property upon which a ground absorption sewage treatment and disposal system is installed shall be responsible for the following items regarding the maintenance of the system:

(1) Ground absorption sewage treatment and disposal systems shall be operated and maintained to prevent the following conditions:

(A) a discharge of sewage or effluent to the surface of the ground, the surface waters, or directly into groundwater at any time; or

(B) a back-up of sewage or effluent into the facility, building drains, collection system, or freeboard volume of the tanks; or

(C) a free liquid surface within three inches of finished grade over the nitrification trench for two or more observations made not less than 24 hours apart. Observations shall be made greater than 24 hours after a rainfall event.

The system shall be considered to be malfunctioning when it fails to meet one or more of these requirements, either continuously or intermittently, or if it is necessary to remove the contents of the tank(s) at a frequency greater than once per month in order to satisfy the conditions of Parts (A), (B), or (C) of this Paragraph. Legal remedies may be pursued after an

authorized agent has observed and documented one or more of the malfunctioning conditions and has issued a notice of violation.

(2) Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

(b) System management in accordance with Tables V(a) and V(b) of this Rule shall be required for all systems installed or repaired after July 1, 1992. After July 1, 1992, system management in accordance with Tables V(a) and V(b) shall be required for all existing Type V and Type VI systems.

(c) No Improvement Permit or Construction Authorization shall be issued for Type IV, Type V, or Type VI systems, unless a management entity of the type specified in Table V(b) is specifically authorized, funded, and operational to carry out this management program in the service area where the proposed system is to be located.

(d) A local health department may be the public management entity only for systems classified Type IV, V(a) and V(b) and only when specifically authorized by resolution of the local board of health.

(e) A contract shall be executed between the system owner and a management entity prior to the issuance of an Operation Permit for a system required to be maintained by a public or private management entity, unless the system owner and certified operator are the same. The contract shall include the specific requirements for maintenance and operation, responsibilities of the owner and system operator, provisions that the contract shall be in effect for as long as the system is in use, and other requirements for the continued proper performance of the system. It shall also be a condition of the Operation Permit that subsequent owners of the system execute such a contract.

(f) Inspections of the system shall be performed by a management entity at the frequency specified in Table V(b). The management entity shall report the results of their inspections to the local health department at the specified reporting frequency. However, where inspections indicate the need for system repairs, the management entity shall notify the local health department within 48 hours in order to obtain a Construction Authorization for the repairs.

(g) The management entity shall be responsible for assuring routine maintenance procedures and monitoring requirements in accordance with the conditions of the Operation Permit and the contract.

(h) Sewage systems with multiple components shall be classified by their highest or most complex system type in accordance with Table V to determine local health department and management entity responsibilities.

(i) Sewage systems not identified in this Rule shall be classified by the Division of Environmental Health after consultation with the appropriate commission governing operators of pollution control facilities.

(j) The local health department shall routinely review the performance and operation reports submitted in accordance with Table V(b) of this Rule and shall perform an on-site inspection of the systems as required in Table V(a).

(k) The certified operator shall hold a valid and current certificate from the appropriate commission, and nothing in this Section shall preclude any requirements for system operators, in accordance with Article 3 of G.S. 90A.

TABLE V(a)

LOCAL HEALTH DEPARTMENT RESPONSIBILITIES

System Classification	System Description	Permits Required	Minimum System Review Frequency
Type I	a. Privy b. Chemical toilet c. Incinerating toilet d. Other toilet system e. Grease trap	Improvement Permit, Construction Authorization, and Operation Permit	N/A
Type II	a. Conventional septic system (single-family or 480 GPD or less) b. Conventional septic system with 750 linear feet of	Improvement Permit, Construction Authorization, and Operation Permit	N/A

	nitrification line or less c. Conventional system with shallow placement		
Type III	a. Conventional septic system > 480 GPD (excluding single-family residence) b. Septic system with single effluent pump or siphon c. Gravity fill system d. Dual gravity field system e. PPBPS system, gravity dosed f. Large diameter pipe system g. Other non-conventional trench systems	Improvement Permit, Construction Authorization, and Operation Permit	5yrs.(IIIbonly)
Type IV	a. Any system with LPP distribution b. System with more than 1 pump or siphon	Improvement Permit, Construction Authorization, and Operation Permit	3 yrs.
Type V	a. Sand filter pretreatment system b. Any > 3,000-GPD septic tank system with a nitrification field designed for > 1500 GPD c. Aerobic Treatment Unit (ATU) d. Other mechanical, biological, or chemical pretreatment plant (< 3000 GPD)	Improvement Permit, Construction Authorization, and Operation Permit	12 mos.
Type VI	a. Any > 3,000 GPD system with mechanical, biological, or chemical pretreatment system plant b. Wastewater reuse/recycle	Improvement Permit, Construction Authorization, and Operation Permit	6 mos.

TABLE V(b)

MANAGEMENT ENTITY RESPONSIBILITIES

System Classification	Management Entity	Minimum System Inspection/Maintenance Frequency	Reporting Frequency
Type I	Owner	N/A	N/A
Type II	Owner	N/A	N/A
Type III	Owner	N/A	N/A
Type IV	Public Management	2/yr.	12 mos.

	Entity with a Certified Operator or a private Certified Operator		
Type V	Public Management Entity With a Certified Operator or a private Certified Operator	a. 2/yr (0-1500 GPD) 4/yr (1500-3000 GPD) 12/yr (3000-10000 GPD) 1/wk (> 10000 GPD) b. 12/yr (3000-10000 GPD) 1/wk (> 10000 GPD) c. 4/yr. d. 12/yr.	6 mos.
Type VI	Public Management Entity With a Certified Operator	a. 1/wk(3000-10000 GPD) 2/wk(10000-25000 GPD) 3/wk(25000-50000 GPD) 5/wk(> 75000 GPD) b. 12/yr.	3 mos.

(l) A sewage collection, treatment, and disposal system that creates or has created a public health hazard or nuisance by surfacing of effluent or discharge directly into groundwater or surface waters, or that is partially or totally destroyed shall be repaired within 30 days of notification by the state or local health department unless the notification otherwise specifies a repair period in writing. If a system described in the preceding sentence has for any reason been disconnected, the system shall be repaired prior to reuse. The state or local health department shall use its best professional judgement in requiring repairs that will reasonably enable the system to function properly. If, for any reason, a sewage collection, treatment, and disposal system is found to be nonrepairable, or is no longer required, the system shall not be used, and may be required to have any contents removed, collapse any components and backfill, or otherwise secured as directed by the authorized agent to protect the public health and safety.

(m) When necessary to protect the public health, the state or local health department may require the owner or controller of a malfunctioning system to pump and haul sewage to an approved wastewater system during the time needed to repair the system.

History Note: *Filed as a Temporary Amendment Eff. July 3, 1991, for a period of 180 days to expire on December 30, 1991;*
Filed as a Temporary Amendment Eff. June 30, 1990, for a period of 180 days to expire on December 27, 1990;
Authority G.S. 130A-335(e),(f);
Eff. July 1, 1982;
Amended Eff. August 1, 1991; October 1, 1990; January 1, 1990; August 1, 1988;
Temporary Amendment Eff. January 20, 1997;
Amended Eff. August 1, 1998.

15A NCAC 18A .1962 APPLICABILITY

The provisions of this Section shall not apply to properly functioning sewage collection, treatment, and disposal systems in use or for which a valid permit to install a system has been issued prior to July 1, 1977. This provision is applicable only where the sewage flow and sewage characteristics are unchanged. This provision does not affect the requirements for system operation, maintenance, and management in accordance with Rule .1961 of this Section.

History Note: *Authority G.S. 130A-335(e);*
Eff. July 1, 1982;
Amended Eff. August 1, 1991; December 1, 1990.

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ☐ N/A ☑ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☑ N/A ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 19521309
STREET ADDRESS: 13203 Fairington Oaks Drive
CITY:
STATE: NC ZIP: 28227
SUBDIVISION NAME: Fairington Oaks
LOT #: 130 LOT SIZE (acres): approx. 1 ac
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☑ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:
BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☑ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE:
NUMBER OF BEDROOMS: 5
NUMBER OF OCCUPANTS:
FOUNDATION TYPE:
☐ CONCRETE SLAB ☑ BASEMENT WITH PLUMBING
☐ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A
NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☑ MUNICIPAL ☐ PRIVATE WELL ☐ PUBLIC WELL ☐ SHARED WELL ☐ OTHER _____

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE (DRINKING WATER) ☐ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:
☐ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☑ INNOVATIVE ☐ ALTERNATIVE ☑ OTHER PFBPS

8A. RANK: ____ ____ 1 ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☑ YES	☐ NO	GRADING/SOIL REMOVAL PERFORMED	☑ YES	☐ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☐ YES	☑ NO	JURISDICTIONAL WETLANDS	☐ YES	☑ NO
WELLS, SPRINGS, OR WATER LINES	☑ YES	☐ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES	☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☑ YES	☐ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES	☑ NO
CHEMICAL/PETROLEUM STORAGE TANKS	☐ YES	☑ NO	KNOWN UNDERGROUND CONTAMINATION	☐ YES	☑ NO
WASTE STORAGE	☐ YES	☑ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	☐ YES	☑ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☐ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____ ☐ N/A

12. PROPERTY OWNER:
NAME: McCAR
ADDRESS: 1050 Mallard Creek Rd STE 106
CITY: Charlotte
STATE: NC ZIP: 28262
HOME PHONE:
WORK PHONE: 704-509-5742
MOBILE PHONE:
FAX: 704-509-5743

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: Soil & Environmental Consultants, PA
ADDRESS: 248 LePhillip Ct
CITY: Concord
STATE: NC ZIP: 28025
HOME PHONE:
WORK PHONE: 704-720-9405
MOBILE PHONE:
FAX: 704-720-9406

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6984

Revised on: 7/1/08

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. *I have read this application and certify that the information* provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the *application carefully and sign in the space provided below.*

Soil & Environmental Consultants, PA (Agent for Applicant) — 7/8/2008

Property Owner's or Owner's Legal Representative Signature — Date

---

OFFICE USE ONLY

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEES RECEIVED: $ 250.00 CK 1076 DATE FEE RECEIVED: 7/8/08

WELL APPLICATION FEES RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: JC

GWS FILE NUMBER ASSIGNED: 07844B

APPLICATION ID NUMBER ASSIGNED: 3693

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6984

Revised on: 7/1/08

DRAFT
FOR REVIEW ONLY


**SUITABLE FOR PRELIMINARY PLANNING PURPOSES ONLY. ALL LOTS WILL REQUIRE APPROVAL BY THE COUNTY HEALTH DEPARTMENT ON A LOT BY LOT BASIS. THIS MAP SHOULD BY USED AS A GENERAL GUIDE, SOME ADJUSTMENTS WILL BE NECESSARY IN THE FIELD DUE TO SOIL VARIABILITY AND TOPOGRAPHIC IRREGULARITIES.
THIS MAP ONLY REFLECTS EXISTING SOIL SUITABILITY FOR ON-SITE SEPTIC TANK SYSTEMS. SOME OTHER CONSIDERATIONS THAT AFFECT SITE SUITABILITY THAT SHOULD BE CONSIDERED IN DEVELOPMENT DESIGN ARE:

1) 10' SETBACK FROM PROPERTY LINE
2) 100' SETBACK FROM ANY WELL
3) 50' SETBACK FROM STREAMS, PONDS OR LAKES.

See accompanying S&EC report.

Not A Survey

- Lines longer than 70' center distributed (repair)

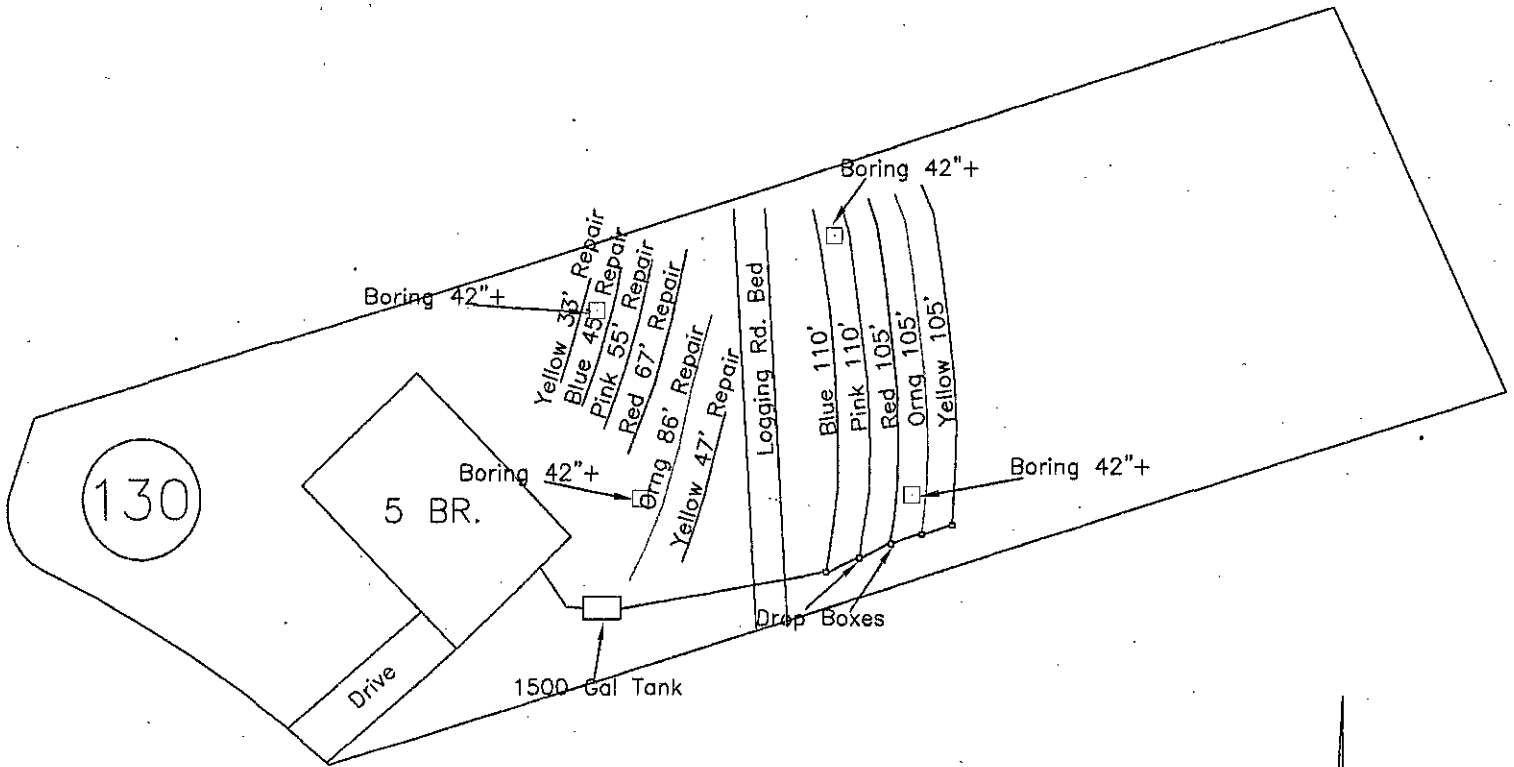

GRAPHIC SCALE
1" = 60'

60 0 60 120

PROJECT NO.	#5-1553
PROJECT MGR.	BF
DRAWN BY	E.B.
FIELD WORK	BB BF CB
SCALE	1" = 60
FILE	Y:\jobs\1553

Soil & Environmental Consultants, PA
218 Lethia Court, ■ Concord, North Carolina, 28025 ■ Phone (704)720-4495 ■ Fax (704) 788-9406

S&EC

Farrington Oaks
McKee Homes
- Farrington Oaks Lot 130 -
MECKLENBURG COUNTY, NORTH CAROLINA
JUNE 2005

SHEET TITLE:
PRELIMINARY SITE PLAN
SKETCH MAP

SHEET 1 OF 1

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 7844B WASPS App #: _____

Primary ES assigned to project: J Michael

Secondary ES assigned to project: —

Project Type: New System ☒ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☑
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☑
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 4 Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☑	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☑	No ☐	N/A ☑
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☑	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☑	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☑	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: 11/22-11

OP issued date: 11/28-11

Review performed by: P Walker RS1 Date performed: 9/2011

FEE: 400.00
DATE: 2/6/2013

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 7844B

PERMIT NUMBER: 30005222

PARCEL NUMBER: 19521309

JOB LOCATION INFORMATION

ADDRESS: 13203 FAIRINGTON OAKS DR

CITY: CHARLOTTE **STATE: NC** **ZIP:** 28227

ISSUED TO: True Homes

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 9/9/2011

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30005222, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.
   *CONSTRUCTION AUTHORIZATION EXPIRATION DATE: 9/9/2016

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 78443 Permit #: 3693 Tax Parcel #: 19521309

Property Owner: Farrington Oaks / True Homes

Job Location Address: 13203 Farrington Oaks Dr

City: Charlotte State: NC Zip Code: 28227

Installation Approval Issuance Date: 11/22/11

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 12/22/11, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 480 GPD

Site LTAR: .3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: N/A gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 4 @ 100 feet

Depth of Media: 12 inches (Type) 25% Reduction

Distribution Device: D Box

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10 feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

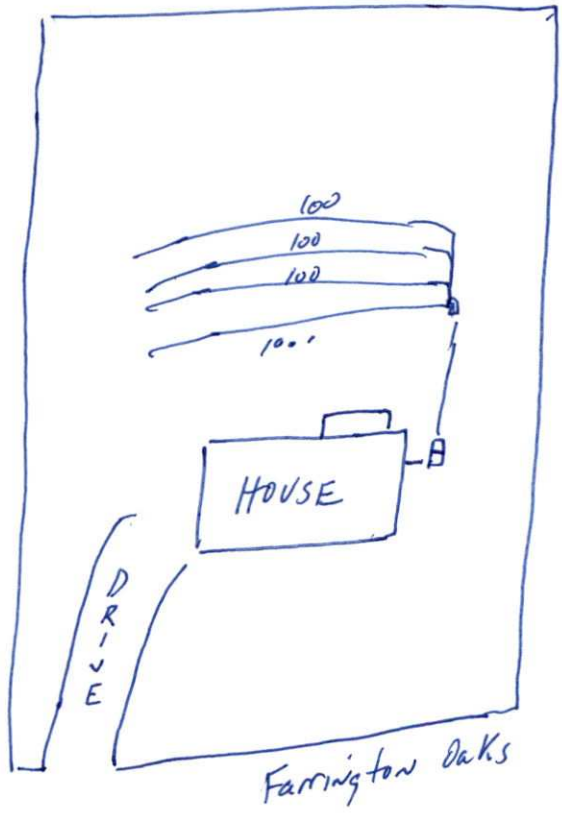

Comments: System Classification & Type: III 1500 ST, Install 4 lines @ 100' long @ 3' wd

DENR Authorized Agent: Philo Walker REHS Signature: Philo Walker REHS

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	09/23/11	**Amount:**	200.00
Receipt #:	74221	**Tendered:**	200.00
Check / Auth #:	CHECK 2190	**Returned:**	0.00
Received By:	BEACHMS		

Account Information

Account #: 200000
Contractor: TRUE HOMES
Attn: TRUE HOMES
Address: 2649 BREKONRIDGE CENTRE DRIVE
Address:
City/State/Zip: MONROE, NC 28110

Item	Description	Permit#	Quantity	Unit Price	Total Price
0734	Auth for Waste Wtr Sys Constr 13203 FAIRINGTON OAKS DRIVE		1	200.00	200.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	09/23/11	**Amount:**	200.00
Receipt #:	74220	**Tendered:**	200.00
Check / Auth #:	CHECK 2190	**Returned:**	0.00
Received By:	BEACHMS		

Account Information

Account #: 200000
Contractor: TRUE HOMES
Attn: TRUE HOMES
Address: 2649 BREKONRIDGE CENTRE DRIVE
Address: STE 104
City/State/Zip: MONROE, NC 28110

Item	Description	Permit#	Quantity	Unit Price	Total Price
0703	Installation/Final Approval 13203 FAIRINGTON OAKS DRIVE		1	200.00	200.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

CHECK REQUEST

DATE: 8/26/11

INVOICE #:

PAYABLE TO: MECKLENBURG COUNTY –

GIVE TO/MAIL TO: Rosa

FRO130-13203 FAIRINGTON OAKS DR-

FOR: Septic_Installation Fee

AMOUNT: $400.00

DATE NEEDED BY: 8/29/11

REQUESTED BY: Rosa

ACCOUNTING INFORMATION

SUBDIVISION: 0169

LOT: 130

AMOUNT: $ 400.00 each house

COST CODE: 1310-1

APPROVAL:

8-26-11	Aug. 26, 2011	Septic Installation f	400.00	.00	400.00

8-29-11	21907		400.00	.00	400.00

SF16001-1
SAFEGUARD. LITHO USA SFSL1M CK7508111M
TO REORDER, CALL YOUR LOCAL SAFEGUARD DISTRIBUTOR AT 704-846-3321
HNY8RL0010000 G08SF000674

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	08/31/11	**Amount:**	250.00
Receipt #:	73986	**Tendered:**	250.00
Check / Auth #:	CHECK 2190	**Returned:**	0.00
Received By:	BEACHMS		

Account Information

Account #: 200000
Contractor: TRUE HOMES
Attn: TRUE HOMES
Address: 2649 BREKONRIDGE CENTRE DRIVE
Address: STE 104
City/State/Zip: MONROE, NC 28110

Item	Description	Permit#	Quantity	Unit Price	Total Price
0701	Improvment Permit App-Residen 13203 FAIRINGTON OAKS		1	250.00	250.00

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance