

3901 EAGLE LAKE DR N

14108204

12/17/07

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 000088

TC: 141-082-04

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

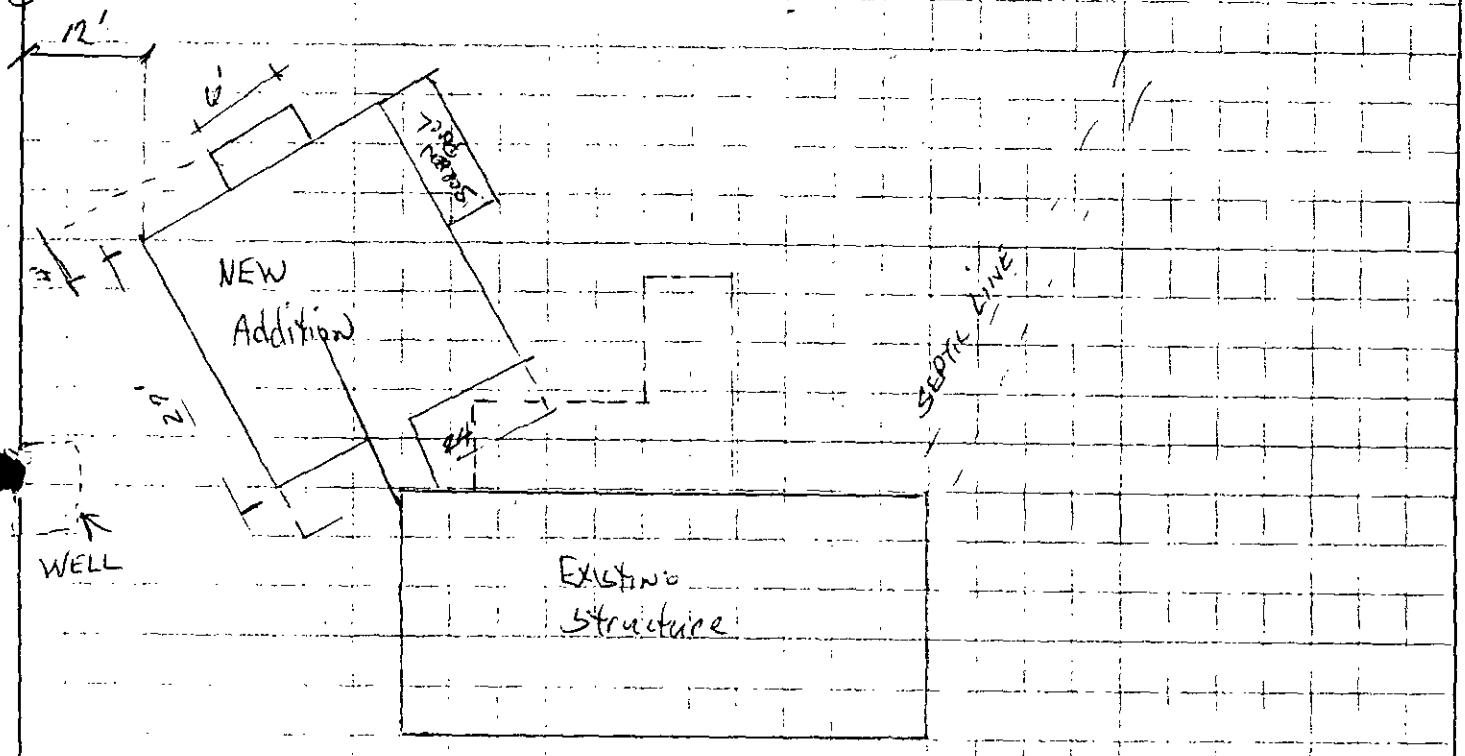

Signed: C B Bowman

Date: 12-9-91

MECKLENBURG COUNTY

Charlotte-Mecklenburg
Building Standards Department

FAX TRANSMITTAL

DATE: Jan 10, 1992

TO: Judy Kiser
Environmental Health Specialist

FROM: Johnnie Waldo

NUMBER OF PAGES TO FOLLOW INCLUDING COVER SHEET: 2

If any of this transmission is not complete or legible, please contact: MC 3803

Message or Comments: (Per our Conversation this morning)

MECKLENBURG COUNTY

Charlotte-Mecklenburg
Building Standards Department

DATE: JANUARY 10, 1992

TO: JUDY KISER, ENVIRONMENTAL HEALTH SPECIALIST

FROM: JOHNNIE WALDO, PERMIT TECHNICIAN II

REFERENCE: **3901 N. EAGLE LAKE DR**

Per our conversation, there has been no building permit obtained for work done at **3901 N. EAGLE LAKE DR**, however, an electrical permit was issued on November 13, 1986 for a furnace, meter box, and motors.

B.K.


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 00008B

TC: 141-082-04

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

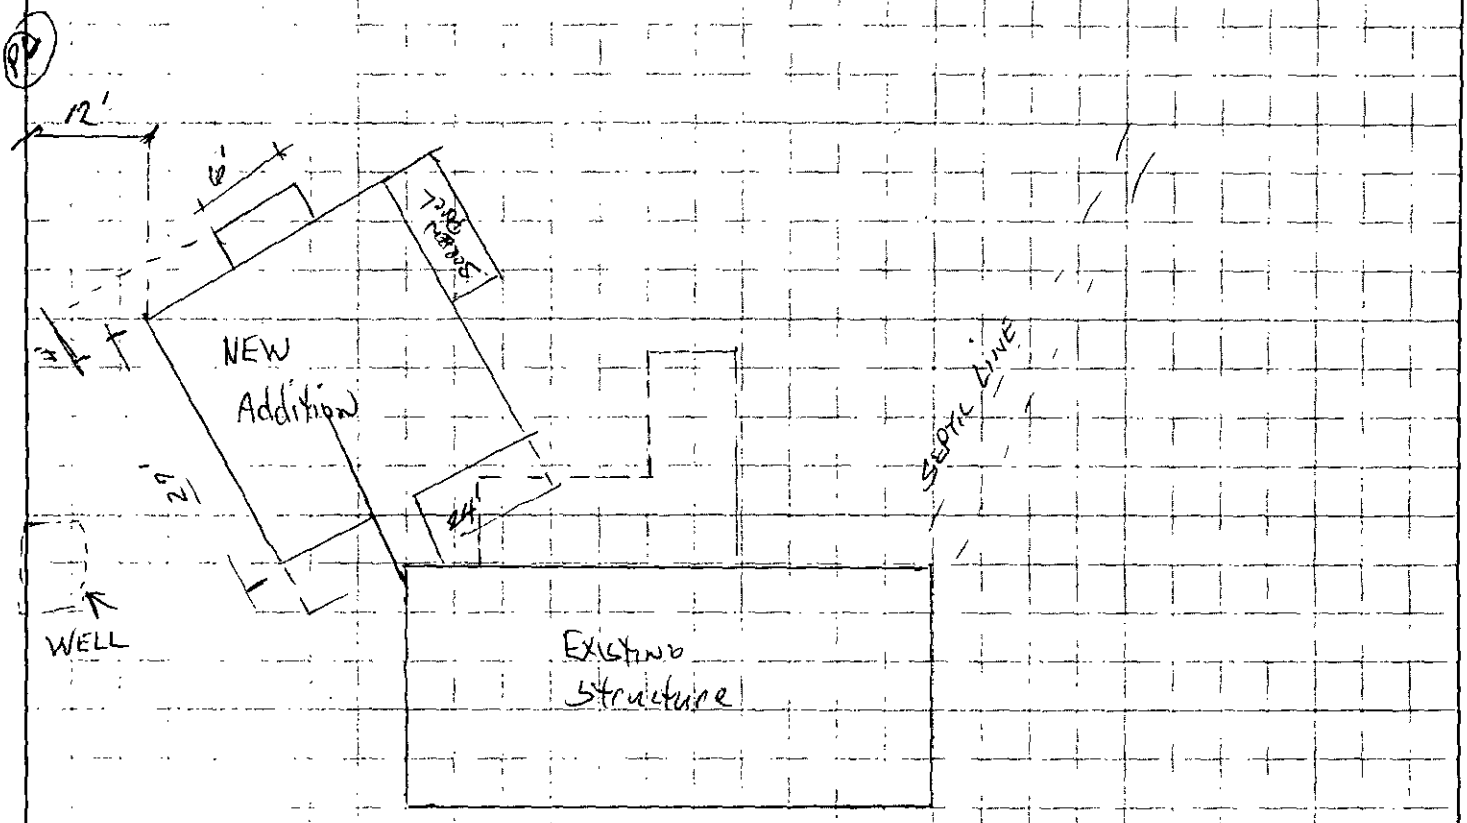

Signed: O.B. Bowman

Date: 12-9-91

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 000083 DATE: 2/10/92
TC: 141-00-04 ☑ L ☑ CRT
SERIAL № 13943

Name of Owner Dennis Nodine Juris.:
Address of Property 3901 Eagle Lake Drive

Inspection Data:

Tank Material PC
Total Length of Drainfield 270'
Number of Lines 3 @ 90'
Cover Depth 24"
Water Supply Source Community
Distance to Water Source ≥ 100
Excavation Inspected 2/10/92
Tank(s) Inspected 2/10/92
Wash Line Inspected
High Water Alarm Inspected

PLOT

Design: 1992 After, 1500 St 810SF, 12" G, Sand CTR# 113

The undersigned has inspected the Septic Tank System described above, and certifies it has been
☐ installed or constructed ☑ altered or repaired
☑ in accordance with the permit issued ☐ as detailed in the plot above
and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this
☑ Certificate of Completion ☐ Operation Permit
does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS: System upgraded for 1 bedroom Addition
Relocated due to location of existing trees to building foundation

STII

Judy J. Rice R.S.
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603


(1891A)

FILE: 00008B DATE: 2/3/92

TC: 141-082-04 ☐ L

SERIAL Nº 14126

Permission is hereby given to ____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 12/9/91. All work shall be completed on or before 3/3/92, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

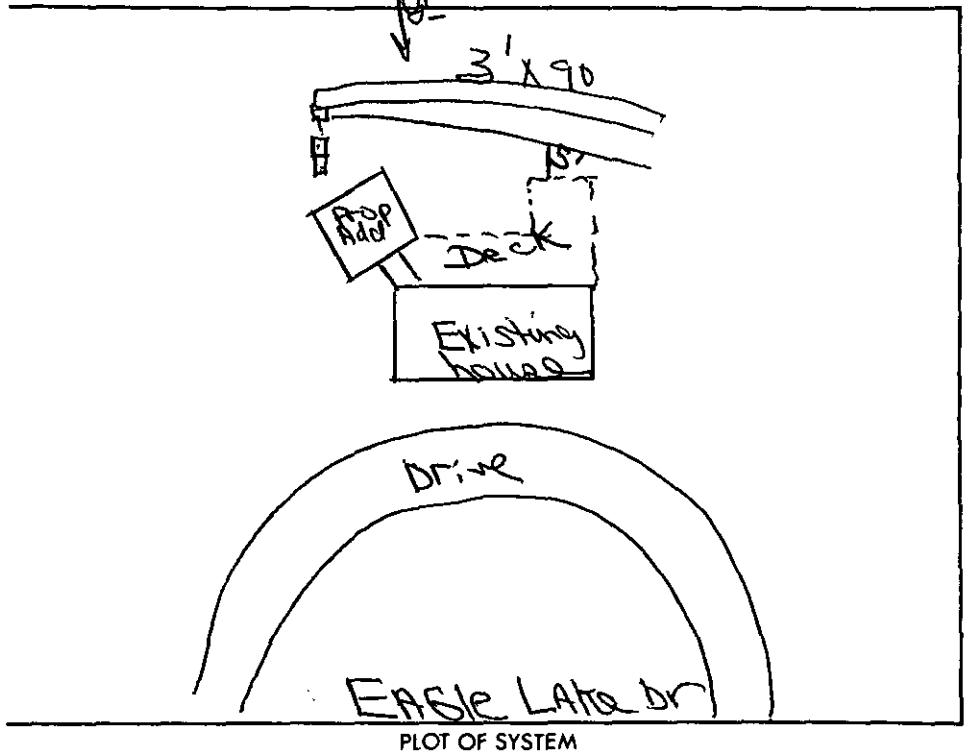

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank ____ gallons

Tank Construction PCC

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 270 feet

Number of Lines 3

Depth of Stone 12 inches

Distance from House 5 Minimum feet

Distance from Property Line 10 feet

Distance from Well Community feet

NAME OF OWNER Dennis Nodine

LOCATION OF PROPERTY 3901 Eagle Lake Drive

Comments: INSTALL New 1500 GALLON TANK, New D-BOX, 3 trenches 3' x 90', 12" Stone

Division or Section Head

Environmentalist Judy J. Kuen R.S

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.