Date Received 7-19-84

SEE INSTRUCTIONS ON BACK

ICAR(S) Application No. 21463

T. C. No. 001-412-06


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ___ Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

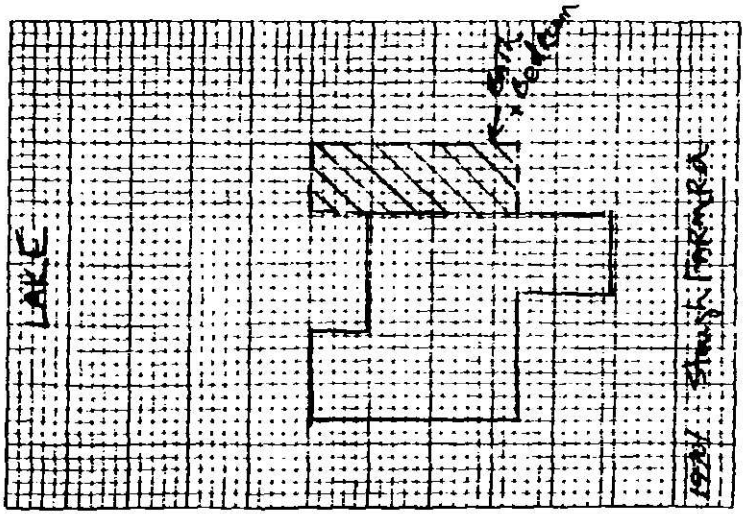

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes ___ No
Residence ✓ Yes ___ No

4) No. of Bedrooms 4
5) Business Use — Max No Employees ___
6) Washing Machine ✓ Yes ___ No
7) Garbage Disposal ___ Yes ___ No
8) Dishwasher ✓ Yes ___ No
9) Water Supply
A) Individual Well ✓
B) Governmental System ___
C) Community System
1 Well source ___
2 Governmental source ___
10) Sewage System
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No
11) FHA Case No ___
12) VA Case No. ___

13) NAME OF OWNER King (LAST) L. (FIRST) Richardson (MIDDLE)

14) ADDRESS OF OWNER 11 Stough Farm Rd. (P.O. Box 459) Davidson, N.C. 28036

15) PHONE NO. Home 892-1385 Office ___

16) LOCATION OF SYSTEM 19701 Stough Farm Rd. (STREET OR COUNTY ROAD)

17) SUBDIVISION Stough Farm Rd Lot No. 60 Block No. ___

Map Book No. ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES ___ NO DATE RUN 1964

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

9/18/84
DATE OF APPLICATION

Mary P. Kimbrough King
OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

C of A (s) No. 2143

Date Issued 10-18-94 **Serial** 7045 T. C. No. 06-412-06 L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Kee Richardson
LAST FIRST MIDDLE

Location of Property 10701 Stillcamp Ln.

Application Number 2143 Permit Number 2143

Inspection Data:

Liquid Capacity of Tank 1000 gal Tank Material Concr

Total Length of Drain Tile 120' Trench 15' Beds Number of Lines 5-5

Depth of Filter Material 14" Cover Depth 2'

Water Supply Source Well Distance from Water Source 50'

Excavation Inspected 10-18-94 DATE Tank Inspected 10-18-94 DATE

Nitrification Field Inspected 10-18-94 DATE

Washing Machine Line Inspected, If Applicable — DATE

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ~~installed~~ or constructed, ~~altered~~ or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments

Environmentalist

EHD-5-76

Environmental Health Department's Copy

Date Issued 10-17-84

Serial No. 7929

SIR No. 21463

T. C. No. 001-412-06

Map Date L, CRT

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
IMPROVEMENT PERMIT

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER King, (LAST) L. (FIRST) Richardson (MIDDLE)

ADDRESS OF OWNER P.O. Box 459, Davidson, NC ZIP 28036

LOCATION OF LOT 19701 Stough Farm Road (STREET OR COUNTY ROAD)

SUBDIVISION _____ LOT NO. _____ BLOCK NO. _____

MAP BOOK NO. _____ PAGE NO. _____

The above specified lot is approved by the Mecklenburg County Department of Environmental Health for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the soil investigation, on an on-site inspection of the said lot; and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 21463 This approval is subject to the following terms and conditions:

1. That the nitrification field be installed, constructed, altered and/or repaired in the same area where the soil investigation was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altered, and/or repaired and that the system be installed in accordance with same.

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic-tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration, and/or Repair Permit.

*** USE EXISTING SYSTEM ***

Environmentalist

Environmental Health Director, or Authorized Section Head

EHD-5-76

Environmental Health Department's Copy

Serial No. 07572

ICAR(S) Permit No. 21463


Date Issued 9-21-84

T. C. No. 001-412-06

Map Date L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ____ Install or Construct, X Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 21463, dated 9-18-84 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before Oct 21st 1984, after which date this permit shall be null and void.

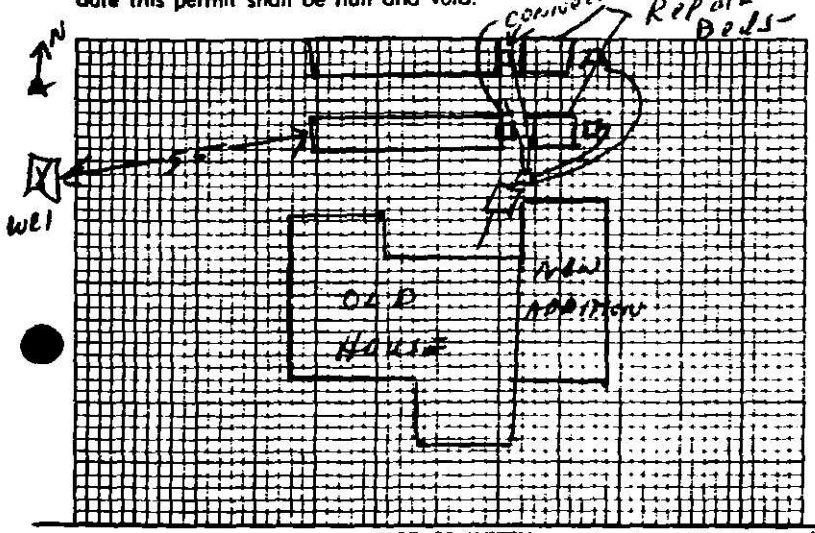

PLOT OF SYSTEM STOUGH FARM RD.

Permeability Rate PS Repair

Liquid Capacity of Tank ____

Tank Construction Repair

Absorption and/or Nitrification Lines:

Total Line Length 100 lin. FT

Number of Lines 5 + 5 on one bed & on other Rep.

Distance from House 10 FT

Distance from Property Line > 10 FT

Distance from Well 55 FT

NAME OF OWNER KING, L. RICHARDSON

LOCATION OF PROPERTY 19701 STOUGH FARM ROAD.

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

Comments: Two beds to be attached to existing beds 10FT x 15 FT x 18 inches stone - layer straw cover - grade bds. Relocate Dist. Box System to EAST

Division or Section Head

Environmentalist Ralph Miller

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

BHD-5-76

Environmental Health Department's Copy