FEE: 100 00
DATE: 12/22/08
CRT [ ]

615413

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM
MECKLENBURG COUNTY - GROUNDWATER & WASTEWATER SERVICES
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

GWS – UES.APP 06/07

FILE #: 44368

TYPE APPLCATION: DC 4019

- ☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A / M)
- ☐ ADDITION - RENOVATION OR GARAGE WITH NO MAJOR CHANGES (X)
- ☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
- ☐ COMMERCIAL OR INDUSTRIAL (N)

P289318

PERSON FILING APPLICATION:
NAME: Donald K Judge
ADDRESS: 6003 Woodbridge Rd
CITY: Charlotte
STATE: NC ZIP: 28227
PHONE: 704-531-4908
ALTERNATE PHONE: 704-231-3468

PROPERTY OWNER:
NAME:
ADDRESS: Same
CITY:
STATE: ZIP:
PHONE:
ALTERNATE PHONE:

JOB LOCATION INFORMATION
TAX/PARCEL #: 109-165-12
STREET ADDRESS: Above Address
CITY:
STATE: NC ZIP:
SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #: 8 B6 1960

TOWNSHIP:
- ☐ 0-MECKLENBURG
- ☐ 1-CHARLOTTE
- ☐ 2-DAVIDSON
- ☐ 3-CORNELIUS
- ☐ 4-PINEVILLE
- ☐ 5-MATTHEWS
- ☐ 6-HUNTERSVILLE
- ☐ 7-MINT HILL

WATER SUPPLY:
☐ MUNICIPAL (M) ☐ COMMUNITY (C) ☑ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

RESIDENTIAL PROPERTY TYPE:
☑ HOUSE (H) ☐ MODULAR HOME (M) ☐ MULTIPLE FAMILY (U)
☐ SINGLE MOBILE HOME (S) ☐ DOUBLE WIDE (D)
☐ OTHER (O)

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2

COMMERCIAL / INDUSTRIAL PROPERTY TYPE:
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ☐ YES ☐ NO
UNDERGROUND STORAGE TANKS? ☐ YES ☐ NO

ADDITION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☐ GARAGE ☐ SUNROOM ☐ PORCH ☐ DECK ☐ OTHER

ADDITION TYPE DETACHED FROM EXISTING STRUCTURE:
☐ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
☑ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Donald K Judge — 12-19-08
Owner's/Agent's Signature — Date

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted y this Department.
- This permit is not transferable.

☐ ADDITION / RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE

Building Meets Setbacks off Septic

Jeremy Mefford — 12-24-08
EHS Signature — Date


DC.

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File # 4436 B
Date_____

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

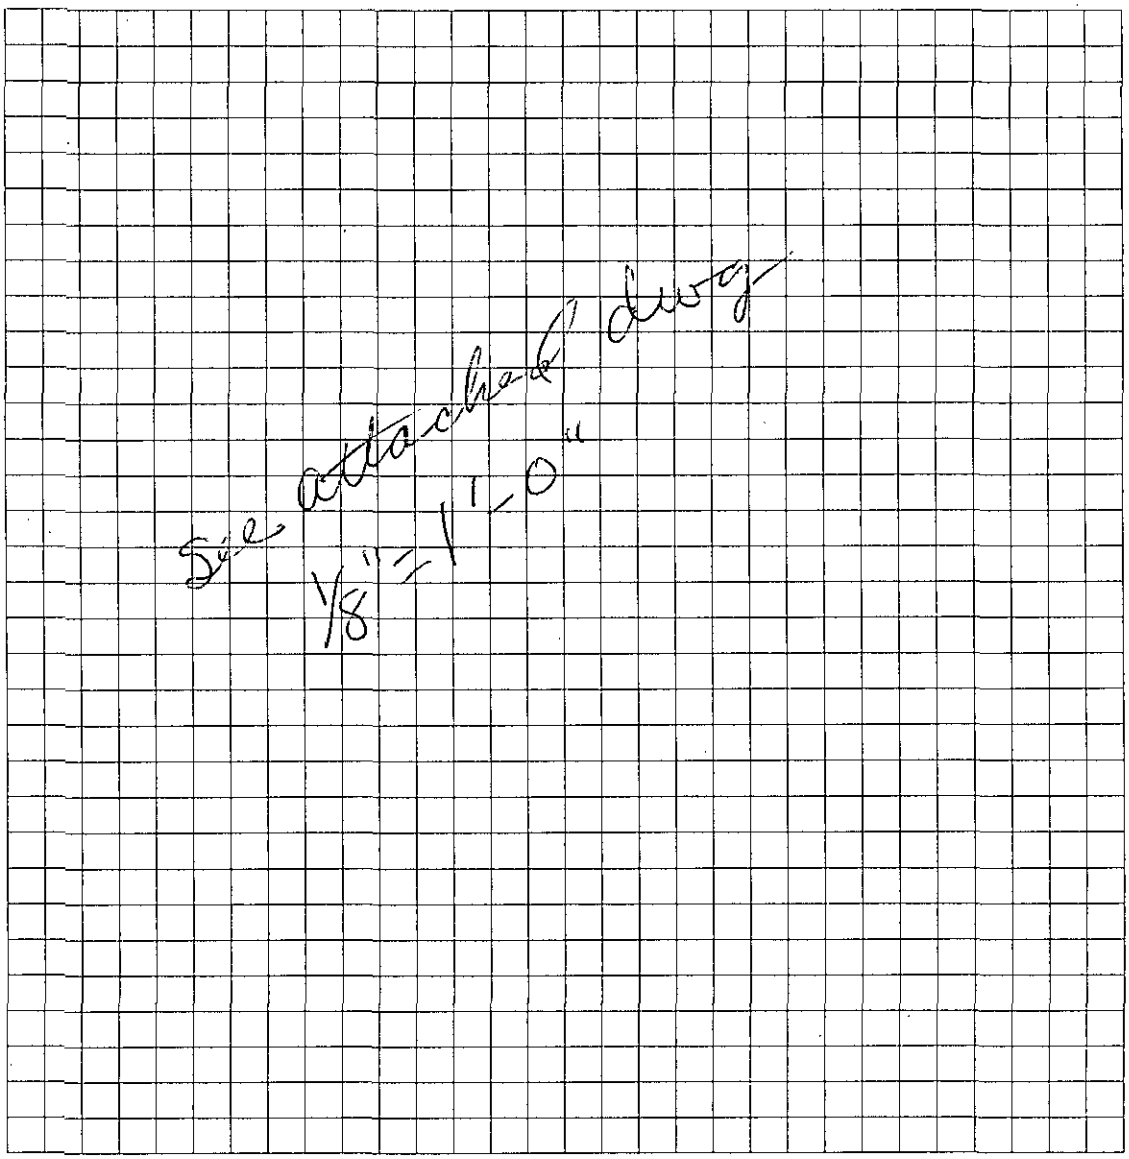


Owner/Agent Signature Donald K Judge

Date 12-19-08

LBC 12/15/04

File # 4436B

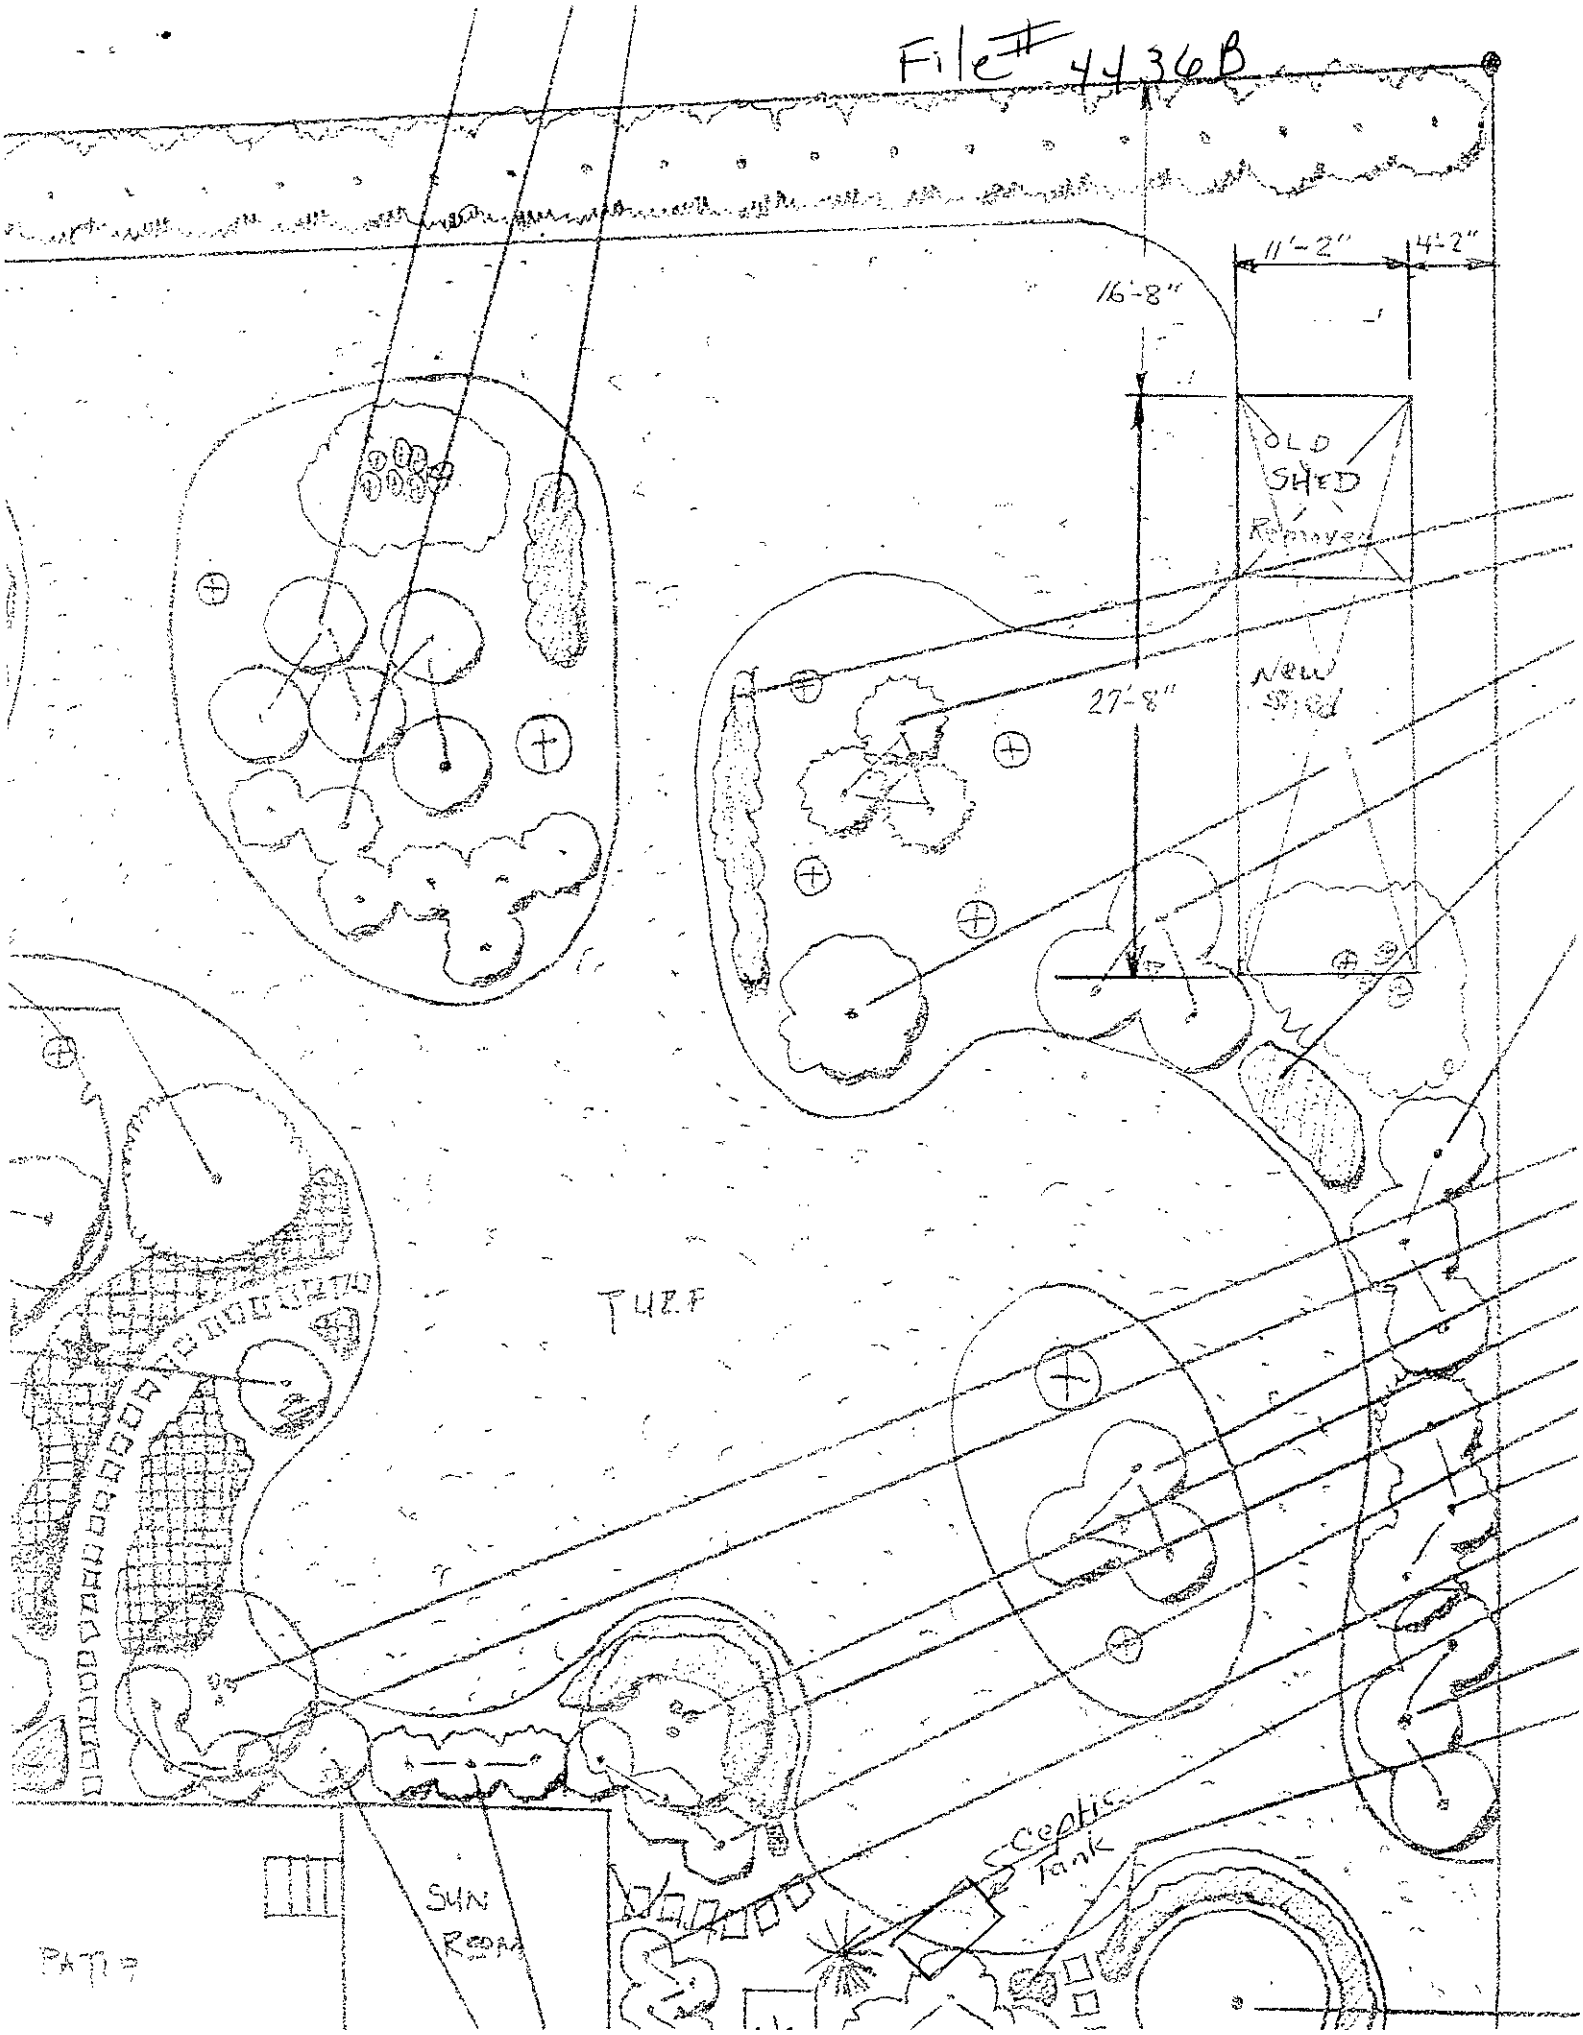
11'-2"
4'-2"
16'-8"
OLD SHED
Removed
New Shed
27'-8"
TURF
SUN ROOM
Septic Tank
PATIO

FEE:

DATE: 10-3-00

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

1 UNIT

TYPE APPLICATION: ___ NEW SYSTEM _ EXPANSION/ ALTERATION OF EXISTING SYSTEM ✓ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 4436

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION: 109-165-12

TAX/PARCEL NUMBER: LB B6 MB-165

STREET ADDRESS: 6003 Woodbridge Rd. 28227

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S) ___ MODULAR HOME (M)
___ DOUBLE WIDE (D) ___ MULTIPLE FAMILY (U)
✓ HOUSE (H) ___ OTHER (O)

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: 8 (1960)

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG ___ 4 PINEVILLE
___ 1 CHARLOTTE ___ 5 MATTHEWS
___ 2 DAVIDSON ___ 6 HUNTERSVILLE
___ 3 CORNELIUS ___ 7 MINT HILL

HEATED SQUARE FOOTAGE: 1600

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 2

CLOSING DATE 6-12-98

FOUNDATION FOR RESIDENCE:

___ WITHOUT BASEMENT ON SLAB
✓ CRAWL SPACE
___ WITH BASEMENT (PLUMBING)
___ WITH BASEMENT (NO PLUMBING)

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

Replace existing septic tank

WILL THERE BE A HOME-BUSINESS IN THE RESIDENCE: ___ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE): ___ COMMUNITY (C) ___ MUNICIPAL (M) ✓ PRIVATE WELL (P)
___ SHARED WELL (S) ___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES ___ NO
EXISTING WASTEWATER SYSTEMS ✓ YES ___ NO
EASTMENTS OR RIGHT-OF-WAYS ___ YES ___ NO
WELL, SPRINGS OR WATERLINES ✓ YES ___ NO
DESIGNATED WETLANDS ___ YES ___ NO

PROPERTY OWNER:	LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:
NAME: Judge, Donald K. (LAST) (FIRST) (MI)	NAME: (LAST) (FIRST) (MI)
ADDRESS: 6003 Woodbridge Rd.	DAYTIME PHONE: ( ) -
CITY: Charlotte STATE: NC ZIP: 28227	
DAYTIME PHONE: (704 -558-4307	

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 1960 ?

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Donald K. Judge DATE: 10-3-00

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4436 B DATE: 10-4-00

TC: 109-165-12 ☒ L

SERIAL No 18515

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 10-3-00. All work shall be completed on or before 11-4-00, after which date this permit shall be null and void. The system shall meet all of the construction requirements of I5A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

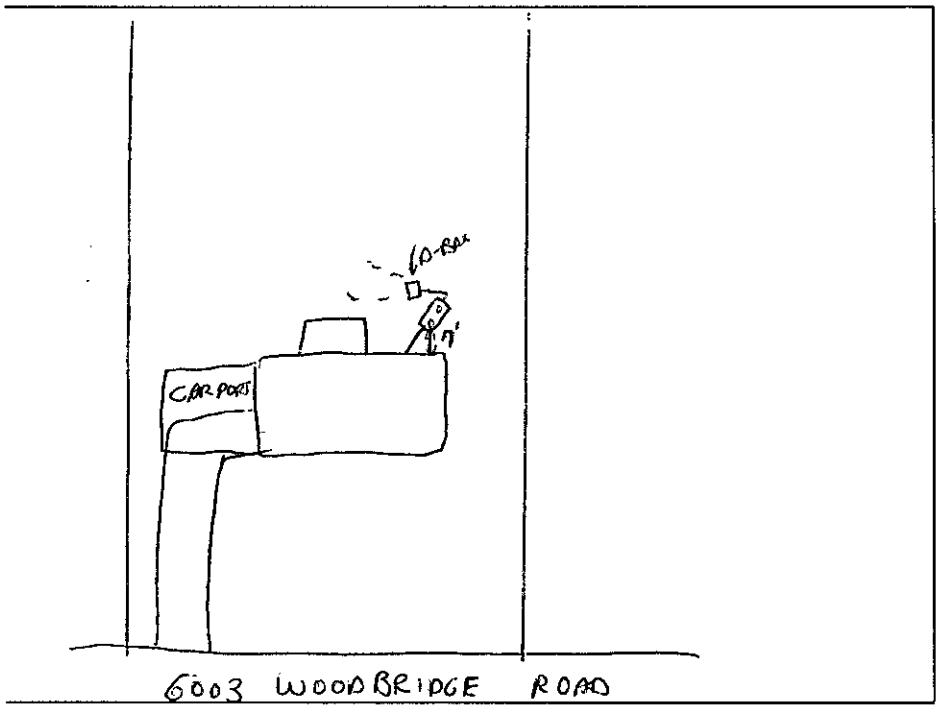

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction PCC

Trench Depth EXISTING

Absorption and/or Nitrification Lines:

Trench Width EXS feet

Trench Walls Scored and Porous EXISTING

Total Line Length EXISTING feet

Number of Lines EXISTING

Depth of Stone — inches

Distance from House — feet

Distance from Property Line — feet

Distance from Well N/A feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER DONALD K. JUDGE

LOCATION OF PROPERTY 6003 WOODBRIDGE ROAD

Comments: (1) SIDE WALL OF TANK CAVED-IN - REPLACE EXISTING TANK WITH NEW 1500 PCC

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 217
CHARLOTTE, NC 28202
PHONE (704) 336-5132

FILE: _____ DATE: _____

TO: _____

SERIAL NO: 18516

Permission is hereby given to _____ Install or Construct _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, surface, or other discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated _____. All work shall be completed on or before _____, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly

Liquid Capacity of
Septic Tank _____ gallons

Liquid Capacity of
Dosing Tank _____ gallons

Tank Construction _____

Trench Depth _____

Absorption and/or Nitrification Lines

Trench Width _____ feet

Trench Walls Scored and Porous _____

Total Line Length _____ feet

Number of Lines _____

Depth of Stone _____ inches

Distance from Hous _____ feet

Distance from Property Line _____ feet

Distance from Well _____ feet

PLOT OR SYSTEM

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER _____

LOCATION OF PROPERTY _____

Comments: _____

_____

_____

_____

_____

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT'S COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4436B DATE: 10-4-00

TC: 109-165-12 ☒ L ☐ CRT

SERIAL Nº 17546

Name of Owner DONALD K. JUDGE Juris.:

Address of Property 6003 WOODBRIDGE ROAD

Inspection Data:

Tank Material PCC 1500 gm

Total Length of Drainfield EXISTING

Number of Lines — @ —

Cover Depth —

Water Supply Source —

Distance to Water Source —

Excavation Inspected —

Tank(s) Inspected 10-4-00

Wash Line Inspected —

High Water Alarm Inspected —

SEE INSTALLATION PERMIT

PLOT

Design REPAIR - REPLACE EXISTING TANK CTR# STEVE AVERY

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: TYPE II

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.



6003 WOODBRIDGE RD

10916512

1/4/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 44368 WASPS App #: 4019

Primary ES assigned to project: KJ

Secondary ES assigned to project: _____

Project Type: New System ☐ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☐
.1945(b) 130A-336 (a)(3)	Proposed System Type stated-Repair System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g) 130A-336(a)	Is the System located in the approved area? Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: _____

OP issued date: _____

Review performed by: IR Date performed: 12-24-08

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	12/19/08	**Amount:**	100.00
Receipt #:	60021	**Tendered:**	0.00
Check / Auth #:	VISA 01541B	**Returned:**	0.00
Received By:	CRAIGGY		

Account Information

Account #: 200000
Contractor: JUDGE DONALD K
Attn:
Address: 6003 WOODBRIDGE ROAD
Address:
City/State/Zip: CHARLOTTE, NC 28227

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	MH Exc/Add/Repl w/o System Mod 6003 WOODBRIDGE RD		1	100.00	100.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
		10.00			