

11324 MOORES CHAPEL RD

05309338

8/22/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 19774 DATE: 6/17/03

TC: 053-04-338 ☑ L ☑ CRT

SERIAL 19250

Name of Owner Richard Patterson Juris.:

Address of Property 11324 Moores Chapel Road

Inspection Data:

Tank Material PVC

Total Length of Drainfield 533'

Number of Lines 5 @ 100+'

Cover Depth 18"

Water Supply Source Well


Distance to Water Source >50'

Excavation Inspected 6/17/03

Tank(s) Inspected N/A

Wash Line Inspected N/A

High Water Alarm Inspected N/A

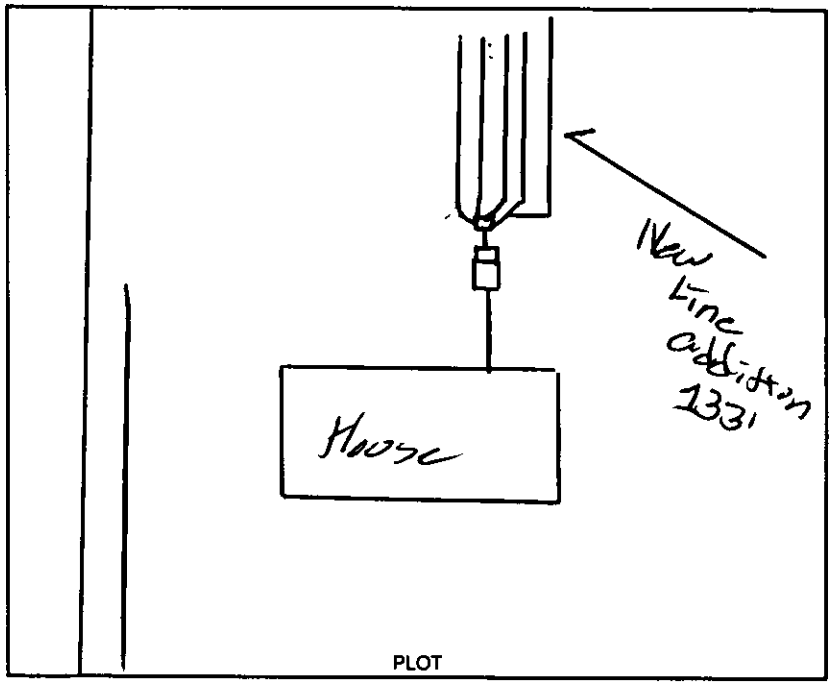

Design 2003 Alteration, Bedroom addition, 12" stone, CTR#

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☒ altered or repaired

☐ in accordance with the permit issued ☒ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: This is a bedroom addition with 133' of drainline added. No installation permit since work was done by home owner.

Brandon Sorey
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 19774

TC: 053-093-38

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

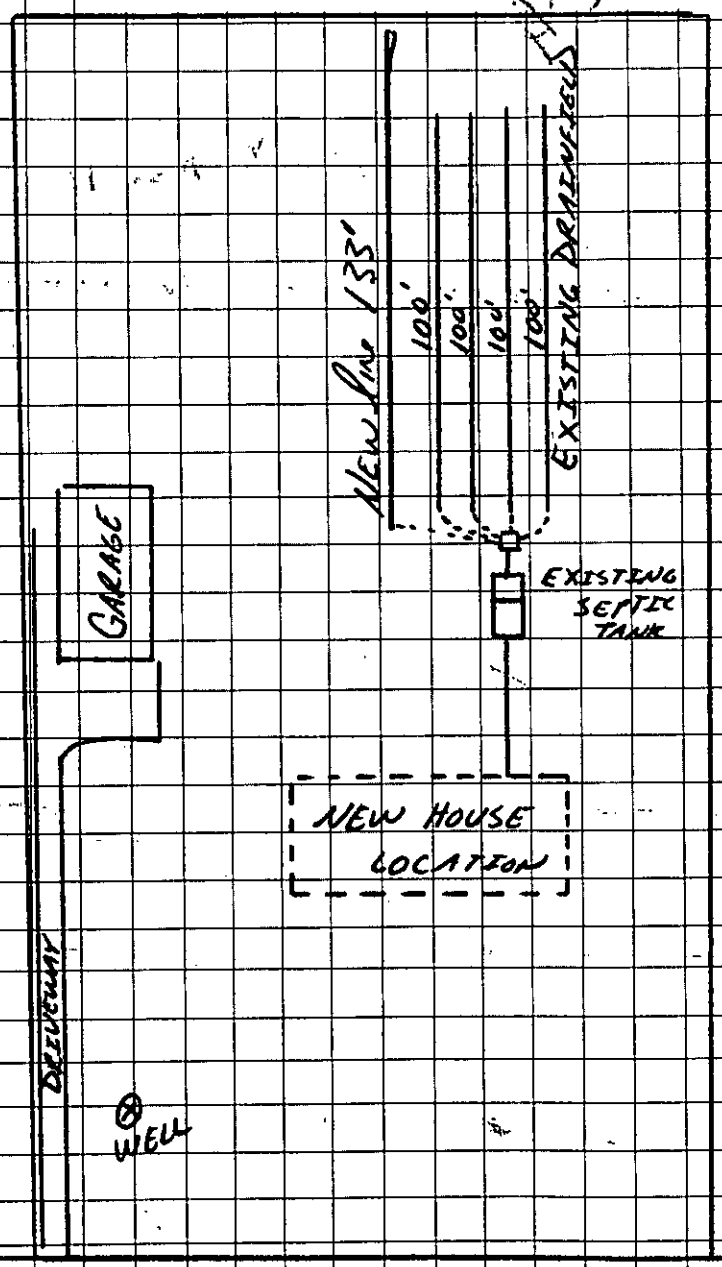

Comments

→ Not Drawn to Scale

→ House upgraded from 3 Bedrooms to 4 Bedrooms.

→ Add additional 133' of drainfield to the existing system.

→ Type II Conventional System.

Richard T. Vitale
OWNER/AGENT SIGNATURE

DATE 5/8/00

APPROVAL DATE Jerry P. Middle 5/3/00

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 19774

TC: 053-093-38

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

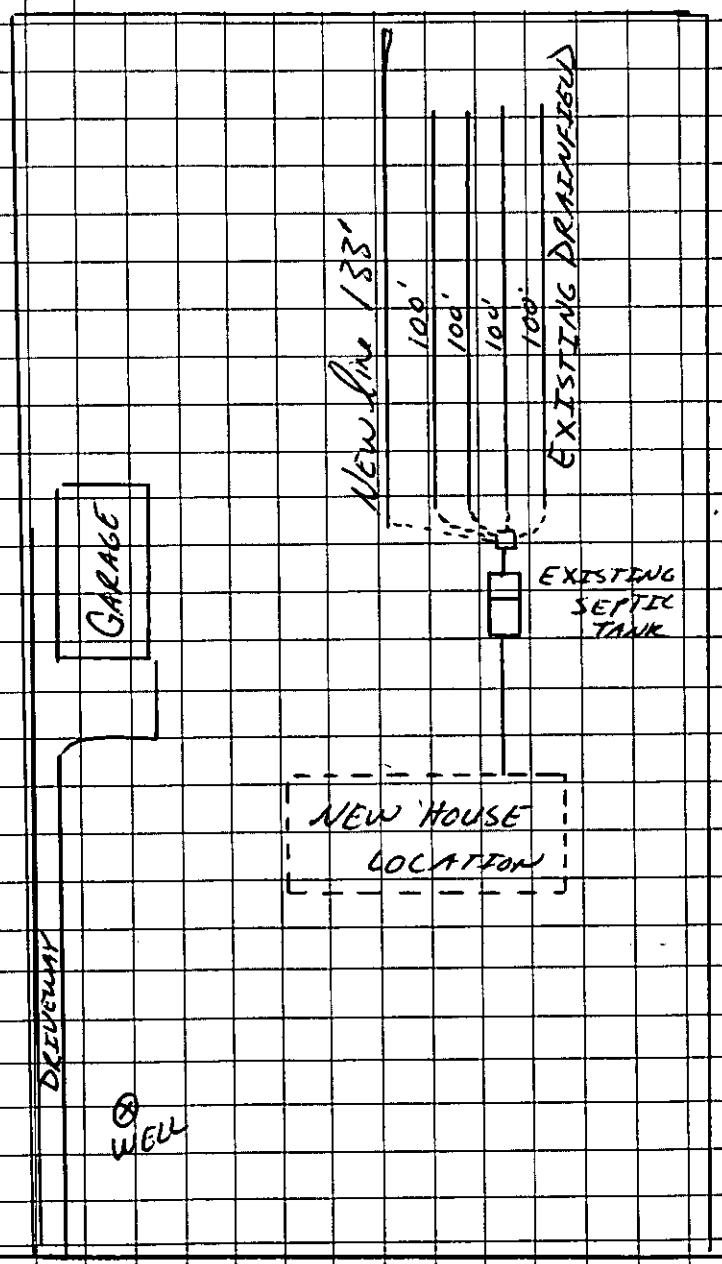

Comments

→ Not Drawn to scale

→ House upgraded from 3 Bedrooms to 4 Bedrooms.

→ Add additional 133' of drainfield to the existing system.

→ Type II Conventional System.

X Richard P. Patterson
OWNER/AGENT SIGNATURE

DATE 5/6/00

APPROVAL DATE Jenny P. Michele 5/8/00

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

CC Deposit # 021789

FEE: 200.00 **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION** PCS X
DATE: 5/8/00 sc **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE**

DATE: _____ PERMIT NO: 19774

PARCEL NO: 053-093-58

JOB LOCATION ADDRESS: 11329 Moores Chapel Road

PROPERTY OWNER: Rick Patterson

BUILDING CONTRACTOR: _____

SUBDIVISION NAME: _____

AUTHORIZATION ISSUED BY: Jenny P. Michelle DATE: 5/3/00

DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 19774, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED **PRIOR** TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: See Conditions of Improvement Permit.

Added additional 133' of drainfield to existing system.

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

X Richard T. Patterson 5/8/00

SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE DATE

Permit Number 19774

CONDITIONS OF IMPROVEMENT PERMIT

Tax Number: 053-093-38

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	X No	___ Partial Basement	
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	X Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1	
0.3 Long-term acceptance rate	400 Max gallons/day wastewater flow	1600 Absorption Area (sq ft)	9' Trench spacing (min. on centers)	
yes Serviced by private well	1000 Gallon septic tank	555 Total trench length (ft)	24" Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)	
4 Bedrooms in residence	NA Gallon pump tank	12" Depth of stone		
Any surface waters present: NO Type:		Minimum separation distance:		
Site modifications required:				
Additional Conditions: House addition/Bedroom. Add additional 133' of drainfield to existing system.				
Repair Area System Type Type (circle one): I (II) III IV V VI	X Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1	
1600 Absorption Area (Sq ft) 533' Total Trench Length (Ft)	12" Depth of Stone Trench	9' Trench spacing (min. on centers)	24" Maximum Trench Depth	
For existing system, enter the year originally installed:				

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department
- This Improvement permit is transferable.

Tommy P. Medlin 5/3/00
DEHNR Authorized Agent — Date

X Richard P. Patton 5/8/00
Owner/Agent Signature — Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

100% 4/27/00 fax + call

[] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date: 4/27/1774

PERSON FILING APPLICATION:

NAME: PATTERSON (last) RICHARD (first) P (mi)

ADDRESS: 11324 MOORES CHAPEL RD PHONE: (704) 3931888

CITY: CHARLOTTE STATE: NC ZIPCODE: 28214

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 05309338

STREET ADDRESS: 11324 Moores Chapel Road

ZONING:

SUBDIVISION OR MOBILE HOME PARK NAME:

PROPERTY OWNER:

NAME: PATTERSON (last) RICHARD (first) P. (mi)

ADDRESS: SAME PHONE: (__) _____

CITY: STATE: ZIPCODE:

Township (check one):
[X] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

LOT NUMBER: LOT SIZE (in acres): 3.2 ACRES

TYPE APPLICATION (check one):

[redacted] 1986 [redacted]

[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[redacted]

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [X] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: 4 NUMBER OCCUPANTS: 5

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [X] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Richard P. Patterson Date: 4/27/00

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[X] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

...Add 133' of drainfield for fourth Bedroom/w existing system. Hold until system installed

Jerry L. Medlin 5/3/00
Environmentalist Date

WATER : 122791

MECKLENBURG COUNTY HEALTH DEPARTMENT
Environmental Health Fees

Requestor (please print): Richard Pallas Phone #: Date Requested: 4/27/00 Date Filled:

Account Name: Cash Charge Account No.:

I certify that I am authorized to charge this account for this service:

Signature: Printed Name: Date:

T.C.	Qty	Description	Unit Cost	Total Cost
0701		Improvement Permit Application - Residential	$ 200.00	
0735		Improvement Permit Application - Commercial	$ 400.00	
0702		Optional Site Evaluations	$ 100.00	
0703		Installation and Final Approval	$ 150.00	
0704		Change in Plot Plan	$ 100.00	
0705	1	MH Exc/Add/Repl without System Modification	$ 100.00	100
0706		MH Exc/Add/Repl with System Modification	$ 300.00	
0707		Site Consultation Visit	$ 100.00	
0734		Authorization for Wastewater System Construction	$ 150.00	
0708		Realty Closing - Conventional	$ 85.00	
0709		Realty Closing - FHA with water	$ 135.00	
0710		Additional Trips	$ 65.00	
0711		Well Water Analysis-Bacteriological with regular parameters	$ 50.00	
0712		Well Water Analysis -Nitrates and Nitrites	$ 15.00	
0714		Well Water Analysis - Organic Analysis	$ 200.00	
0715		Admin. Fee - Field Activity Letter	$ 25.00	
0718		Residential Pool Permit	$ 50.00	
0719		Public Pool Permit - operating	$ 240.00	
0720		Seasonal Pool Permit - operating	$ 120.00	
0736		Pool Late Fee	$ 120.00	
0733		Permit to Construct a Public Pool	$ 200.00	
0721		Home Day Care Evaluation and Permit	$ 70.00	
0722		Home Day Care Evaluation and Annual Fee	$ 40.00	
0723		Eval and Report Non-Permit Facility	$ 50.00	
0724		Private Pool Testing	$ 15.00	
0731		Garbage Hauler Permit - (1-9 vehicles)	$ 30.00	
0736		Garbage Hauler Permit - (each over 9)	$ 20.00	
0725		Document Copies	$ 0.05	

Payment received by: KDJ Date: 4-27-00 Total: 100

11324 Moores Chapel Rd.

4/2000

White-AUDIT Canary-CUSTOMER Pink-DIVISION

COPY


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 19774

TC: 053-093-38

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

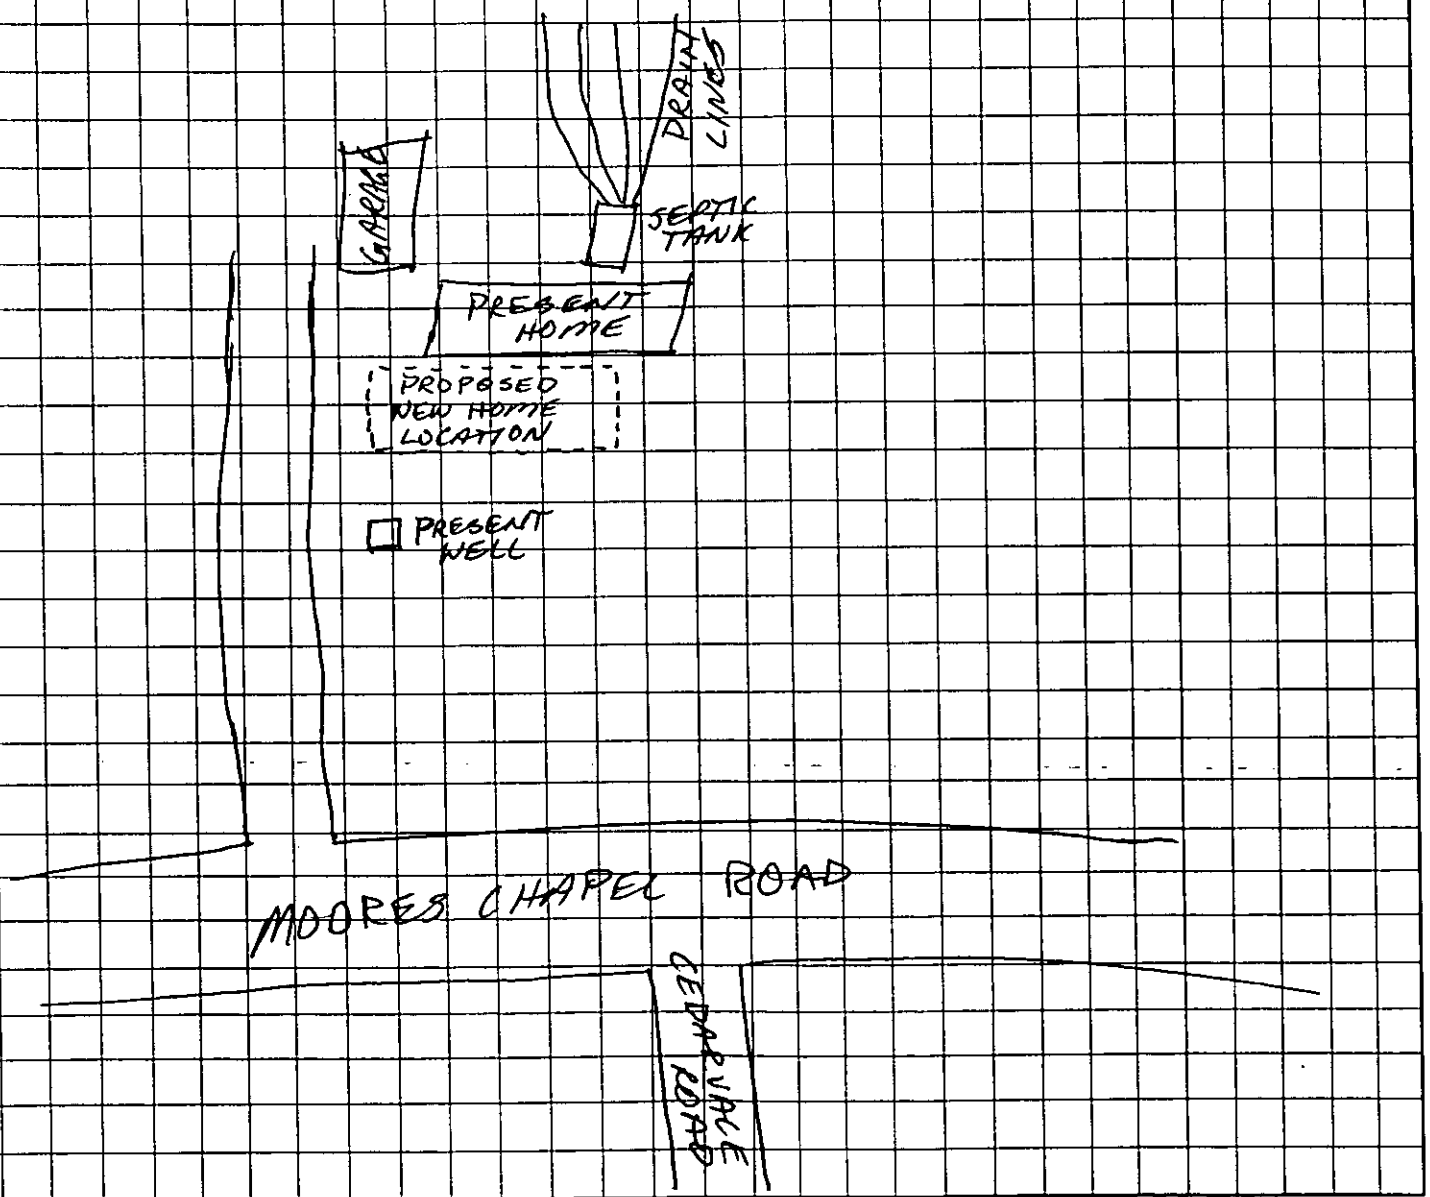

OWNER/AGENT SIGNATURE

DATE

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy