

2227 CORAL VALLEY RD

02315158

9/4/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2108 B DATE 2-26-96

TC: 0235158 ☐ L ☐ CRT

SERIAL № 16535

Name of Owner William TADLOCK Juris.: _____

Address of Property 2227 CORAL VALLEY

Inspection Data:

Tank Material 1996 REPAIR

Total Length of Drainfield 100'

Number of Lines 1 @ 33

Cover Depth 18"

Water Supply Source well

Distance to Water Source 50'+


Excavation Inspected 2-26-96

Tank(s) Inspected —

Wash Line Inspected 2-26-96

High Water Alarm Inspected NA

Design 1996 REPAIR

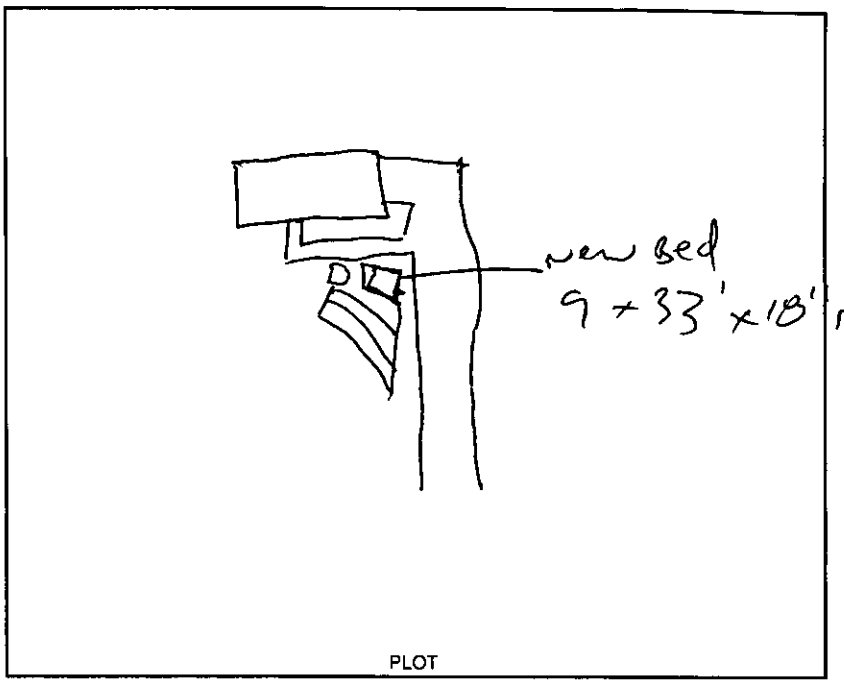

CTR# BREUARD K-00

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☑ altered or repaired

☐ in accordance with the permit issued ☑ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: _____

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

Repair 2400

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

21028 → 21048

☐ CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: _____ (last) (first) (mi)

ADDRESS: _____ PHONE: (__) _____

CITY: STATE: ZIPCODE:

Date:

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 023-157-58

STREET ADDRESS: 2227 CORAL VALLEY RD

ZONING:

PROPERTY OWNER:

NAME: TADLOCK William D. JR. (last) (first) (mi)

ADDRESS: 2227 CORAL VALLEY RD PHONE: (704) 392-7620

CITY: CHARLOTTE STATE: NC ZIPCODE: 28214

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
☒ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☐ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres):

☐ SOIL TEST - INDIVIDUAL LOT (D)
☐ NEW CONSTRUCTION ON VACANT LOT - 6 BEDROOMS OR LESS (N)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or N)
☐ COMMERCIAL OR INDUSTRIAL (N)
☐ SOIL TEST DEVELOPMENT (P)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☐ MODIFIED /ALTERNATIVE/ OR RESIDENCE > 6 BEDROOMS (Z)
☒ REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
☐ SINGLE MOBILE HOME (S) ☒ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 4 NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☐ Community (C) ☒ Shared Well (S)
☐ Municipal (M) ☐ Other 'spring' (O)
☐ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☐ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☐ None
☐ Garage ☐ Storage Building ☐ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: William D Tadlock Date: 11/21/95

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules for Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...Repair

☒ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Phillip S Walker 11/21/95
Environmentalist Date

Director or Authorized Section Head Date

WATER · 22 [illegible]

Permit Number: 21048

CONDITIONS OF IMPROVEMENT PERMIT

Tax Number: 023 157 58

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	✓ No	___ Partial Basement
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
___ Long-term acceptance rate	___ Max gallons/day wastewater flow	___ Absorption Area (sq ft)	___ Trench spacing (min. on centers)
yes Serviced by private well	___ Gallon septic tank	___ Total trench length (ft)	___ Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
3 4 Bedrooms in residence Flow	___ Gallon pump tank	___ Depth of stone	
Any surface waters present: NO Type:		Minimum separation distance:	
Site modifications required:			
Additional Conditions: Repair to existing wastewater system Washer system addition; Bed system (1) 6'wd x 33'long x 18" stone			
Repair Area System Type Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
300' Absorption Area (Sq ft) 100 Total Trench Length (Ft)	18 Depth of Stone Trench	NA Trench spacing (min. on centers)	28" Maximum Trench Depth
For existing system, enter the year originally installed:			

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.
- This Improvement permit is transferable.

Philip S. Walker R.S. 11/21/95

DEHNR Authorized Agent Date

Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Permit Number: 21048

CONDITIONS OF IMPROVEMENT PERMIT

Tax Number: 023 15158

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	✓ No	___ Partial Basement
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
___ long-term acceptance rate	___ Max gallons/day wastewater flow	___ Absorption Area (sq ft)	___ Trench spacing (min. on centers)
YES Serviced by private well	___ Gallon septic tank	___ Total trench length (ft)	___ Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
3 / 4 psw Bedrooms in residence	___ Gallon pump tank	___ Depth of stone	

Any surface waters present: NO Type: Minimum separation distance:

Site modifications required:

Additional Conditions: Repair to existing wastewater system
Washer system addition, Bed system (1) 6'wd x 33'long x 18" stone

Repair Area System Type Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
300' Absorption Area (Sq ft) 100 Total Trench Length (Ft)	18 Depth of Stone Trench	NA Trench spacing (min. on centers)	28" Maximum Trench Depth

For existing system, enter the year originally installed:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.
- This Improvement permit is transferable.

Philip S. Walker R.S. 11/21/95
DEHNR Authorized Agent Date

William R. Mitchell Jr. 11/21/95
Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 21028 DATE: 11/21/95

TC: 023 151 58 ☐ L

SERIAL Nº 16328

Permission is hereby given to _____ Install or Construct, ___✓___ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 11/21/95. All work shall be completed on or before 12/21/95, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

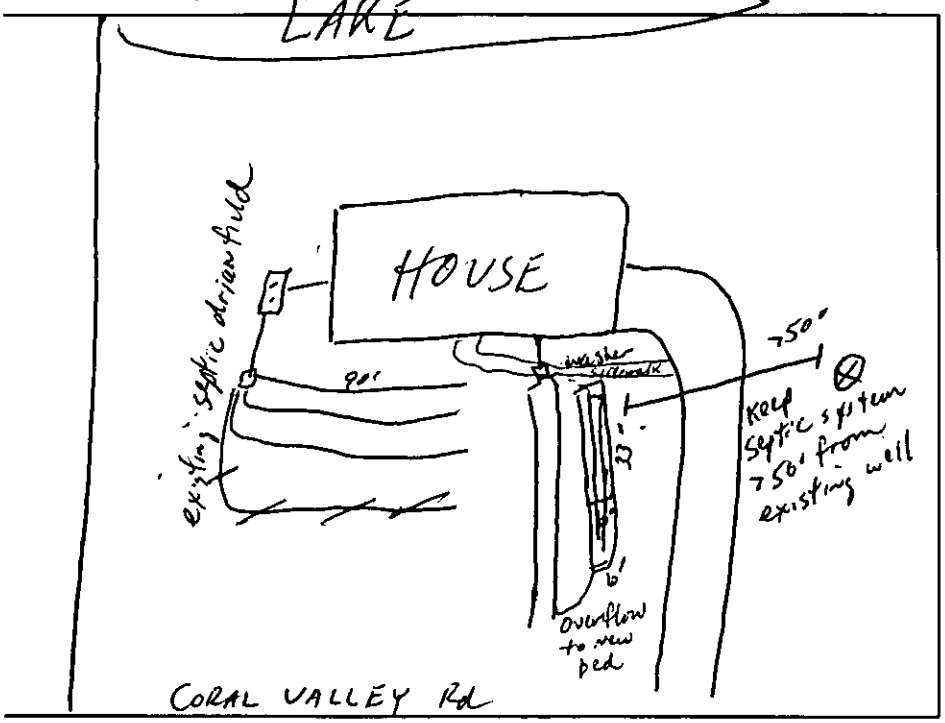

PLOT OF SYSTEM

Liquid Capacity of Septic Tank — gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction —

Trench Depth 24"

Absorption and/or Nitrification Lines:

Trench Width Bed 69' feet

Trench Walls Scored and Porous ~

Total Line Length 100' feet

Number of Lines Bed 3 (33')

Depth of Stone 18 inches

Distance from House 5 feet

Distance from Property Line 10' feet

Distance from Well >50' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER William Tadlock

LOCATION OF PROPERTY 2227 Coral Valley Rd

Comments: Washer bed system Repair 6'wd x 33'long x 18" Stone
Keep septic system >50' from existing well. Feed line through D-Box if possiable

Philo S. Walker R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

Mecklenburg County
Health Department

TELECOPIER TRANSMITTAL COVER SHEET

NOTICE

THE INFORMATION CONTAINED IN THIS TELECOPY MAY BE PRIVILEGED AND/OR CONFIDENTIAL AND IS INTENDED ONLY FOR THE USE OF THE PERSON TO WHOM IT IS ADDRESSED. IF THE READER OF THIS MESSAGE IS NOT THE INTENDED RECIPIENT (OR SUCH RECIPIENT'S EMPLOYEE OR AGENT), YOU ARE HEREBY NOTIFIED NOT TO READ, DISTRIBUTE OR COPY THE MATERIALS ATTACHED HERETO WITHOUT THE PRIOR WRITTEN CONSENT OF THE SENDER. IF YOU HAVE RECEIVED THIS TELECOPY IN ERROR, PLEASE NOTIFY THE SENDER BY TELEPHONE CALL AND RETURN THE ORIGINAL TELECOPY TO US BY MAIL AND WE WILL REIMBURSE YOU FOR THE REQUIRED POSTAGE. THANK YOU.

TO: William Tadlock TELECOPIER # 391-5820

FROM: Gwen DATE 11/28/95

NUMBER OF PAGES TRANSMITTED: 3 (including cover sheet)

COMMENTS: per request

If you do not receive all pages, please call us as soon as possible at the following number: (704)336-5102.

[✓] Original will not follow [ ] Original will follow via:

[ ] U.S. Mail [ ] Hand Delivery [ ] ____