Serial No. 2318

PTR No. 4942

Date Issued September 28, 1972

T C No. 001-111-07

Mcp Date 8/9/72

Do Not Issue A Building Permit Based On This Form

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION


PERCOLATION TEST REPORT

NAME OF OWNER Love (LAST) Sam (FIRST) D. (MIDDLE)

ADDRESS OF OWNER 123 Patrick (Gastonia, N.C.) ZIP 28052

LOCATION OF PROPERTY Island Forest Drive (STREET OR COUNTY ROAD)

SUBDIVISION Island Forest LOT NO. 47 BLOCK NO.

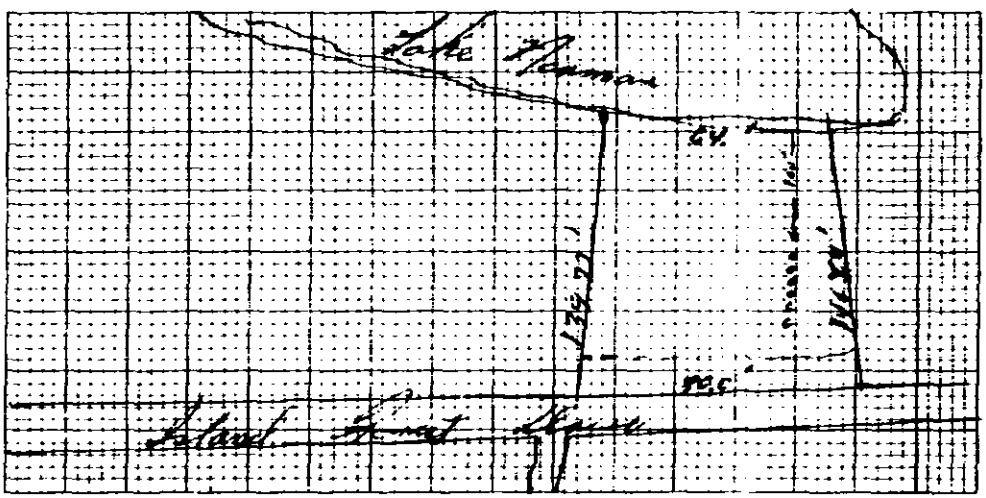

PLOT PLAN

This is to certify that a percolation test has been run and an on-site inspection made by the Mecklenburg County Health Department on the lot described above. The said test was conducted on that portion of the lot as indicated on above plot.

The percolation rate determined by the test was 40 min/in The said lot is approved for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge subject to the following terms and conditions

1. A permit to install, construct, alter, or repair the specific system shall be obtained from the Mecklenburg County Health Department prior to the beginning of any construction of buildings, or of the wastewater treatment system on the said lot
2. The size of the septic tank wastewater teratment system which must be installed will be determined by the Health Department prior to installation based on the percolation rate obtained above, and on the size and type of building constructed thereon.
3. This approval is valid only if the system is installed in the immediate area where the percolation test was run
4. This approval is void if any grading, filling, or construction (including the drilling of a well) is performed on the lot which, in the opinion of the Health Department, renders the area where the percolation test was run unsuitable for the installation, construction, alteration, and/or repair of such a system

This approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina State Board of Health and the Mecklenburg County Board of Health which were in effect on the date of issuance and is void if at any time in the future, prior to the completion of the system, these laws, rules, and regulations are changed such that this approval would not have been granted had the new or revised laws, rules, and regulations been in effect on the issue date.

John L Adkisson

Director, Environmental Health Division or Authorized Section Head

FORM NO. E-2-4-1-71

HEALTH DEPARTMENT'S COPY

Date Received 11/14/77

ICAR(S) Application No. 4942

T. C. No. 001-111-07


Map Date 8-9-72

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ✓ Install or Construct 2) _____ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

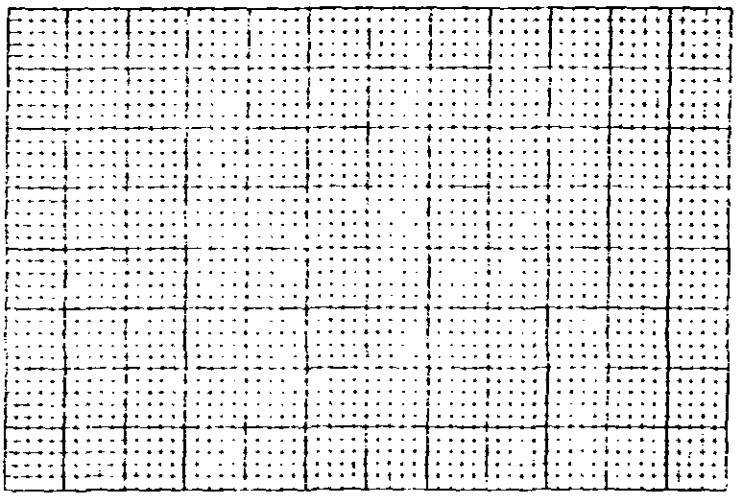

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___Yes ✓No
Residence ✓Yes ___No
4) No of Bedrooms 3
5) Business Use - Max No Employees N/A
6) Washing Machine ✓Yes ___No
7) Garbage Disposal ___Yes ✓No
8) Dishwasher ___Yes ✓No
9) Water Supply:
A) Individual Well ___
B) Governmental System ___
C) Community System:
1 Well source ✓
2 Governmental source ___
10) Sewage System
House located within 200 feet of public sewer ___Yes ✓No
House located within 200 feet of community sewer ___Yes ✓No
11) FHA Case No. ___
12) VA Case No. ___

13) NAME OF OWNER Elliott (LAST) Johnny (FIRST) Lee (MIDDLE)

14) ADDRESS OF OWNER 5035 Wedgewood Dr. Charlotte, N.C. 28210

15) PHONE NO. Home 523-2665 Office 373-4968

16) LOCATION OF SYSTEM Island Forest Dr. (STREET OR COUNTY ROAD) lot No. 47

17) SUBDIVISION Island Forest Lot No. 47 Block No. ___

Map Book No. 12 Page No. 339 & 341

18) DEED REFERENCE — DEED BOOK 3644 AT PAGE 0543

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES ___ NO DATE RUN 9/28/72

20) PTR NUMBER (See Instructions) 4942

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

11-14-77
DATE OF APPLICATION

Johnny L Elliott
OWNER

EHD-5-76

Environmental Health Department's Copy

Serial No. 1341

LA No. 4942

Date Issued November 14, 1977

T. C. No. 001-111-07

Map Date 8-9-72

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

IMPROVEMENT PERMIT
TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER Elliott (LAST) Johnny (FIRST) Lee (MIDDLE)

ADDRESS OF OWNER 5035 Wedgewood Drive, Charlotte, NC ZIP 28210

LOCATION OF LOT Island Forest Drive (STREET OR COUNTY ROAD)

SUBDIVISION Island Forest LOT NO 47 BLOCK NO.

MAP BOOK NO. 12 PAGE NO. 399 & 341

The above specified lot is approved by the Mecklenburg County Department of Environmental Health for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the soil investigation, on an on-site inspection of the said lot; and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 4942. This approval is subject to the following terms and conditions:

1. That the nitrification field be installed, constructed, altered and/or repaired in the same area where the soil investigation was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altred, and/or repaired and that the system be installed in accordance with same.

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic-tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration, and/or Repair Permit

Environmentalist

Environmental Health Director, or Authorized Section Head

EHD-5-76

Environmental Health Department's Copy

Date Issued 21 Mar 78

Serial No. 1476


ICAR(S) Permit No. 4942

T. C No. 001-111-01

Map Date 8-9-72

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, ___ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 4942, dated 11-14-77 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 21 Mar 78, after which date this permit shall be null and void.

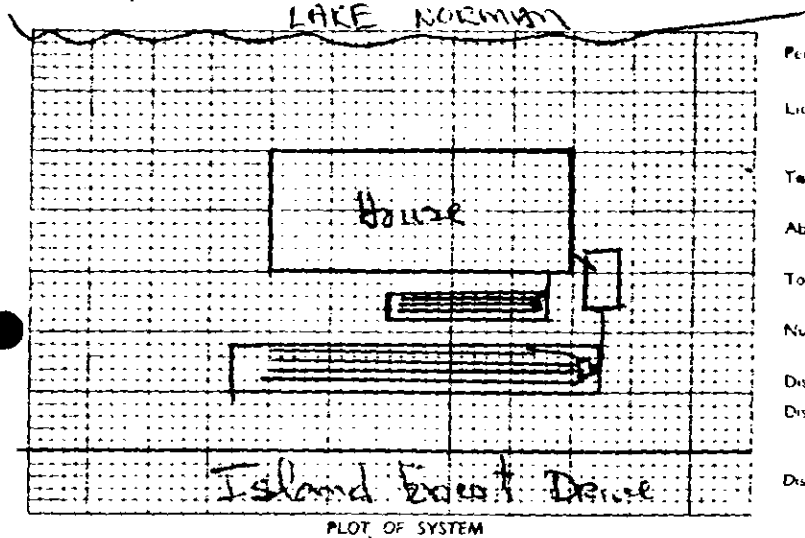

PLOT OF SYSTEM

Permeability Rate 60

Liquid Capacity of Tank 1000 gal

Tank Construction Precast Concrete

Absorption and or Nitrification Lines

Total Line Length 330' - 125'

Number of Lines 5 - 3

Distance from House 10'

Distance from Property Line 10'

Distance from Well 100'

NAME OF OWNER Elliott, Johnny L.

LOCATION OF PROPERTY Island Point Dr. lot # 47

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. **The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

Comments

Division or Section Head

A M Reynolds
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

END-5-76

Environmental Health Department's Copy