

4013 DAVID DR

19501325

1/7/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 4646B DATE: 05-09-01

TC: 195-013-25 ☐ L ☐ CRT

SERIAL № 13777

Name of Owner Tracy Trigg Juris.:

Address of Property 4013 District Dr.

Inspection Data:

Tank Material PCC

Total Length of Drainfield 100' sept sys 100' washing machine

Number of Lines 2 @ 6' x 50'

Cover Depth 12-24"

Water Supply Source Purell

Distance to Water Source >50'

Excavation Inspected 05-09-01

Tank(s) Inspected Existing

Wash Line Inspected 05-09-01

High Water Alarm Inspected N/A

See Installation Permit.

PLOT

Design: 2001 Repair to Septic Sys. & Washing Machine Line CTR#

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☑ altered or repaired

☑ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☐ Certificate of Completion ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." *This document shall be* null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS: Type II Repair.

OD 2 1991

Joshua R. Sellers, R.S.
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4646B DATE: 05-09-01

TC: 195-013-25 ☒ L

SERIAL Nº 18776

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 05-09-01. All work shall be completed on or before 06-09-01, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

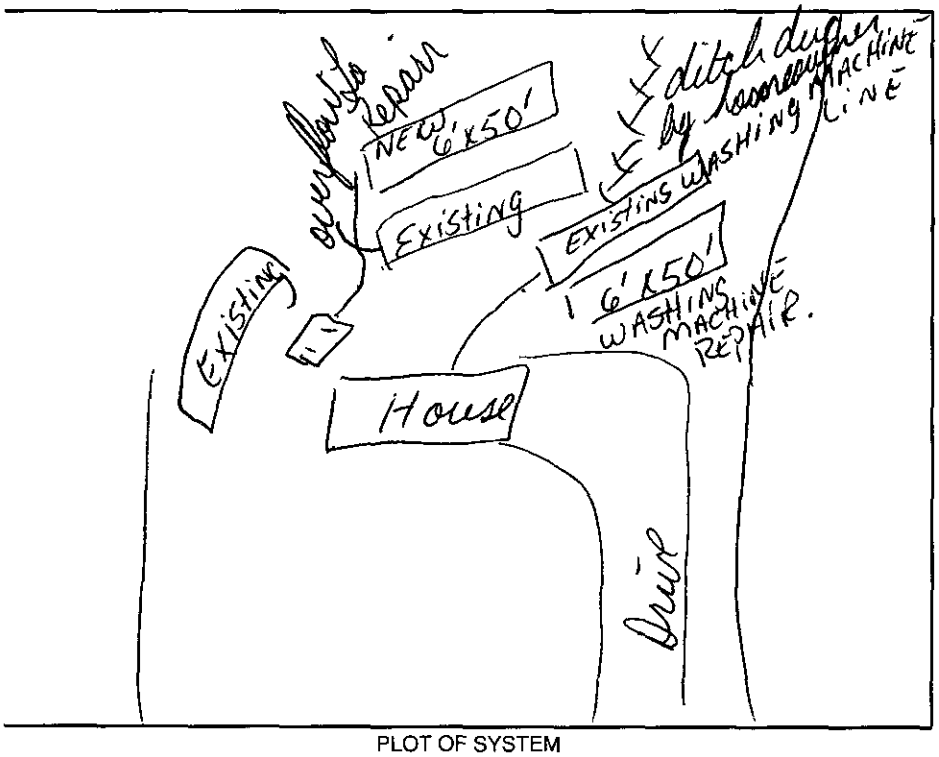

PLOT OF SYSTEM

Liquid Capacity of Septic Tank Existing gallons

Liquid Capacity of Dosing Tank N/A gallons

Tank Construction PCC

Trench Depth ≤36"

Absorption and/or Nitrification Lines:

Trench Width 36" feet

Trench Walls Scored and Porous yes

Total Line Length WM 6'x50' + 6'x50' feet

Number of Lines 2@6'x50'

Depth of Stone 17" inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well >50' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Tracy Trigg

LOCATION OF PROPERTY 4013 Dalton Dr.

Comments: Repair of septic system by overflowing to new 6'x50' bed. Repair washing machine line by overflowing 1 of 6'x50' bed.

Joshua R. Sellers R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

NOTICE OF VIOLATION
ON-SITE WASTEWATER SYSTEM

__Certified Mail
(Return Receipt)

__First Class Mail

__ Hand Deliver

Owner Tracy J. Trigg

Occupant Same

Mailing Address 4013 David Dr.
Charlotte NC 28227

Location Same

☑ Residence
☐ Business
☐ Other _____

You are hereby notified that you are violating the Rules adopted by the North Carolina Commission for Health Services, Article 11 of Chapter 130A of the General Statutes of North Carolina; or Permit Conditions by owning or controlling a residence, place of business, or place of public assembly which is not provided with an approved wastewater system. Your wastewater system is not in compliance.

On May 7, 2001, an inspection of the wastewater system by the Mecklenburg County Health Department indicated the following violations:

Violation	Law or Rule Cite
Sewage on Surface Sewage lying / discharged to Surface of Ground.	GS 130A-335(A) 15NCAC 18A .1938(B) 15NCAC 18A .1961(a)1(A) 15NCAC 18A .1961@1(c)

You are hereby ordered to bring your wastewater system into compliance by completing the following:

☑ Install/Repair wastewater system. You must obtain a Repair Permit from the local health department prior to repairing your system.
☐ Eliminate wastewater discharge and connect to an approved wastewater system.
☐ Other (specify) _____

If the wastewater violation is not brought into compliance by June 7, 2001, appropriate legal action will be taken.

Failure to comply with the laws, rules and this notice will subject you to the following legal remedies; Injunction Relief [G.S. 130A-18], Administrative Penalties [G.S. 130-22(c)], Suspension or Revocation of Permits [G.S. 130-23], and Criminal Penalties [G.S. 130-25].

You may contact our office at 700 N. Tryon St Charlotte NC 28202 (704) 336-5569, phone; (704) 336-6894, fax).

Notice Issued 05-08-01 (Date) Signed Joshua R. Sellers R.S. (DENR/DEH) Agent

Compliance 05-09-01 (Date) Signed Joshua R. Sellers R.S. (DENR/DEH) Agent