FEE: 200.00
DATE: 1/27/2020

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 481A

PERMIT NUMBER: 481A

PARCEL NUMBER: 02311212

JOB LOCATION INFORMATION

ADDRESS: 4117 EAGLE CHASE DR

CITY: CHARLOTTE **STATE: NC** **ZIP:** 28216

ISSUED TO: SUZANNE MACKEY

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 1/27/2020

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30010283, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. A PRE-CONSTRUCTION MEETING MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A LICENSED SEPTIC TANK CONTRACTOR WITH THE NORTH CAROLINA ONSITE WASTEWATER CONTRACTOR INSPECTOR CERTIFICATION BOARD.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, AND MAY BE ISSUED AT THE SAME TIME THE IMPROVEMENT PERMIT IS ISSUED.

Authorized Agent Signature _____

SUPERVISOR/ADMINISTRATIVE PROFESSIONAL CHECKLIST

NEW SEPTIC ☐ NEW WELL ☐ USE EXISTING ☐ MODIFIED PLOT PLAN ☐

ALTERATION

New Septic Fees Paid

IP ($250.00) _____ Initial/Date

CA ($200.00) _____Initial/Date

OP ($200.00) _____Initial/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fees Paid: $550.00 _____ Initial/Date

Use Existing Fees Paid: $100.00 _____Initial/Date

Alteration Fees Paid: $300 Total $200 3/29/19 _____Initial/Date (If use existing was part of payment)

Modified Plot Plan Fees Paid: $100.00 _____Initial/Date

Floor plans need to be submitted and reviewed before CA can be issued ☒ Review ☑ 1/27/2020

This site is served by septic and well. Verify each is complete before final hold is released ☐

Septic file complete ☒ 1/27/20 Well complete ☐ _____

Send permit for signature ☒ Signature received ☑ _____

This septic system requires a certified operation contract before final hold is released ☐

Certified operator contract is on file ☐ _____

Please send for signature

Groundwater & Wastewater Services: Septic Project File & D

Edit Response | Delete Response | Manage Permissions | Workflows | Alert Me

GWS File #:	481A
WASPS App #:	10283
Primary ES assigned to project:	Jeremy Michelone
Secondary ES assigned to project:	
Project Type:	Alteration
Site Evaluation Information: .1939(a)(1) - Topography and Landscape Position Recorded?	Yes
Site Evaluation Information: .1940(a-g) - Slope % Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Texture Class Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Structure Type Recorded?	Yes
Site Evaluation Information: .1939 (a)(2) - Consistence Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Mineralogy Recorded?	Yes
Site Evaluation Information: .1939(a)(3) - Soil Wetness Condition Recorded?	Yes
Site Evaluation Information: .1939(a)(4) - Soil Depth to Rock or Parent Material Recorded when Encountered?	Yes
Site Evaluation Information: .1939(a)(5) - Depth to Restrictive Horizons Recorded when Encountered?	Yes
Site Evaluation Information: .1939(a)(6) - Sufficient Available Space Recorded?	Yes
Site Evaluation Information: .1937(m) - Are the Profile Locations Shown?	Yes
Site Evaluation Information: .1939(a) - Are the S/PS Profiles in system & in repair area?	Yes
Site Evaluation Information: .1939(d), .1955, .1956, .1957 - LTAR	Yes
Improvement Permit/Construction Authorization: .1937(g), 130A-336(a) - Proposed System Type stated - Initial	Yes
Improvement Permit/Construction Authorization: .1945(b) - Proposed System Type stated - Repair	Yes
Improvement Permit/Construction Authorization: 130A-336(a)(3) - System location identifiable by setbacks - Initial	Yes
Improvement Permit/Construction Authorization: .1937(g), .1945(b) - System components shown - Initial	Yes
Information Permit/Construction Authorization: .1945(b) - Repair area shown	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Does System design match facility, flow & WW characteristics?	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Is System design consistent with soil/site conditions?	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Is the System located in the approved area?	Yes
Improvement Permit/Construction Authorization: 130A-336(a) - Number of Bedrooms, employees, seats, etc. indicated?	Yes
Improvement Permit/Construction Authorization: .1937 (g) - Trench depth correct?	Yes
Improvement Permit/Construction Authorization: .1937(g) - Trench width correct?	Yes
Improvement Permit/Construction Authorization: .19379(g) - Trench length correct?	Yes
Improvement Permit/Construction Authorization: 130A-336(a)(1) - Proposed/existing well shown?	Yes

Improvement Permit/Construction Authorization: 130A-336(a)(1) - Property line lengths shown?	Yes
Improvement Permit/Construction Authorization: 130A-336(a) - Facility/appurtenance setbacks shown from fixed points?	Yes
Corrections/modifications needed?	No
Comments:	
IA issued date:	- 1/21/20
OP Issued date:	- 1/23/20
Review performed by:	Jeremy Michelone
Date performed:	4/16/2019

Created at 4/16/2019 4:35 PM by Michelone, Jeremy
Last modified at 4/16/2019 4:35 PM by Michelone, Jeremy

Close

481A #10283

MECKLENBURG COUNTY
HEALTH DEPARTMENT

29 MAR '19 PM 2:38

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. **SEPTIC / TYPE APPLICATION:** ○ N/A ○ NEW SYSTEM ☑ ALTERATION ○ ...R ○ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ○ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. **JOB LOCATION INFORMATION:**

TAX PARCEL NUMBER: 02311212
STREET ADDRESS: 4117 EAGLE CHASE DR.
CITY: CHAR. NC 28216.
STATE: NC ZIP: 28216.
SUBDIVISION NAME: _____
LOT #: _____ LOT SIZE (acres): _____
TOWNSHIP:

☑ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. **BUILDING INFORMATION:**

BUILDING TYPE:

☑ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
○ HOUSE ○ OTHER _____

HEATED SQUARE FOOTAGE: 500
NUMBER OF BEDROOMS: 2
NUMBER OF OCCUPANTS: 0

FOUNDATION TYPE:

○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
☑ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: 2 NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. **WATER SUPPLY:** ○ MUNICIPAL ☑ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. **PROPOSED USE OF WELL:** ○ N/A ○ IRRIGATION ☑ POTABLE (DRINKING WATER) ○ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED):*

☐ N/A ☐ ANY TYPE ☑ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. **RANK:** ____ ____ ____ ____ ____

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	☑ YES ○ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ☑ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☑ YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ☑ NO
WELLS, SPRINGS, OR WATER LINES	☑ YES ○ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ☑ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ☑ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☑ YES ○ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ☑ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ☑ NO
WASTE STORAGE	○ YES ☑ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ☑ NO

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____ ☑ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☐ N/A

12. **PROPERTY OWNER:**

NAME: SUZANNE MACKEY
ADDRESS: 4229 OVERLOOK COVE RD.
CITY: CHAR
STATE: NC ZIP: 28216
WORK PHONE: _____
MOBILE PHONE: 704-622-9628
FAX: _____
E-MAIL: JBEATY001@AOL.COM

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**

NAME: _____
ADDRESS: James M. Beaty 4229 Overlook Cove Rd
CITY: Charlotte, NC 28216
STATE: _____ ZIP: _____
WORK PHONE: ~~704~~
MOBILE PHONE: 704-622-9628
FAX: _____
E-MAIL: JBEATY001@AOL.COM.

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

Property Owner's or Owner's Legal Representative Signature

3-25-19
Date

OFFICE USE ONLY

O SURVEY PLAT TO SCALE SUBMITTED O SCALED SITE PLAN SUBMITTED O UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ 300,00 DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 4117 EAGLE CHASE DR. Tax Parcel #: 02311212

Subdivision Name: _____ Lot #: _____

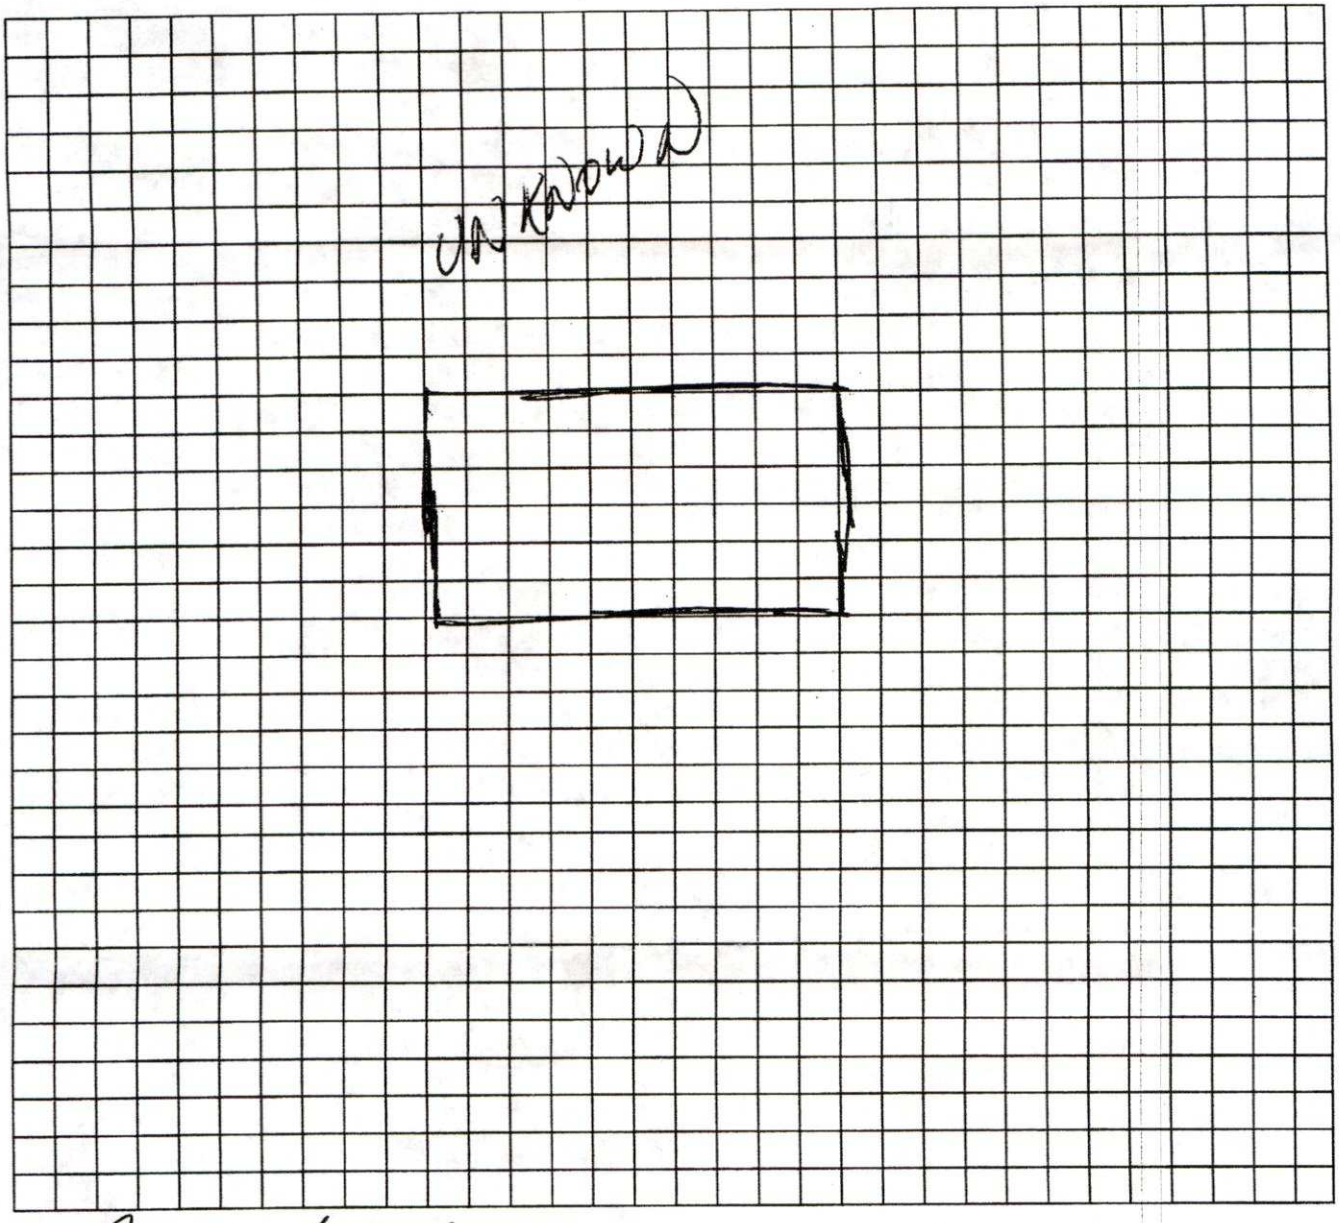

James M Kirby
Property Owner's or Owner's Legal Representative Signature

3-25-19
Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	03/29/19	**Amount:**	300.00
Receipt #:	116455	**Tendered:**	300.00
Check / Auth #:	CHECK 1457	**Returned:**	0.00
Received By:	ELLISLW		

Account Information

Account #: 200000
Contractor: SUZANNE MACKEY RENTALS
Attn:
Address: 4229 OVERLOOK COVE RD
Address:
City/State/Zip: CHARLOTTE, NC 28216

Item	Description	Permit#	Quantity	Unit Price	Total Price
0706	Septic Alteration Permit 4117 EAGLE CHASE DR		1	300.00	300.00

----------**Outstanding Balances**----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Property ID: 2311212
Lot #:
File #: 481A
AppID: 10283

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Suzanne Mackey
Applicant: James Beatty
Address: 4229 Overlook Cove Road Charlotte, NC 28216
Date Evaluated: 4/10/2019
Proposed Facility: 4 Bedroom House Design Flow (.1949) 480 GPD
Property Size: 2 acres
Location of Site: 4117 Eagle Chase Drive Charlotte, NC 28216
Property Recorded:
Water Supply: [ ] Public [X] Individual [X] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS 8%	0-4	GR/L	FR/NS/NP/NEXP	>48" TO SOIL WETNESS	>48	NA	NA	PS IV 0.3 G/D/FT2
		4-48	SBK/C	FI/S/P/SEXP					
2	LS 10%	0-6	GR/L	FR/NS/NP/NEXP	>48" TO SOIL WETNESS	>48"	NA	NA	PS IV 0.3 G/D/FT2
		6-48	SBK/C	FI/S/P/SEXP					


Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	III g	III g
Site LTAR	0.3	0.3

Other Factors (.1946):
Soil Evaluation By: Jeremy Michelone, REHS
Others Present: James Beatty
Site Classification (.1948): Provisionally Suitable
Site Evaluation By: Jeremy Michelone, REHS
Others Present: James Beatty

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

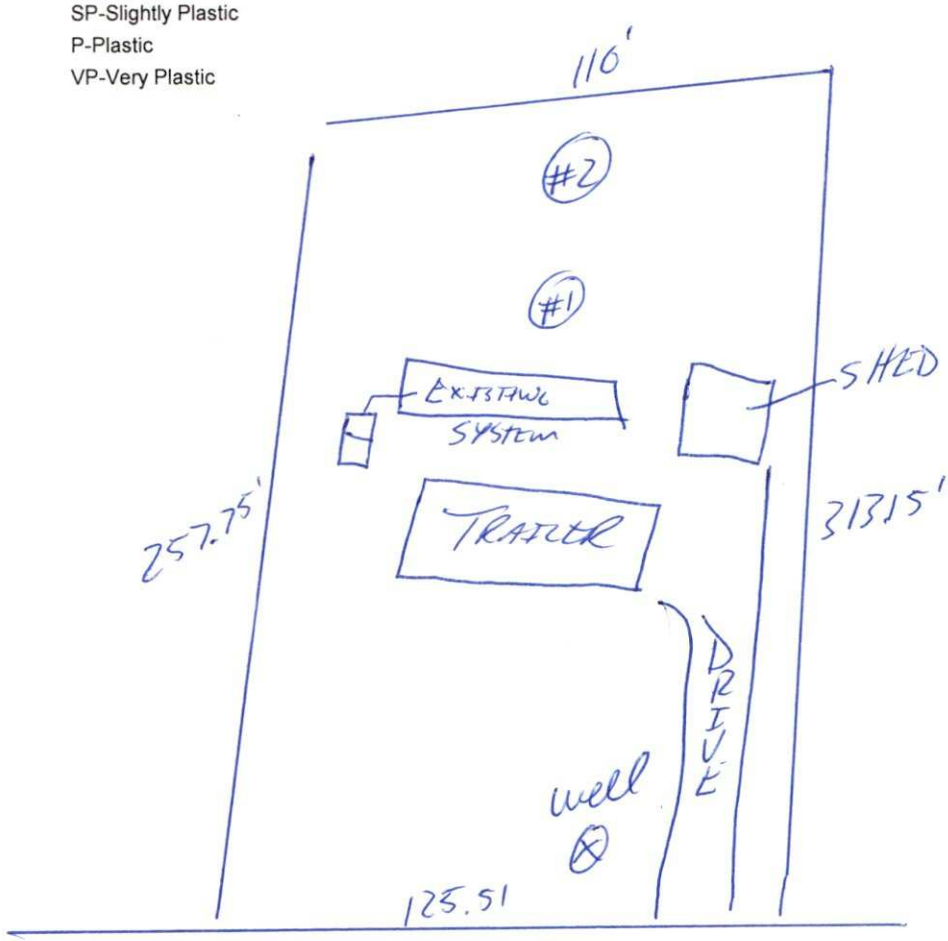

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30010283** GWS File #: **481A** Tax Parcel #: **023-112-12**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 4/16/2024

Type of Installation: Residential - Alteration Lot Number: 0

Structure Type: SINGLE MOBILE HOME Size (ft^2): 500 # Bedrooms: 4 Max. Occup.: 8

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Accepted **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	240	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	600	Total Trench Length (ft):	200
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

III. Repair System Type: Accepted **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1200	Total Trench Length (ft):	400
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone Owner/Legal Agent: JAMES M BEATY

Print Name

Signature: Jeremy Michelone Signature: James M Beaty

Date Issued: 4/16/2019

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30010283** GWS File #: **481A**

IV. Permit Conditions/Comments:

- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- System alteration for the addition of two bedrooms for a total of a 4 bedroom new home.

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone

Signature: Jeremy Michelone

Date Issued: 4/16/2019

Owner/Legal Agent: Jim Beaty

Print Name

Signature: Jim Beaty

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30010283** GWS File #: **481A** Tax Parcel #: **023-112-12**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 4/16/2024

Type of Installation: Residential - Alteration Lot Number: 0

Structure Type: SINGLE MOBILE HOME Size (ft^2): 500 # Bedrooms: 4 Max. Occup.: 8

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Accepted **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	240	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	600	Total Trench Length (ft):	200
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

III. Repair System Type: Accepted **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1200	Total Trench Length (ft):	400
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone Owner/Legal Agent: _____
Print Name

Signature: Jeremy Michelone 4/16/19 Signature: _____

Date Issued: 4/16/2019

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30010283** GWS File #: **481A**

IV. Permit Conditions/Comments:

- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- System alteration for the addition of two bedrooms for a total of a 4 bedroom new home.

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone

Signature: Jeremy Michelone

Date Issued: 4/16/2019

Owner/Legal Agent: _____
Print Name

Signature: _____

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30010283** GWS File #: **481A** Tax Parcel #: **023-112-12**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 4/16/2024

Type of Installation: Residential - Alteration Lot Number: 0

Structure Type: SINGLE MOBILE HOME Size (ft^2): 500 # Bedrooms: 4 Max. Occup.: 8

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Accepted **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	240	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	600	Total Trench Length (ft):	200
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

III. Repair System Type: Accepted **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1200	Total Trench Length (ft):	400
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone Owner/Legal Agent: JAMES BEATY

Signature: Jeremy Mich. REHS Signature: James Beaty

Print Name

Date Issued: 4/16/2019

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30010283** GWS File #: **481A**

IV. Permit Conditions/Comments:

- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- System alteration for the addition of two bedrooms for a total of a 4 bedroom new home.

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone

Signature: Jeremy Michelone


Date Issued: 4/16/2019

Owner/Legal Agent: JAMES BEATY
Print Name

Signature: James Beaty

On-site Wastewater Improvement Permit Diagram

4117 EAGLE CHASE DRIVE

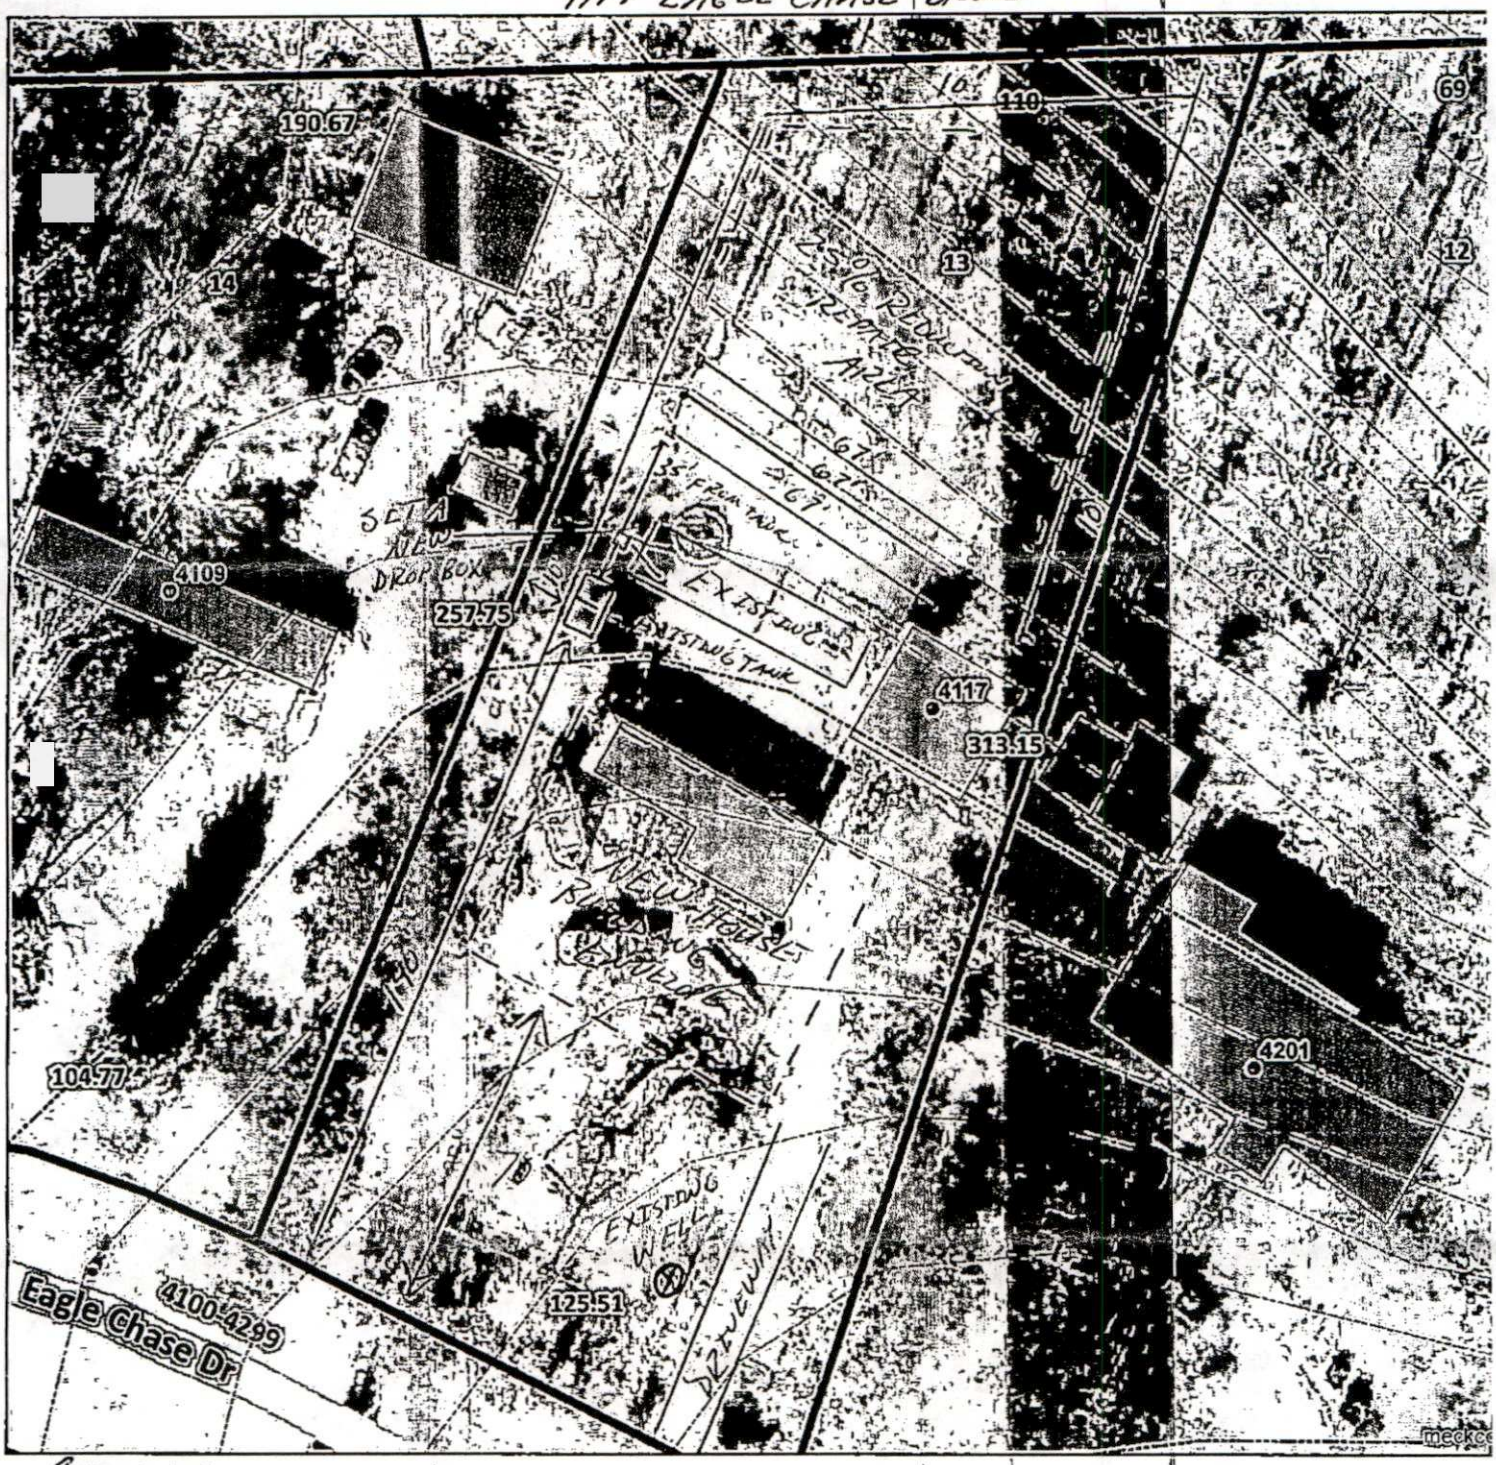

COMMENTS:

→ Install a new DROP Box and tie into the existing system
→ Install 3 lines x 67' x 3 (200 TLF)
→ Type IIIg 25% Reduction system & Repair
→ System alteration for a 2 Bedroom addition (4 Bedroom Total)

Mecklenburg County Health Department
Environmental Health - Groundwater and Wastewater Services

Permit #: 10283
PID #: 023-112-12
File #: 481A

Authorized Agent: Jimmy Mack, REHS Date: 4/16/19

Owner/ Legal Agent: _____ Date: _____

1 inch = 40 fe

On-site Wastewater Improvement Permit Diagram

4117 EAGLE CHASE DRIVE



COMMENTS:

- → Install a new DROP Box and tie into the existing system
- → Install 3 lines x 67' x 3 (200 TLF)
- → Type IIIg 25% Reduction system + Repair
- → System alteration for a 2 Bedroom addition (4 Bedroom Total)

Mecklenburg County Health Department
Environmental Health - Groundwater and Wastewater Services

Permit #: 10283
PID #: 023-112-12
File #: 481A

Authorized Agent: Jimmy Mack, REHS Date: 4/16/19

Owner/ Legal Agent: _____ Date: _____

1 inch = 40 fee

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr. Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

Septic System Pre-Construction Meeting Checklist

File # 481A App# 10283 Tax Parcel# 023-112-12

Property Owner: James Beatty

Job Location Address: 4117 Eagle Chase Drive

City: Charlotte State: NC Zip Code: 28216

1. **Does System design match facility, flow & wastewater characteristics?**

   ☒ YES ☐ NO

   Comments:

2. **Is there sufficient available space for the septic systems initial and repair areas?**

   ☒ YES ☐ NO

   Comments:

3. **Can the septic system be installed per the permit conditions and drawing on file?**

   ☒ YES ☐ NO

   Comments: A 3 Bedroom Septic System was discovered while meeting for the pre-construction meeting

*If "NO" is checked for any of the above the existing permit may need to be revoked.

Permission is hereby given to ☐ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge meeting all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. System shall not be installed while soils are in wet condition.

Jerry Nail, REHS — Authorized Agent

1/21/20 — Date

Chris Wagner — Others Present

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211, Charlotte, NC 28202
Phone: (980) 314-1680 • Fax (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 481A Permit #: 10283 Tax Parcel #: 023-112-12

Property Owner: James Beatty

Job Location Address: 4117 Eagle Chase Drive

City: Charlotte State: NC Zip Code: 28216

Operation Permit Issuance Date: 1/23/20 **Contractor Name:** Chris Wagner

Permitted Design Flow: 480 GPD Liquid Capacity of Dosing Tank: — gallons

Liquid Capacity of Septic Tank: 1500 gallons Manufacture Existing Effluent Pump Model: —

Drainfield Installation ☐ N/A

Trench Depth: 26 inches

Trench Width: 3 feet

Line Spacing: 16 feet (O.C.)

Total line length: 100' feet

# of Lines: 1 @ 100 feet

Depth of Media: 12 inches (Type) IQ4

Depth of Cover: 14 inches

Distribution Device: Drop Box

Bed Installation (For Repair Installations ONLY) ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 25' feet

Distance from Property Line: >10' feet


Distance from Water Supply Source: >100' feet

Inspection Dates

Tank(s) Inspected: —

Excavation Inspected: 1/23/20

Pump & Controls Inspected: —

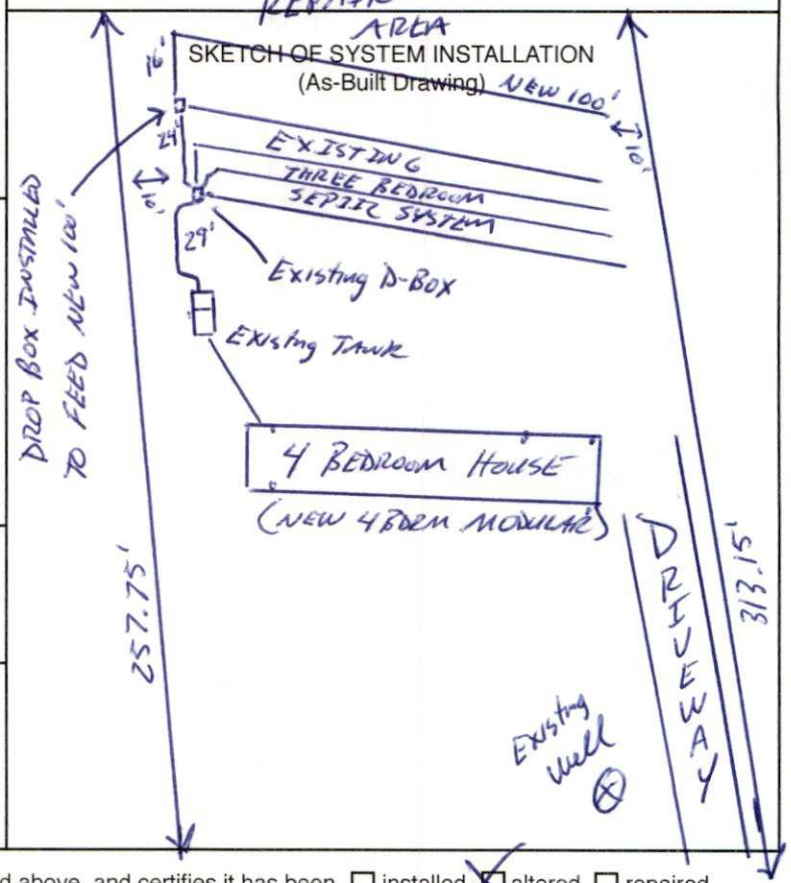

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☒ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operated properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments" This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIg, G, IQ4, NA, NA

Alteration for a 4 Bedroom House

DENR Authorized Agent: Jeremy Mathis, REHS Signature: Jeremy Mathis, REHS

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr. Suite 8000, Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 481A Permit #: 10283 Tax Parcel #: 023-112-12

Property Owner: James Beatty

Job Location Address: 4117 Eagle Chase Drive

City: Charlotte State: NC Zip Code: 28216

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIg

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☒ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: System A Heater for a 4 Bedroom House

DENR Authorized Agent: Jeremy Mechler REHS Date: 4/23/20

Signature: Jeremy Mech. REHS