

800 MT HOLLY-HUNTERSVILLE RD

03137117

1/4/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4421B DATE: 9/22/00
TC: 031-37-17 ☒ L ☐ CRT
SERIAL. Nº 18480

Name of Owner Mona Hayes Juris.:
Address of Property 800 Mt. Holly-Huntersville Road

Inspection Data:

Tank Material Existing
Total Length of Drainfield 200'
Number of Lines 5 @ 67'
Cover Depth 24"
Water Supply Source Municipal
Distance to Water Source NA
Excavation Inspected 9/22/00
Tank(s) Inspected —
Wash Line Inspected —
High Water Alarm Inspected —

See Installation Permit

PLOT

Design 2000, Repair, 600 SFB, 18" Stone CTR# Audrey

The undersigned has inspected the Septic Tank System described above, and certifies it has been
☐ installed or constructed ☒ altered or repaired
☐ in accordance with the permit issued ☒ as detailed in the plot above
and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this
☐ Certificate of Completion ☒ Operation Permit
does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Repair to system
9' x 67' x 18" Stone Bed
Type II Conventional System

Terry P. Medlin
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4421B DATE: 9/22/00

TC: 031-371-17 ☒ L

SERIAL Nº 18547

Permission is hereby given to _____ Install or Construct, _____ After or (Repair) the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 9/22/00. All work shall be completed on or before 10/22/00, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

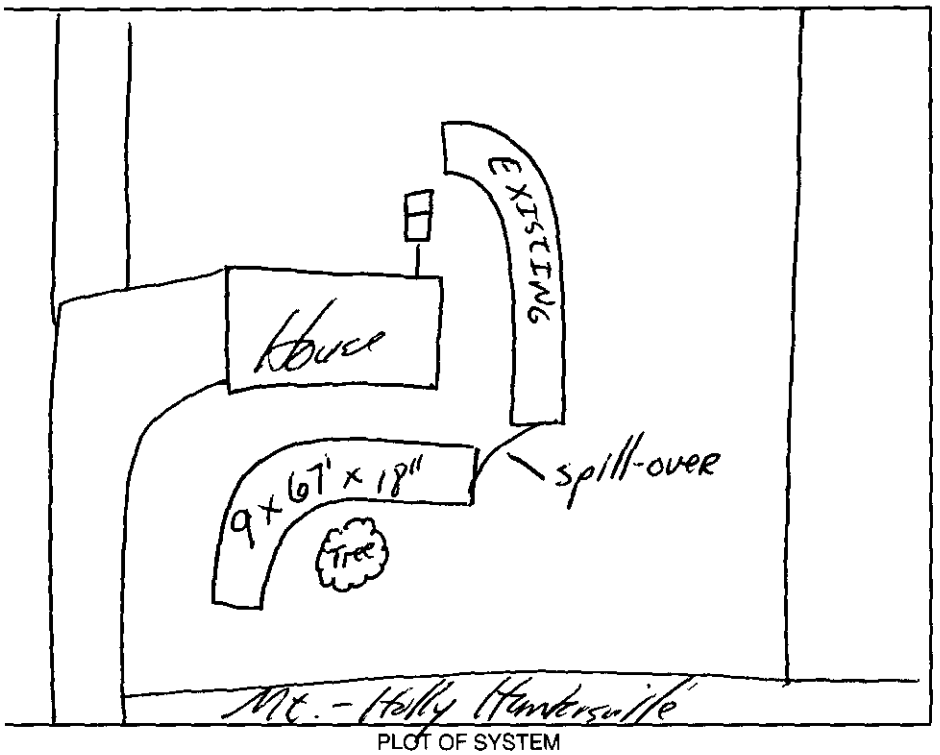

PLOT OF SYSTEM

Liquid Capacity of Septic Tank existing gallons

Liquid Capacity of Dosing Tank NA gallons

Tank Construction PCC

Trench Depth 36"

Absorption and/or Nitrification Lines:

Trench Width 9' x 67' feet

Trench Walls Scored and Porous yes

Total Line Length 200' feet

Number of Lines 3 x 67

Depth of Stone 18" inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well NA feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Mona Hayes

LOCATION OF PROPERTY 800 Mount Holly Huntersville Road

Comments: Repair to system
Install 9' x 67' x 18" stone Bed
Type II Conventional System

Tammy L. Miller
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

FEE: _____

DATE: _____

APPLICATION FOR IMPROVEMENT PERMIT
FOR RESIDENTIAL SITE
INDIVIDUAL WATER AND WASTEWATER
SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: __ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM X REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 4218

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 031-371-17

STREET ADDRESS: 8001 Mt Holly Huntersville Rd

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: 30 + 31 1955

TOWNSHIP (CHECK ONE):

__ 0 MECKLENBURG
✓ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

CLOSING DATE_____

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
✓ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 4

FOUNDATION FOR RESIDENCE:

__ WITHOUT BASEMENT
__ ON SLAB
✓ CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):
✓ COMMUNITY (C) __ MUNICIPAL (M) __ PRIVATE WELL (P)
__ SHARED WELL (S) __ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ✓ YES __ NO
EXISTING WASTEWATER SYSTEMS ✓ YES __ NO
EASTMENTS OR RIGHT-OF-WAYS __ YES ✓ NO
WELL, SPRINGS OR WATERLINES ✓ YES __ NO
DESIGNATED WETLANDS __ YES ✓ NO

PROPERTY OWNER:

NAME: (LAST) Hayes (FIRST) Mona (MI)

ADDRESS: 8719 Bedford Dr Rd

CITY: Charlotte STATE: NC ZIP: 28214

DAYTIME PHONE: ( ) –

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) Nantz (FIRST) Michele L (MI)

DAYTIME PHONE: (704) 345-2009

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Michele Nantz DATE: 9/22/10

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102