SUPERVISOR/ADMINISTRATIVE PROFESSIONAL CHECKLIST

☑ NEW SEPTIC ☐ REPAIR ☐ USE EXISTING ☐ MODIFIED PLOT PLAN ☐ ALTERATION

File Number: 11674B

Assigned Inspector: Jacob ?

☑ IP $250.00: 5/22/23 SM Initial/Date

☐ IP Commercial $450.00: _____ Initial/Date

☐ CA & OP $400.00: _____ Initial/Date

☐ Alteration Fees $300: _____ Initial/Date

☐ Modified Plot Plan Fees $100.00: _____ Initial/Date

☐ Use Existing Fees $100.00: _____ Initial/Date

☐ Use Existing Approved ☐ Use Existing Denied

System Denied
Place Mail
Denial letter

☐ Send IP permit for signature: _____ ☐ Signature received: _____

☐ Floor plans reviewed

☐ Generate CA ☐ Approve as Noted in Winchester

☐ This site is served by septic and well. Verify each is complete before final hold is released

☐ This septic system requires a certified operation contract before final hold is released

☐ Certified operator contract is on file: _____

☐ Septic file complete: _____

☐ Release final hold in Winchester: _____

Comments:

22 MAY '23 PM 4:34

1167 LB #13875

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. **SEPTIC / TYPE APPLICATION:** ○ N/A ◉ NEW SYSTEM ○ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ○ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. **JOB LOCATION INFORMATION:**
TAX PARCEL NUMBER: 03307312 / 03307311
STREET ADDRESS: 6529 Pargo Rd / 6519
CITY: Charlotte
STATE: NC ZIP: 28216
SUBDIVISION NAME: _____
LOT #: _____ LOT SIZE (acres): _____
TOWNSHIP:
◉ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. **BUILDING INFORMATION:**
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
◉ HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 2,200
NUMBER OF BEDROOMS: 5
NUMBER OF OCCUPANTS: 5
FOUNDATION TYPE:
◉ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
○ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☑ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. **WATER SUPPLY:** ◉ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. **PROPOSED USE OF WELL:** ○ N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED):*
☐ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. **RANK:** ____ ____ ____ ____ ____

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ◉ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ◉ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	○ YES ◉ NO	JURISDICTIONAL WETLANDS	○ YES ◉ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ◉ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ◉ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ◉ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ◉ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ◉ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ◉ NO
WASTE STORAGE	○ YES ◉ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ◉ NO

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____ ☑ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☑ N/A

12. **PROPERTY OWNER:**
NAME: Luis Garcia - Margarita Garcia
ADDRESS: 501 Austin Dr.
CITY: charlotte
STATE: NC ZIP: 28213
WORK PHONE: _____
MOBILE PHONE: 980.721.0107
FAX: _____
E-MAIL: LUISGRCIA25@6mail.com

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**
NAME: _____
ADDRESS: _____
CITY: _____
STATE: _____ ZIP: _____
WORK PHONE: _____
MOBILE PHONE: _____
FAX: _____
E-MAIL: _____

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring. LFG (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

Luis C Garcia — Property Owner's or Owner's Legal Representative Signature

05/22/23. — Date

OFFICE USE ONLY

O SURVEY PLAT TO SCALE SUBMITTED O SCALED SITE PLAN SUBMITTED O UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

File #: _____

PROPOSED PLOT PLAN


A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 6529 Parso Rd

Tax Parcel #: _____

Subdivision Name: _____


Lot #: _____

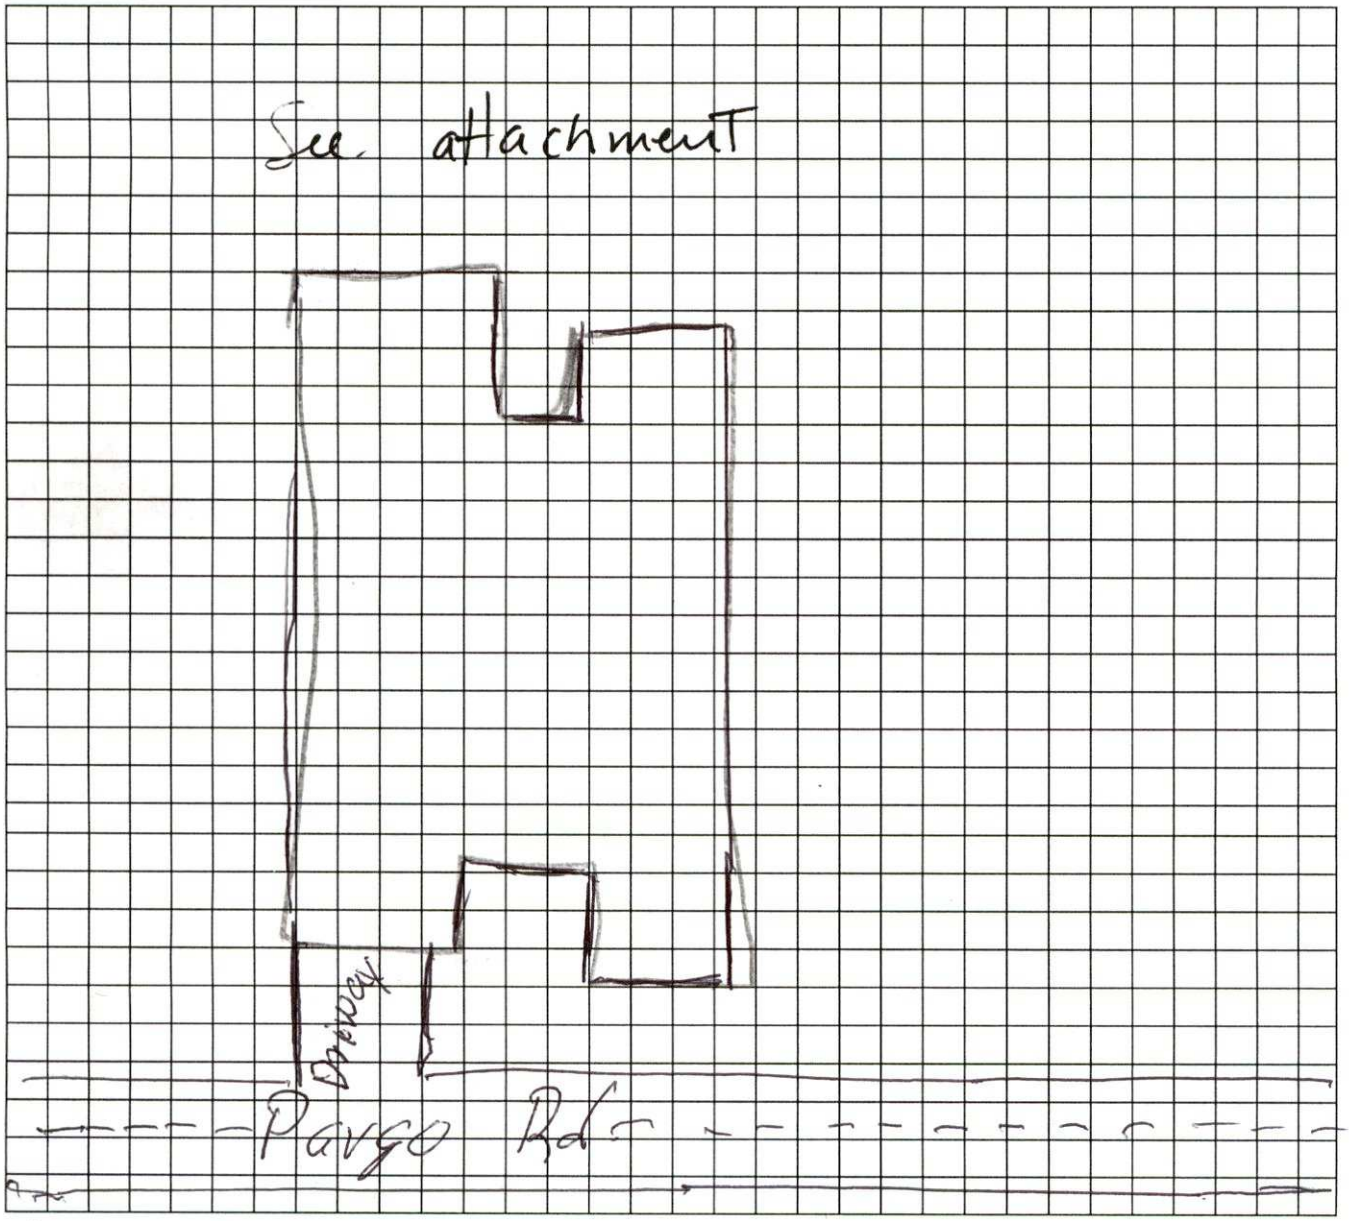

Luis Garcia
Property Owner's or Owner's Legal Representative Signature

05/22/23
Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

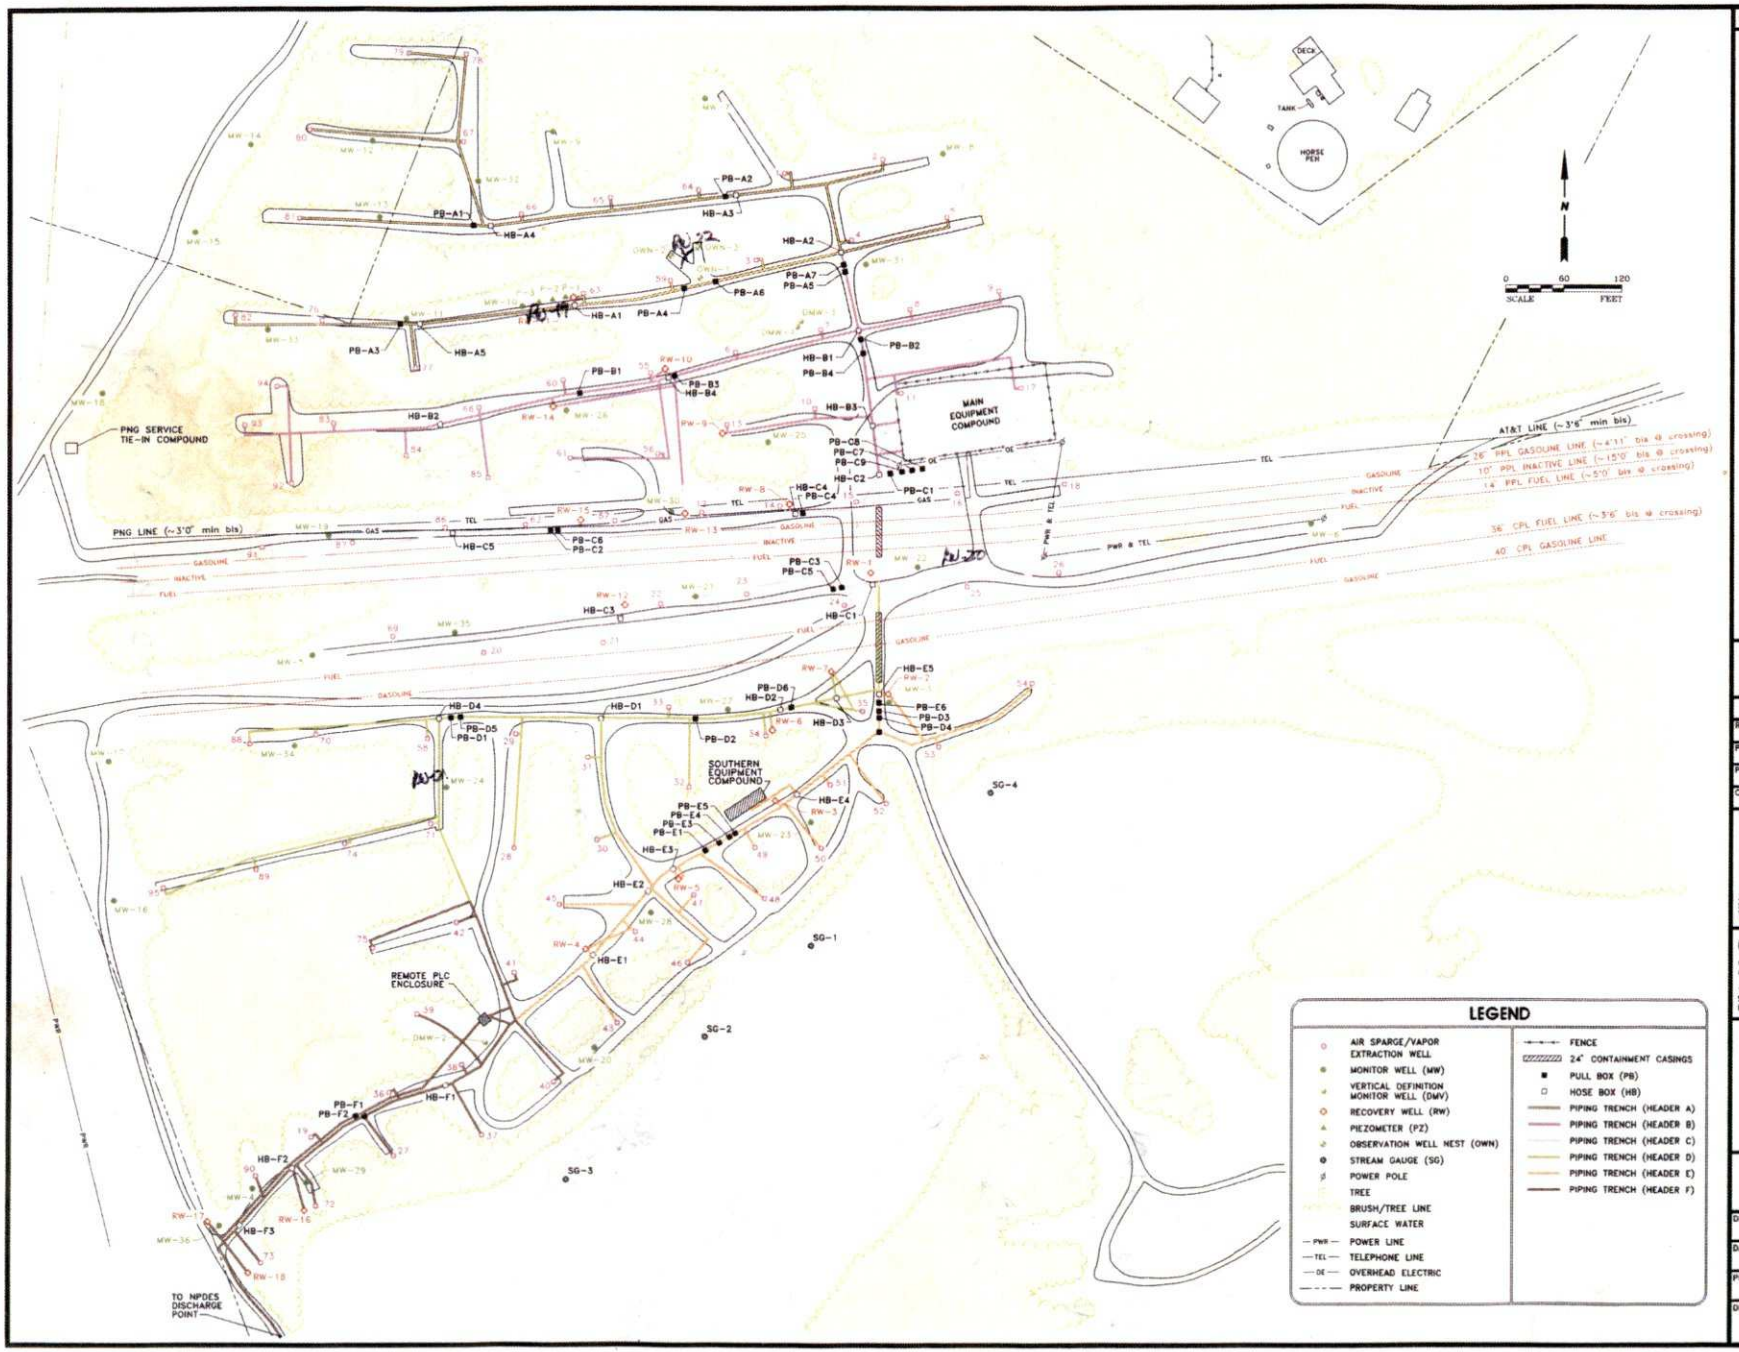

NO.	DATE	BY	REVISION

THIS DRAWING AND ANY ATTACHMENTS ("DRAWINGS") HAVE BEEN PRODUCED FOR THE SOLE USE OF THE RECIPIENT AND MUST NOT BE USED, REVISED, REPRODUCED, MODIFIED OR COPIED ("USE") IN ANY MANNER WITHOUT PRIOR WRITTEN APPROVAL OF GROUNDWATER TECHNOLOGY, INC. THIS DRAWING MAY CONTAIN CONFIDENTIAL AND PROPRIETARY INFORMATION OF GROUNDWATER TECHNOLOGY, INC. ANY UNAUTHORIZED USE OF THIS DRAWING IS STRICTLY PROHIBITED.

SIGNATURE	DATE
REVIEW ENGR:	
PROJECT ENGR:	
PROJECT MGR:	
CLIENT:	

FLUOR DANIEL GTI
3110 Cherry Palm Dr.
Suite 350
Tampa, FL 33619
(813) 626-2336

GT DESIGN SERVICES, INC., P.C.
1000 PERIMETER PARK DR.
Suite 1
MORRISVILLE, NC
(919) 467-7913

PLANTATION PIPE LINE COMPANY STIFFORD FERRY RD. SITE

REMEDIATION SYSTEM LAYOUT

DESIGNED BY:	DETAILED BY:	CHECKED BY:
SDB	KMP	BSL
DATE: 1 / 8 / 97	FILE: PRESENT	
PROJECT NO.: 053240003	CONTRACT:	
DRAWING:	REVISION:	

Carla Garrison

Pargo

D) 0-14 sbk SCL 10YR 7/2 17"
14-32 sbk C SVP VFi @
32-40 grinding on SCL saprolite

E) 0-> gr SCL
7-12 mass C VP VFi 10YR 7/2 @ 8"
12-18 grinding on mass SCL w/ weathered rock

MECKLENBURG COUNTY
Public Health

Raynard Washington
Health Director
(704) 336-4700

July 10, 2023
Luis & Margarita Garcia
501 Austin Dr
Charlotte, NC 28213

Re: Application for improvement permit for: 5 Bedroom House
Property Location: 6529 Pargo Rd, Charlottee, NC 28216 (PID 033-073-11 & 12)
Health Department File Number: **11674B (App ID 13875)**

Dear Property Owner or Owner's Agent:

The Mecklenburg County Health Department, Environmental Health Division on May 23rd, 2023, and June 20th, 2023 evaluated the above-referenced property at the site designated on the site plan that accompanied your improvement permit application. According to the application the site is to serve a 5 Bedroom House, with a daily design flow of 600 gallons per day. The evaluation was done in accordance with the laws and rules governing wastewater systems in North Carolina General Statute 130A-333 and related statutes and Title 15A, Subchapter 18A, of the North Carolina Administrative Code, Rule .l900 and related rules.

Based on the criteria set out in Title 15A, Subchapter 18A, of the North Carolina Administrative Code, Rules .1940 through .1948, the evaluation indicated that the site is **UNSUITABLE** for a ground absorption sewage system. Therefore, your request for an improvement permit is **DENIED.** A copy of the site evaluation is enclosed. The site is unsuitable based on the following:

- ☒ Unsuitable soil topography and/or landscape position (Rule .1940)
- ☒ Unsuitable soil characteristics (structure or clay mineralogy) (Rule .1941)
- ☒ Unsuitable soil wetness condition (Rule .1942)
- ☒ Unsuitable soil depth (Rule .1943)
- ☐ Presence of restrictive horizon (Rule .1944)
- ☒ Insufficient space for septic system and repair area (Rule .1945)
- ☐ Unsuitable for meeting required setbacks (Rule .1950)
- ☐ Other (Rule .1946)

These severe soil or site limitations could cause premature system failure, leading to the discharge of untreated sewage on the ground surface, into surface waters, directly to ground water or inside your structure.

The site evaluation included consideration of possible site modifications, and modified, innovative or alternative systems. However, the Health Department has determined that none of the above options will overcome the severe conditions on this site. A possible option might be a system designed to dispose of sewage to another area of suitable soil or off-site to additional property.

MECKLENBURG COUNTY
Public Health

Raynard Washington
Health Director
(704) 336-4700

For the reasons set out above, the property is currently classified **UNSUITABLE,** and an improvement permit shall not be issued for this site in accordance with Rule .1948 (c).

However, the site classified as **UNSUITABLE** may be classified as **PROVISIONALLY SUITABLE** if written documentation is provided that meets the requirements of Rule .1948(d). A copy of this rule is enclosed. You may hire a consultant to assist you if you wish to try to develop a plan under which your site could be reclassified as **PROVISIONALLY SUITABLE.**

You have a right to an informal review of this decision. You may request an informal review by the soil scientist or environmental health supervisor at the local health department. You may also request an informal review by the N. C. Department of Health and Human Services regional soil specialist. A request for informal review must be made in writing to the local health department.

You also have a right to a formal appeal of this decision. To pursue a formal appeal, you must file a petition for a contested case hearing with the Office of Administrative Hearings, 6714 Mail Center, Raleigh, NC 27699-6714. To get a copy of a petition form, you may write the Office of Administrative Hearings or call the office at (919) 431-3000 or from the OAH web site at http://www.oah.state.nc.us/hearings. The petition for a contested case hearing must be filed in accordance with the provision of North Carolina General Statutes 130A-24 and 150B-23 and all other applicable provisions of Chapter 150B. N. C. General Statue 130A-335(g) provides that your hearing would be held in the county where your property is located.

Please note: If you wish to pursue a formal appeal, you must file the petition form with the Office of Administrative Hearings **WITHIN 30 DAYS OF THE DATE OF THIS LETTER.** The date of this letter is July10, 2023. Meeting the 30-day deadline is critical to your right to a formal appeal. Beginning a formal appeal within 30 days will not interfere with any informal review that you might request. Do not wait for the outcome of any informal review if you wish to file a formal appeal.

If you file a petition for a contested case hearing with the Office of Administrative Hearings, you are required by law (N.C. General Statute 150B-23) to send a copy of your petition to the North Carolina Department of Environment and Natural Resources. Send the copy to: Office of General Counsel, N. C. Department of Environment and Natural Resources, 1601 Mail Service Center, Raleigh, NC. 27699-1601. Do **NOT** send the copy of the petition to your local health department. Sending a copy of your petition to the local health department will **NOT** satisfy the legal requirement in N.C. General Statute 150B-23 that you send a copy to the Office of General Counsel, NCDENR.

You may call or write the local health department if you need any additional information or assistance.

Sincerely,

Jacob Presley, REHS, LSS 980-314-1646
Soil Scientist/Sr. Environmental Specialist
Encl: (2)

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 033-073-12 & 033-073-11
Lot #: NA
File #: 11674B
AppID: 13875

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Luis & Margarita Garcia
Address: 501 Austin Dr, Charlotte, NC 28213
Proposed Facility: 5 Bedroom House
Design Flow (.1949): 600 GPD
Location of Site: 6519 & 6529 Pargo Rd, Charlotte, NC 28216
Water Supply: [ ] Public [X] Individual [X] Well
Evaluation Method: [X] Auger Boring [ ] Pit
Type of Wastewater: [X] Sewage [ ] Industrial Process

Applicant: owner
Date Evaluated: 5/30/2023
Property Size: 0.81 ac (combined)
Property Recorded: Unknown
[ ] Spring [ ] Municipal
[ ] Cut
[ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Trench Low Side
Boring A	R 3%	0 - 9	gre/sbk SCL	SS SP FR SEXP							
		9 - 15	sbk/abk SC	S P FI SEXP	10YR 6/2	15	NA	NA	Auger Refusal at 20"	US	NA
		15 - 20	mass SCL	SS SP FI/VFI SEXP	at 10"						
Boring B	LS 5%	0 - 7	sbk SCL	SS SP FR SEXP							
		7 - 14	sbk/abk C	S P VFI EXP	10YR 6/2	14	NA	NA	Auger Refusal at 22"	US	NA
		14 - 22	mass SCL	SS SP FI/VFI SEXP	at 7"						
Boring C	R 2%	0 - 7	sbk SCL	SS SP FR SEXP							
		7 - 28	mass/sbk C	VS VP VFI EXP	10YR 6/2	7	NA	NA	Auger Refusal at 32"	US	NA
		28 - 32	Weathered Rock w/ SCL inclusions		at 7"						
Boring D	R 3%	0 - 5	gr SCL	SS SP FR SEXP							
		5 - 15	sbk SCL	SS SP FR SEXP	10YR 7/2	15	NA	NA		US	NA
		15 - 38	mass/sbk C	S VP VFI EXP	at 12"						
Boring E	R 3%	0 - 7	gr SCL	SS SP FR SEXP							
		7 - 12	mass C	VS VP VFI EXP	10YR 7/2	7	NA	NA	Auger Refusal at 18"	US	NA
		12 - 18	Weathered Rock w/ SCL inclusions		at 8"						
Boring F	R 2%	0 - 14	sbk SCL	SS SP FR SEXP							
		14 - 32	mass/sbk C	S VP VFI EXP	10YR 7/2	7	NA	NA	Auger Refusal at 40"	US	NA
		32 - 40	Weathered Rock w/ SCL inclusions		at 17"						
Boring G	LS 4%	0 - 4	gr SL	SS SP FR SEXP	10YR 6/2				grinding through LS		
		4 - 30	mass LS/SCL	SS SP FI SEXP	at 22"	4	NA	NA	24 - 30"	US	NA

Description	Initial System	Repair System
Available Space (.1945)	US	US
System Type(s)	NA	NA
Site LTAR (gpd/sq ft)	**US**	**US**

Other Factors (.1946):
Soil Evaluation By: Jacob Presley, LSS, REHS
Others Present:
Site Classification (.1948): Unsuitable
Site Evaluation By: Jacob Presley, LSS, REHS
Others Present:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM
CONTINUED

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
Boring H	R 2%	0 - 4	gr SL	SS SP FR SEXP	10YR 6/2 at 16"	19	NA	NA	auger refusal at 29"	US	NA
		4 - 19	mass C	S P VFI EXP							
		19 - 24	mass SCL	SS SP FR SEXP							
		24 - 29	mass LS Sap	SS SP FI SEXP							
Boring I	R 2%	0 - 4	gr SL	SS SP FR SEXP	10YR 6/2 at 12"	30	NA	NA		US	NA
		4 - 12	gr SCL	SS SP FR SEXP							
		12 - 30	mass C	VS VP VFI EXP							
Boring J	R 2%	0 - 6	gr LS	SS SP FR SEXP	10YR 6/2 at 17"	27	NA	NA		US	NA
		6 - 27	mass C	S VP VFI EXP							
		27 - 34	mass CL	S P FI SEXP							

COMMENTS:

Landscape Position
R-Ridge
SS-Shoulder Slope
LS-Linear Slope
FS-Foot Slope
NS-Nose Slope
HS-Head Slope
CC-Concave Slope
CV-Convex Slope
T-Terrace
FP-Flood Plain
D-Drainage Way

Group	Texture	.1955 LTAR
I	S-Sand	1.2 - 0.8
	LS-Loamy Sand	
II	SL-Sandy Loam	0.8 - 0.6
	L-Loam	
III	Si-Silt	0.6 - 0.3
	SiCL-Silty Clay Loam	
	CL-Clay Loam	
	SCL-Sandy Clay Loam	
	SiL-Silt Loam	
IV	SC-Sandy Clay	0.4 - 0.1
	SiC-Silty Clay	
	C-Clay	

Structure
sg-Single Grain
mass-Massive
cr-Crumb
gr-Granular
sbk-Subangular Blocky
abk-Angular Blocky
pl-Platy
pr-Prismatic

Structure Prefixes
w-weak
m-moderate
s-strong
f-fine
m-medium
c-coarse


Consistence
Moist
VFR-Very Friable
FR-Friable
FI-Firm
VFI-Very Firm
EFI-Extremely Firm

Consistence
Wet
SS-Slightly Sticky
S-Sticky
VS-Very Sticky
NP-Non-Plastic
SP-Slightly Plastic
P-Plastic
VP-Very Plastic

Mineralogy
SEXP-Slightly Expansive
EXP-Expansive

Classification
US-Unsuitable
PS-Provisionally Suitable
S-Suitable
NA-Not Applicable

Sketch of Soil Evaluation Locations

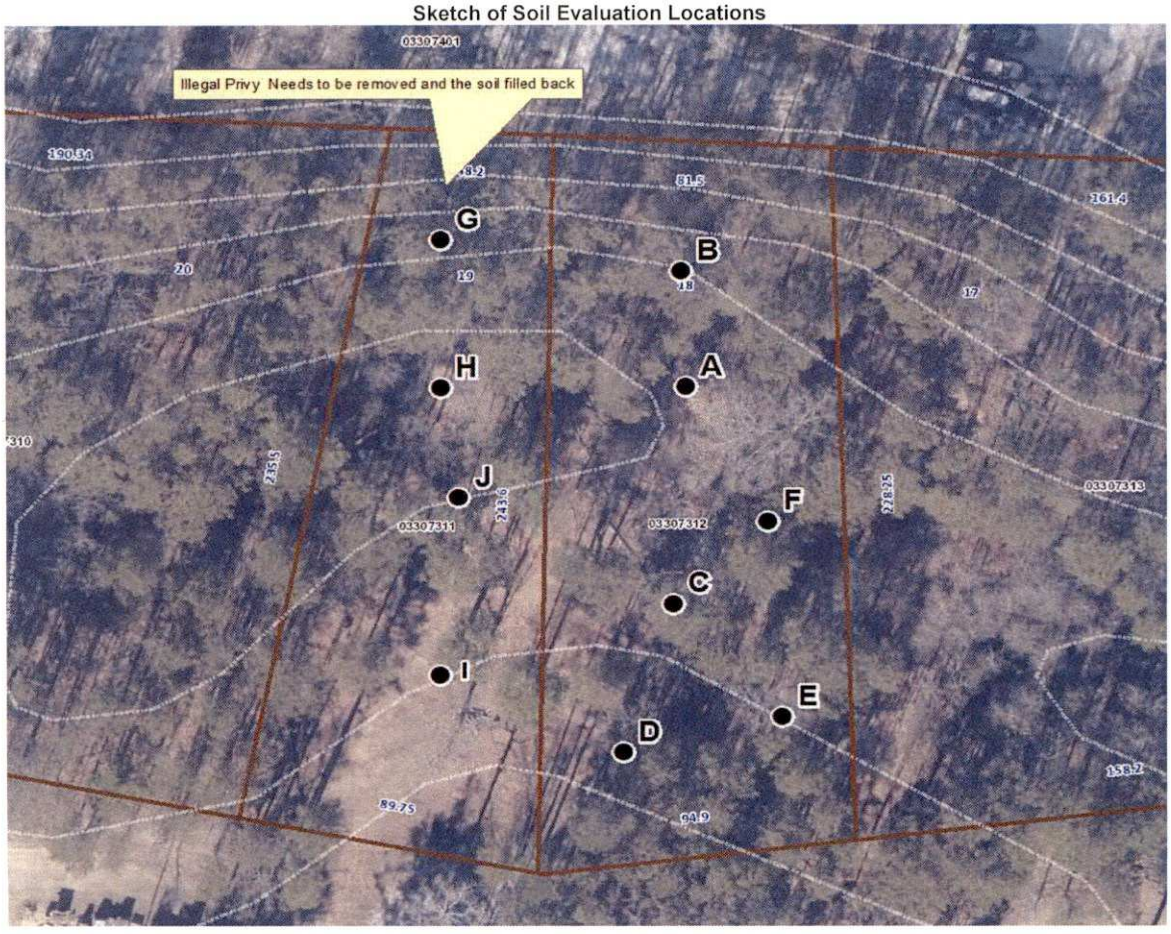

History Note: *Authority G.S. 130A-335(e);*
Eff. July 1, 1982;
Amended Eff. January 1, 1990.

15A NCAC 18A .1947 DETERMINATION OF OVERALL SITE SUITABILITY

All of the criteria in Rules .1940 through .1946 of this Section shall be determined to be SUITABLE, PROVISIONALLY SUITABLE, or UNSUITABLE, as indicated. If all criteria are classified the same, that classification will prevail. Where there is a variation in classification of the several criteria, the most limiting uncorrectable characteristics shall be used to determine the overall site classification.

History Note: *Authority G.S. 130A-335(e);*
Eff. July 1, 1982;
Amended Eff. January 1, 1990.

15A NCAC 18A .1948 SITE CLASSIFICATION

(a) Sites classified as SUITABLE may be utilized for a ground absorption sewage treatment and disposal system consistent with these Rules. A suitable classification generally indicates soil and site conditions favorable for the operation of a ground absorption sewage treatment and disposal system or have slight limitations that are readily overcome by proper design and installation.

(b) Sites classified as PROVISIONALLY SUITABLE may be utilized for a ground absorption sewage treatment and disposal system consistent with these Rules but have moderate limitations. Sites classified Provisionally Suitable require some modifications and careful planning, design, and installation in order for a ground absorption sewage treatment and disposal system to function satisfactorily.

(c) Sites classified UNSUITABLE have severe limitations for the installation and use of a properly functioning ground absorption sewage treatment and disposal system. An improvement permit shall not be issued for a site which is classified as UNSUITABLE. However, where a site is UNSUITABLE, it may be reclassified PROVISIONALLY SUITABLE if a special investigation indicates that a modified or alternative system can be installed in accordance with Rules .1956 or .1957 of this Section.

(d) A site classified as UNSUITABLE may be used for a ground absorption sewage treatment and disposal system specifically identified in Rules .1955, .1956, or .1957 of this Section or a system approved under Rule .1969 if written documentation, including engineering, hydrogeologic, geologic or soil studies, indicates to the local health department that the proposed system can be expected to function satisfactorily. Such sites shall be reclassified as PROVISIONALLY SUITABLE if the local health department determines that the substantiating data indicate that:

(1) a ground absorption system can be installed so that the effluent will be non-pathogenic, non-infectious, non-toxic, and non-hazardous;
(2) the effluent will not contaminate groundwater or surface water; and
(3) the effluent will not be exposed on the ground surface or be discharged to surface waters where it could come in contact with people, animals, or vectors.

The State shall review the substantiating data if requested by the local health department.

History Note: *Authority G.S. 130A-335(e);*
Eff. July 1, 1982;
Amended Eff. April 1, 1993; January 1, 1990.

15A NCAC 18A .1949 SEWAGE FLOW RATES FOR DESIGN UNITS

(a) In determining the volume of sewage from dwelling units, the flow rate shall be 120 gallons per day per bedroom. The minimum volume of sewage from each dwelling unit shall be 240 gallons per day and each additional bedroom above two bedrooms shall increase the volume of sewage by 120 gallons per day. In determining the number of bedrooms in a dwelling unit, each bedroom and any other room or addition that can reasonably be expected to function as a bedroom shall be