

REFER TO SPECIFICATION PACKAGE FOR MATERIALS SELECTION AND INSTALLATION REQUIREMENTS

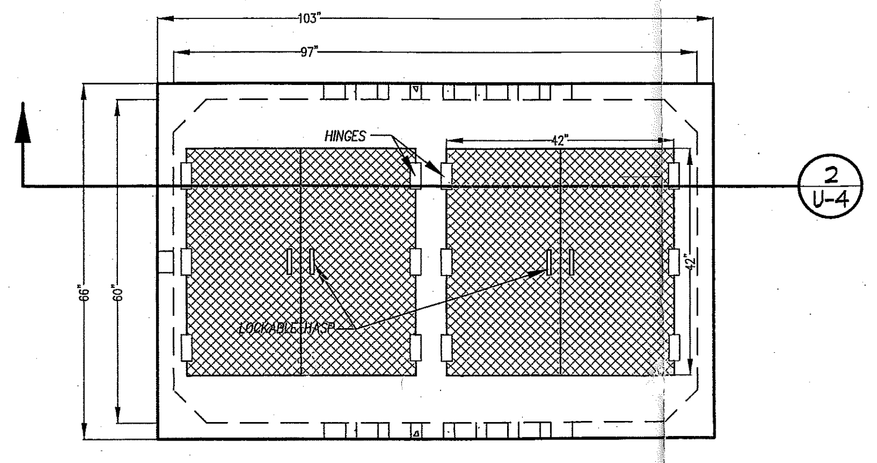


1 U-3 Plan View – Pressure Manifold Vault Lid

N.T.S.

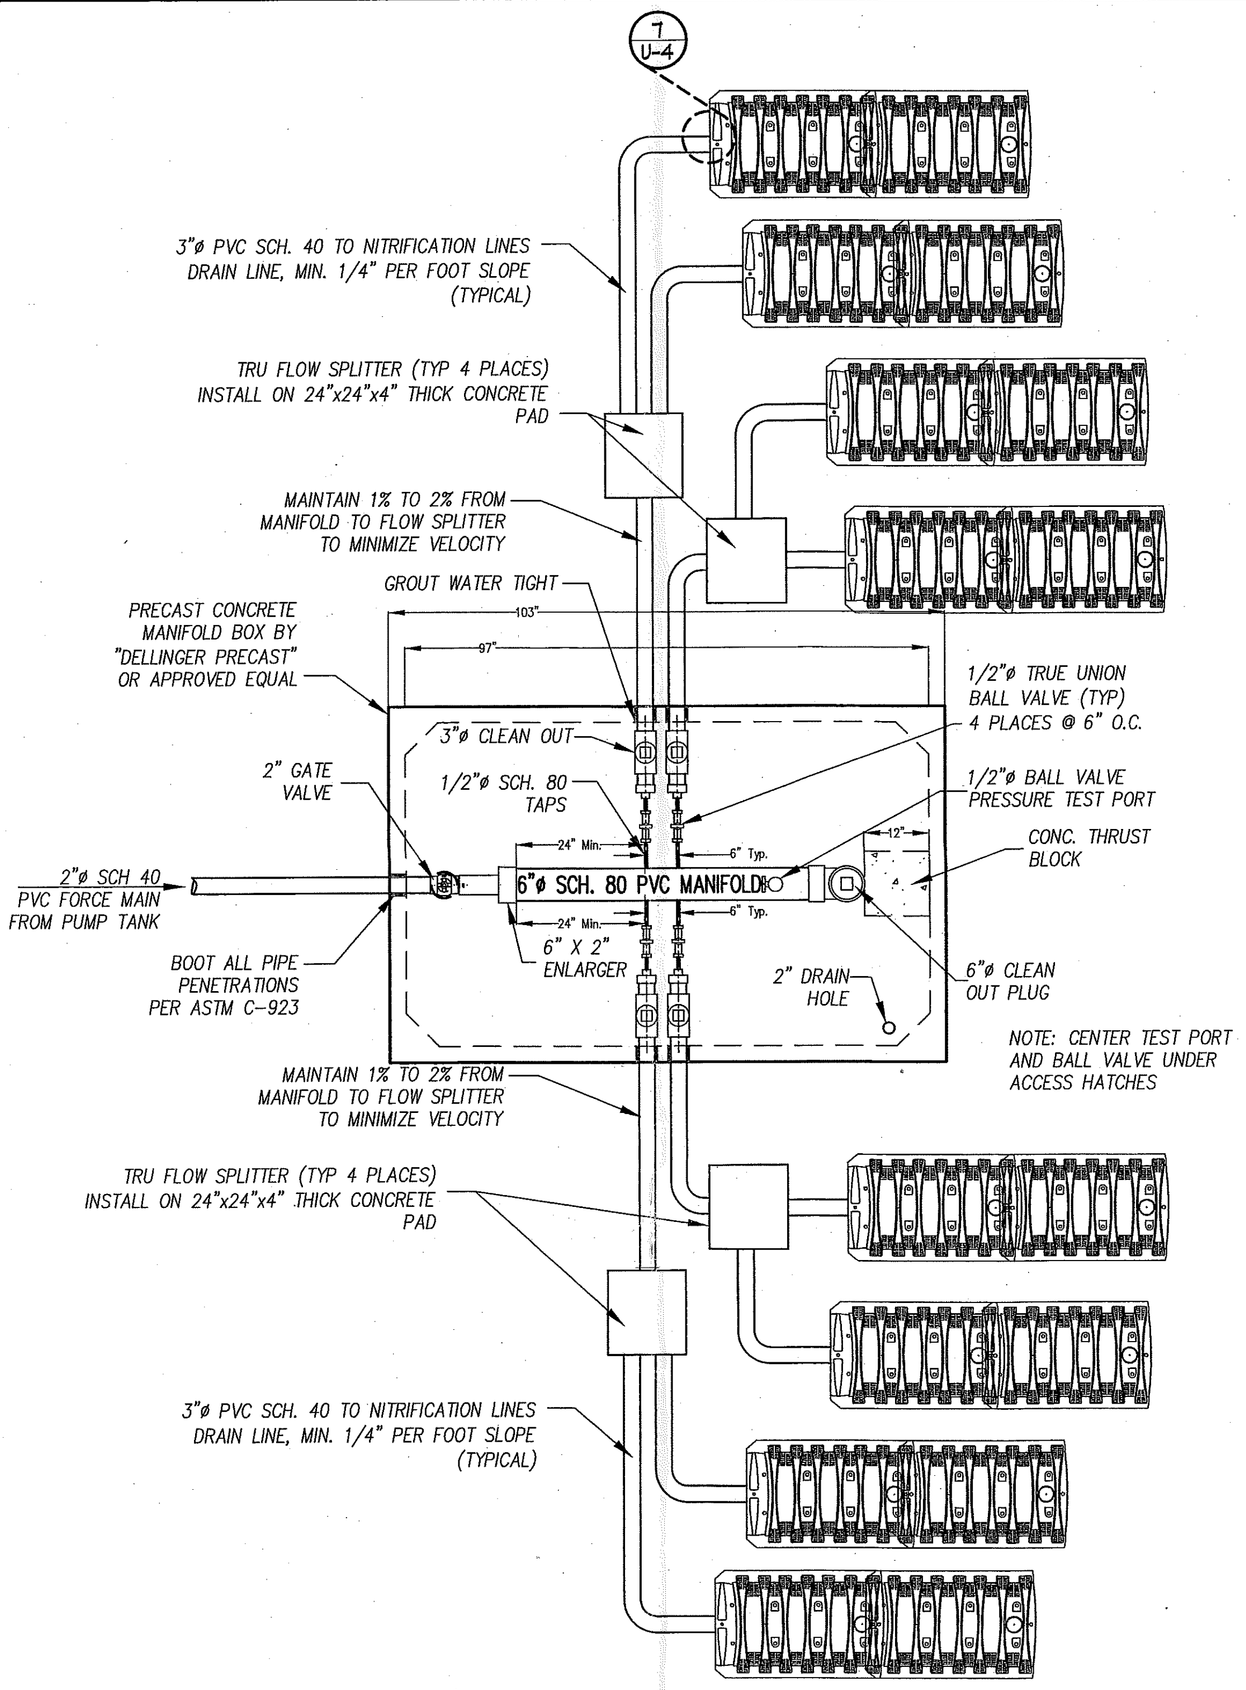

Plan View – Pressure Manifold Vault


N.T.S.

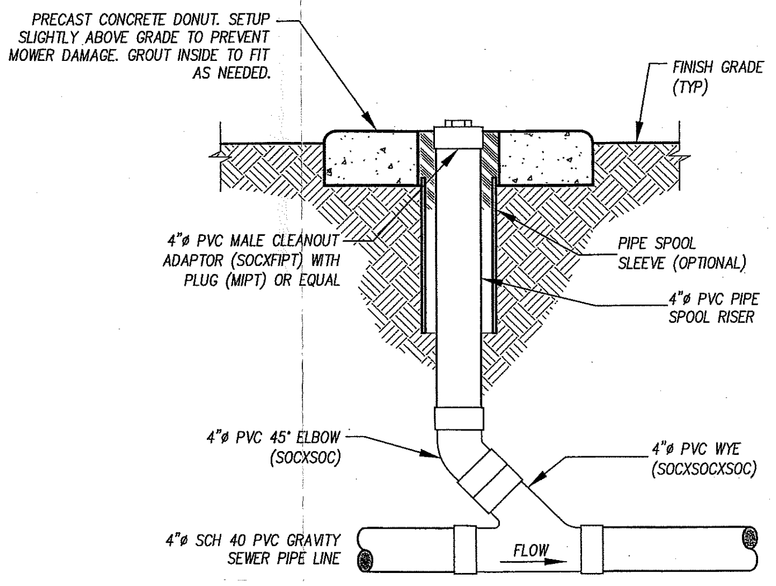

NOTE: ALL PVC FITTINGS SHOWN ARE SCH 40 RATED

Cleanout Detail


N.T.S.

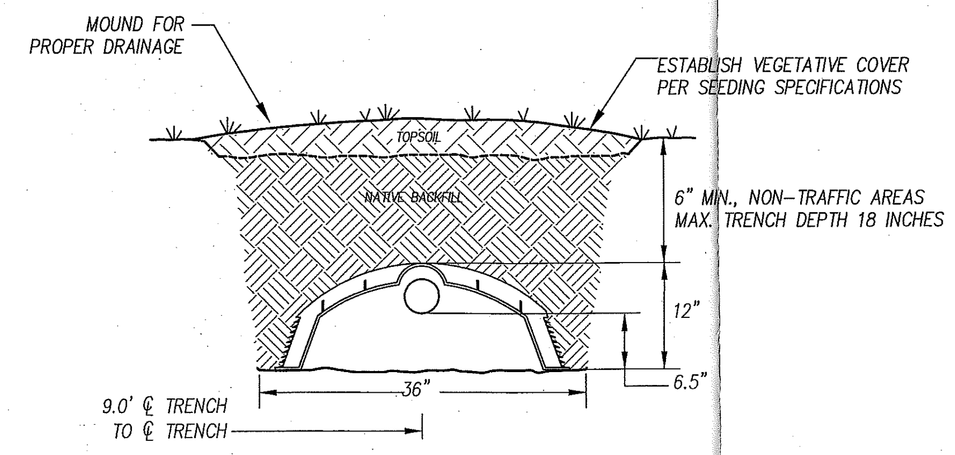

Gravelless Chamber Nitrification Trench Typical Section View


7 U-4

N.T.S.

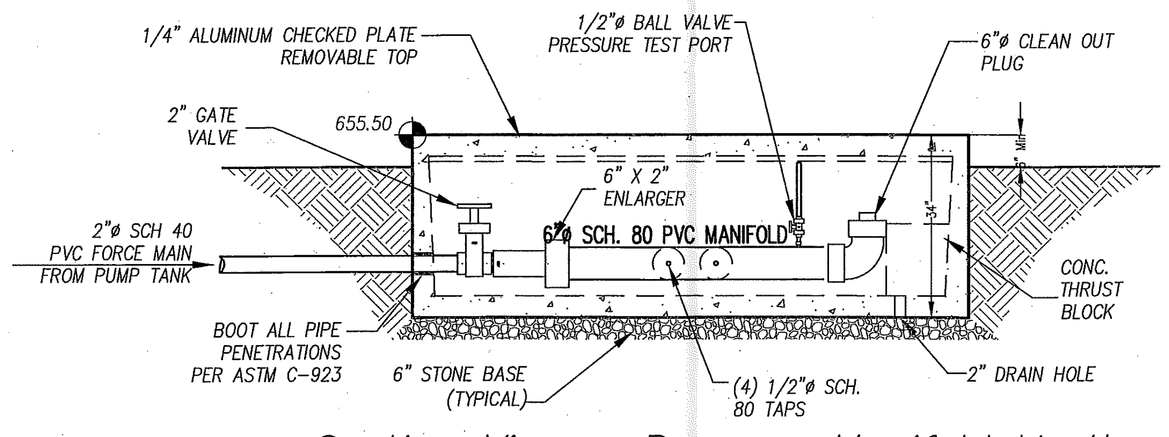

2 U-4 Section View – Pressure Manifold Vault

N.T.S.

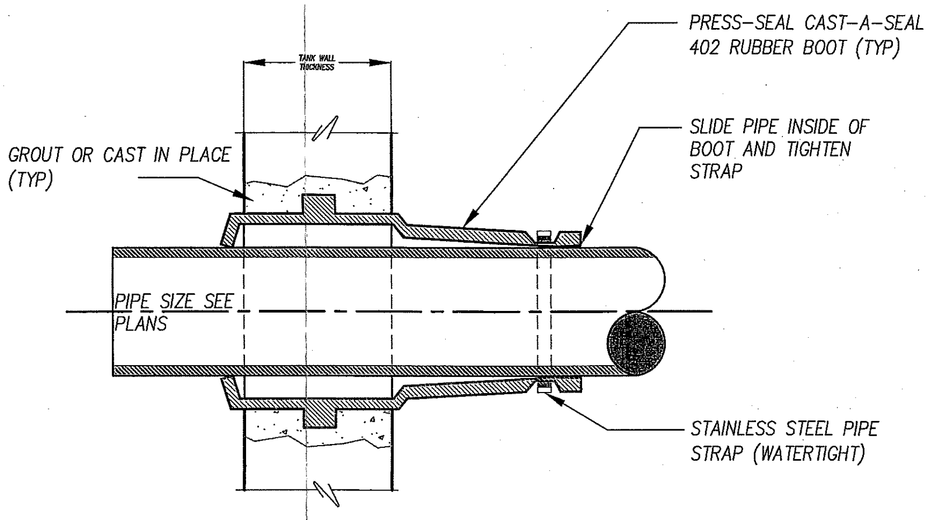

Pipe Penetration Detail

N.T.S.

Know what's below. Call before you dig.

PIEDMONT DESIGN
ENGINEERING/SURVEYING/PLANNING
Associates, P.A.
Suite 101 Westfield Center, 125 East Plaza Drive
Mooresville, North Carolina 28115
Phone:(704) 664-7888 Fax:(704) 664-1778 www.pdapa.com
NCBELS License #: C-1007

PREPARED FOR:
ARCADIA HOMES
6428 BANNINGTON ROAD
CHARLOTTE, NC 28226
(704) 412-4130

SEPTIC SYSTEM DETAILS
7 BEDROOM RESIDENCE
LOT 124 THE SANCTUARY
CHARLOTTE, MECKLENBURG COUNTY, NORTH CAROLINA

REVISIONS	BY

Date: 10/8/13
Scale: 1"=20 FT AS SHOWN
Drawn: DMD
Checked: DLM
Project: 2013-10-02
Job: 2013-10-02
Sheet U-4
of 4 Sheets

Location: PR-31
PUBLICATION OR REUSE OF THESE DRAWINGS OR ANY DETAILS WITHIN MUST BE WITH THE WRITTEN CONSENT OF PIEDMONT DESIGN ASSOCIATES, P.A.

Owner: _____ Approved: _____ Date of Issue: _____