

1916 LITTLE ROCK RD

05532102

6/1/2007

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 5540-A DATE: 4-6-90

TC: 055-321-02 ☐ L ☒ CRT

SERIAL Nº 13176

Name of Owner Anna Price Juris.:

Address of Property 1916 Little Rock Rd.

Inspection Data:

Tank Material repair

Total Length of Drainfield 120' + 120'

Number of Lines 4 + 2 @ 30' + 60'

Cover Depth 18" - 21"

Water Supply Source city

Distance to Water Source —

Excavation Inspected 4-6-90

Tank(s) Inspected

Wash Line Inspected 4-6-90

High Water Alarm Inspected

PLOT

Design: 1990 wash + septic repair CTR# 5

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☒ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS:

B. R. Ferguson
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 5540-A DATE: 4-4-90

TC: 055-321-02 #1

SERIAL Nº 14641

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 5-18-89. All work shall be completed on or before 5-4-90, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

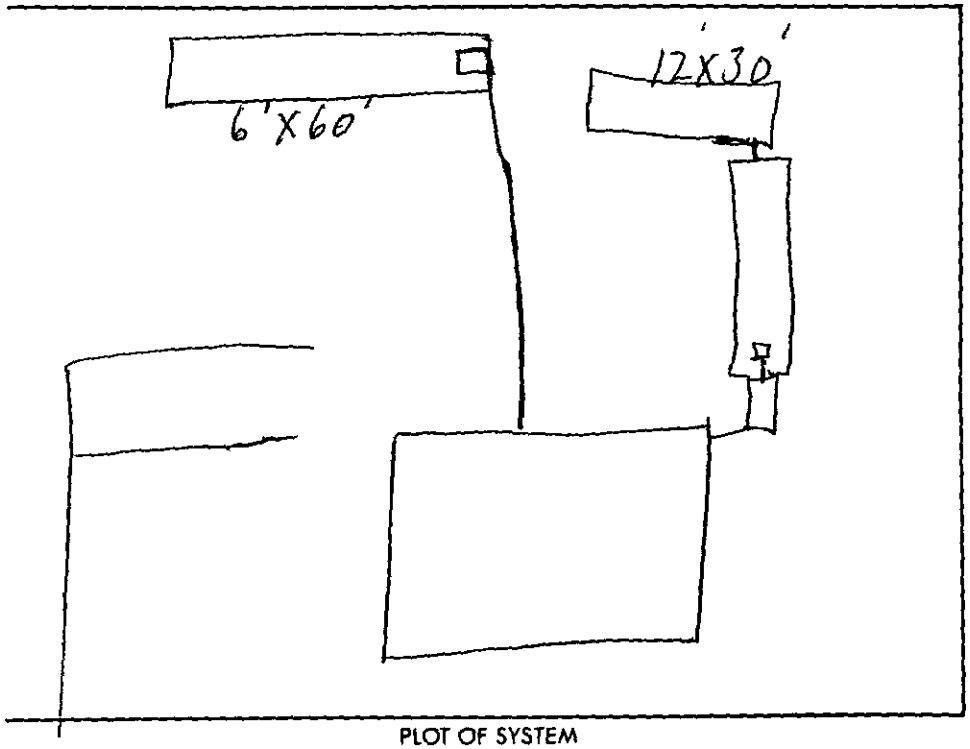

PLOT OF SYSTEM

Liquid Capacity of Septic Tank repair gallons

Liquid Capacity of Dosing Tank _____ gallons

Tank Construction _____

Absorption and/or Nitrification Lines:

Trench Width 12+6 feet

Total Line Length 130+120 feet

Number of Lines 4+2

Depth of Stone 18 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well city feet

NAME OF OWNER Anna Price

LOCATION OF PROPERTY 1916 Little Rock Rd

Comments: 1 bed 12'X30'X18" stone - septic
1 bed 6'X60'X18" stone - wash

Division or Section Head

B. R. Ferguson
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

SERVICE REQUEST/WORK ORDER

Tax Code: _____ Emergency? _____

Date: [redacted] Hour: _____

Section: [redacted] Log No.: [redacted]

REQUESTING PERSON: _____ Tel. No. _____

8-5

Address _____ City _____ Zip _____

PROPERTY CONCERNED: Facility Name Fred Price 554 5135

Address 1916 Little Rock Rd City Charlotte Zip _____

SERVICE REQUESTED: Sewage leak in the front yard of line

ASSIGNED TO: Kiser TAKEN BY: K Zalton

DATE	ACTIVITY REPORT
3/14/89	Application Sent
3/21/89	Site Visit - there is no obvious malfunction - Mrs Price Stated Sometimes it looks at the end. She will Contact Approp Contractors (list given) And be back in touch. She may wait until Summer. Her husband has Cancer And they are involved With this at their time. She just wanted Our Opinion in Case They needed to repair immediately. May be due to Rains
2/28/90	No further Contact Called Mrs Price no real Problem will follow-up if indicated
	5540A File

NOTIFICATION OF FINAL DISPOSITION TO REQUESTING PERSON:

Judy C Kiser R.S. 2/28/90 WRITTEN ___ VERBAL ___

Environmentalist's Signature Date

REVIEWED BY: _____ / _____ RECALL DATE: _____

Section Head's Signature Date

APPLICATION FOR AN IMPROVEMENT PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

(OFFICE USE ONLY)
RECEIVED
MECKLENBURG COUNTY
HEALTH DEPT.

FILE: 5540A

TC: 055-321-02 MAP:

SERIAL: No 17933

ENVIRONMENTAL HEALTH ☐ CRT DIVISION

JOB LOCATION

① ADDRESS: 1916 Little Rock Rd. (STREET NO. / STREET) ② FILE: ____

③ JURISDICTION: ____ ④ TAX PARCEL NO.: ____

⑤ SUBDIVISION: ____ ⑥ LOT: ____ ⑦ BLOCK: ____

OWNER

⑧ NAME: Fred D. Price (FIRST / MIDDLE / LAST)

⑨ MAILING ADDRESS: 1916 Little Rock Rd.

⑩ CITY: Charlotte ⑪ STATE: N. C ⑫ ZIP: 28214

⑬ PHONE: (WORK) ____ ⑭ (HOME) 399-5135

REQUEST

This request is for a(n):

⑮ ☐ New permit

⑯ ☒ Repair or alteration permit

⑰ ☐ Authorization for mobile home exchange

⑱ ☐ Other (specify) ____

DESIGN CRITERIA

System will serve:

⑲ ☒ Residence ⑳ ☐ Mobile home

㉑ ☐ Business or place of public assembly

㉒ Number of bedrooms? 3

㉓ Maximum occupancy? 2

㉔ Basement? ☒ yes ☐ no

㉕ Type? ____

㉖ Maximum number of employees? ____

㉗ Maximum number of seats? ____

WATER SUPPLY

㉘ Water supply from (present or proposed):

A ☐ Individual well

B ☒ Municipal system

C ☐ Community well

D ☐ Community system

㉙ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Fred D. Price

Date: 3-15-89

IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

... No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair permit is issued by this Department.

... This permit is not transferable, and shall become null and void 36 months from the date of issuance.

Ralph Willis, 5-18-89
Environmentalist — Date

Director or Authorized Section Head — Date

*This permit must be signed by the Director of Mecklenburg County Health Department or an authorized section head in order to be valid.