Date Received 6-24-82

MECK COUNTY DEPARTMENT OF
RECEIVED
JUN 24 1982
ENVIRONMENTAL HEALTH

SIR No. 18816

T. C. No 001-085-18

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER Gibbs (LAST) Philip (FIRST) Hamilton (MIDDLE)

2) ADDRESS OF OWNER 1120 Westbrook Circle, Gastonia, NC ZIP 28052

3) PHONE NO. Home 865-0136 Office 865-9595


4) LOCATION OF PROPERTY 19533 Bustle Road (STREET OR COUNTY ROAD)

5) SUBDIVISION _____ LOT NO ___ BLOCK NO. ___

MAP BOOK NO 14 PAGE NO 331

6) DEED REFERENCE DEED BOOK ___ PAGE NO ___

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface soil absorption effluent discharge

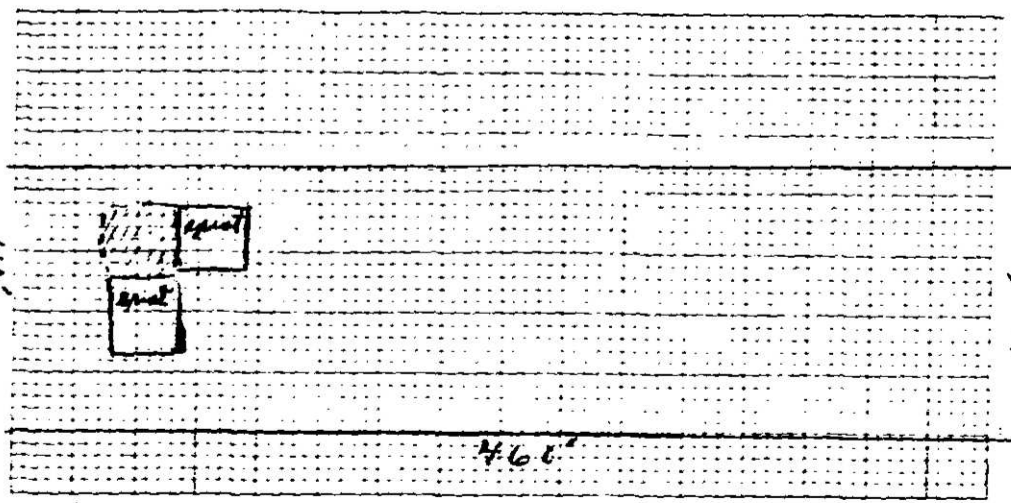

Existing houses each 26'x26'

7) ACCURATELY DIAGRAM & DIMENSION LOT

Rev. Philip H Gibbs
OWNER

EHD-5-76

Environmental Health Department's Copy

Serial No. 4608

PTR No. 18816

Date Issued 7-7-82

T. C. No. 001-085-18

Map Date


MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
SOIL INVESTIGATION REPORT

NAME OF OWNER Gibbs, (LAST) Philip (FIRST) Hamilton (MIDDLE)

ADDRESS OF OWNER 1120 Westbrook Cr., Gastonia, NC ZIP 28052

LOCATION OF PROPERTY 19533 Bustle Road (STREET OR COUNTY ROAD)

SUBDIVISION LOT NO BLOCK NO

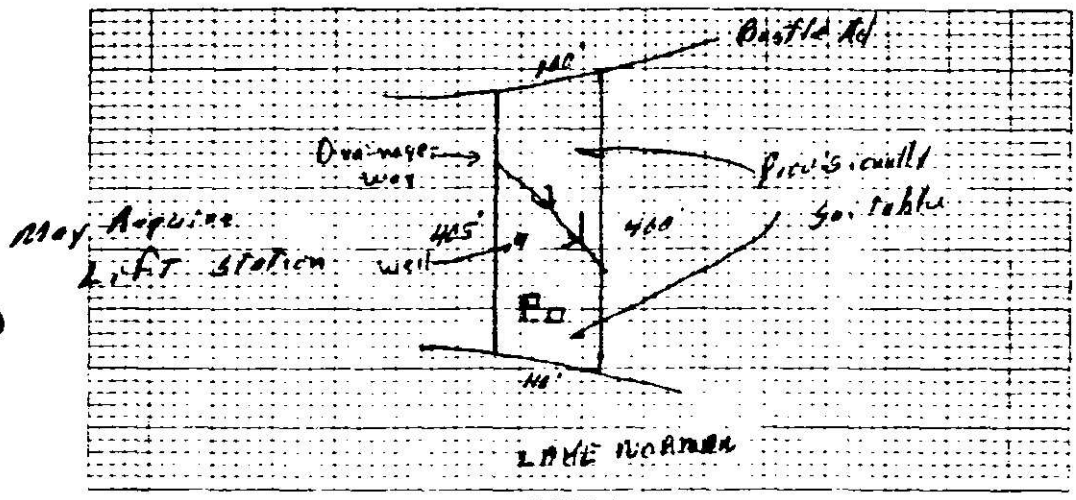

PLOT PLAN

This is to certify that [illegible] and that the [illegible] by the Mecklenburg County Department of Environmental Health and that [illegible] was conducted on that part of the [illegible] Provisionally Suitable

The permeability rate determined [illegible] The said lot is approved for the [illegible] and the [illegible] and the [illegible] subsurface soil absorption [illegible]

1. [illegible] Mecklenburg County Department of Environmental Health [illegible]
2. [illegible] by the Mecklenburg County [illegible] and on the [illegible]
3. [illegible]
4. [illegible]

This approval is granted subject to the laws of the State of North Carolina [illegible] and regulations of the North Carolina Department of Human Resources, Division of Health Services and the Mecklenburg County Health Commission which were in effect on the date hereof and which may at any time in the future be [illegible] or the site changed such that this approval would not have been granted had the new [illegible] been in effect on the issuance date.

William A. Martin
Soil Scientist

Mike Sexton
Environmental Health Director or Authorized Representative

EHC-5-76

Environmental Health Department's Copy

DEPARTMENT OF
ENVIRONMENTAL HEALTH
MECKLENBURG COUNTY,
NORTH CAROLINA

SITE EVALUATION

S.I.R. NO. 10816

T.C. NO. 001-085-10

(Ground Absorption Sewage Disposal)

OWNER: Phillip H. Hilbert
ADDRESS: 1120 Westbrook Dr. Gastonia, N.C. 28052
PLAT NO:
LOT SIZE: 45,302
LOCATION OF SITE: 19533 Beatty Road

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	S (PS) U 2-8%	S (PS) U 2-8%	S PS U	S PS U
2. SOIL TEXTURE (12-36 inches) Sandy, Loamy, Clayey (i.e. 2-1 Clay)	S (PS) U clay	S (PS) U clay	S PS U	S PS U
3. SOIL STRUCTURE (12-36 inches)	S (PS) U Blocky	S (PS) U Blocky	S PS U	S PS U
4. SOIL DEPTH (inches)	S PS U 49"	S PS U 49"	S PS U	S PS U
5. RESTRICTIVE HORIZONS (Inches) (Impervious strata, Rock)	S PS U None	S PS U None	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (external and internal)	S PS U 7-6" ground water	S PS U old Terrace	S PS U	S PS U
7. OTHER (Specify)	S PS U see Note	S PS U	S PS U	S PS U
8. SOIL GROUP	IVA	IVA		
9. SITE CLASSIFICATION	Provisionally Suitable	unsuitable		
10. SOIL SERIES	Cecil	old Terrace		

S - Suitable PS - Provisionally Suitable U - Unsuitable


**See Diagram on Back (includes: soil areas, property lines, roads, streams, gullies, wet areas, fill areas, wells, water bodies, slopes)

Recommendations/Comments: System will probably require lift station

Described by: William B. Martin
Title: Soil Scientist

Date: 7-7-82

EHD 539 (Revised: 6/82)

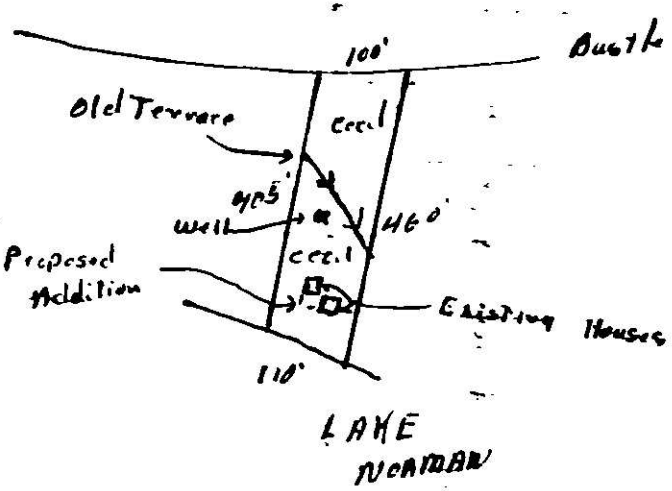
100'
Old Terrace
Well
405'
460'
Proposed
Addition
Existing House
110'
LAKE
NORMAN

Serial No. 5780

LA No. 18816

Date Issued 7-7-82

T. C. No. 001-085-18

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

IMPROVEMENT PERMIT

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER Gibbs, (LAST) Philip (FIRST) Hamilton (MIDDLE)

ADDRESS OF OWNER 1120 Westbrook Cr., Gastonia, NC ZIP 28052

LOCATION OF LOT 19533 Bustle Road (STREET OR COUNTY ROAD)

SUBDIVISION _____ LOT NO _____ BLOCK NO _____

MAP BOOK NO _____ PAGE NO _____

The above specified lot is approved by the Mecklenburg County Department of Environmental Health for the installation of an individual septic tank system with subsurface, soil absorption effluent discharge based on the soil investigation, on an onsite inspection of the said lot, and upon the information supplied in the "Application for an Installation, Construction, Alteration and/or Repair Permit", number 18816 This approval is subject to the following terms and conditions

1. That the nitrification field be installed constructed altered and/or repaired in the same area where the soil investigation was run
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altred, and or repaired and that the system be installed in accordance with same

This approval may be revoked and the building inspection department requested to revoke any building permits which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic-tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration, and/or Repair Permit LIFT STATION WILL BE REQUIRED

Adam Wingfield
Environmentalist

Mike Sekler
Environmental Health Director or Authorized Section Head

EHD-5-78

Environmental Health Department's Copy

9

Date Received 6-24-82

RECEIVED
JUN 24 1982
ENVIRONMENTAL HEALTH

CAR(S) Application No. 18816

T. C. No 001-085-18


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to

1) ✓ Install or Construct 2) ___ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption effluent discharge.

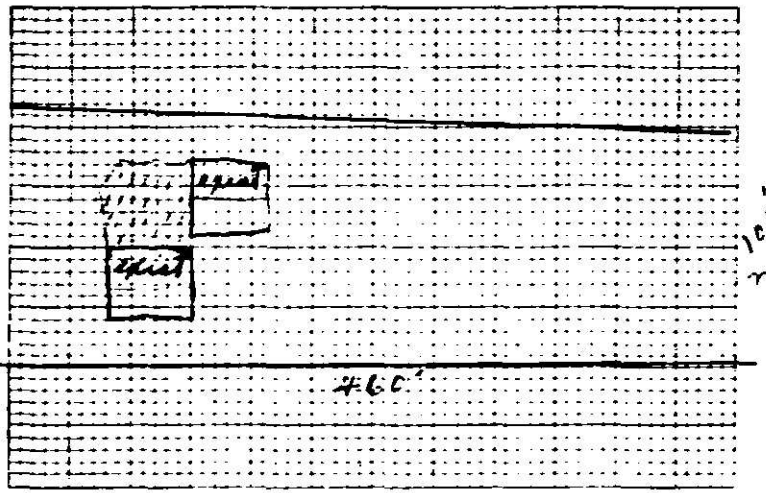

3 PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes ✓ No
Residence ✓ Yes ___ No
4) No of Bedrooms 3
5 Business Use — Max No Employees ___
6 Washing Machine ✓ Yes ___ No
7 Garbage Disposal ✓ Yes ___ No
8 Dishwasher ✓ Yes ___ No
9 Water Supply
A Individual Well ✓
B Governmental System ___
C Community System
1 Well source ✓
2 Governmental source ___
10 Sewage System
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No
11 FmHA Case No ___
12 VA Case No ___

13) NAME OF OWNER Gibbs (LAST) Philip (FIRST) Hamilton (MIDDLE)

14) ADDRESS OF OWNER 1121 Heathbrook Circle Gastonia, N.C. 28052

15) PHONE NO Home 865-6136 Office 865-9595

16) LOCATION OF SYSTEM 19533 Bessie Rd (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No ___ Block No. ___

Map Book No 14 Page No 331

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ✓ NO DATE RUN ___


20) PTR NUMBER (See Instructions ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

June 24 1982
DATE OF APPLICATION

Rev Philip H. Gibbs
OWNER

EHDE-76 ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

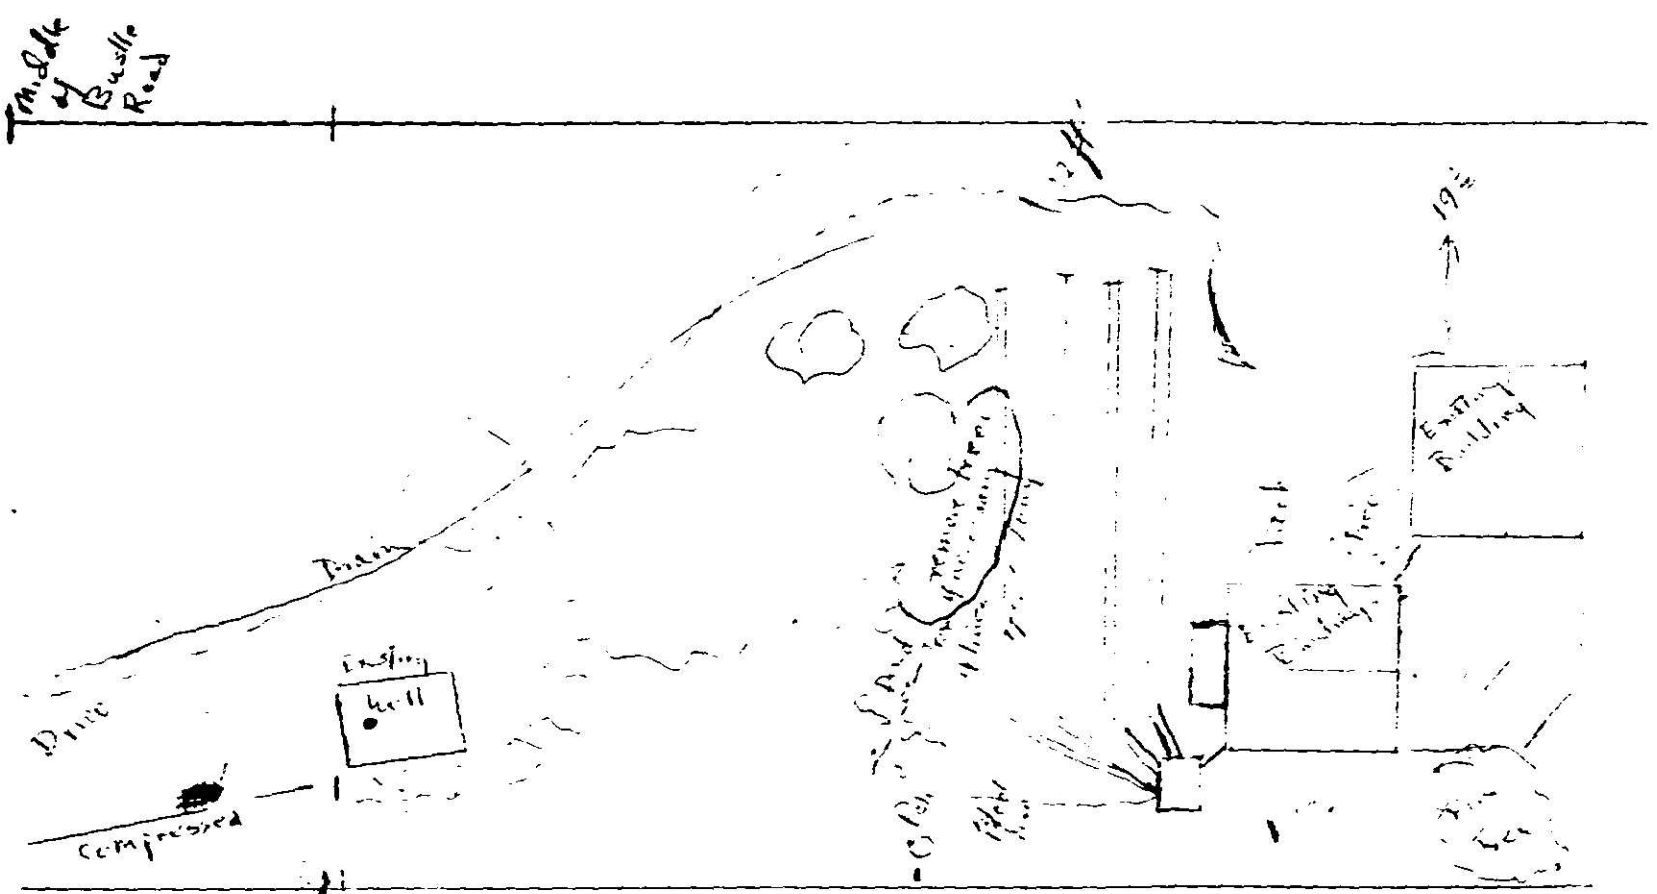

1st. Plan

LOT 19533 Bustle Rd

Mrs Phillip H Gibbs
1.20 Westbrook Circle
Greenville NC

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 18816 DATE: 5-21-86

TC: 001-085-18 pl

SERIAL Nº 10008

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 6-24-92. All work shall be completed on or before 6-21-96, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Department of Environmental Health before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

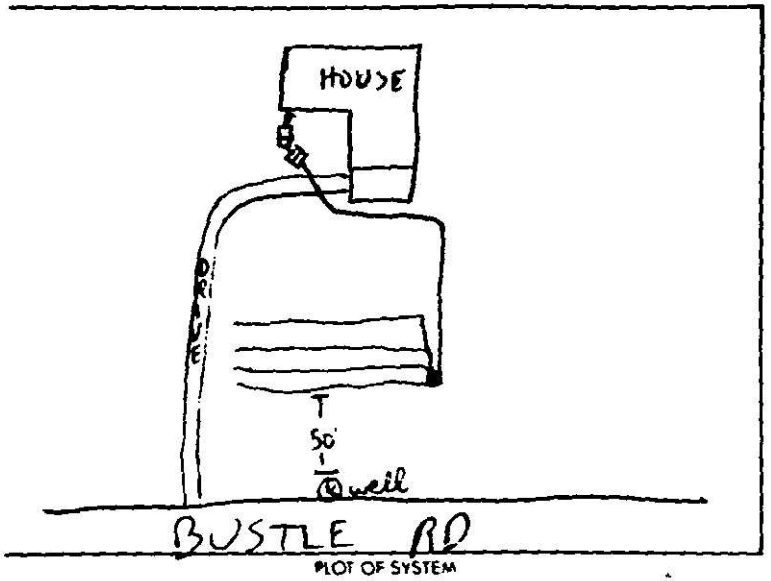

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank 1000 gallons

Tank Construction PCC

Absorption and or Nitrification Lines.

Trench Width 3' feet

Total Line Length 300' feet

Number of Lines 4 x 75

Depth of Stone 12" inches

Distance from House 5'+ feet

Distance from Property Line 10'+ feet

Distance from Well 50'+ feet

NAME OF OWNER GIBBS PHILIP H.

LOCATION OF PROPERTY 19533 BUSTLE RD

Comments: 4 lines @ 75' long each x 3' wide x 12" stone

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - ENVIRONMENTAL HEALTH DEPARTMENT'S COPY ● CANARY - ENVIRONMENTALIST'S COPY ● PINK - OWNER OR AGENTS COPY

Paid 3/15/88 engineered $100.00 ck

APPLICATION FOR AN IMPROVEMENT PERMIT

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

Mecklenburg County services are available without regard to ethnic origin, sex, or disability

(OFFICE USE ONLY)
FILE: 18816
TC: 001-085-18
SERIAL Nº 15723
☑ L ☑ CRT

JOB LOCATION

① ADDRESS: 19533 Bustle Rd. (STREET NO / STREET) ② FILE: 18816
③ JURISDICTION: ④ TAX PARCEL NO.: 001-085-18
⑤ SUBDIVISION: ⑥ LOT: ⑦ BLOCK:

OWNER

⑧ NAME: Rev Philip (FIRST) Hamilton (MIDDLE) Gibbs (LAST)
⑨ MAILING ADDRESS: 227 N. Main St
⑩ CITY: Stanley ⑪ STATE N.C. ⑫ ZIP: 28164
⑬ PHONE: WORK 263-2691 ⑭ HOME 263-2731

REQUEST

This request is for a/n:

⑮ ☐ New permit ⑰ ☐ Authorization for mobile home exchange Additional
⑯ ☐ Repair or alteration permit ⑱ ☒ Other specify Carport/workshop

DESIGN CRITERIA

System will serve:

⑲ ☐ Residence ⑳ ☐ Mobile home ㉑ ☐ Business or place of public assembly
㉒ Number of bedrooms? 3 ㉓ Type?
㉓ Maximum occupancy? 3 ㉔ Maximum number of employees?
㉔ Basement? ☐ yes ☒ no ㉕ Maximum number of seats?

WATER SUPPLY

㉖ Water supply from present or proposed

A ☑ Individual well
B ☐ Municipal system
C ☐ Community well
D ☐ Community system

㉗ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH to enter onto the property for the purpose of processing this request.

Signed: Rev. Philip H. Gibbs

Date:

IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH, certifies that the Department has approved the Application for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair permit is issued by this Department.

This permit is not transferable, and shall become null and void 36 months from the date of issuance.

[redacted]

Judy J. Klein RS 3/17/88
Agent Date

S. K. Rowell 3/15/88
Director or Authorized Section Head Date

*This permit must be signed by the Director of Environmental Health or an authorized section head in order to be valid.

DATE 3/14/88

TO: CHARLOTTE-MECKLENBURG BUILDING STANDARDS
PERMIT ISSUING SECTION

FROM: MECKLENBURG COUNTY ENGINEERING

JURISDICTION MCR

001-085-18

PARCEL NUMBER

19533 Bustle Rd

ASSIGNED STREET ADDRESS (ADDRESS OF RECORD)

EXISTING STREET ADDRESS (IF DIFFERENT FROM ASSIGNED)

N/A

PROJECT NAME (IF APPLICABLE)

THE ABOVE DESCRIBED LOCATION HAS BEEN CHECKED CONCERNING:

1.	SUBDIVISION REGULATIONS		APPROVED	NOT APPROVED
2.	FLOODWAY REGULATIONS		APPROVED	NOT APPROVED
3.	EROSION CONTROL REGULATIONS		APPROVED	NOT APPROVED
4.	COMMERCIAL DRAINAGE PLAN		APPROVED	NOT APPROVED
5.	PUBLIC UTILITY EASEMENT		PRESENT	NOT PRESENT
6.	PROPERTY FRONTS ON THOROUGHFARE		YES	NO
7.	DRIVEWAY PERMIT REQUIRED		YES	NO

REMARKS: Building permit - Carport - work Room

NOTE: THIS FORM MUST BE TURNED IN AT THE CASHIERS OFFICE WHEN PAYING PERMIT FEE. CERTIFICATE OF OCCUPANCY WILL NOT BE GRANTED UNTIL TRANSPORTATION DIVISION GRANTS FINAL APPROVAL ON DRIVEWAY(S).

09-19-86
ALL OTHER FORMS OBSOLETE

SIGNED:

PROPOSED PLOT PLAN


MECKLENBURG COUNTY · ENVIRONMENTAL HEALTH ·

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 18816

TC: 001-085-18

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

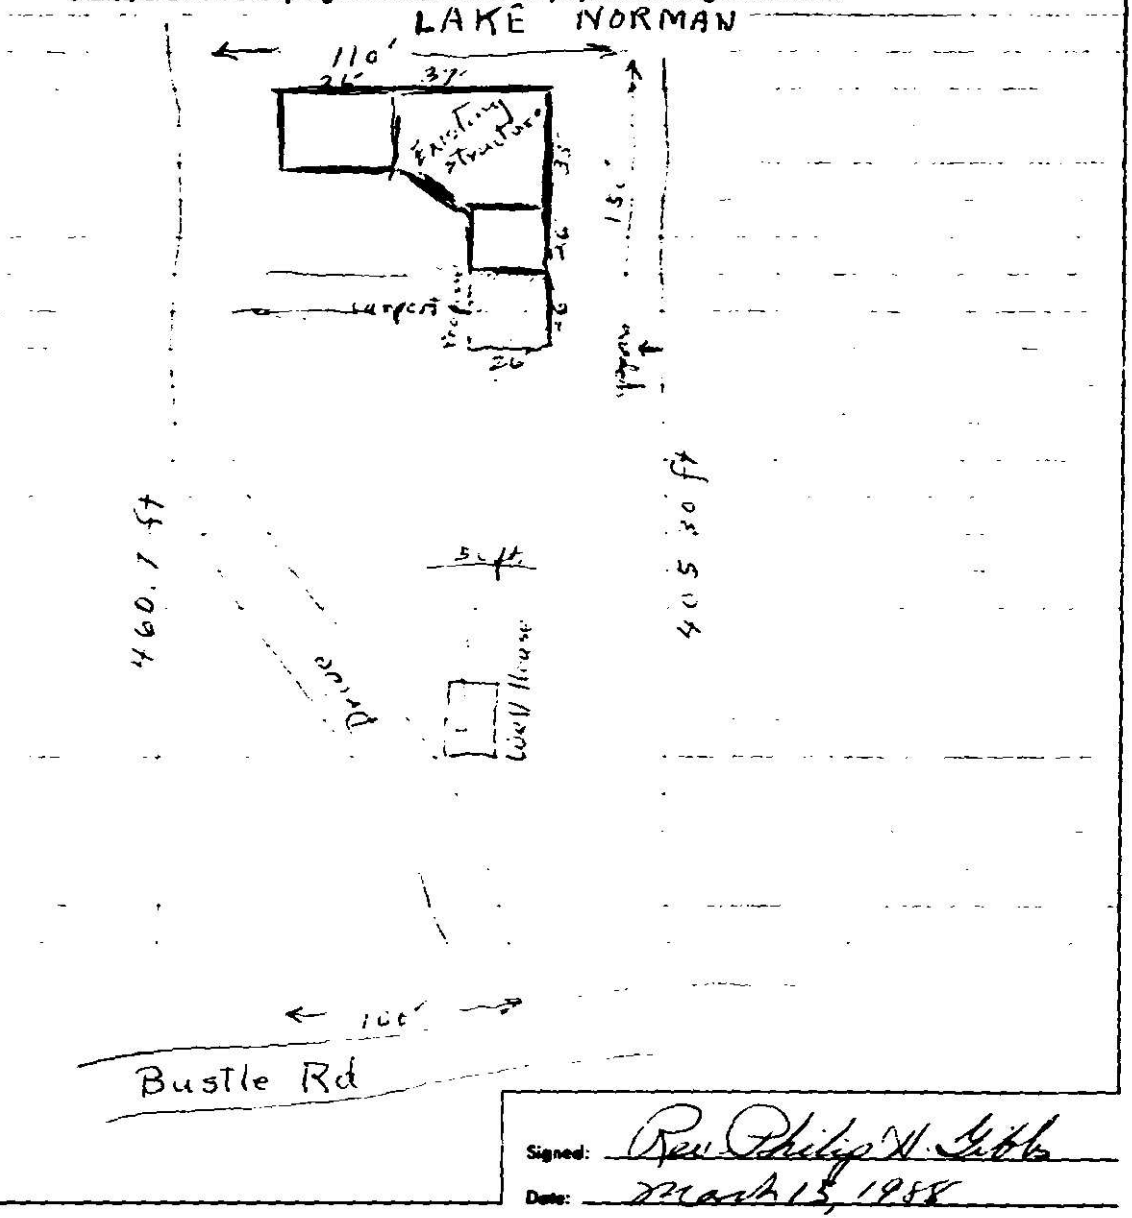

Signed: Rev Philip N. Gibbs

Date: March 15, 1988

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 18816 DATE: 5-21-86

TC: 001-085-10 pl

SERIAL Nº 10008

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 6-24-92. All work shall be completed on or before 6-21-96, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Department of Environmental Health before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

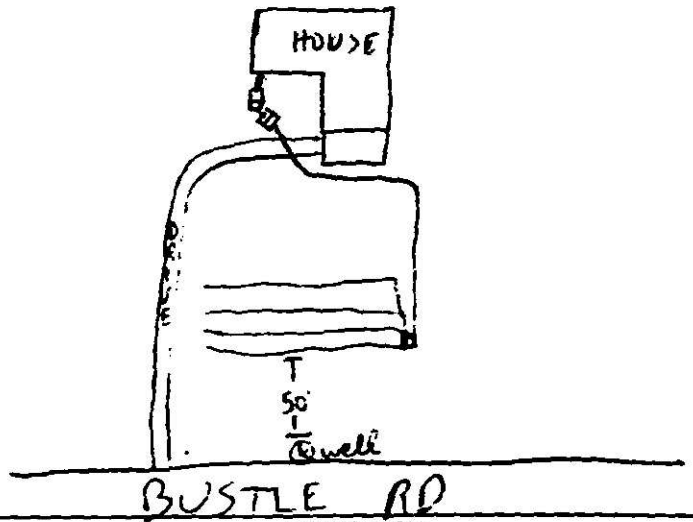

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank 1000 gallons

Tank Construction PCC

Absorption and or Nitrification Lines

Trench Width 3' feet

Total Line Length 300' feet

Number of Lines 4 x 75

Depth of Stone 12" inches

Distance from House 5' + feet

Distance from Property Line 10' + feet

Distance from Well 50' + feet

NAME OF OWNER GIBBS PHILIP H.

LOCATION OF PROPERTY 19533 BUSTLE RD

Comments: 4 lines @ 75' long each x 3' wide x 12" stone

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - ENVIRONMENTAL HEALTH DEPARTMENT'S COPY ● CANARY - ENVIRONMENTALIST'S COPY ● PINK - OWNER OR AGENT'S COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 18816 DATE: 3-31-88

TC: 001-086-18 ☑ L ☐ CRT

SERIAL № 10974

Name of Owner Phillip H. Gibbs Juris.:

Address of Property 19533 Bustle Rd

Inspection Data:

Tank Material Concrete

Total Length of Drainfield 400

Number of Lines 4 @ 100

Cover Depth 12-15"

Water Supply Source Well

Distance to Water Source 50'

Excavation Inspected 3-31-88

Tank(s) Inspected 3-31-88

Wash Line Inspected N A

High Water Alarm Inspected on site

PLOT

Design 1388 1500 St 1000 gal ST, PI, Con. 1200 SFT, 12"6, Gravel CTR#

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A 1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A 1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS Pump Myers 1/3 HP Cat. No 3S N133 M1C Amps 6

W. B. Ramsey
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.