

12/26/2007

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

Mecklenburg County
Health Department

September 10, 1996

Mr. John Parker
11433 Rozzelles Ferry Road
Charlotte, NC 28214

Re: Rozzelles Ferry Road
File: 1536A
Parcel: 023-132-01

Dear Mr. Parker:

Receipt of the plans and specifications for a conventional system of sewage treatment and disposal for the above property is hereby acknowledged. Upon receipt of the information, a review was made of the material on file and a site evaluation was conducted. The plan was then reviewed in conjunction with provisions of 15A NCAC 18A .1900, "Laws and Rules for Sewage Treatment and Disposal Systems." Our comments are listed below (see enclosed soil report):

1- The available area on this site is classified as **UNSUITABLE** according to the following rules:

(a) .1945 Available Space

For these reasons, the plans as submitted are disapproved.

Possible ways to develop this site includes submittal of a plan for a Prefabricated, Permeable Block Panel System (PPBPS). These plans would also need to include appropriate surface water diversions. Enclosed is a copy of Rule .1956 Modifications to Septic Tank Systems pertaining to PPBP Systems. This system would require a pump and a maintenance agreement. This system would be required to be designed by a consultant or engineer and the plans submitted to the Health Department for approval.

Due to space limitations, there does not appear to be any additional area for an expansion of the church or utilization of a day care.

You also have the right to an informal review with this Department, you have the right to appeal under G.S. 130A-24 through the State Office of Administrative Hearings (OAH), and to have the appeal held in Mecklenburg County.

If you have any questions concerning this matter, please contact me at 336-5572.

Sincerely,

Toni Higgins-Bunney, R.S.
Individual Water and Wastewater Systems

Enclosure

cc: Randy McCurry

Randy Curry
#558-2526

Mecklenburg County
Health Department

September 2, 1994

Enclose

~~Mr. William Meyer~~ JOHN Parker
~~5110 Rolling Oaks~~ 11433 Rozzelles Ferry Rd.
~~Charlotte, NC 28227~~ Charlotte, NC 28214

soil Reports +

Re: ~~9026 Lauriston Place~~ 10500 Rozzelles copy attached.
File: ~~3011A~~ 1536A Ferry Rd.
Parcel: ~~139-054-27~~ 023-132-01

Dear Mr. Meyer:

Receipt of the plans and specifications for a conventional system of sewage treatment and disposal for the above property is hereby acknowledged. Upon receipt of the information, a review was made of the material on file and a site evaluation was conducted. The plan was then reviewed in conjunction with provisions of 15A NCAC 18A.1900, "Laws and Rules for Sewage Treatment and Disposal Systems." Our comments are listed below (see enclosed soil report):

1- The available area on this site is classified as **UNSUITABLE** according to the following rules:

~~(a) .1940 Topography and Landscape Position~~
(b) .1945 Available Space

For these reasons, the plans as submitted are disapproved.

Possible ways to develop this site includes submittal of a plan for a Prefabricated, Permeable Block Panel System (PPBPS). These plans would also need to include appropriate surface water diversions. Enclosed is a copy of Rule .1956 Modifications to Septic Tank Systems pertaining to PPBP Systems. THIS SYSTEM WOULD REQUIRE A PUMP AND A MAINTENANCE AGREEMENT. THIS SYSTEM WOULD BE REQUIRED TO BE DESIGNED BY A

You may not want this sentence

You also have the right to an informal review with this Department, you have the right to appeal under G.S. 130A-24 through the State Office of Administrative Hearings (OAH), and to have the appeal held in Mecklenburg County.

If you have any questions concerning this matter, please contact me at 336-5569.

THE PLANS
A CONSULTANT OR ENGINEER AND SUBMITTED TO THE HEALTH DEPARTMENT
Sincerely, FOR APPROVAL. ~~THIS IS~~

Susan M. Bateman, R.S.
Individual Water and Wastewater Systems

NEXT PARAGRAPH — THERE DOES NOT APPEAR TO BE ANY ADDITIONAL AREA FOR AN EXPANSION OR UTILIZATION OF A DAY CARE DUE TO SPACE LIMITATIONS.

cc: Mr. ~~William Martin, Soil~~ Scientist

Enclosure

cc: Randy McCurry

FILE: 106 CH 17750

DATE: 8-13-96

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR IMPROVEMENT PERMIT FOR COMMERCIAL/INDUSTRIAL SITE

[redacted] | CRT

TYPE APPLICATION: ✓ NEW SYSTEM ___ EXPANSION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

COPY

FILE #: 15368

PROJECT TRACKING #:

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 023-132-01

STREET ADDRESS: 10500 Rozzelles Ferry Rd.

LOT NUMBER:

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
___ 7 MINT HILL

___ COMMERICAL ___ INDUSTRIAL

DESCRIBE TYPE OF BUSINESS:

Specific Nature of Facility: CHURCH

NUMBER OF EMPLOYEES: _____ PER SHIFT: _____

HOW WILL WATER BE USED IN THE FACILITY:

✓ TOILETS/URINALS
✓ HANDSINK
✓ SHOWERS
✓ FLOOR DRAINS

OTHER, PLEASE DESCRIBE:

TYPE OF WASTEWATER:

✓ SEWAGE ___ INDUSTRIAL PROCESS WASTE WATER

An IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change.

IF EXPANSION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED ADDITION:

WATER SUPPLY (CHECK ONE): ___ COMMUNITY (C) ___ MUNICIPAL (M) ✓ PRIVATE WELL (P) ___ SHARED WELL (S) ___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	___ YES ✓ NO	WELL SPRINGS OR WATERLINES	___ YES ___ NO
EXISTING WASTE WATER SYSTEMS	✓ YES ___ NO	DESIGNATED WETLANDS	___ YES ___ NO
EASEMENTS OR RIGHT-OF-WAYS	___ YES ___ NO		

BUILDING PLANS TO INCLUDE ALL PLUMBING, FLOOR DRAINS AND ALL SOURCES OF WASTEWATER DISCHARGE AND GRADING PLANS MAY BE REQUIRED DURING THE EVALUATION STAGE.

PROPERTY OWNER:	LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:
NAME: (LAST) DARKER (FIRST) JOHN (MI)	NAME: (LAST) McCURRY (FIRST) RANDY (MI)
ADDRESS: 11433 Rozzelles Ferry RD	DAYTIME PHONE: ( ) - 556-2526
CITY: Charlotte STATE: NC ZIP: 28214	
DAYTIME PHONE: ( )	

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

THE UNDERSIGNED, OWNER, OR LEGAL AGENT FOR THE OWNER, OF THE PROPERTY DESCRIBED ABOVE AS THE "JOB LOCATION" HAS READ THE FOREGOING APPLICATION, ACKNOWLEDGES THAT THE CONTENTS OF SAME ARE TRUE, AND AUTHORIZES AGENTS OF THE MECKLENBURG COUNTY HEALTH DEPARTMENT TO ENTER ONTO THE PROPERTY FOR THE PURPOSE OF PROCESSING THIS REQUEST.

SIGNED: Randy McCurry DATE:

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

PROPOSED PLOT PLAN


COPY

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 1536

TC: 023-132-01

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

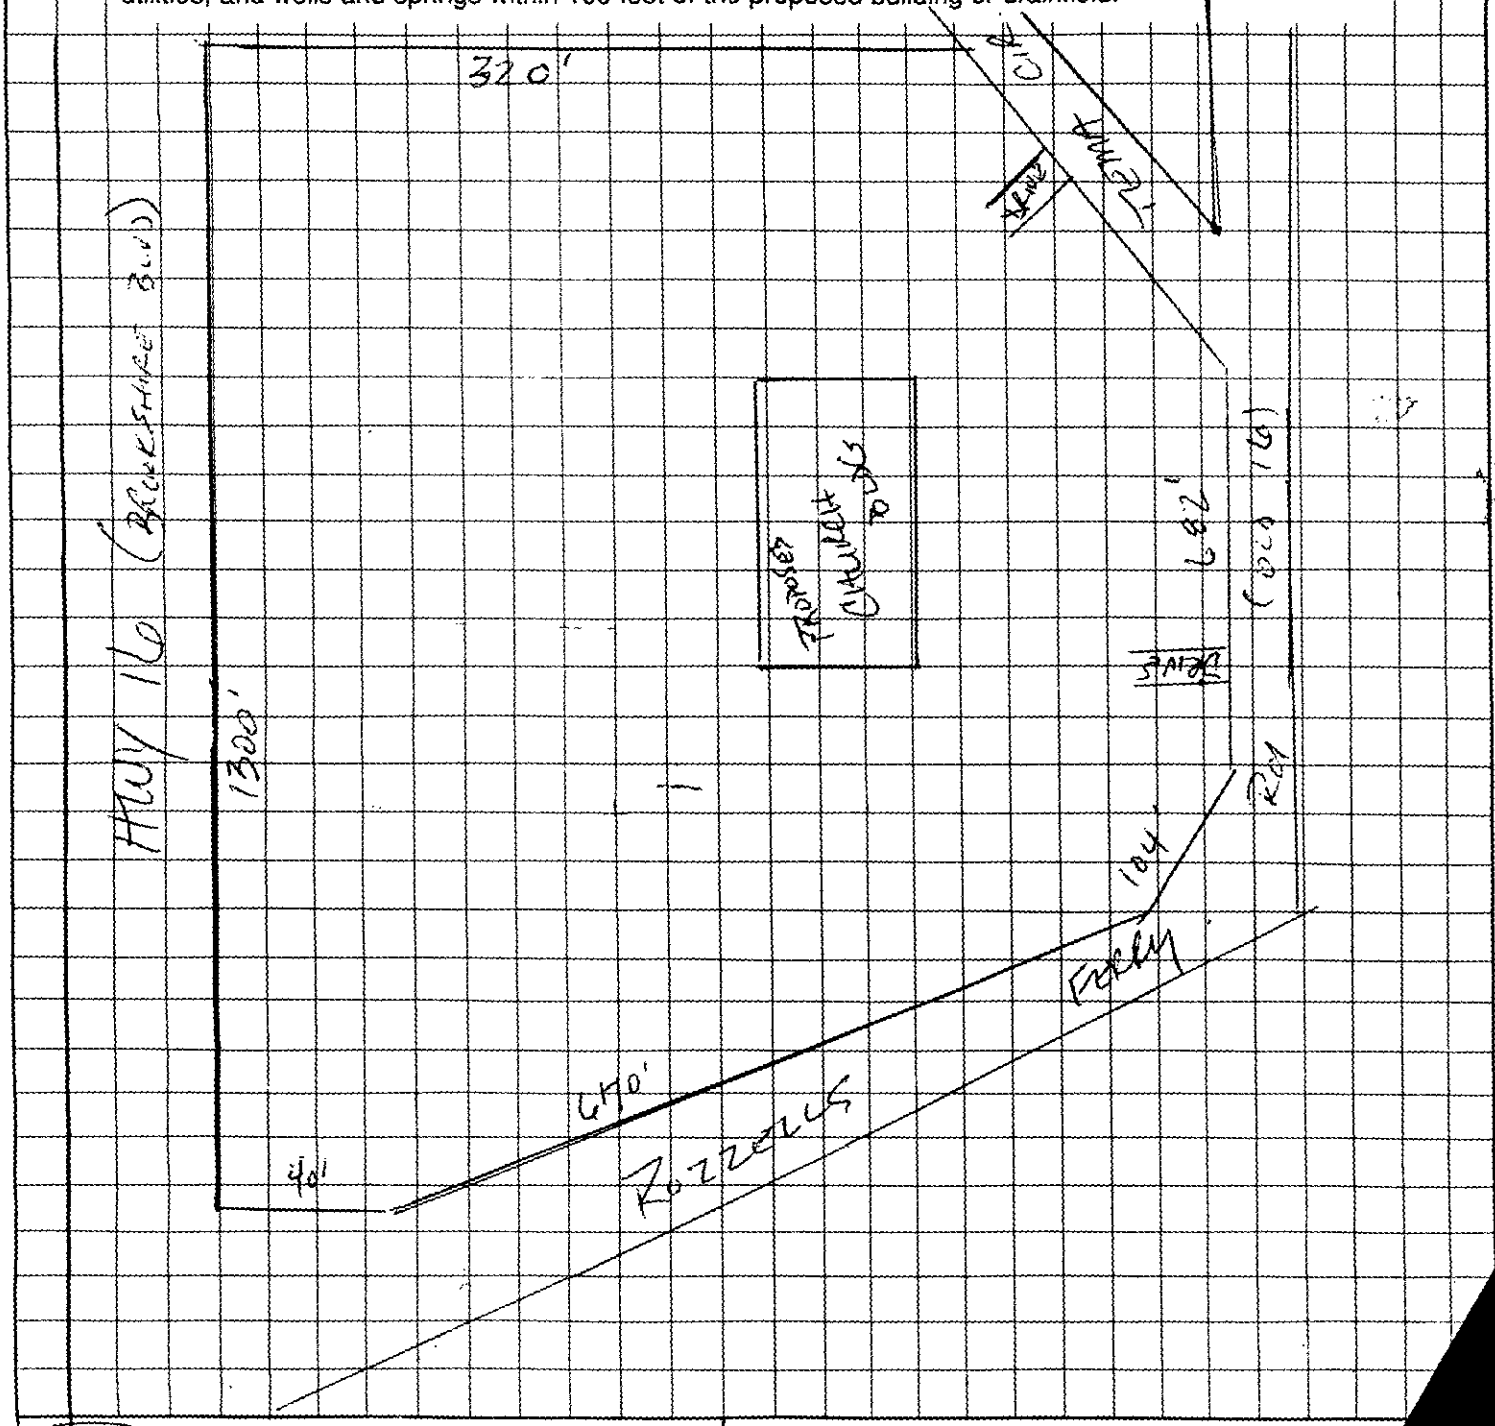

Randy McCurry
OWNER/AGENT SIGNATURE

DATE 8-13-96


APPROVAL DATE _____

White - Health Department's Copy

3-6-2"=1

5-36"

6-14"
7-1

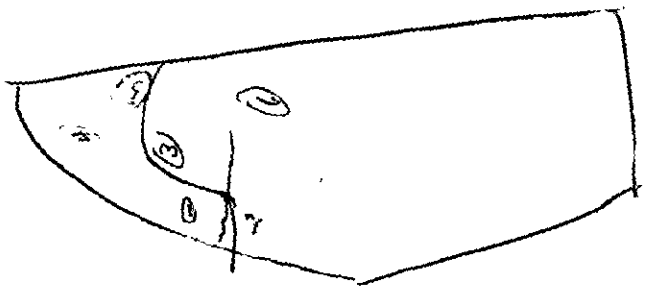

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet #2
PROPERTY ID #: #1536B
COUNTY: PO 023-132-01

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: John Parker
ADDRESS: 1433 Rizzelle Ferry Rd Shal
PROPOSED FACILITY: church
LOCATION OF SITE: 1850 Rizzelle Ferry Rd
APPLICANT:
APPLICATION DATE:
PROPOSED DESIGN FLOW (.1949): 1,000gpd
DATE EVALUATED:
PROPERTY SIZE: 1.5
PROPERTY RECORDED:
WATER SUPPLY: ☑ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	1940 LAND-SCAPE POSITION/ SLOPE % (Slop=9 3-10%)	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS	0-4"	gr/scl	Fr/SEXP/ss/sP	>41" to Chroma 2 Colors	41"	N/A	None	PS .3gl F2 LK
		4-41"	SBM/C	Fr-Fi/SEXP/SIP					
2	LS	0-3"	gr/scl	Fr/SEXP/ss/sP	>18" to Chroma 2 colors	18"	N/A	None	US
		3-18"	SBK-ABK/C	Fi/EXP/SIP V V					
3	LS	0-4"	gr/scl	Fr/SEXP/ss/sP	>41" to Chroma 2 colors	41"	N/A	None	US
		4-41"	SBM/C	Fi/EXP/SIP					
4	LS	0-4"	gr/scl	Fr/SEXP/ss/sP	>41" to Chroma 2 Colors	41"	N/A	None	PS .3gl F2 LK
		4-41"	SBK-ABK/C	Fr-Fi/SEXP/SIP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Unsuitable
EVALUATED BY: William A. Marks 6-29-96
OTHER(S) PRESENT:

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Street
PROPERTY ID #:
COUNTY:

15363

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: _____ PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
5	LS	0-3"	gr/sc	Fr/SEXP/SS/SP	7.5YR 5/6 common 2 colors	36"	N/A	None	PS IC 139/F2
		3-36"	SBK/C	Fr-Fi/SEXP/SP					
2	LS	0-2"	gr/sc	Fr/SEXP/SS/SP	7.5YR 5/6 common 2	14"	N/A	None	LCS
		2-14"	SBK/C	Fi/EXP/SP					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____

OMMENTS: 1002 Mean

LEGEND

use the following standard abbreviations

ANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	LPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)			MOIST	WET
(Ridge)		SCL (Sandy Clay Loam)				
(Shoulder Slope)		SLC (Silt Loam Clay)			VFR (Very Friable)	NS (Non-sticky)
(Terrace)					FR (Friable)	SS (Slightly Sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FI (Firm)	S (Sticky)
		SIC (Silty Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
					EFI (Extremely Firm)	NP (Non-plastic)
		O (Organic)	None			SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)


OTES

ORIZON DEPTH	In inches below natural soil surface
PTH OF FILL	In inches from land surface
STRUCTIVE HORIZON	Thickness and depth from land surface
PROLITE	S(suitable) or U(unsuitable)
IL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

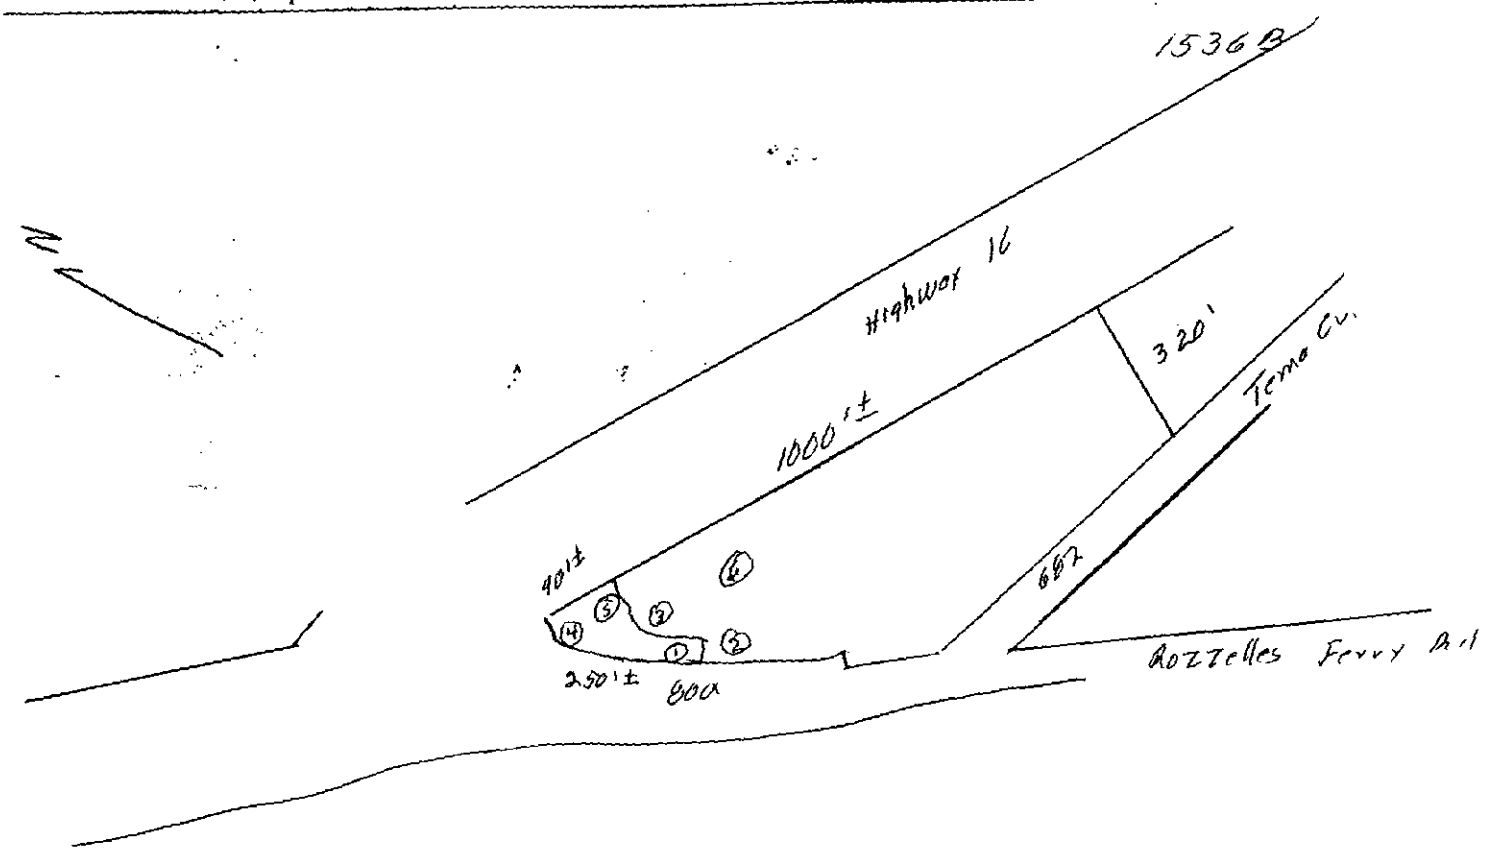

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

#2 D400

Sheet
PROPERTY ID #:
COUNTY:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

#1536B
PO 023-132-01

OWNER: John Parker APPLICANT:
ADDRESS: 11433 Rozzelles Ferry Rd Char APPLICATION DATE: DATE EVALUATED:
PROPOSED FACILITY: Church PROPOSED DESIGN FLOW (.1949): 1,000gpd PROPERTY SIZE: 1.5
LOCATION OF SITE: 1050 Rozzelles Ferry Rd PROPERTY RECORDED:
WATER SUPPLY: ☑ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	6 lop*9 3-12% 1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS	0-4"	gr/scl	Fv/SEXP/ss/sP	7 41" TO Chroma 2 Colors	41"	N/A	None	PS .3g/F2 IV
		4-41"	sBK/c	Fv-Fi/SEXP/ss/P					
2	LS	0-3"	gr/scl	Fi/SEXP/ss/sP	7 18" TO Chroma 2 Colors	18"	N/A	None	US ~~.3g/F2~~
		3-18"	sBK-ABK/c	Fi/EXP/s/vP					
3	LS	0-41"	gr/scl	Fi/SEXP/ss/sP	7 41" TO Chroma 2 Colors	41"	N/A	None	US
		4-41"	sBK/c	Fi/EXP/s/P					
4	LS	0-4"	gr/scl	Fv/SEXP/ss/sP	7 41" TO Chroma 2 Colors	41"	N/A	None	PS .3g/F2 IV
		4-41"	sBK-ABK/c	Fv-Fi/SEXP/ss/P					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Unsuitable
EVALUATED BY: William A. Marlin 6-29-96
OTHER(S) PRESENT:

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet
PROPERTY ID #:
COUNTY:

1536B

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: _____ PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
5	LS	0-3"	gr/sc	Fr/SEXP/SS/SP	736" to Chroma 2 colors	36"	N/A	None	PS IV .137/F2
		3-36"	SBK/c	Fr-Fi/SEXP/SP					
2	LS	0-2"	gr/sc	Fr/SEXP/SS/SP	714" TO Chroma 2	14"	N/A	None	LS
		2-14"	SBK/c	Fi/EXP/SP					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____

OMMENTS: 1002 Repair

LEGEND

use the following standard abbreviations

ANDSCAPE POSITION	GROUT	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	LPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)				
(Ridge)		SCL (Sandy Clay Loam)			MOIST	WET
(Shoulder Slope)		SLC (Silt Loam Clay)				
(Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SIC (Silty Clay)			FI (Firm)	S (Sticky)
					VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None		EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)


OTES

ORIZON DEPTH	In inches below natural soil surface
PTH OF FILL	In inches from land surface
STRUCTIVE HORIZON	Thickness and depth from land surface
APROLITE	S(suitable) or U(unsuitable)
IL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

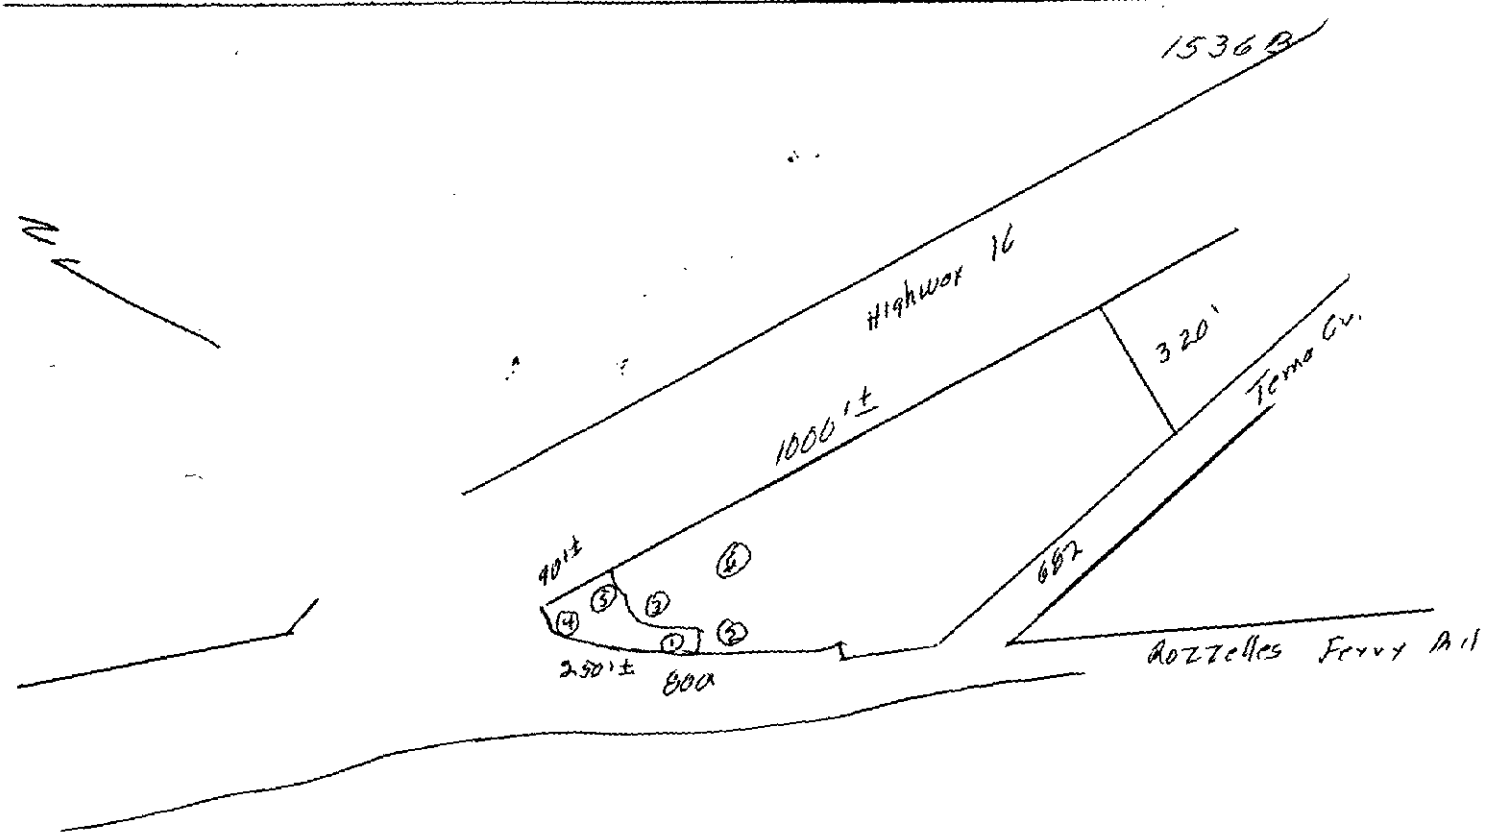

FEE: 100.00 CK 15750
DATE: 8-13-96 JC

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR IMPROVEMENT PERMIT FOR COMMERCIAL/INDUSTRIAL SITE

[redacted] | CRT

TYPE APPLICATION: ✓ NEW SYSTEM ___ EXPANSION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 15368

PROJECT TRACKING #:

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 023-132-01

STREET ADDRESS: 10500 Rozzelles Ferry Rd.

LOT NUMBER:

___ COMMERICAL ___ INDUSTRIAL

DESCRIBE TYPE OF BUSINESS:

Specific nature of facility: CHURCH

NUMBER OF EMPLOYEES: _____
PER SHIFT: ___ ___ ___

HOW WILL WATER BE USED IN THE FACILITY:

✓ TOILETS/URINALS
✓ HANDSINK
✓ SHOWERS
✓ FLOOR DRAINS

OTHER, PLEASE DESCRIBE:

TYPE OF WASTEWATER:
✓ SEWAGE
___ INDUSTRIAL PROCESS WASTE WATER

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
___ 7 MINT HILL

An IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change.

IF EXPANSION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED ADDITION:

WATER SUPPLY (CHECK ONE):
___ COMMUNITY (C) ___ MUNICIPAL (M) ✓ PRIVATE WELL (P)
___ SHARED WELL (S) ___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES ✓ NO
EXISTING WASTE WATER SYSTEMS ✓ YES ___ NO
EASEMENTS OR RIGHT-OF-WAYS ___ YES ___ NO
WELL SPRINGS OR WATERLINES ___ YES ___ NO
DESIGNATED WETLANDS ___ YES ___ NO

BUILDING PLANS TO INCLUDE ALL PLUMBING, FLOOR DRAINS AND ALL SOURCES OF WASTEWATER DISCHARGE AND GRADING PLANS MAY BE REQUIRED DURING THE EVALUATION STAGE.

PROPERTY OWNER:

NAME: (LAST) PARKER (FIRST) JOHN (MI)

ADDRESS: 11433 Rozzelles Ferry Rd

CITY: Charlotte STATE: NC ZIP: 28214

DAYTIME PHONE: ( ) [redacted]

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) McCurry (FIRST) Randy (MI)

DAYTIME PHONE: ( ) - 558-2526

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

THE UNDERSIGNED, OWNER, OR LEGAL AGENT FOR THE OWNER, OF THE PROPERTY DESCRIBED ABOVE AS THE "JOB LOCATION" HAS READ THE FOREGOING APPLICATION, ACKNOWLEDGES THAT THE CONTENTS OF SAME ARE TRUE, AND AUTHORIZES AGENTS OF THE MECKLENBURG COUNTY HEALTH DEPARTMENT TO ENTER ONTO THE PROPERTY FOR THE PURPOSE OF PROCESSING THIS REQUEST.

DATE: 8-13-96

SIGNED: Randy McCurry

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102