


8100 DOUGLAS DR

14122409

7/12/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
*Barcode Font = IDAutomationHC39M*

# CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 7780A DATE: 10/15/92

TC: 14-046-09 ☐ L ☐ CRT

SERIAL Nº 15507

Name of Owner Anatoli Dolshchenko (Tony) Juris.:

Address of Property 8100 Douglas Dr.

**Inspection Data:**

Tank Material

Total Length of Drainfield 100'

Number of Lines 1" @ 100'

Cover Depth 24"

Water Supply Source > 50'


Distance to Water Source Well

Excavation Inspected 10/15/92

Tank(s) Inspected

Wash Line Inspected

High Water Alarm Inspected

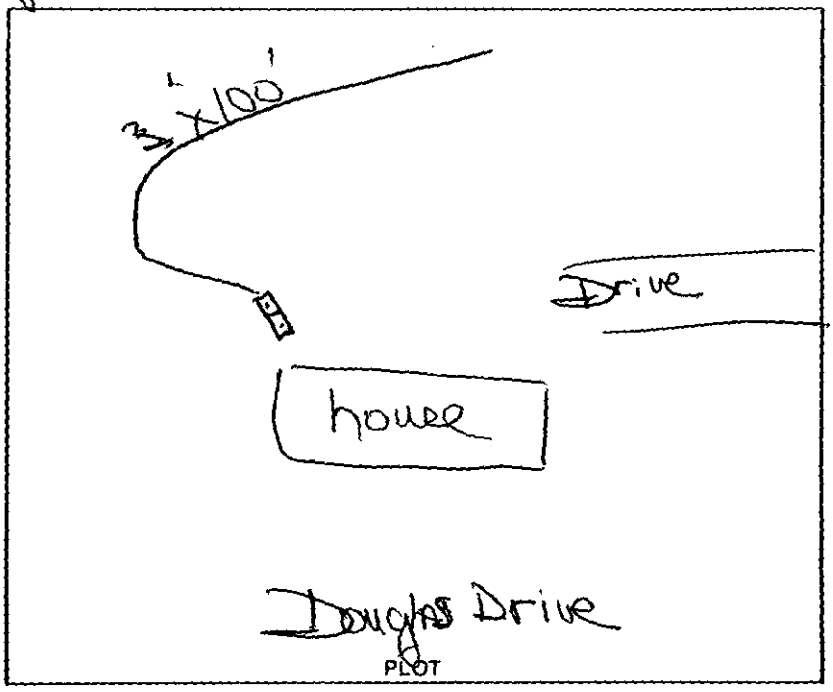


Design: 1992 Repair CTR# 16

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☒ altered or repaired

☐ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS: Original System 1958

Judy J. Kuen R.S.
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

400
I

# INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 7780A DATE: 8/27/92

TC: 141-046-09 ☐ L

SERIAL Nº 14411

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated _____. All work shall be completed on or before _____, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

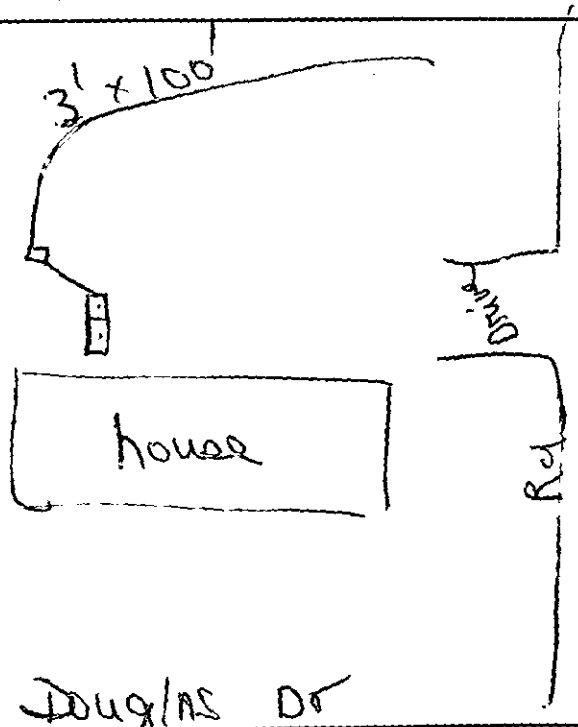


PLOT OF SYSTEM

Liquid Capacity of Septic Tank _____ gallons

Liquid Capacity of Dosing Tank _____ gallons

Tank Construction _____

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 100' feet

Number of Lines 1

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well >50' feet

NAME OF OWNER Anatoli Dolschenko (tony)

LOCATION OF PROPERTY 8100 Douglas Drive

Comments: Install New "T" if needed 3' x 100' 12" Stone

Original System 1958

Division or Section Head

Judy J Kuer R.S.
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

# INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 7780 A DATE: 9/30/91

TC: 141.046.09 ☑ L

SERIAL Nº 13784

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 9/29/91. All work shall be completed on or before 10/30/91, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

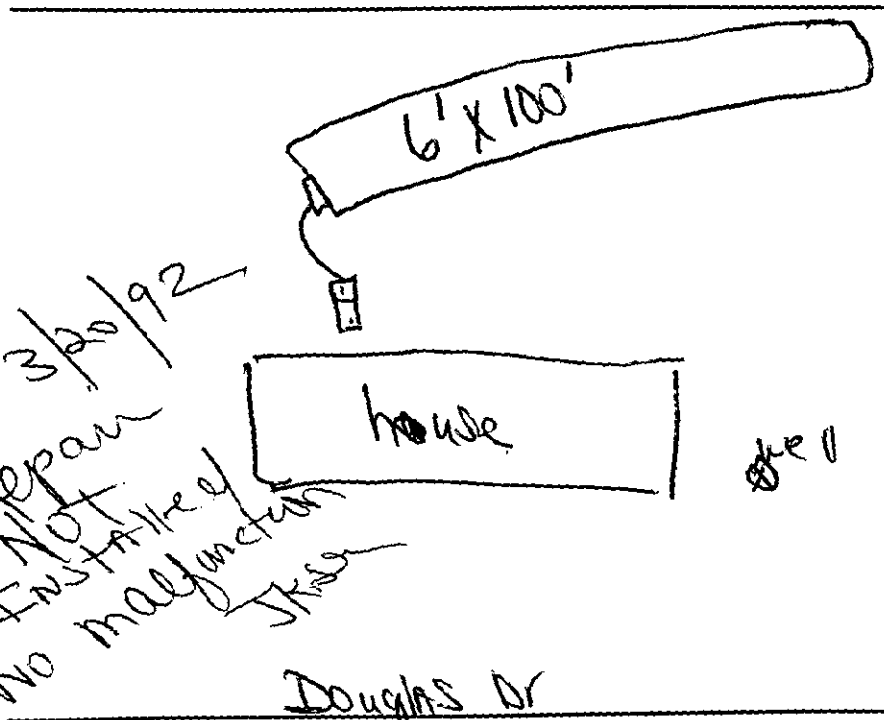


PLOT OF SYSTEM

3/20/92
Repair
Not
Installed
No malfunction
JKS

Liquid Capacity of Septic Tank _____ gallons

Liquid Capacity of Dosing Tank _____ gallons

Tank Construction _____

Absorption and/or Nitrification Lines:

Trench Width 6 X 100 feet

Total Line Length 200 feet

Number of Lines 2

Depth of Stone 18" inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well 50' feet

NAME OF OWNER Anatolij Dalschevske

LOCATION OF PROPERTY 8100 Douglas Dr

Comments: Install A bed 6' x 100' 18" Stone

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

# APPLICATION FOR AN IMPROVEMENT PERMIT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr 2nd Floor
700 N. Tryon Street
Charlotte, NC 28202

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

(OFFICE USE ONLY)
FILE: 7780 A
TC: 141-046-09
SERIAL: № 0019903 ☑ L ☐ CRT

**JOB LOCATION**

① ADDRESS: 8100 (STREET NO.) Douglas Dr (STREET) ② FILE:
③ JURISDICTION: ④ TAX PARCEL NO.:
⑤ SUBDIVISION: Spruce Forest ⑥ LOT: 5 ⑦ BLOCK: D

**OWNER**

⑧ NAME: Anatoli (FIRST) Dolschenko (LAST) (MIDDLE)
⑨ MAILING ADDRESS: 8100 Douglas Dr
⑩ CITY: Charlotte, ~~NC~~ ⑪ STATE: N.C. ⑫ ZIP: 28217
⑬ PHONE: (WORK) (803) 286 6927 ⑭ (HOME) (704) 5882792

**REQUEST**

This request is for a(n): 9/30/91 Did not view malfunction — Mr Dolschenko says Slow Plumbing — Advised pumping TANK. Wrote Permit to repair —
3/11 Site visit no malfunction found

⑮ ☐ New permit ⑰ ☐ Authorization for mobile home exchange
⑯ ☑ Repair or alteration permit ⑱ ☐ Other (specify)

**DESIGN CRITERIA**

System will serve: 3/20/92 Mr. Dolschenko says did not put in repair System sorta of straightened itself out

⑲ ☑ Residence ⑳ ☐ Mobile home ㉑ ☐ Business or place of public assembly
㉒ Number of bedrooms? 3 ㉕ Type?
㉓ Maximum occupancy? 3 ㉖ Maximum number of employees?
㉔ Basement? ☐ yes ☒ no ㉗ Maximum number of seats?

**WATER SUPPLY**

㉘ Water supply from (present or proposed):

A ☑ Individual well
B ☐ Municipal system
C ☐ Community well
D ☐ Community system

㉙ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Anatoly Dolschenko
Date: 9-24-91

## IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

... No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair permit is issued by this Department.

... This permit is not transferable, and shall become null and void 60 months from the date of issuance.

Environmentalist / Date

Director or Authorized Section Head / Date

*This permit must be signed by the Director of Mecklenburg County Health Department or an authorized section head in order to be valid.