

14008 ERWIN RD

20142472

12/19/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 666B WASPS App #: _____

Primary ES assigned to project: CS

Secondary ES assigned to project: _____

Project Type: New System ☐ Alteration ☐ Repair ☑ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☑
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☑
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☑
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☑
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☑
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☑
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☑
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☑
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☑
.1945(b)	Proposed System Type stated-Repair	Yes ☐	No ☐	N/A ☑
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☑
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☑
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☑
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☑
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☑
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☑
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☑

C Sherrill

FILE NUMBER: 666B

Revised On: August 31, 2007

APPLICATION NUMBER: 3674

SEPTIC FEE:
DATE: 7/2/08

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: _____
DATE: _____

1. **SEPTIC / TYPE APPLICATION:** ☐ NONE ☐ NEW SYSTEM ☐ ALTERATION ☑ REPAIR ☐ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ☑ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. **JOB LOCATION INFORMATION:**
TAX PARCEL NUMBER: 201-424-72
STREET ADDRESS: 14008 Erwin Rd
CITY: Charlotte
STATE: NC ZIP: 28273
SUBDIVISION NAME:
LOT #: LOT SIZE (acres):
TOWNSHIP:
☑ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☐ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. **BUILDING INFORMATION:**
BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☐ HOUSE ☑ OTHER 150 member Church
HEATED SQUARE FOOTAGE: 1800 sq ft
NUMBER OF BEDROOMS: NA
NUMBER OF OCCUPANTS:
FOUNDATION TYPE:
☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☑ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☐ N/A
NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. **WATER SUPPLY:** ☐ MUNICIPAL ☐ PUBLIC WELL ☑ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. **PROPOSED USE OF WELL:** ☐ N/A ☐ IRRIGATION ☑ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED)*:

8A. **RANK:** ☑ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	☑ YES	☐ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☑ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☑ YES	☐ NO	JURISDICTIONAL WETLANDS	☐ YES	☑ NO
WELLS, SPRINGS, OR WATER LINES	☑ YES	☐ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES	☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☑ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES	☑ NO

10. **PROPERTY OWNER:**
NAME: McClintock Presbyterian Church
ADDRESS: 14008 + 01 Erwin Rd
CITY: Charlotte
STATE: NC ZIP: 28273
HOME PHONE: 704-583-2733 WORK PHONE:
MOBILE PHONE: 704-712-5590 FAX: 704 527 0206

11. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**
NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

12. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____
13 **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____

14. **SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:**
If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.


[signature] 6-17-08
Property Owner's or Owner's Legal Representative Signature Date

15. **WELL PERMIT APPLICATION SIGNATURE SECTION:**
If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

_____
Property Owner's or Owner's Legal Representative Signature Date

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

MECKLENBURG COUNTY-GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211, CHARLOTTE, NC 28202 PHONE: (704) 336-5103 FAX: (704) 336-6894

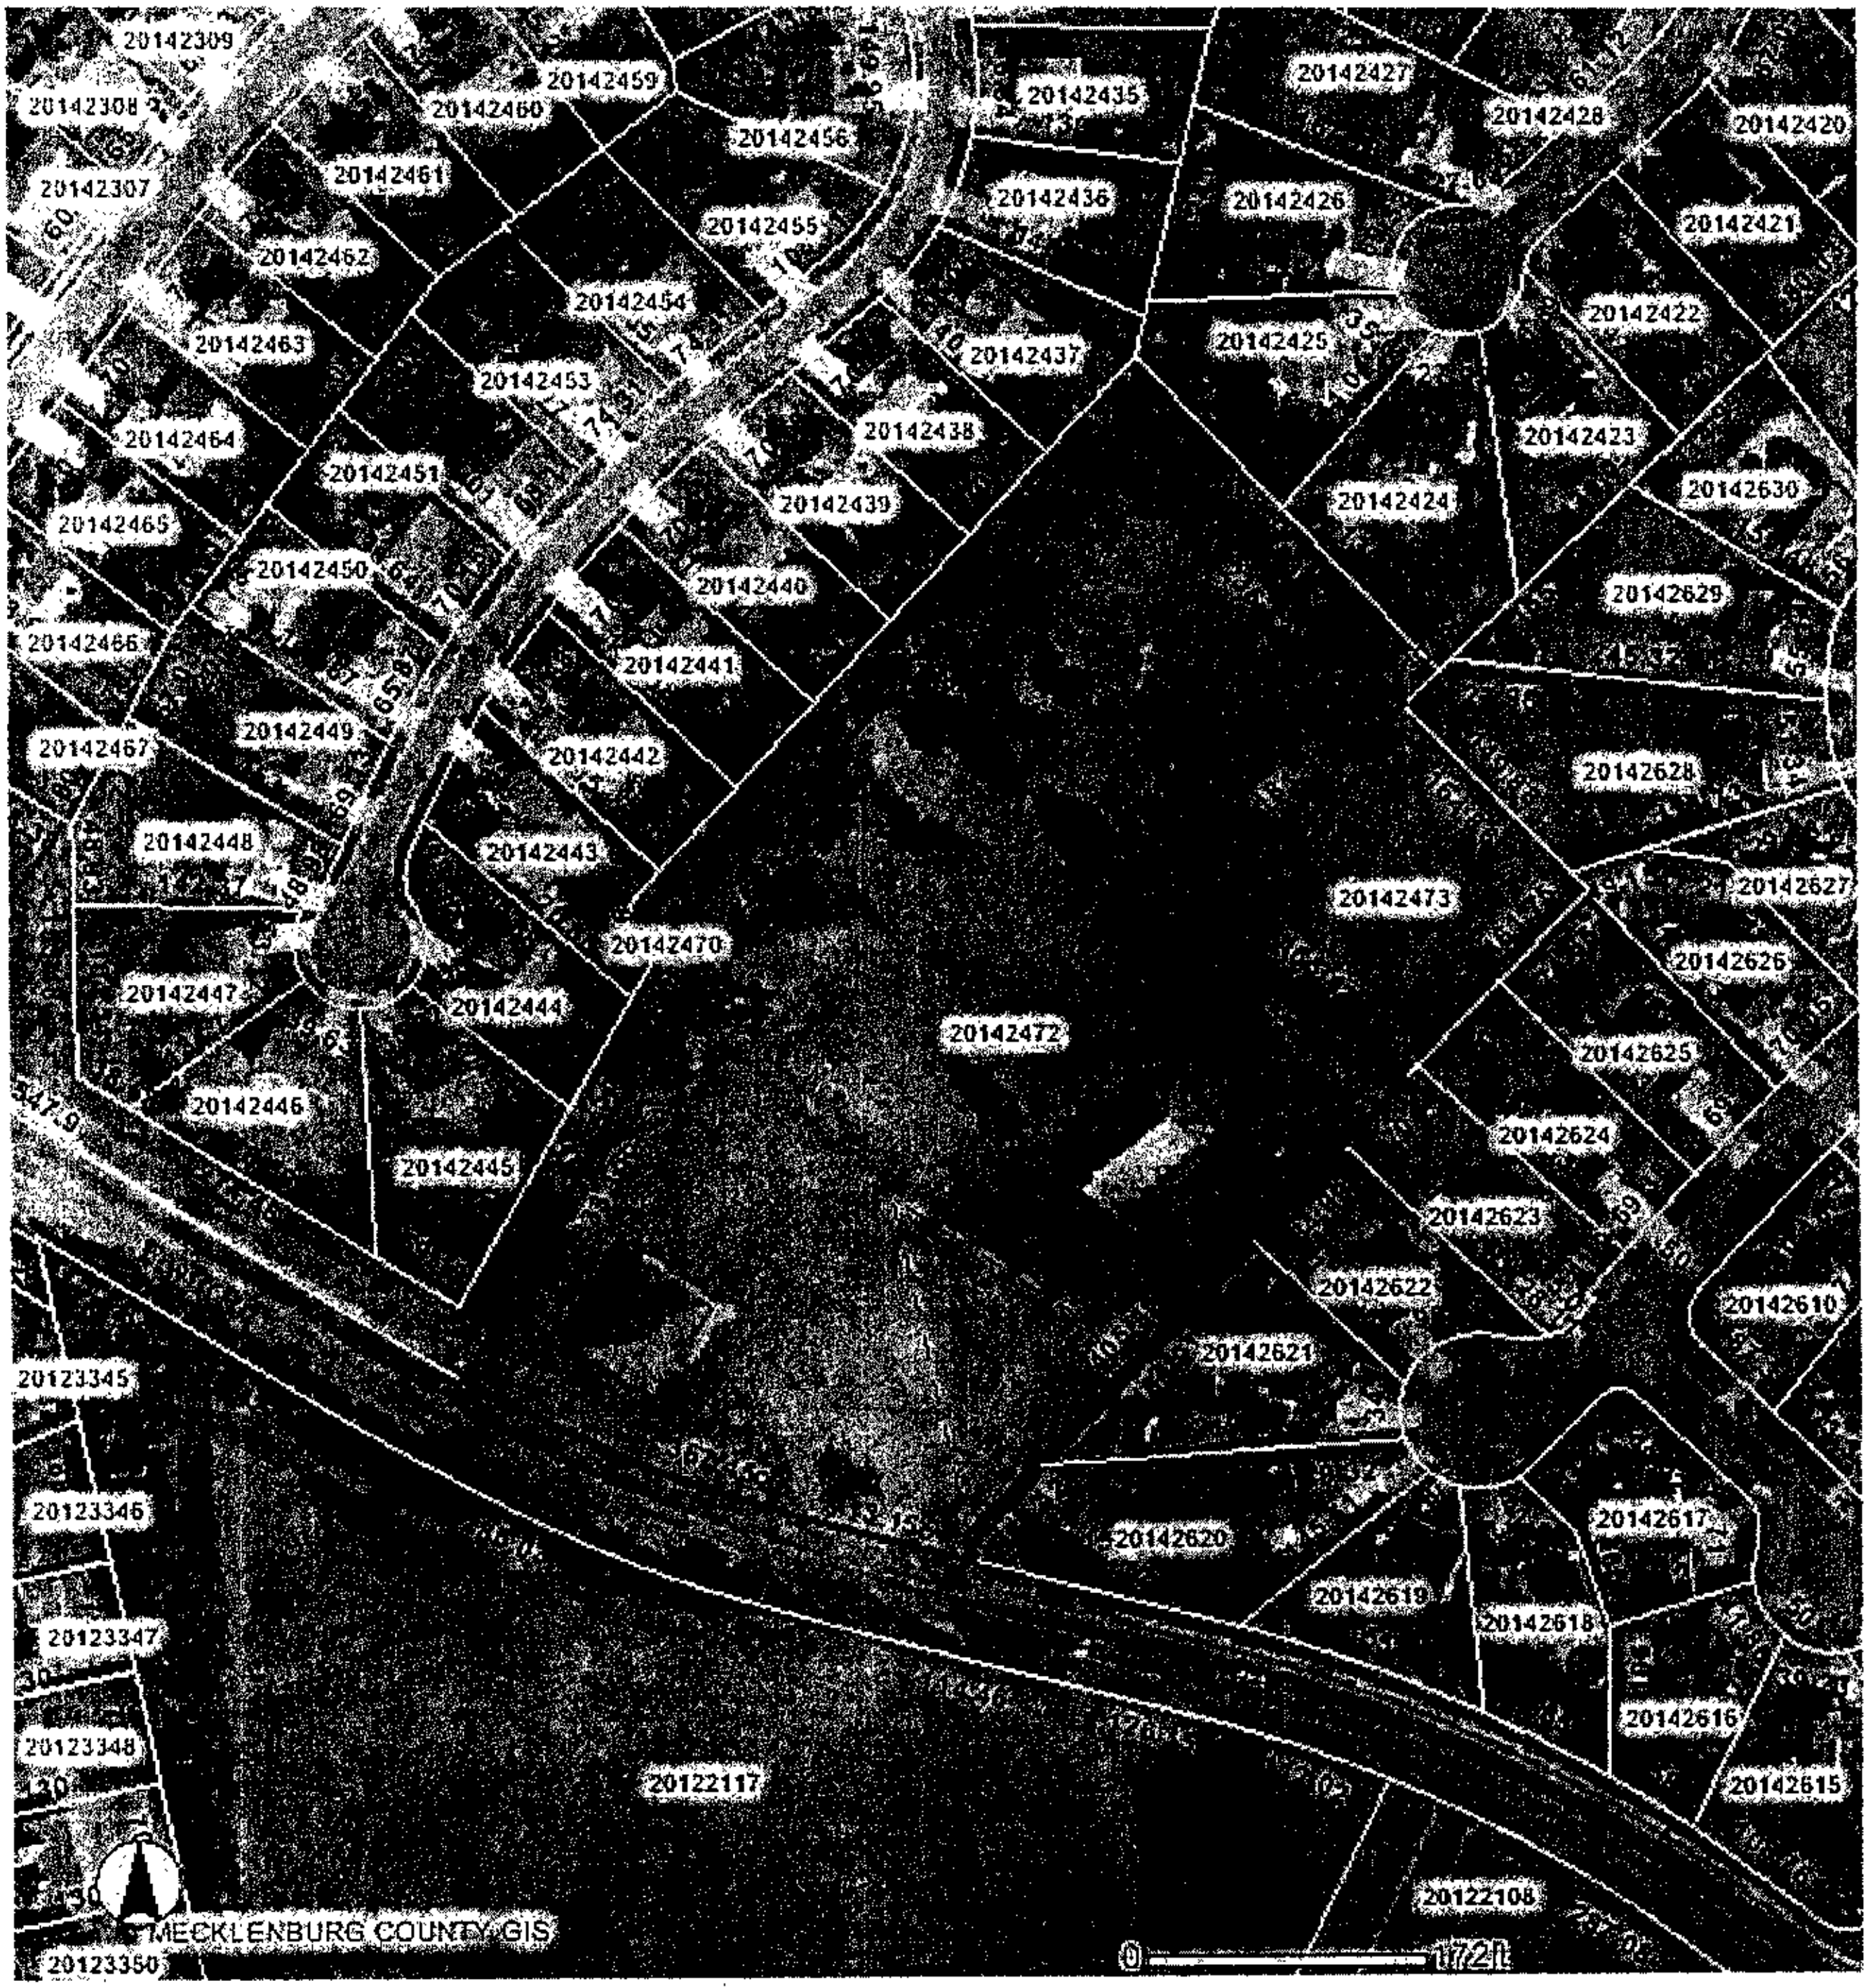
20142309
20142308
20142307
20142459
20142460
20142456
20142461
20142455
20142462
20142454
20142463
20142453
20142464
20142451
20142465
20142450
20142466
20142449
20142467
20142448
20142447
20142446
20142445
20142444
20142443
20142442
20142441
20142440
20142439
20142438
20142437
20142436
20142435
20142427
20142428
20142420
20142426
20142421
20142425
20142422
20142423
20142424
20142630
20142629
20142628
20142627
20142473
20142470
20142472
20142626
20142625
20142624
20142623
20142622
20142610
20142621
20142620
20142617
20142619
20142618
20142616
20142615
20123345
20123346
20123347
20123348
20122117
20122108
MECKLENBURG COUNTY GIS
20123350
0
172 ft

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 666B Permit #: _____ Tax Parcel #: 201-424-72

Property Owner: McCLINTOCK PRESBYTERIAN CHURCH

Job Location Address: 14008 ERWIN RD.

City: CHARLOTTE State: NC Zip Code: 28273

Installation Approval Issuance Date: 6/17/08

Permission is hereby given to ☐ install ☐ alter ☑ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 7/17/08, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 450 GPD

Site LTAR: — GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: EXISTING gallons

Liquid Capacity of Dosing Tank: — gallons

Drainfield Design ☑ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Bed Design *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 36 inches

Bed Width: 6 feet

Total line length: 50 feet

# of Lines: 1 @ 50 feet

Depth of Media: 24 inches (Type) GRAVEL

Distribution Device: D-BOX (EXISTING)

Water Supply Source

☐ Municipal ☑ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 5 feet

Distance from Water Supply Source: 100 feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

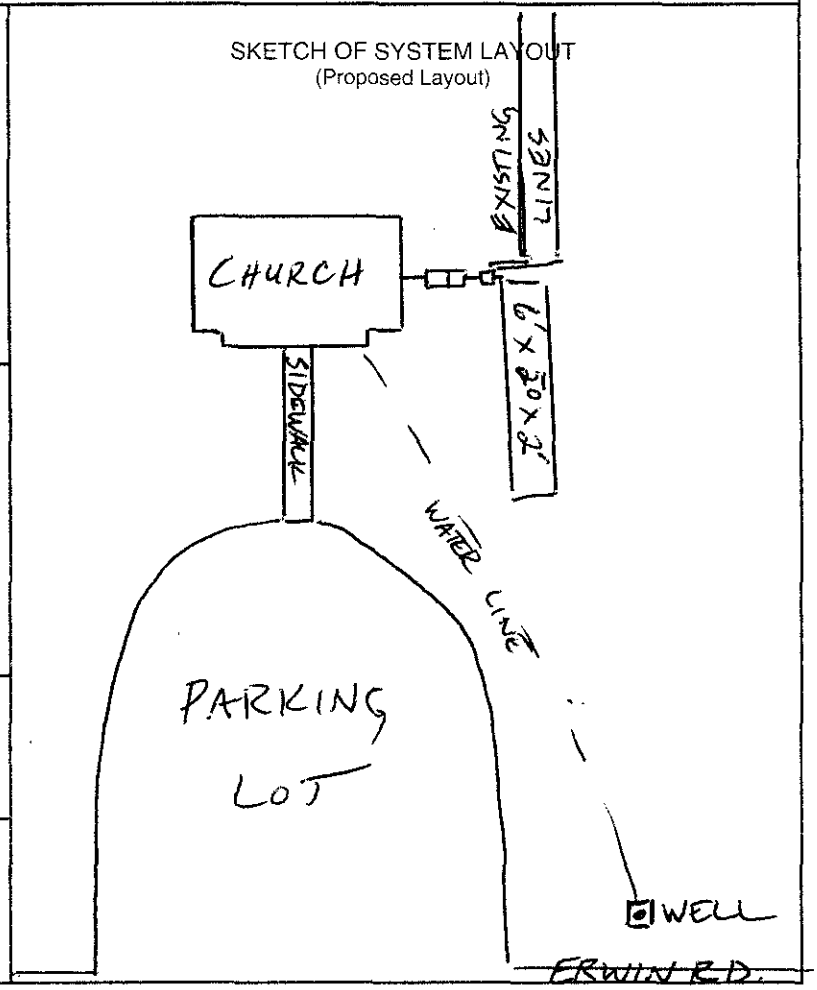

Comments: System Classification & Type: II a CONVENTIONAL

DENR Authorized Agent: Chris Sherrill, RS, LSS Signature: Christopher M Sherrill

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 666 B Permit #: _____ Tax Parcel #: 201-424-72

Property Owner: McCLINTOCK PRESBYTERIAN CHURCH

Job Location Address: 14008 ERWIN RD.

City: CHARLOTTE State: NC Zip Code: 28273

Operation Permit Issuance Date: 6/18/08 Contractor Name: AUTRY

Permitted Design Flow: 450 GPD

Liquid Capacity of Septic Tank: EXISTING gallons

Liquid Capacity of Dosing Tank: — gallons

Effluent Pump Model: —

Drainfield Installation ☑ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Inspection Dates

Tank(s) Inspected: —

Excavation Inspected: 6/18/08

Pump & Controls Inspected: —

Bed Installation *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 36 inches

Bed Width: 6 feet

Total line length: 50 feet

# of Lines: 1 @ 50 feet

Depth of Media: 24 inches (Type) GRAVEL

Depth of Cover: 12 inches

Distribution Device: D-BOX (EXISTING)

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

INSTALLED PER INSTALLATION APPROVAL CMS 6/18/08

Water Supply Source

☐ Municipal ☑ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 5 feet

Distance from Water Supply Source: 100 feet

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☐ altered ☑ repaired ☐ as detailed in the plot above ☑ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIa GBD G NA NA

DENR Authorized Agent: Chris Sherrill, RS, LSS Signature: Chris M Sherrill

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 66 6B Permit #: _____ Tax Parcel #: 201-424-72

Property Owner: McCLINTOCK PRESBYTERIAN CHURCH

Job Location Address: 14008 ERWIN RD.

City: CHARLOTTE State: NC Zip Code: 28273

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIa

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☑

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☑ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

_____

_____

_____

_____

DENR Authorized Agent: Chris Sherrill, RS, CSS Date: 6/18/08

Signature: Chris M Sherrill

666 B1 8537A

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

COPY

PA 100% C&F 9/24/02 [ ] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date: 9/24/02

PERSON FILING APPLICATION:
NAME: Hawkins (last) Teresa (first) L. (mi) DT.
ADDRESS: GNA Design Associates 428 E. Fourth St. PHONE: (704) 373-1407
CITY: Charlotte STATE: NC ZIPCODE: 28202

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 20-211-05 20-211-06
STREET ADDRESS: 14008 Erwin Rd. Charlotte NC
ZONING: R-3

PROPERTY OWNER:
NAME: McClintock (last) Presbyterian Church (first) (mi)
ADDRESS: 14008 Erwin Road PHONE: 704 588-2133
CITY: Charlotte STATE: NC ZIPCODE: 28273

SUBDIVISION OR MOBILE HOME PARK NAME: N/A

Township (check one):
[X] 0 Mecklenburg County [ ] 2 Davidson [ ] 4 Pineville [ ] 6 Huntersville
[ ] 1 Charlotte [ ] 3 Cornelius [ ] 5 Matthews [ ] 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres): 5.87 Acres

[X] SOIL TEST - INDIVIDUAL LOT (O)
[ ] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[ ] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[X] COMMERCIAL OR INDUSTRIAL (N) church
[ ] SOIL TEST DEVELOPMENT (P)
[ ] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[ ] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[ ] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one): N/A
[ ] SINGLE MOBILE HOME (S) [ ] HOUSE (H) [ ] MULTIPLE FAMILY (U)
[ ] DOUBLE WIDE (D) [ ] MODULAR HOME (M) [ ] OTHER _____ (O)

NUMBER BEDROOMS: N/A NUMBER OCCUPANTS:
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business church # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) No
Underground Storage Tanks On Property (Y/N) No Type _____

WATER SUPPLY (check one):
[ ] Community (C) [ ] Shared Well (S)
[ ] Municipal (M) [ ] Other 'spring' (O)
[ ] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[ ] Swimming Pool [ ] Jacuzzi [ ] Stable/Barn [ ] Workshop [ ] None
[ ] Garage [ ] Storage Building [ ] Deck/Patio [ ] Bedrooms [X] Other Education Bldg 9,200SF

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Date:

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[ ] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[ ] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date

Director or Authorized Section Head Date

WWATER : 122791

(Lot 2 on 2nd)

666 B/ 8537A

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

Pd 100.00 CK # [ ] CRT 9/24/92

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date: 9/24/92

PERSON FILING APPLICATION:
NAME: Hawkins (last) Teresa (first) L. (mi) DT.
GNA Design Associates
ADDRESS: ~~420 E. Fourth St.~~ PHONE: (704) 373-1907
CITY: Charlotte STATE: NC ZIPCODE: 28202

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 201-211-03 201-211-06
STREET ADDRESS: 14008 Erwin Rd.
Charlotte NC
ZONING: R-3

PROPERTY OWNER:
NAME: McClintock (last) Presbyterian Church (first) (mi)
ADDRESS: 14008 Erwin Road PHONE: 704 588-2133
CITY: Charlotte STATE: NC ZIPCODE: 28273

SUBDIVISION OR MOBILE HOME PARK NAME: N/A

Township (check one):
[X] 0 Mecklenburg County [ ] 2 Davidson [ ] 4 Pineville [ ] 6 Huntersville
[ ] 1 Charlotte [ ] 3 Cornelius [ ] 5 Matthews [ ] 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres): 5.87 Acres

[X] SOIL TEST - INDIVIDUAL LOT (D)
[ ] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[ ] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[X] COMMERCIAL OR INDUSTRIAL (N) Church
[ ] SOIL TEST DEVELOPMENT (P)
[ ] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[ ] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[ ] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one): N/A
[ ] SINGLE MOBILE HOME (S) [ ] HOUSE (H) [ ] MULTIPLE FAMILY (U)
[ ] DOUBLE WIDE (D) [ ] MODULAR HOME (M) [ ] OTHER _____ (O)

NUMBER BEDROOMS: N/A NUMBER OCCUPANTS:
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business Church # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) No
Underground Storage Tanks On Property (Y/N) No Type _____

WATER SUPPLY (check one):
[ ] Community (C) [ ] Shared Well (S)
[ ] Municipal (M) [ ] Other 'spring' (O)
[ ] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[ ] Swimming Pool [ ] Jacuzzi [ ] Stable/Barn [ ] Workshop [ ] None
[ ] Garage [ ] Storage Building [ ] Deck/Patio [ ] Bedrooms [X] Other Education Bldg 9,200SF

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Date:

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[ ] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[ ] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date

Director or Authorized Section Head Date

WWATER : 122791

(last page)


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 666B/8537A

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

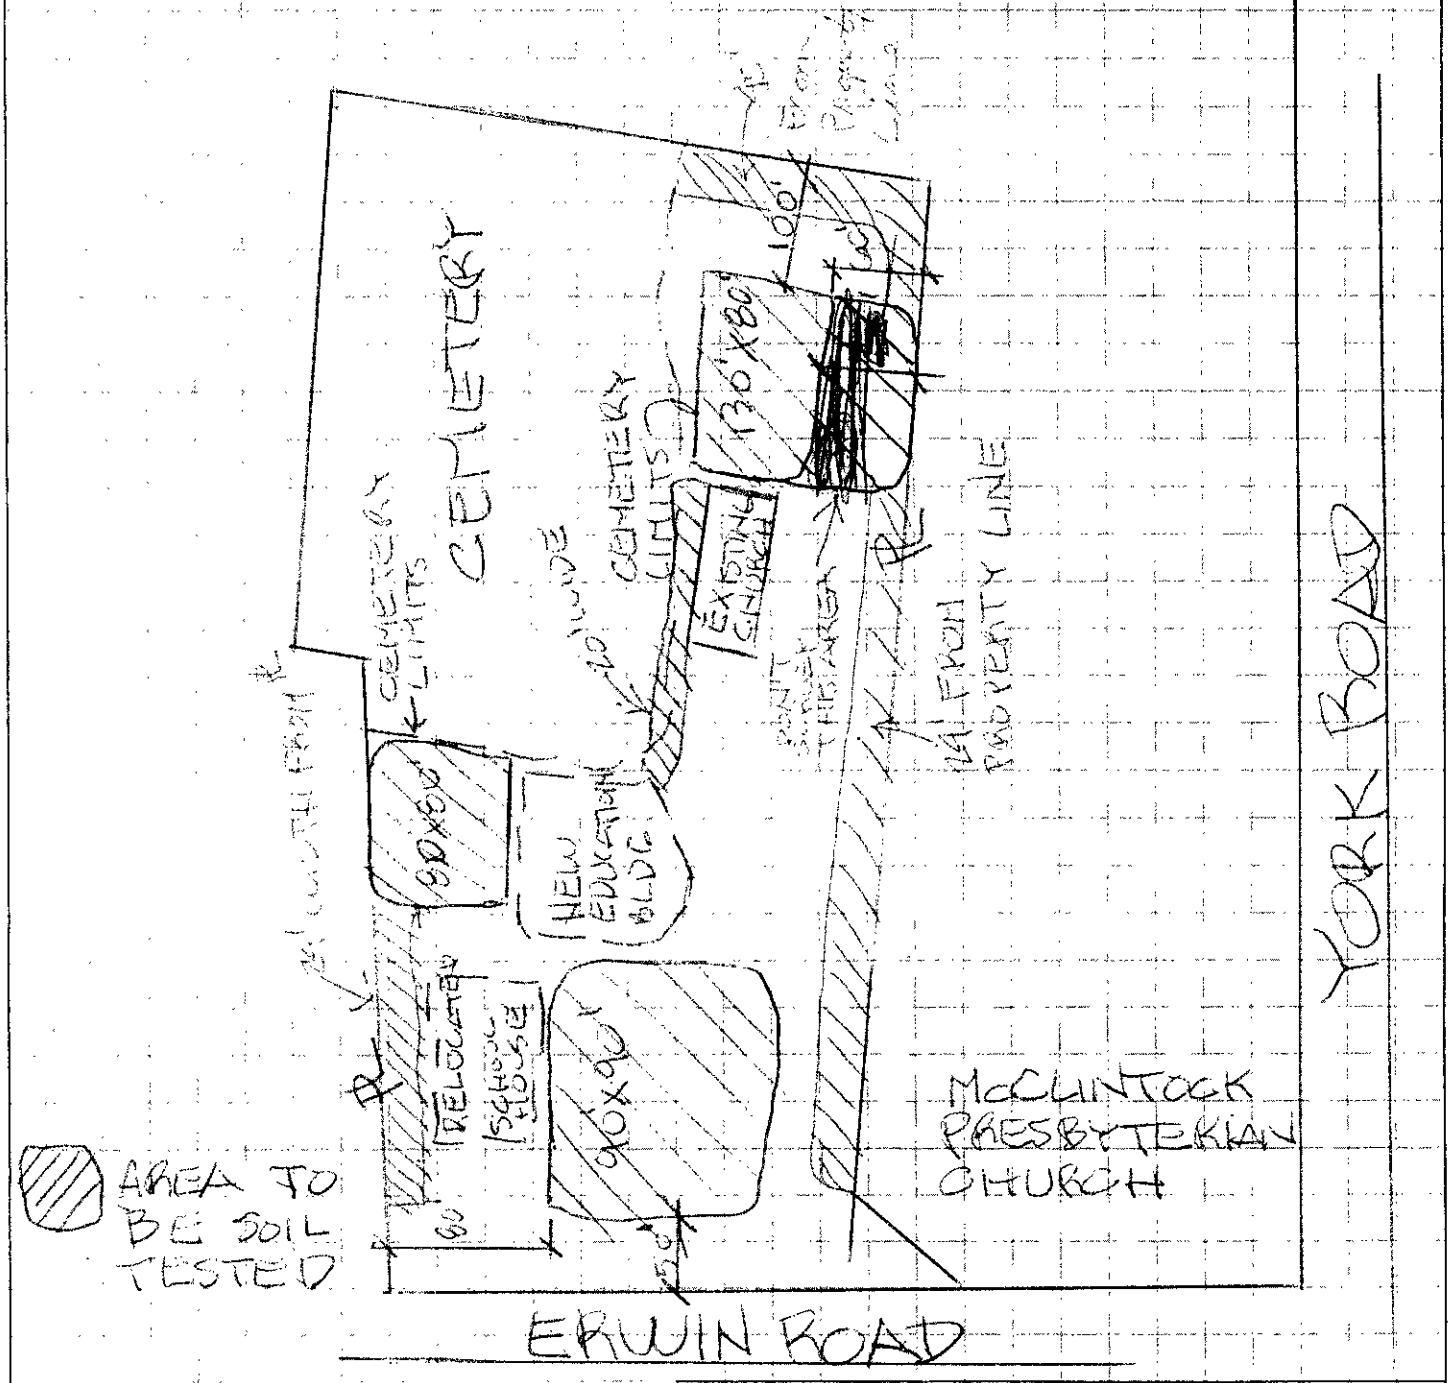

APPROVAL DATE _____

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

8537A / 66B — $50 ck# 10317 — 3/25/96 — [] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:
NAME: COLES (last) JUDITH (first) A (mi)
ADDRESS: 14033 POINT LOOKOUT PHONE: 704 587-9737
CITY: CHARLOTTE STATE: NC ZIPCODE: 28278

Date: MARCH 24, 1996

PROPERTY OWNER:
NAME: McCLINTOCK PRESBYTERIAN CHURCH (last) (first) (mi)
ADDRESS: 14008 ERWIN RD. PHONE: 704 588-2733
CITY: CHARLOTTE STATE: NC ZIPCODE: 28273

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 201-211-05
STREET ADDRESS: ~~14008~~ 14008 ERWIN RD.
ZONING:

Township (check one):
[X] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: LOT SIZE (in acres):

TYPE APPLICATION (check one):

[redacted] Use Existing System

[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[redacted]

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: NUMBER OCCUPANTS:
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business CHURCH # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) N
Underground Storage Tanks On Property (Y/N) Y Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Judith A. Coles Date: March 24, 1996

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

...3/26/96 - Met with Judy Coles & Minister & Contractor

Environmentalist Date

Jobs unsuitable for alteration & upgrade — Explained they could use existing system if no increase in bedrooms — Filed with Variance

Director or Authorized Section Head Date

They are going to divide by 2

WATER : 1


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 8537A

TC: 201-211-05

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

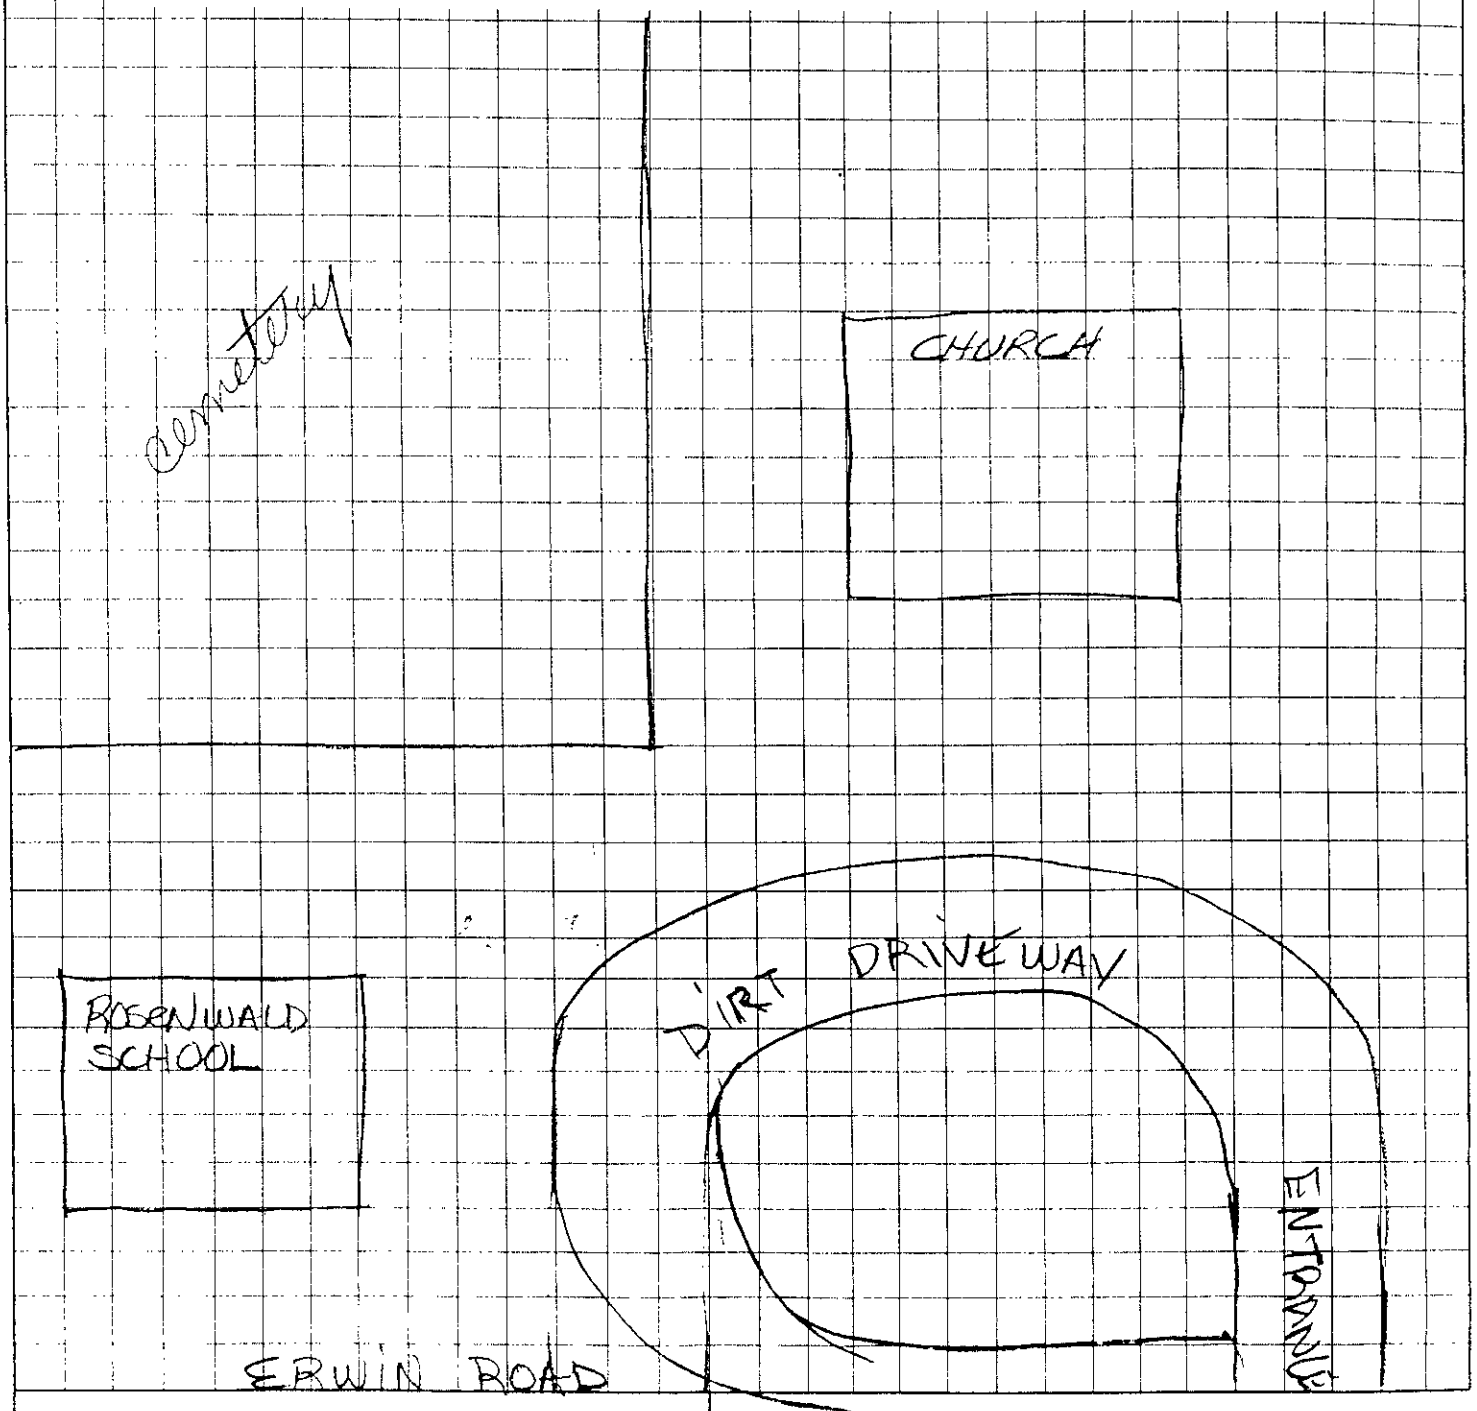

OWNER/AGENT SIGNATURE

DATE

APPROVAL DATE

8537A/666B

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

$50 ck 3/25/96 ck# 10317

[] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: COLES (last) JUDITH (first) A (mi)

ADDRESS: 14032 POINT LOOKOUT RD PHONE: 704 582-9737

CITY: CHARLOTTE STATE: NC ZIPCODE: 28278

Date: MARCH 24, 1996

PROPERTY OWNER:

NAME: MCCLINTOCK PRESBYTERIAN CHURCH (last) (first) (mi)

ADDRESS: 14008 ERWIN RD. PHONE: 704 588-2733

CITY: CHARLOTTE STATE: NC ZIPCODE: 28273

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 201-211-05

STREET ADDRESS: ~~14008~~ 14008 ERWIN RD.

ZONING: _____

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[X] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres):

[redacted] Use Existing System

[redacted]

[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)

[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)

[] COMMERCIAL OR INDUSTRIAL (N)

[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)

[redacted]

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business CHURCH # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) N
Underground Storage Tanks On Property (Y/N) Y Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Judith A. Coles Date: March 24, 1996

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

_____ Environmentalist Date

_____ Director or Authorized Section Head Date

WWATER : 122791


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 8537A

TC: 201-211-05

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

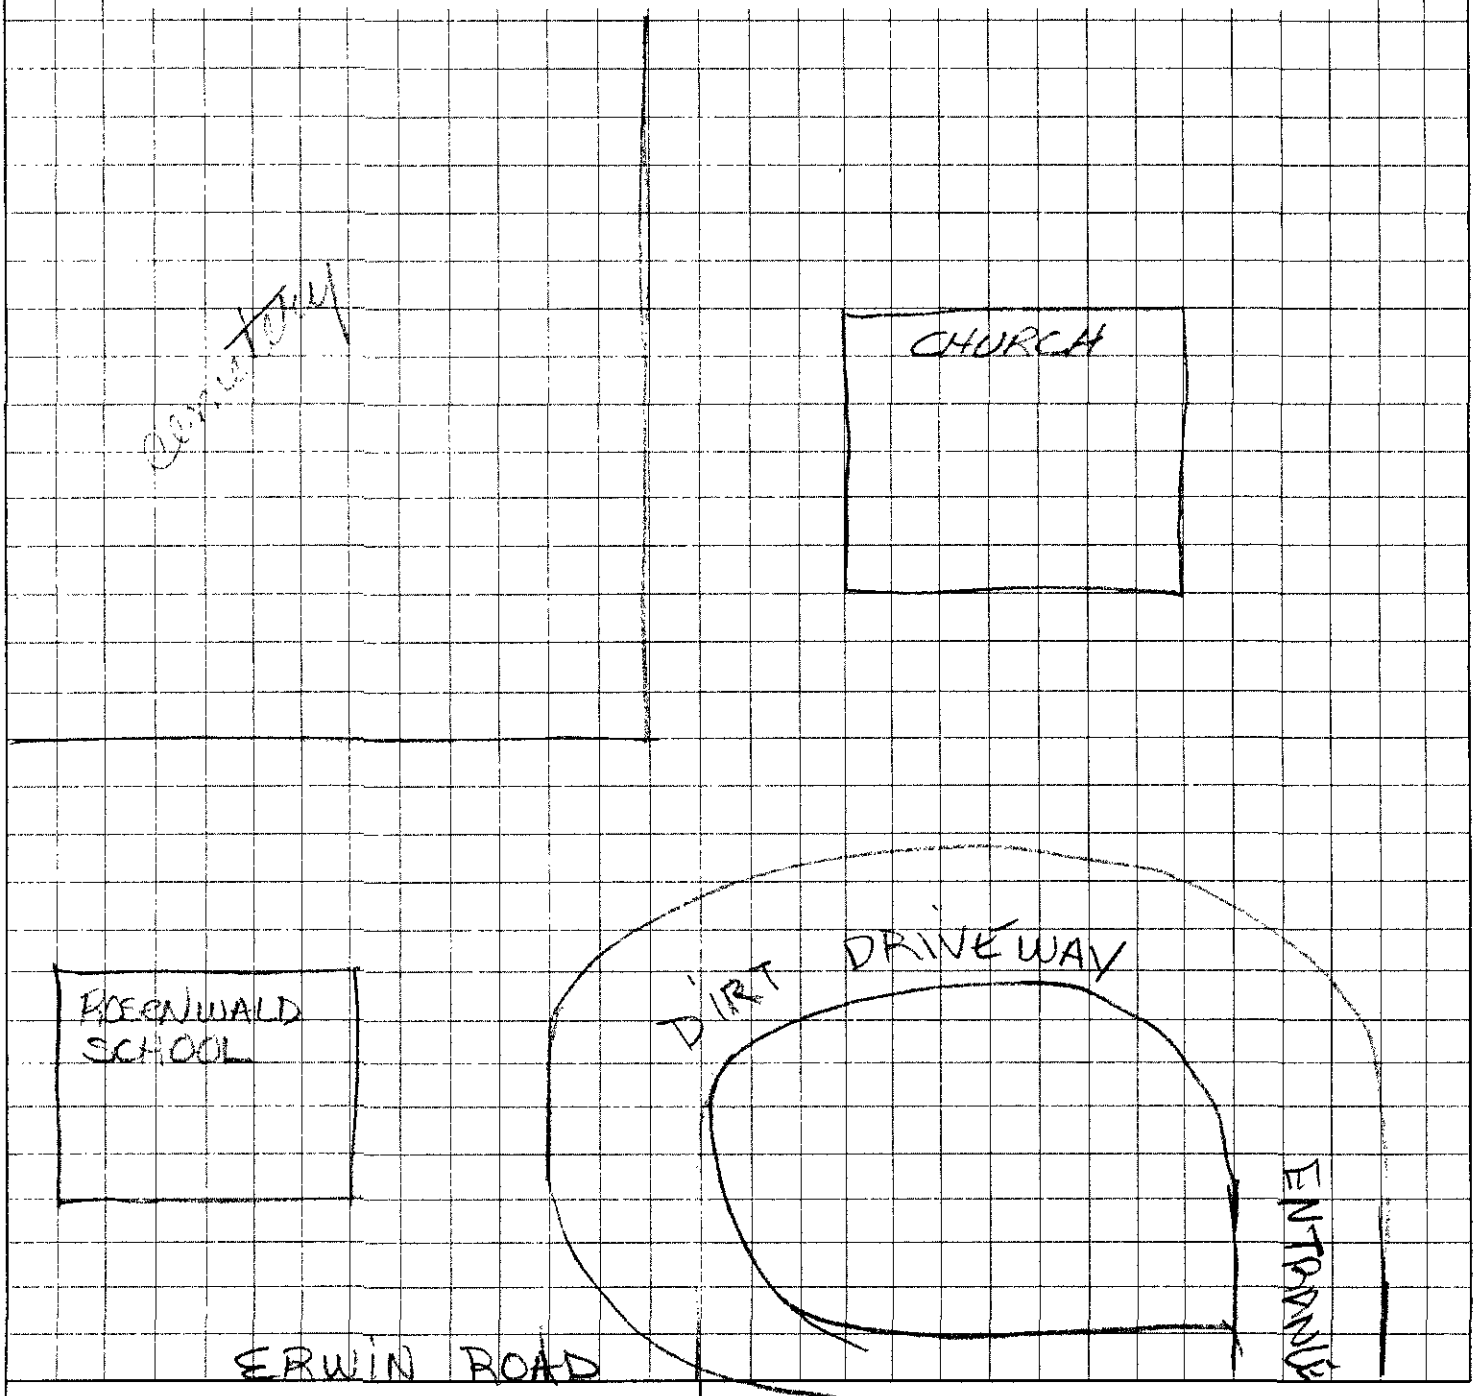

APPROVAL DATE

OWNER/AGENT SIGNATURE

DATE

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

8537A / 166B

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

$50 ck 3/25/96 ck#1037

[] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: COLES (last) JUDITH (first) A (mi)

ADDRESS: 14033 POINT LOOKOUT PHONE: 704 587-9737

CITY: CHARLOTTE STATE: NC ZIPCODE: 28278

Date: MARCH 24, 1996

PROPERTY OWNER:

NAME: MCCLINTOCK PRESBYTERIAN CHURCH (last) (first) (mi)

ADDRESS: 14008 ERWIN RD. PHONE: 704 588-2733

CITY: CHARLOTTE STATE: NC ZIPCODE: 28273

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 201-211-05

STREET ADDRESS: ~~14008~~ 14008 ERWIN RD.

ZONING:

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[X] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres):

[redacted] Use Existing System

[redacted]

[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)

[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)

[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)

[] COMMERCIAL OR INDUSTRIAL (N)

[redacted]

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business CHURCH # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) N
Underground Storage Tanks On Property (Y/N) Y Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Judith A. Coles Date: March 24, 1996

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date

Director or Authorized Section Head Date

WATER : 122791


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 85378

TC: 201-211-05

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

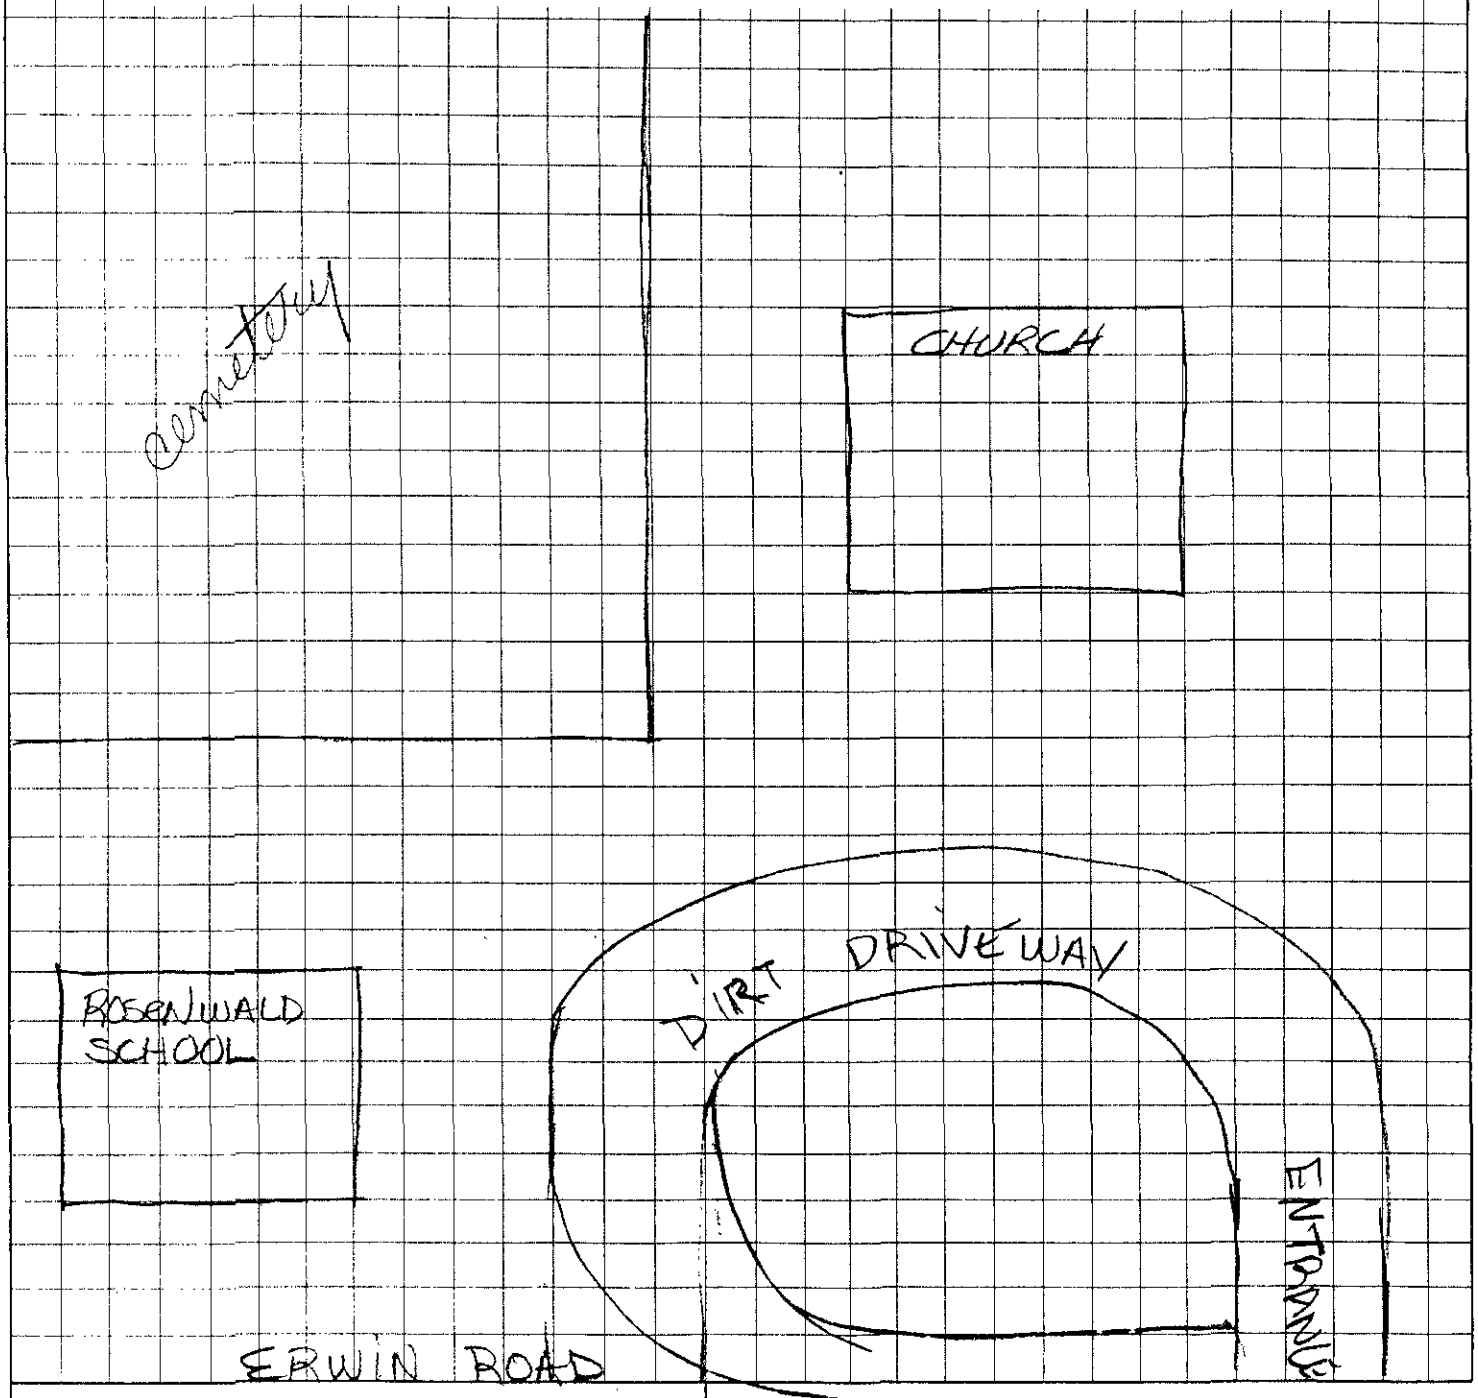

APPROVAL DATE _____

OWNER/AGENT SIGNATURE

DATE

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

GNA DESIGN ASSOCIATES, INC.

September 24, 1992

Ms. Judy Kiser
Mecklenburg County Health Department
Environmental Health Division
700 North Tryon Street
Charlotte, North Carolina 28202

Re: McClintock Presbyterian Church
14008 Ervin Road
Mecklenburg County

Dear Ms. Kiser:

Please find the enclosed application and fee to proceed with the soils investigation associated with the above referenced project.

The church is planning on constructing a new 9,200 S.F. education building. The primary use of this new building will be for Sunday School classrooms. This addition will also house the Church administration offices and will have a small nursery/daycare for about 25 children.

A summary of the restroom facilities includes:

- 2 public restrooms
  Womens: 3 water closets/2 lavatories
  Mens: 1 water closet/2 urinals/
  2 lavatories
- 1 private paster restroom with 1 bathtub/1 water closet/1 lavatory
- 1 nursery restroom with 1 water closet/ 1 lavatory

This new building will have a small kitchen which will be primarily used for receptions and occasional church dinners. This kitchen will also be used to prepare daily lunches for the nursery.

Should you have any questions, or need additional information, please don't hesitate to give a call.

Sincerely,

GNA DESIGN ASSOCIATES, INC.

Teresa L. Hawkins, ASLA
President

TLH/tp/80C3

cc: Ms. Kathryn Horne, Gantt-Huberman Architects
Rev. James Ephraim

GNA DESIGN
ASSOCIATES, INC.
428 East Fourth Street
Suite 408 (704) 373-1907
Charlotte, NC 28202
Fax (704) 358-0766

Principals
Teresa L. Hawkins, ASLA
Landscape Architecture

Jeff D. Oden, PE
Civil Engineering

Jeff Hladun, RLS
Surveying

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
SITE EVALUATION REPORT
SERIAL NUMBER 12848

File: 666B/8531A Action 3

Parcel: 201-211-05,16 ☐ PC

Location: Erwin Road

Subdivision:

Lot: Block: Acres: 2.0


Owner: Mt Clinton Pres. Church
Address: c/o GNA Design Associates
428 E. Fourth St.
Charlotte, N.C. 28202

Comments: all borings Mecklenburg soils described earlier
Area 1

Described by: William R. Marlin

Date: 9-28-92

x - Approximate location of borings

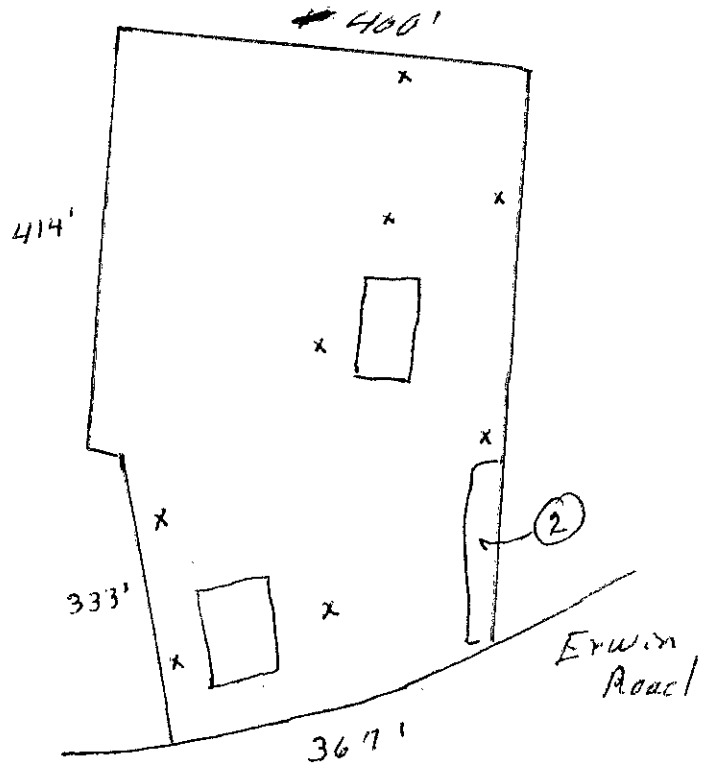

*** EVALUATION KEY ***

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	(S) PS U 2-6%	S PS (U) Depression	S PS U	S PS U	S PS U	S PS U
Texture	S PS (U) Expansive clay	S PS U	S PS U	S PS U	S PS U	S PS U
Structure	S (PS) U Lot ~~109~~ Sub 2 Block 1	S PS U	S PS U	S PS U	S PS U	S PS U
Drainage	S PS (U) perched water 15"	S PS U	S PS U	S PS U	S PS U	S PS U
Depth	S PS (U) 12-27"	S PS U	S PS U	S PS U	S PS U	S PS U
Restrictive Horizons	S (PS) U 736"	S PS U	S PS U	S PS U	S PS U	S PS U
Available Space	S (PS) U	S PS U	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	Iredell-Like	Depression				
Area Classification	S PS (U)	S PS (U)	S PS U	S PS U	S PS U	S PS U

12400

Mecklenburg County

Health Department

Betty S. Snow, R.N., M.A.
Health Director

September 28, 1992

McClintoch Presbyterian Church
c/o GNA Design Associates
428 East Fourth Street
Charlotte, NC 28202

RE: Property located off Old Erwin Road
FILE: 666B/8537A
PARCEL: 201-211-05,16

Dear Sirs:

At your request a soils investigation was conducted on the property designated above. Results of this investigation showed the site to be classified as **UNSUITABLE** under criteria as set forth in 15A NCA 18A .1900 of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal, August 1, 1991. Evaluation Report (Serial Number 12848) is enclosed.

The soil on this property is not suitable for use with any conventional, modified or alternative system of which I am aware. If you wish to exercise your right of appeal concerning the interpretation and enforcement of these rules you may do so in accordance with G.S. 150B-23.

If there are any questions, please contact Bill Marlin at 336-5574.

Sincerely,

Kelly Randall

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems

Enclosure