## Groundwater & Wastewater Services
### Septic Project File & Data Review Worksheet

GWS File #: 8122 WASPS App #: 4460

Primary ES assigned to project: PW

Secondary ES assigned to project: _____

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

Poss 3/19/15

I. File Review:

| Rule or Law | Permit Application | | | |
|---|---|---|---|---|
| .1937(d) | Is the Application complete | Yes ☑ | No ☐ | N/A ☐ |
| .1937(d) | Is there a Site plan/Plat with application | Yes ☑ | No ☐ | N/A ☐ |
| .1937(d) | Is the Facility shown? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(d) | Are appurtenances shown | Yes ☑ | No ☐ | N/A ☐ |
| | **Site Evaluation Information** | | | |
| .1939 (a)(1) | Topography and Landscape Position Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1940 (a-g) | Slope % Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(2) | Texture Class Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(2) | Structure type Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(2) | Consistence Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(2) | Mineralogy Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1939 (a)(3) | Soil Wetness Condition Recorded? | Yes ☐ | No ☐ | N/A ☑ |
| .1939 (a)(4) | Soil Depth to Rock or Parent Material Recorded When Encountered | Yes ☐ | No ☐ | N/A ☑ |
| .1939 (a)(5) | Depth to Restrictive Horizons Recorded When Encountered? | Yes ☐ | No ☐ | N/A ☑ |
| .1939 (a)(6) | Sufficient Available Space Recorded? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(m) | Are the Profile Locations Shown? | | | |
| .1939(a) | Are the S/PS Profiles in system & in repair area? | Yes ☑ | No ☐ | N/A ☐ |
| & .1945(b) | Number of auger borings made: 3 | | | |
| | Were sufficient auger borings made? | Yes ☑ | No ☐ | N/A ☐ |
| .1939(d), .1955, .1956, .1957 | LTAR 3 | Yes ☑ | No ☐ | N/A ☐ |
| | **Improvement Permit/Construction Authorization** | | | |
| .1937(g) 130A-336(a) | Proposed System Type stated-Initial | Yes ☑ | No ☐ | N/A ☐ |
| .1945(b) | Proposed System Type stated-Repair | Yes ☑ | No ☐ | N/A ☐ |
| 130A-336 (a)(3) | System location identifiable by setbacks - Initial | Yes ☑ | No ☐ | N/A ☐ |
| .1937(g) .1945(b) | System components shown – Initial | Yes ☑ | No ☐ | N/A ☐ |
| .1945(b) | Repair area shown | Yes ☐ | No ☐ | N/A ☐ |
| .1937 (f)(g) | Does System design match facility, flow & WWcharacteristics? | Yes ☐ | No ☐ | N/A ☐ |
| .1937 (f)(g) | Is System design consistent with soil/site conditions? | Yes ☑ | No ☐ | N/A ☐ |
| .1937 (f)(g) | Is the System located in the approved area? | Yes ☑ | No ☐ | N/A ☐ |
| 130A-336(a) | Is the Design flow (gpd) indicated? | Yes ☑ | No ☐ | N/A ☐ |

| | | | | |
|---|---|---|---|---|
| 130A-336(a) | Number of Bedrooms, employees, seats, etc. indicated? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(g) | Trench depth indicated? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(g) | Trench width indicated? | Yes ☑ | No ☐ | N/A ☐ |
| .1937(g) | Trench length indicated? | Yes ☑ | No ☐ | N/A ☐ |
| 130A-336(a)(1) | Proposed/existing well shown? | Yes ☐ | No ☐ | N/A ☑ |
| 130A-336(a)(1) | Property line lengths shown? | Yes ☑ | No ☐ | N/A ☐ |
| 130A-336(a) | Facility/appurtenance setbacks shown from fixed points? | Yes ☑ | No ☐ | N/A ☐ |
| | **Operation Permit** | | | |
| .1937(i) | System type as described in table V(a) of rule .1961 | Yes ☑ | No ☐ | N/A ☐ |
| .1937(i) | Conditions for system performance, operation, maintenance, monitoring and reporting. | Yes ☑ | No ☐ | N/A ☐ |

II. WASPS Review:

| | | | |
|---|---|---|---|
| Construction authorization issued | Yes ☐ | No ☐ | N/A ☐ |
| Installation approval issued | Yes ☐ | No ☐ | N/A ☐ |
| Operation permit issued | Yes ☐ | No ☐ | N/A ☐ |
| Other related documentation | Yes ☐ | No ☐ | N/A ☐ |

# Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: 2 19 10

OP issued date: 2 19 10

Review performed by: Caly-M Date performed: 1/4 10

8122B

**MECKLENBURG COUNTY**
**GROUNDWATER & WASTEWATER SERVICES**

4468

## APPLICATION FOR A COMMERCIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ☐ N/A ☒ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☒ N/A ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 117-051-03
STREET ADDRESS: 1951 OLD Steele Creek Rd
CITY: Charlotte
STATE: NC ZIP:
LOT #: LOT SIZE (acres): 1.42
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☒ 1-CHARLOTTE ☐ 4-PINEVILLE ☐ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:
DESCRIBE TYPE OF BUSINESS: MEDICAL Office (Internal Medicine)
☒ COMMERCIAL ☐ INDUSTRIAL
SQUARE FOOTAGE OF FACILITY: 4495
NUMBER OF EMPLOYEES PER SHIFT: 8
NUMBER OF SHIFTS: 1 NUMBER OF SEATS: ____
TYPE OF WASTEWATER GENERATED:
☒ DOMESTIC SEWAGE ☐ INDUSTRIAL WASTEWATER
☐ OTHER ____

5. *IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM, INFORMATION DOCUMENTING THE INCREASED WASTEWATER FLOW AND/OR A JUSTIFICATION FOR SYSTEM ALTERATION IS REQUIRED.*

6. WATER SUPPLY: ☒ MUNICIPAL ☐ PRIVATE WELL ☐ PUBLIC WELL ☐ SHARED WELL ☐ OTHER ____

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE (DRINKING WATER) ☐ OTHER ____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:
☐ N/A ☒ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER ____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

| | | | | | |
|---|---|---|---|---|---|
| BURIED CABLES, LANDFILLS, STUMPHOLES | ☐ YES ☒ NO | | GRADING/SOIL REMOVAL PERFORMED | ☐ YES ☒ NO | |
| EXISTING WASTEWATER (SEPTIC) SYSTEMS | ☐ YES ☒ NO | | JURISDICTIONAL WETLANDS | ☐ YES ☒ NO | |
| WELLS, SPRINGS, OR WATER LINES | ☐ YES ☒ NO | | APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY | ☐ YES ☒ NO | |
| EASEMENTS OR RIGHT-OF-WAYS | ☐ YES ☒ NO | | WASTEWATER OTHER THAN DOMESTIC SEWAGE | ☐ YES ☒ NO | |
| CHEMICAL/PETROLEUM STORAGE TANKS | ☐ YES ☒ NO | | KNOWN UNDERGROUND CONTAMINATION | ☐ YES ☒ NO | |
| WASTE STORAGE | ☐ YES ☒ NO | | GROUNDWATER USE RESTRICTIONS/VARIANCES | ☐ YES ☒ NO | |

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? ____ ☒ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? ____ ☐ N/A

12. PROPERTY OWNER:
NAME: Joyce, LLC
ADDRESS: 2900 Providence Forest Drive
CITY: Weddington
STATE: NC ZIP: 28112
HOME PHONE: 704-925-6004
WORK PHONE: "
MOBILE PHONE: "
FAX: 704-256-9759

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE:
WORK PHONE:
MOBILE PHONE:
FAX:



MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 7/1/08

**14. SEPTIC SYSTEM PERMIT APPLICATION:**

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

**15. WELL PERMIT APPLICATION:**

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

**16. APPLICATION SIGNATURE SECTION:**

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below.

_____ 12/21/2009

Property Owner's or Owner's Legal Representative Signature — Date

---

*OFFICE USE ONLY*

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEES RECEIVED: $ 450.00 CHK 16183 — DATE FEE RECEIVED: 12/21/09

WELL APPLICATION FEES RECEIVED: $ _____ 400 CHK 3/9/10 — DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: SC

GWS FILE NUMBER ASSIGNED: 8122B

APPLICATION ID NUMBER ASSIGNED: 4468

COMMENTS: full set of plans submitted with application, plans given to Jason by KR



MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 7/1/08

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of
Property ID: 11705104
Lot #:
File #: 8122B
AppID: 4468

# SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Joyce, LLC
Applicant:
Address: 2900 Providence Forest Dr Weddington, NC 28102
Date Evaluated: 12/22/2009
Proposed Facility: Medical Office
Design Flow (.1949): 240gpd
Property Size: 1
Location of Site: 1951 Old Steele Creek Rd Charlotte NC
Property Recorded:
Water Supply: [x] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

| PROFILE # | .1940 Landscape Position/ Slope% | Horizon Depth (IN.) | SOIL MORPHOLOGY .1941 .1941 Structure/ Texture | .1941 Consistence Mineralogy | b PROFILE FACTORS .1942 Soil Wetness/ Color | .1943 Soil Depth (IN.) | .1956 Sapro Class | .1944 Restr Horiz | Profile Class & LTAR |
|---|---|---|---|---|---|---|---|---|---|
| 1 | 5% | 0-4 | GR/L | FR,SS,SP,SXP | >48" TO SOIL WETNESS | 48 | N/A | NONE | .3GPD/FT2 |
| | L.S | 4-16 | GR/SCL | " | | | | | |
| | | 16-48 | SBK/C | FI,S,P,SXP | | | | | |
| | | | | | | | | | |
| 2 | 4 | 0-3 | GR/L | FR,SS,SP,SXP | " | " | " | " | " |
| | L.S | 3-22 | GR/SCL | " | | | | | |
| | | 22-48 | SBK/C | FI,S,P,SXP | | | | | |
| | | | | | | | | | |
| 3 | " | 0-6 | GR/L | FR,SS,SP,SXP | " | " | " | " | " |
| | | 6-19 | GR/SCL | " | | | | | |
| | | 19-48 | SBK/C | FI,S,P,SXP | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | SITE LTAR .3GPD/FT2 | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

| Description | Initial System | Repair System |
|---|---|---|
| Available Space (.1945) | PS | PS |
| System Type(s) | IIIb | IIIb |
| Site LTAR | 0.3 | 0.3 |

Other Factors (.1946):
Soil Evaluation By: Jason Jackson
Others Present:
Site Classification (.1948): Provisionally Suitable
Site Evaluation By: PHILO WALKER RS
Others Present: H BOWERS


**COMMENTS:** **100% repair area required for site**

Keep system out of drainage way areas


| Landscape Position | Group | Texture | .1955 LTAR | Structure |
|---|---|---|---|---|
| R-Ridge | I | S-Sand | 1.2 - 0.8 | SG-Single Grain |
| SS-Shoulder Slope | | LS-Loamy Sand | | M-Massive |
| LS-Linear Slope | | | | CR-Crumb |
| FS-Foot Slope | II | SL-Sandy Loam | 0.8 - 0.6 | GR-Granular |
| NS-Nose Slope | | L-Loam | | SBK-Subangular Blocky |
| HS-Head Slope | | | | ABK-Angular Blocky |
| CC-Concave Slope | III | SI-Silt | 0.6 - 0.3 | PL-Platy |
| CV-Convex Slope | | SICL-Silty Clay Loam | | PR-Prismatic |
| T-Terrace | | | | |
| FP-Flood Plain | | CL-Clay Loam | | |
| | | SCL-Sandy Clay Loam | | |
| | IV | SC-Sandy Clay | 0.4 - 0.1 | |
| | | SIC-Silty Clay | | |
| | | C-Clay | | |

| Consistence Moist | Consistence Wet | Mineralogy |
|---|---|---|
| VFR-Very Friable | NS-Non-Sticky | SEXP-Slightly Expansive |
| FR-Friable | SS-Slightly Sticky | EXP-Expansive |
| FI-Firm | S-Sticky | |
| VFI-Very Firm | VS-Very Sticky | |
| EFI-Extremely Firm | NP-Non-Plastic | |
| | SP-Slightly Plastic | |
| | P-Plastic | |
| | VP-Very Plastic | |

**Sketch of Soil Evaluation Locations**

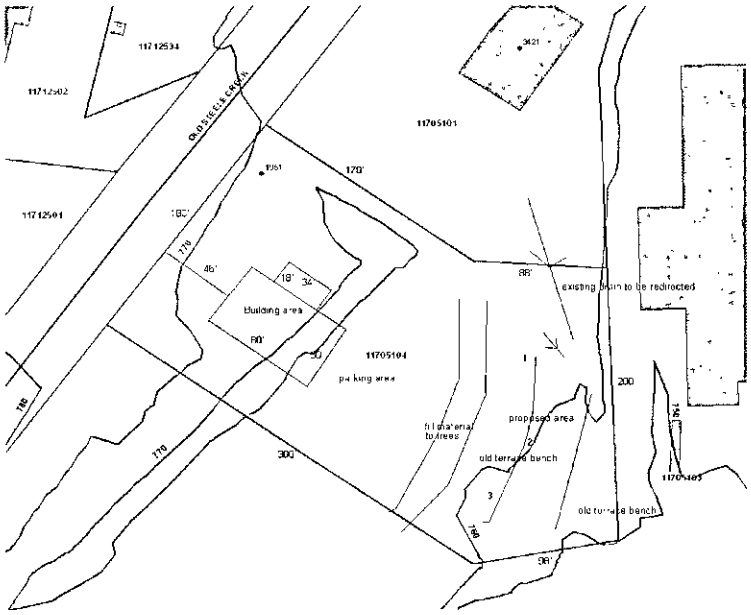


1951 Old Steele Creek Rd
FILE# 8122B

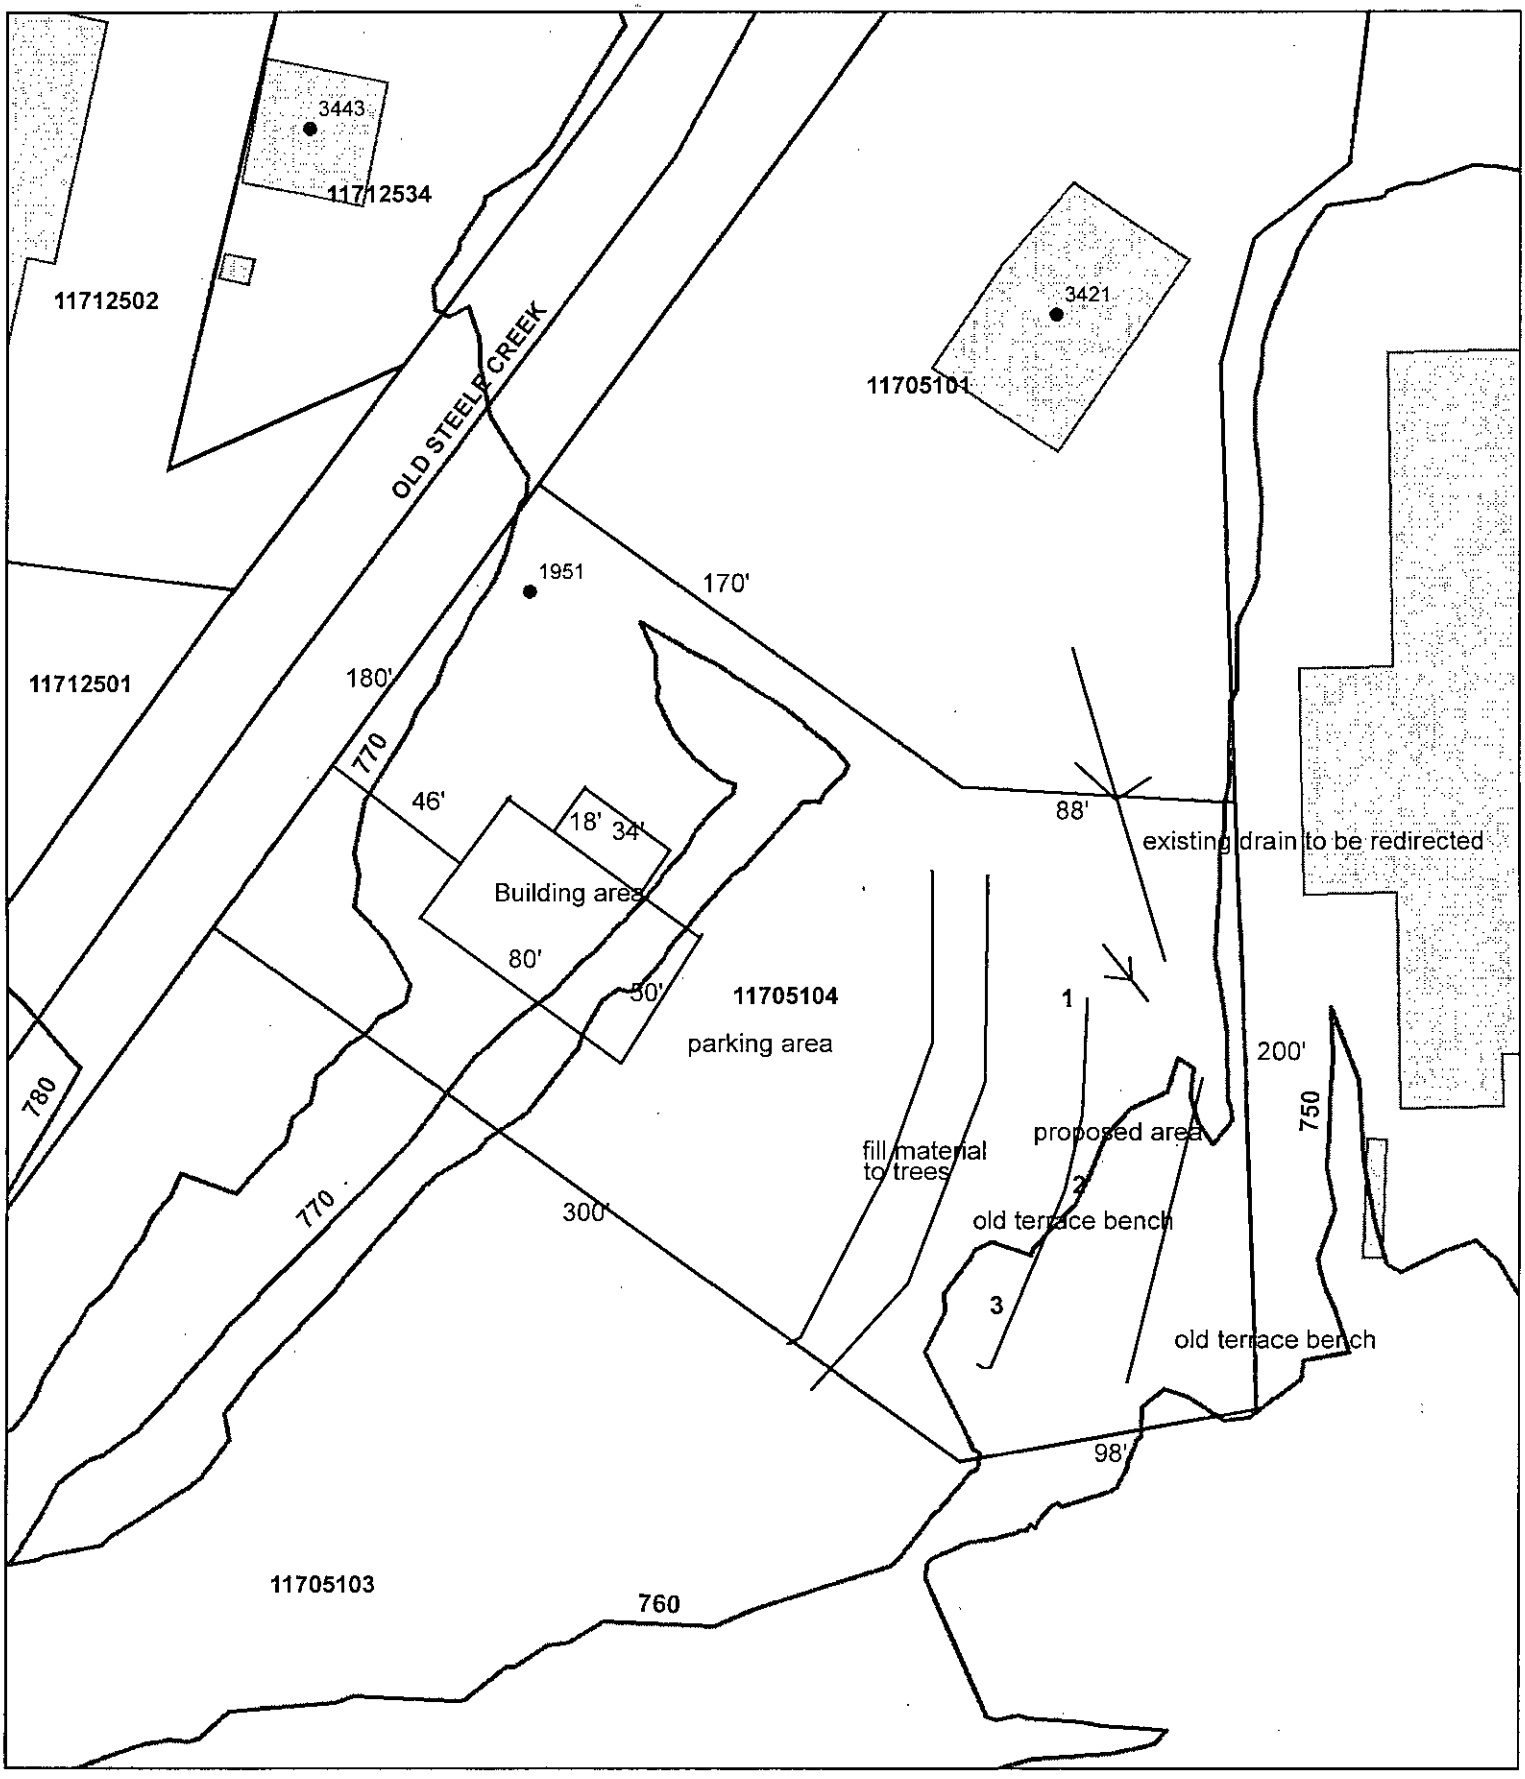


Map Created By: J. Jackson
Map Created On: 12/29/09

0 37.5 75 150
F

# 1951 Old Steele Creek Rd
# FILE# 8122B

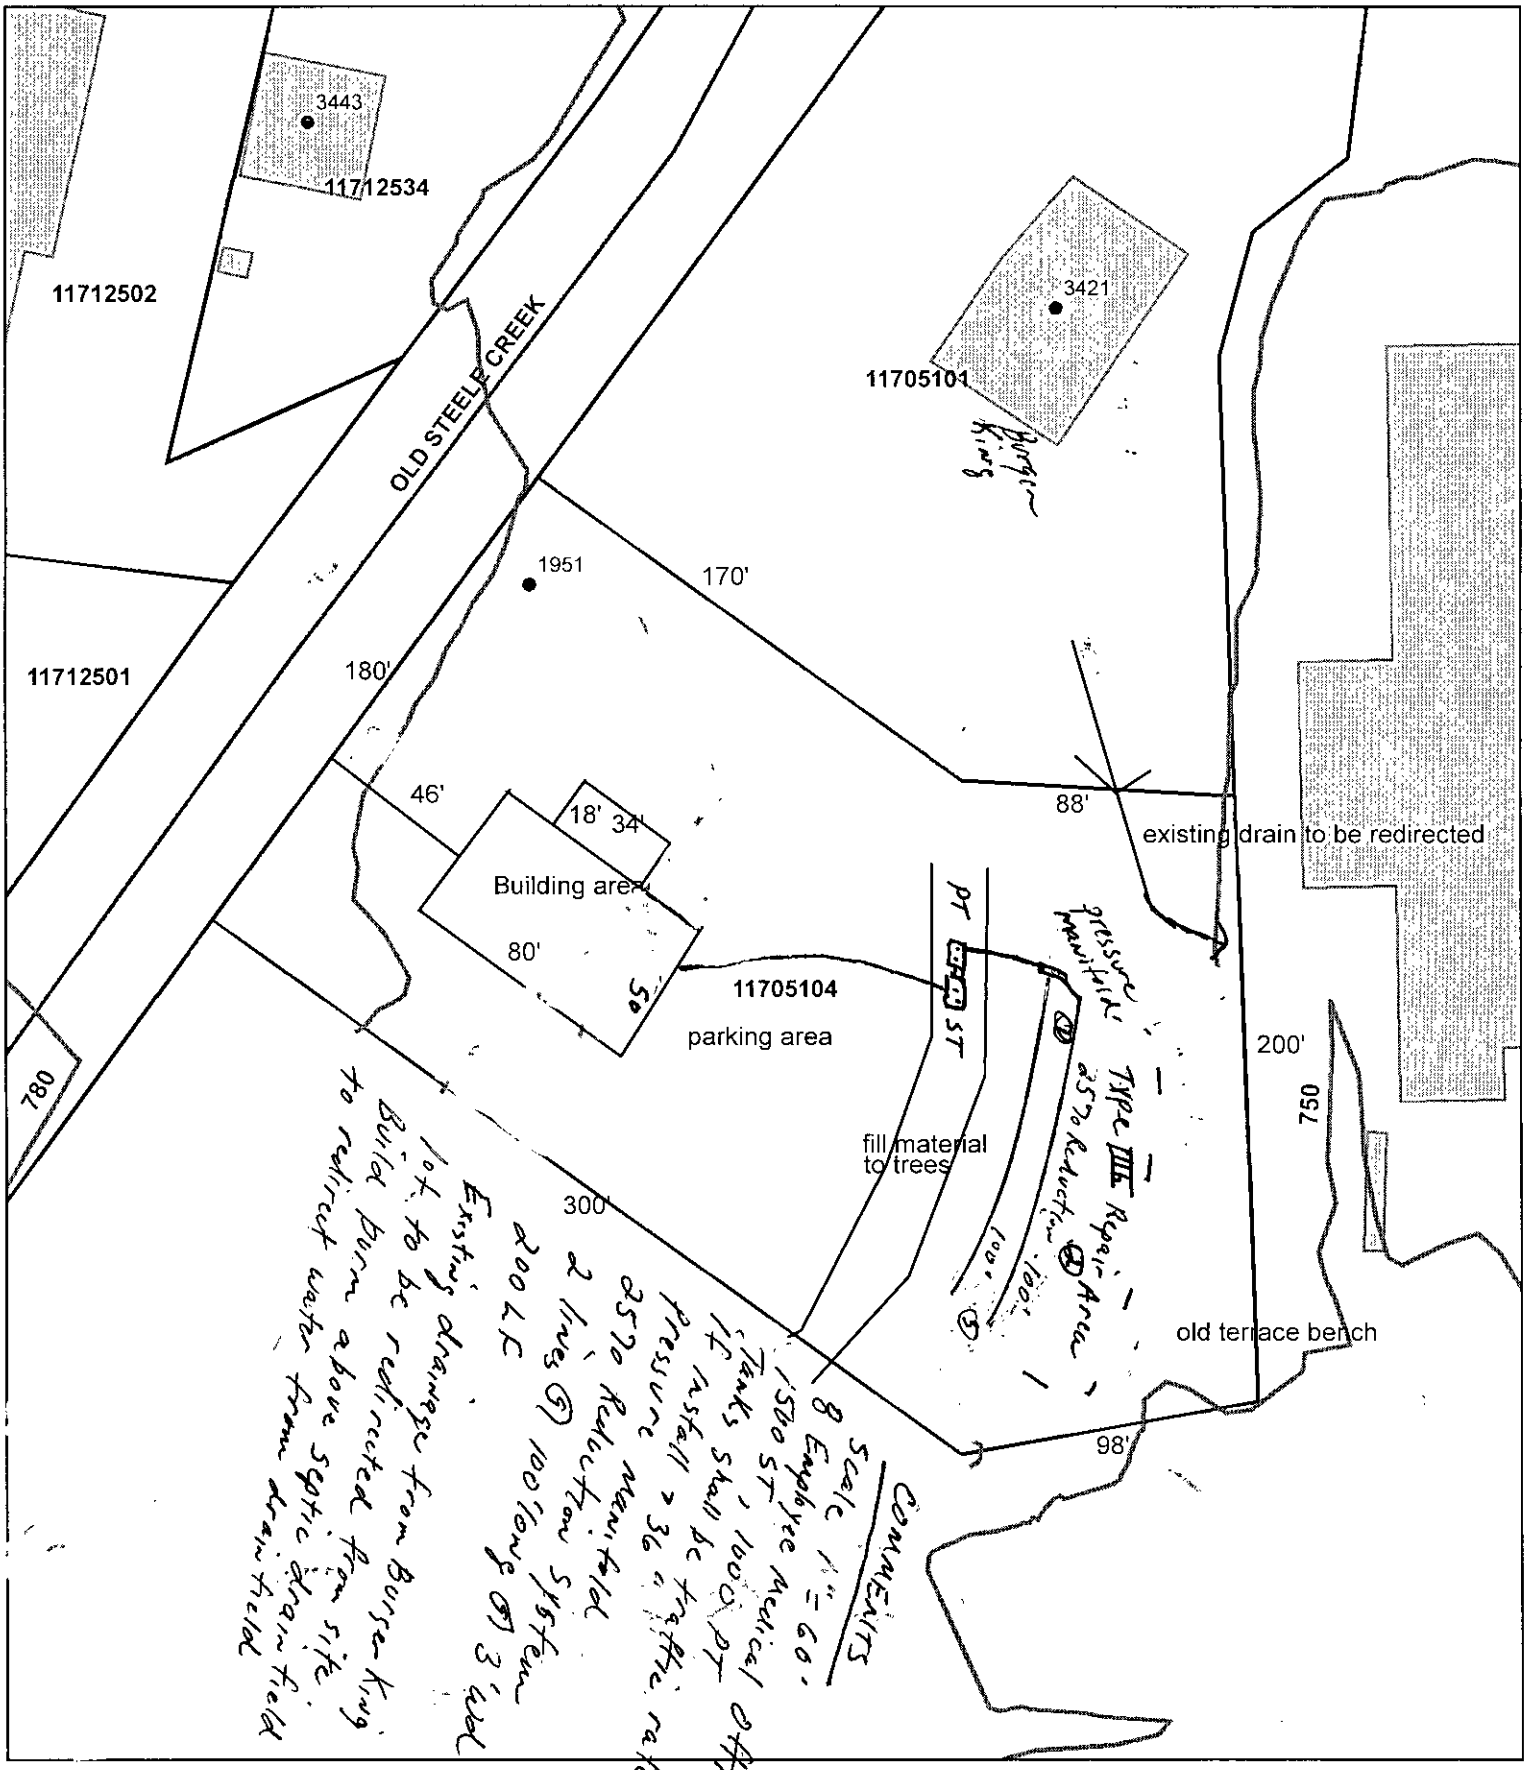


Map Created By: J. Jackson
Map Created On: 12/29/09

0 37.5 75 150
F

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

# IMPROVEMENT PERMIT for a COMMERCIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30004468** GWS File #: **8122B** Tax Parcel #: **117-051-04**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

**I. This Improvement Permit Shall:** Expire in Five (5) Years **Expiration Date (If Applicable):** 1/6/2015

Intallation Type: Commercail/Industrial - New System Business Type: Commercial

Facility Size ($ft^2$): 4495 # Employees/Shift: 8 # Shifts: 1

Wastewater Type: Sewage Water Supply: Municipal

**II. Initial System Type:** Pump to Approved **System Classification:** IIIb

Initial System Specifications:

| | | | | | | | |
|---|---|---|---|---|---|---|---|
| Design Flow (gpd): | 240 | LTAR ($gpd/ft^2$): | 0.3 | Septic Tank Size (gal): | 1000 | Pump Tank Size (gal): | 1000 |
| Trench Width (ft): | 3 | Trench Spacing (ft): | 9 | Absorption Area ($ft^2$): | 600 | Total Trench Length (ft): | 200 |
| Maximum Trench Depth (in): | 30 | Depth of Media (in): | 12 | Distribution Device: | Pressure Manifold | | |

**III. Repair System Type:** Pump to Approved **System Classification:** IIIb

Repair System Specifications:

| | | | | | | | |
|---|---|---|---|---|---|---|---|
| Design Flow (gpd): | 240 | LTAR ($gpd/ft^2$): | 0.3 | Septic Tank Size (gal): | 1000 | Pump Tank Size (gal): | 1000 |
| Trench Width (ft): | 3 | Trench Spacing (ft): | 9 | Absorption Area ($ft^2$): | 600 | Total Trench Length (ft): | 200 |
| Maximum Trench Depth (in): | 30 | Depth of Media (in): | 12 | Distribution Device: | Pressure Manifold | | |

**IV. Permit Conditions/Comments:**

*(Please See the Following Page for Permit Conditions.)*

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Philo Walker Owner/Legal Agent: John L. Hill
Print Name

Signature: Philo Walker RS Signature: John L. Hill

Date Issued: 1/6/2010

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

## IMPROVEMENT PERMIT for a COMMERCIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30004468** GWS File #: **8122B**

**IV. Permit Conditions/Comments:**

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- All drainage improvements (swales, interceptor drains, etc.) noted on the plot plan must be inspected and approved prior to issuance of an Operation Permit.
- All waterlines must be located a minimum of 10 ft. from any part of the septic system.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- TRAFFIC RATED TANKS SHALL BE INSTALLED IF DEEPER THAN 36".SURFACE WATER FROM ADJACENT LOT SHALL BE DIVERTED AWAY FROM THE SEPTIC SYSTEM.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Philo Walker

Signature: Philo Walker ZD

Date Issued: 1/6/2010

Owner/Legal Agent: John L. Hill

Print Name

Signature: John L. Hill

Page 2 of 2

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

**INSTALLATION APPROVAL for an**
**ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM**

File #: 8122B Permit #: 4468 Tax Parcel #: 117 05104

Property Owner: Joyce, LLC

Job Location Address: 1951 Old Steele Creek Rd

City: Charlotte State: NC Zip Code: 28208

**Installation Approval Issuance Date:** 2/18/10

Permission is hereby given to ☑ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 3/18/10, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 240 GPD Site LTAR: .3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons Liquid Capacity of Dosing Tank: N/A gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 200 feet

# of Lines: 2 @ 100 feet

Depth of Media: 12 inches (Type) 25% Reduction

Distribution Device: D Box

Bed Design *(For Repair Installations ONLY.)* ☑ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☑ Municipal ☐ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: > 10' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

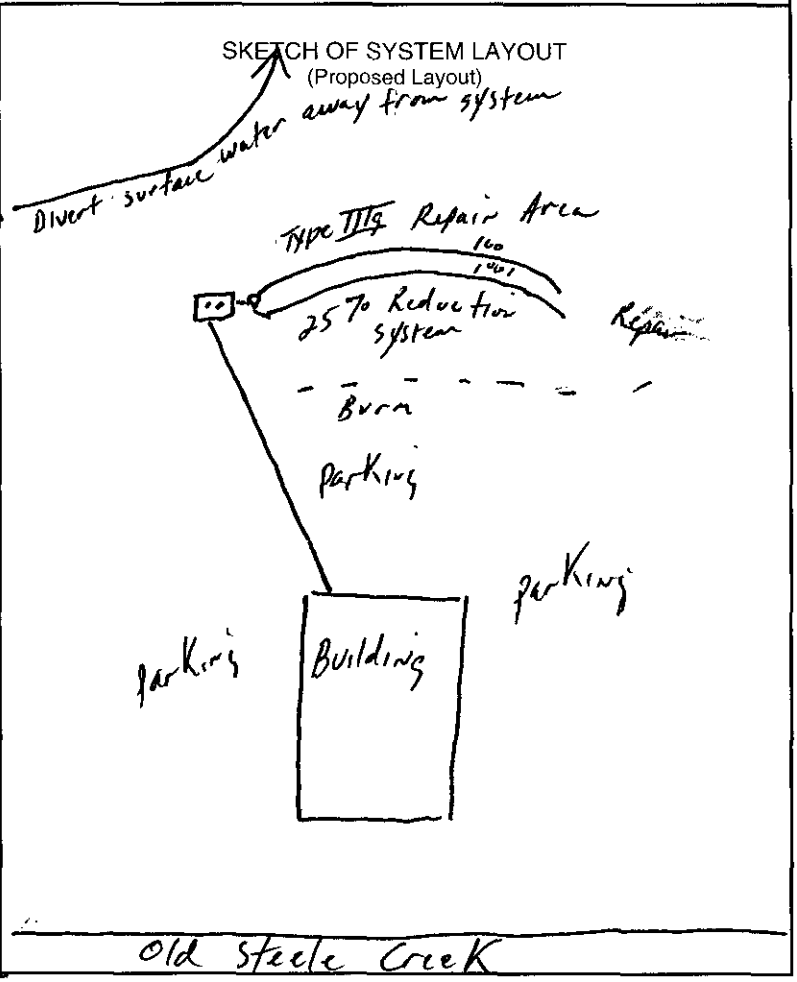


Comments: System Classification & Type: Type IIIg Install 1500 ST, D-Box, 2 lines (5) 100' long @ 3' wid 25% Reduction system Pump tank omitted due to plumbing adjustments

DENR Authorized Agent: Philo Walker Signature: Philo Walker RS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

# OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 8122B Permit #: 4468 Tax Parcel #: 117 051 04

Property Owner: Joyce, LLC

Job Location Address: 1951 Old Steele Creek Rd

City: Charlotte State: NC Zip Code: 28208

**Operation Permit Issuance Date:** 2/18/10 Contractor Name: B W Christenbury

Permitted Design Flow: 240 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: NA gallons

Effluent Pump Model: NA

Drainfield Installation ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 200 feet

# of Lines: 2 @ 100 feet

Depth of Media: 12 inches (Type) chambers

Depth of Cover: 18 inches

Distribution Device: D Box

Bed Installation *(For Repair Installations ONLY.)* ☑ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☑ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: >10' feet

Inspection Dates

Tank(s) Inspected: 2/18/10

Excavation Inspected: 2/18/10

Pump & Controls Inspected: N/A

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

See installation approval

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☑ installed ☐ altered ☐ repaired ☐ as detailed in the plot above ☑ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

**Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.**

Comments: System Classification & Type: Type IIIg IS, G

DENR Authorized Agent: Philo Walker Signature: Philo Walker RS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

**OPERATION PERMIT for an**
**ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM**

File #: 8122B Permit #: 4468 Tax Parcel #: 117 051 04

Property Owner: Joyce LLC

Job Location Address: 1951 Old Steele Creek Rd

City: Charlotte State: NC Zip Code: 28208

**OPERATION PERMIT CONDITIONS:**

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIg

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☑

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: Gravity chamber

DENR Authorized Agent: Philo Walker Date: 2/18/10

Signature: Philo Walker

FEE: 0.00
DATE: 3/7/2013

# CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

**MECKLENBURG COUNTY**
**GROUNDWATER & WASTEWATER SERVICES**

**FILE NUMBER:** 8122B

**PERMIT NUMBER:** 30004468

**PARCEL NUMBER:** 11705104

**JOB LOCATION INFORMATION**

**ADDRESS:** 1951 OLD STEELE CREEK RD

**CITY:** CHARLOTTE **STATE: NC** **ZIP:** 28208

**ISSUED TO:** Joyce, LLC

**CONSTRUCTION AUTHORIZATION ISSUANCE DATE:** 2/18/2010

## CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30004468, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.
   ***CONSTRUCTION AUTHORIZATION EXPIRATION DATE:** 1/6/2015