Date Received 8-4-78

APT No. 14,3 4B

T. C. No. 217-201-02B

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER Austin, (LAST) Baxter (FIRST) E. (MIDDLE)

2) ADDRESS OF OWNER Rt 1 Box 132 Fort Mill, S.C. ZIP 29715

3) PHONE NO Home 803/548-0515 Office 704-375-7321

4) LOCATION OF PROPERTY Hwy. 49, left on Youngblood (STREET OR COUNTY ROAD) left on Micehouse, Passage left on Way

5) SUBDIVISION Lake Wylie LOT NO 2B BLOCK NO. 201


MAP BOOK NO 217 PAGE NO 20

6) DEED REFERENCE DEED BOOK PAGE NO

Recorded: Plat Book 17, Page 579, March 1, 1976

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge

Copy of Plat enclosed

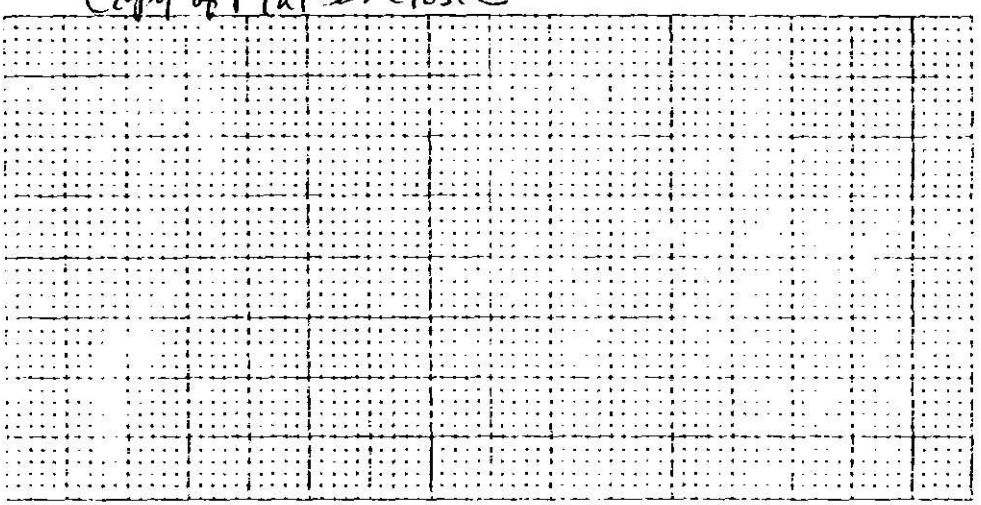

7) ACCURATELY DIAGRAM & DIMENSION LOT

Baxter F. Austin
OWNER

EHO 5 76

Environmental Health Department's Copy

Date Received 5-24-82

MECK COUNTY DEPARTMENT OF
RECEIVED
MAY 24 1982
ENVIRONMENTAL HEALTH

SIR No. 14368

T. C. No. 217-201-02

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER CRESCENT LAND & TIMBER / THE HENDRIX COMPANY (LESSEE)
LAST FIRST MIDDLE

2) ADDRESS OF OWNER 6618 FAIRVIEW RD., SUITE 203 ZIP 28210

3) PHONE NO. Home _____ Office 365-4680


4) LOCATION OF PROPERTY PASSAGE WAY Court
STREET OR COUNTY ROAD

5) SUBDIVISION LAKE WYLIE, S.C. LOT NO 146 BLOCK NO _____

MAP BOOK NO _____ PAGE NO _____ TAX CODE 217-201-2

6) DEED REFERENCE DEED BOOK _____ PAGE NO _____

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on-site inspection of the lot hereinafter described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge.

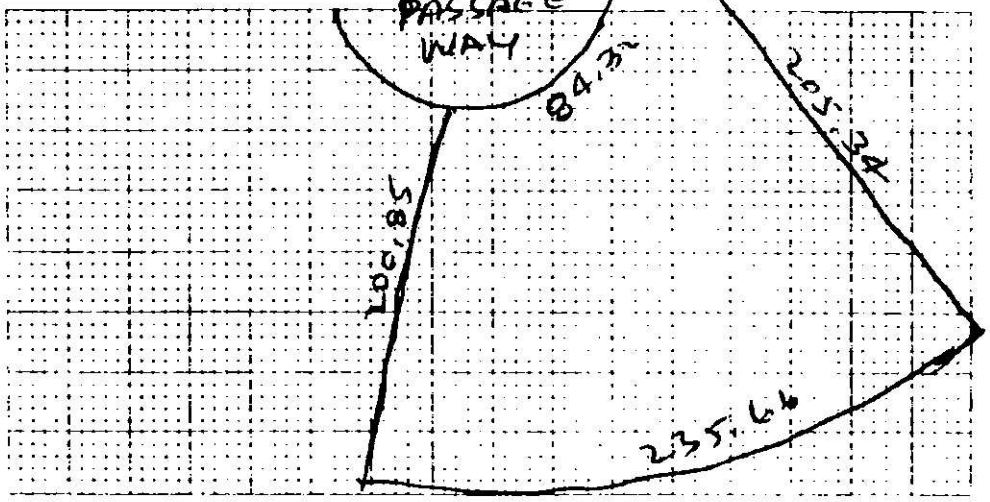

7) ACCURATELY DIAGRAM & DIMENSION LOT

OWNER

EHD 5 76

Environmental Health Department's Copy

APT 14368

NORTH CAROLINA
DEPARTMENT OF HUMAN RESOURCES
DIVISION OF HEALTH SERVICES
RALEIGH, NORTH CAROLINA

APPENDIX H
SITE EVALUATION

TC 217-201-02
Lot 28

(Ground Absorption Sewage Disposal)

OWNER: Baxter F. Mullis
ADDRESS: Rt. 1, Box 132
COUNTY: Fort Mill
LOCATION OF SITE: Passageway Ct.

DATE REQUESTED:
PLAT NO.:
LOT SIZE: 30,492

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	(S) 8-15% PS 20-30% U	S PS U	S PS U	S PS U +
2. SOIL TEXTURE (12-36 in.) (Sandy, loamy, clayey, Note 2:1, Clay)	S PS 2:1 clay (U)	S PS U	S PS U	S PS U
3. SOIL STRUCTURE (12.36 in.) (Clayey Soils)	S PS massive (U)	S PS U	S PS U	S PS U
4. SOIL DEPTH (In.)	S PS < 48" (U)	S PS U	S PS U	S PS U
5. RESTRICTIVE HORIZONS (In.) (Imprevious Strata, Rock)	S Saprolite PS < 48" (U)	S PS U	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (External & Internal)	(S) PS Potential/ External (U) water movement	S PS U	S PS U	S PS U
7. SOIL PERMEABILITY (Percolation Rate)	S Slow PS (U) very slow	S PS U	S PS U	S PS U
8. OTHER (Specify)	S PS U	S PS U	S PS U	S PS U
9. SITE CLASSIFICATION	unsuitable			
SOIL SERIES	Enon-ur. Hug			

S - Suitable PS - Provisionally Suitable U - Unsuitable

* See Diagram on Back (Include: Soil areas, property lines, roads, streams, gullies, wet areas, fill areas, wells, water bodies, slope patterns, etc)

Recommendations/Comments:

Described By: William B. Main

Title: Soil Scientist Date: 6-15-92

DHS Form 2601 (2/77)
Sanitation

Soil reviewed 5-20-92
no change in status of repor

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
1200 BLYTHE BOULEVARD
CHARLOTTE, NORTH CAROLINA 28203

SITE INVESTIGATION REPORT
INDIVIDUAL SEPTIC TANK SYSTEM WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

SIR.NO. 14368
T. C.NO. 217-201-028
MAP DATE
DATE 8-21-78

NAME OF OWNER Austin, Baxter F.

ADDRESS OF OWNER Route 1, Box 132, Fort Mill, S.C. 29715

LOCATION OF LOT Passageway Court, Lot 28, Block 201

At your request and pursuant to Section. 1900 of the North Carolina Administrative Code, Title 10, Department of Human Resources, Chapter 10, Health Services, Subchapter 10A, a site evaluation has been made for an on premises ground absorption sewage disposal system on the property designated above and the following conditions were found:

Soil Structure Massive.
Soil Permeability Unsuitable.

Section 10 of the North Carolina Administrative Code 10A, .1910 of these regulations states "Sites originally classified as unsuitable may be used for soil absorption disposal systems, provided engineering, hydrogeologic, and soils studies indicate to the local agency that a suitable alternate system can reasonably be expected to function satisfactorily.

Section 10, North Carolina Administrative Code 10A, .1916 states that "The design, construction, and maintenance of ground absorption sewage systems, whether septic tank systems or alternate systems shall be the responsibility of the owner, developer. installer, and user of the system as applicable in the circumstances."

We would also advise you that according to Regulation 10, North Carolina Administrative Code 10A, . 1916(b), "Actions of representatives of state or local agencies engaged in the evaluation and determination of measures required to effect compliance with the provisions of this section shall in no way be taken as a guarantee that sewage disposal systems approved and permitted will function in a satisfactory manner for any given period of time or that such employees assume any liability for damages, consequential or direct, which are caused or which may be caused, by a malfunction of such system.

These regulations became effective July 1, 1977. Since that time the second sentence of Section .1910(c) has been found to be nugatory. For this reason, if you desire to file for permission to install an "alternate" system you should present this office with your proposals in the form of plans and specifications. These would be reviewed and if it is found that the system may reasonably be expected to function satisfactorily approval may be given on the execution by you of a "Septic Tank Agreement Form" available in this office.

John R. Adkisson

John R. Adkisson, Environmentalist
On Premises Waste Disposal Section

EHD #584

R

Date Received 6-28-82

MECK COUNTY DEPARTMENT OF
SEE INSTRUCTIONS ON BACK
RECEIVED
JUN 28 1982

ICAR (S) Application No. 14368

T. C. No. 217-201-03


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ✓ Install or Construct 2) _____ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

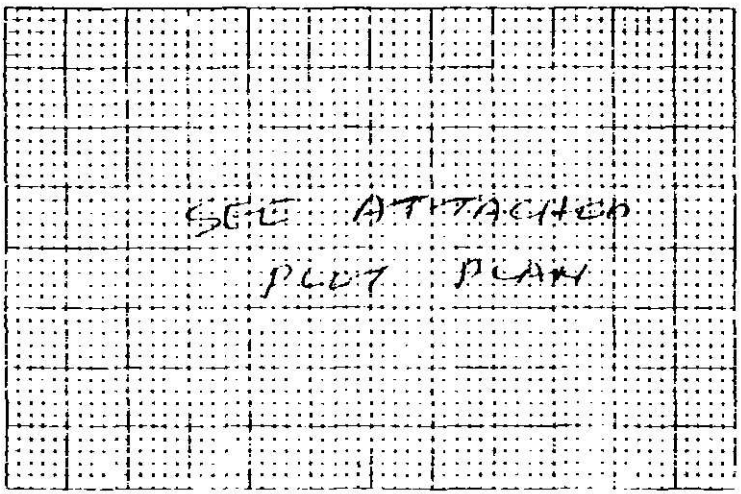

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes ___ No
Residence ✓ Yes ___ No
4) No of Bedrooms 2
5) Business Use - Max No Employees ___
6 Washing Machine ✓ Yes ___ No
7) Garbage Disposal ___ Yes ✓ No
8) Dishwasher ✓ Yes ___ No
9) Water Supply:
A) Individual Well ✓
B) Governmental System ___
C) Community System
1 Well source ___
2 Governmental source ___
10) Sewage System
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No
11) FHA Case No ___
12) VA Case No ___

13) NAME OF OWNER THE HENDRIX COMPANY (LAST / FIRST / MIDDLE)

14) ADDRESS OF OWNER 6616 FAIRVIEW RD, SUITE 203

15) PHONE NO Home ___ Office 365-4680

16) LOCATION OF SYSTEM 18225 PASSAGE WAY COURT (STREET OR COUNTY ROAD)

17) SUBDIVISION LAKE WYLIE Lot No. 146 Block No. 43

Map Book No ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES NO DATE RUN 5/26/82

20) PTR NUMBER (See Instructions) 14368


The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

6/28/82
DATE OF APPLICATION


OWNER

EHD-5-76

[illegible] METER'S COPY

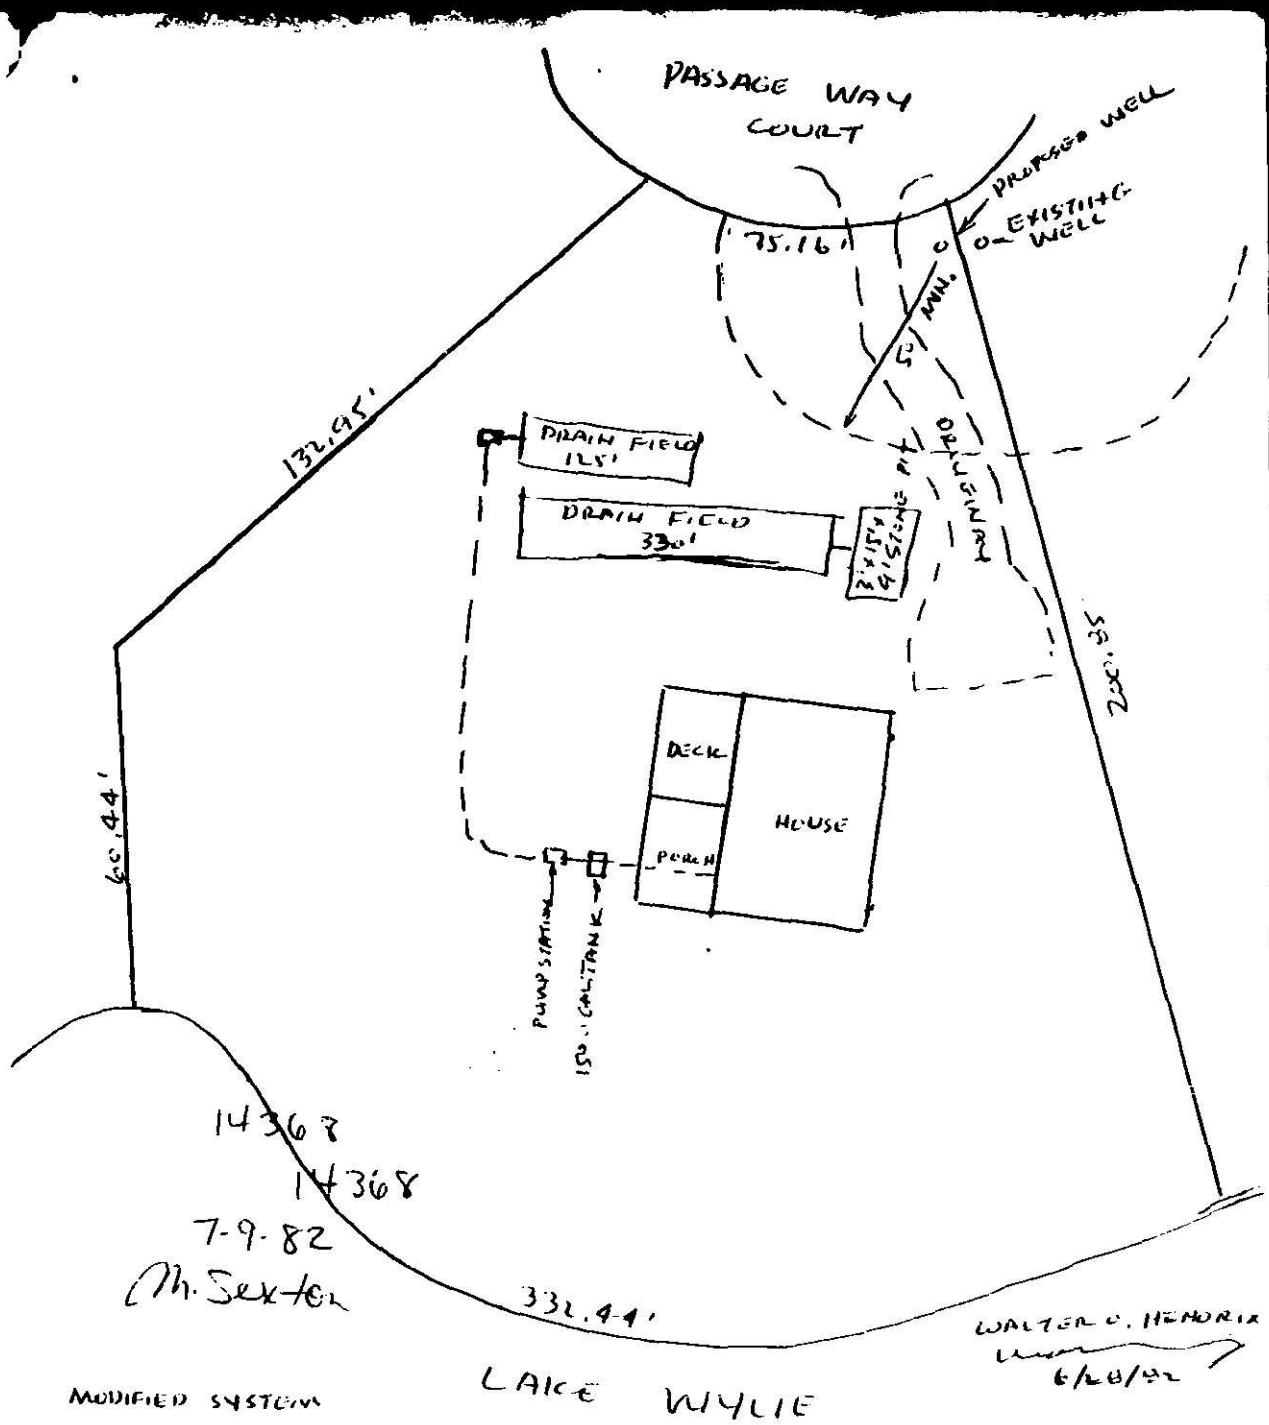

MODIFIED SYSTEM

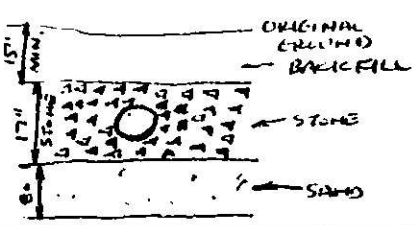

MODIFIED SEPTIC TANK
SYSTEM FOR PTR # 14368
PASSAGE WAY CT.
LAKE WYLIE, N.C.