Date Received 4-12-83

RECEIVED
APR 12 19

ICAR(S) Application No. 19551

T. C. No. 057-011-02


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ___ Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

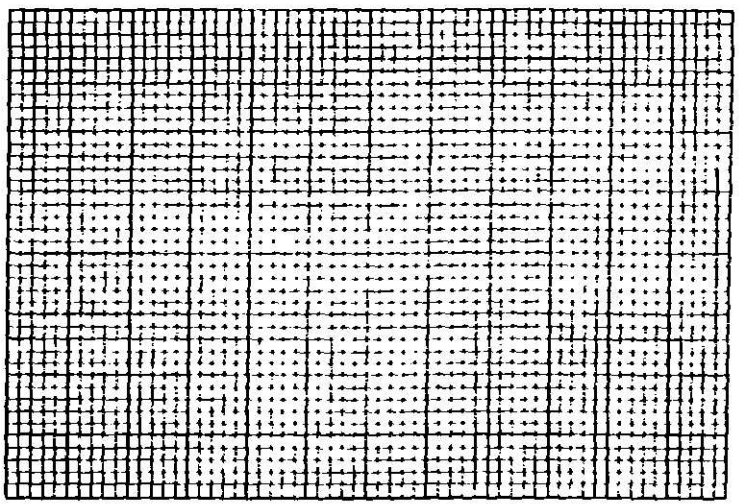

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes X No
Residence ___ Yes X No

4) No of Bedrooms none
5) Business Use — Max No Employees 100
6) Washing Machine ___ Yes X No
7) Garbage Disposal ___ Yes X No
8) Dishwasher ___ Yes X No
9) Water Supply:
   A) Individual Well ___
   B) Governmental System ___
   C) Community System:
      1 Well source ___
      2 Governmental source ___
10) Sewage System:
   House located within 200 feet of public sewer ___ Yes X No
   House located within 200 feet of community sewer ___ Yes X No
11) FHA Case No ___
12) VA Case No. ___

13) NAME OF OWNER Ryerson, Joseph T. & Son, Inc.
(LAST, FIRST, MIDDLE)

14) ADDRESS OF OWNER Mt. Holly & Hovis Roads

15) PHONE NO. Home ___ Office 392-1321

16) LOCATION OF SYSTEM Hovis Road
(STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No. ___ Block No. ___

Map Book No. ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

4-12-83
DATE OF APPLICATION

OWNER for

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY


Date Issued 4-14-83 Serial No. 6178 ICAR(S) Permit No. 19551

T. C. No. 057-011-02

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 19551, dated 4-12-83 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 4-29-83, after which date this permit shall be null and void.

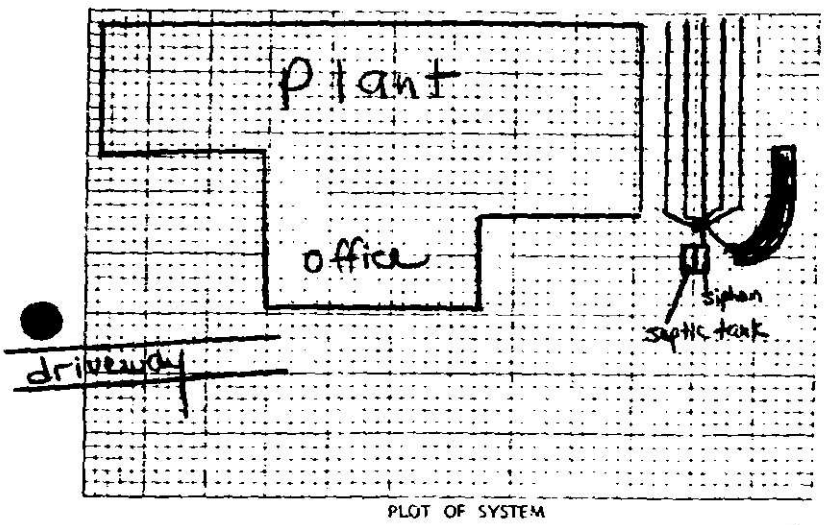

PLOT OF SYSTEM

Permeability Rate

Liquid Capacity of Tank

REPAIR

Tank Construction

Absorption and or Nitrification Line

Total Line Length 600'

Number of Lines 4

Distance from House > 10'

Distance from Property Line > 10'

Distance from Well —

NAME OF OWNER Joseph T. Ryerson + Son, Inc.

LOCATION OF PROPERTY Houis Road

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

Overflow from the distribution box to a 12' wide x 50' long

Comments: 54" of stone repair - use 6" sand under stone if soil is unsuitable

Stepdown as needed to keep 1-2' cover

Division or Section Head

Environmentalist Mike Sekhon

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-S-76 Grade to drain all surface water.

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

C of A (s) No. 19551

Date Issued 4-29-83 **Serial** 5780 T. C. No. 057-011-02

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

ERTIFICATE OF COMPLETION
CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Joseph T. Ryerson + Son, Inc.
(LAST, FIRST, MIDDLE)

Location of Property Houis Rd. + Mt. Holly Road

Application Number 19551 Permit Number 19551

Inspection Data:

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 600' Number of Lines 4

Depth of Filter Material 48" Cover Depth 28"

Water Supply Source city Distance from Water Source —

Excavation Inspected — (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 4-29-83 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ✓ installed or constructed, ___ altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments Cecil soil series.
Landscape to drain all surface water + provide a regular pumping schedule for maintenance of septic tank.

Mike Sexton
Environmentalist

EHO-S-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY