200 7/15/10 JM 3332A JAM 4706

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ☐ N/A ☐ NEW SYSTEM ☒ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☐ N/A ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 11132122
STREET ADDRESS: 5010 Tracewood CT.
CITY: Charlotte
STATE: NC ZIP: 28215
SUBDIVISION NAME: North Lake
LOT #: LOT SIZE (acres): .85
TOWNSHIP:
☒ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☐ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:
BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☒ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE: 2700
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 3
FOUNDATION TYPE:
☐ CONCRETE SLAB ☒ BASEMENT WITH PLUMBING
☐ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A
NUMBER OF BEDROOMS TO BE ADDED: 1 NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: 0

6. WATER SUPPLY: ☐ MUNICIPAL ☒ PRIVATE WELL ☐ PUBLIC WELL ☐ SHARED WELL ☐ OTHER _____

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☒ POTABLE (DRINKING WATER) ☐ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:
☐ N/A ☒ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____
8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES ☒ NO		GRADING/SOIL REMOVAL PERFORMED	☐ YES ☒ NO	
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☒ YES ☐ NO		JURISDICTIONAL WETLANDS	☐ YES ☒ NO	
WELLS, SPRINGS, OR WATER LINES	☐ YES ☒ NO		APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES ☒ NO	
EASEMENTS OR RIGHT-OF-WAYS	☐ YES ☒ NO		WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES ☒ NO	
CHEMICAL/PETROLEUM STORAGE TANKS	☐ YES ☒ NO		KNOWN UNDERGROUND CONTAMINATION	☐ YES ☒ NO	
WASTE STORAGE	☐ YES ☒ NO		GROUNDWATER USE RESTRICTIONS/VARIANCES	☐ YES ☒ NO	

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☒ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? 7-22-10 ☐ N/A

12. PROPERTY OWNER:
NAME: Jason Young
ADDRESS: 5010 Tracewood CT.
CITY: Charlotte
STATE: N.C. ZIP: 28215
HOME PHONE:
WORK PHONE: 704-947-7630
MOBILE PHONE:
FAX:

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: Jay Young
ADDRESS: 15669 Birkdale Comm. Pkwy
CITY: Huntersville, N.C.
STATE: ZIP: 28078
HOME PHONE:
WORK PHONE: 704-947-7630
MOBILE PHONE: 704-363-6759
FAX: 704-947-7631

DENR/DEH

ON-SITE WASTEWATER SECTION

Sheet 1 of 2
PROPERTY ID #: 111-321-22
COUNTY: Mecklenburg

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Jason Young — APPLICATION DATE: 7/15/2010
ADDRESS: 5010 Tracewood Ct. — DATE EVALUATED: 07/19/2010
PROPOSED FACILITY: Residence — PROPOSED DESIGN FLOW (.1949): 480 — PROPERTY SIZE: 1 Ac+
LOCATION OF SITE: 5010 Tracewood Ct. — PROPERTY RECORDED: _____
WATER SUPPLY: • (Private) • Public • (Well) • Spring • Other _____
EVALUATION METHOD: • (Auger Boring) • Pit • Cut — TYPE OF WASTEWATER: • (Sewage) • Industrial Process • Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS, 4-5	0-24	w/SBK SCL	FR/SEXP/SS/SP		42"			PS III .25 6PD/FT²
		24-30	SBK Cl	FR/SEXP/SS/SP					
		30-42	SBK SCl	FR/SEXP/SS/SP					
2	LS, 3	0-20	w/SBK SCl	FR/SEXP/SS/SP		20"			U III 0.2
		20+	Saprolite						
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	III g	DRIP/SHALLOW
Site LTAR	0.25	0.2

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: Jeremy Michael / Jeremy Michael 7/19/2010
OTHER(S) PRESENT: _____

COMMENTS: _____

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL .1955 LTAR*	LPP .1957 LTAR*	MINERALOGY/ CONSISTENCE	STRUCTURE
CC (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
CV (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
D (Drainage Way)					EXP (Expansive)	CR (Crumb)
DS (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
FP (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
FS (Foot Slope)						ABK (Angular Blocky)
H (Head Slope)	III	Si (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
L (Linear Slope)		SiCL (Silty Clay Loam)				PR (Prismatic)
N (Nose Slope)		CL (Clay Loam)				
R (Ridge)		SCL (Sandy Clay Loam)			**MOIST**	**WET**
S (Shoulder Slope)		SiL (Silt Loam)				
T (Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SiC (Silty Clay)			FI (Firm)	S (Sticky)
		C (Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None	None	EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)

*Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.


NOTES

HORIZON DEPTH	In inches below natural soil surface
DEPTH OF FILL	In inches from land surface
RESTRICTIVE HORIZON	Thickness and depth from land surface
SAPROLITE	S(suitable) or U(unsuitable)
SOIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
CLASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

Evaluation of saprolite shall be by pits.

Long-term Acceptance Rate (LTAR): gal/day/ft^2


Show profile locations and other site features (dimensions, reference or benchmark, and North).

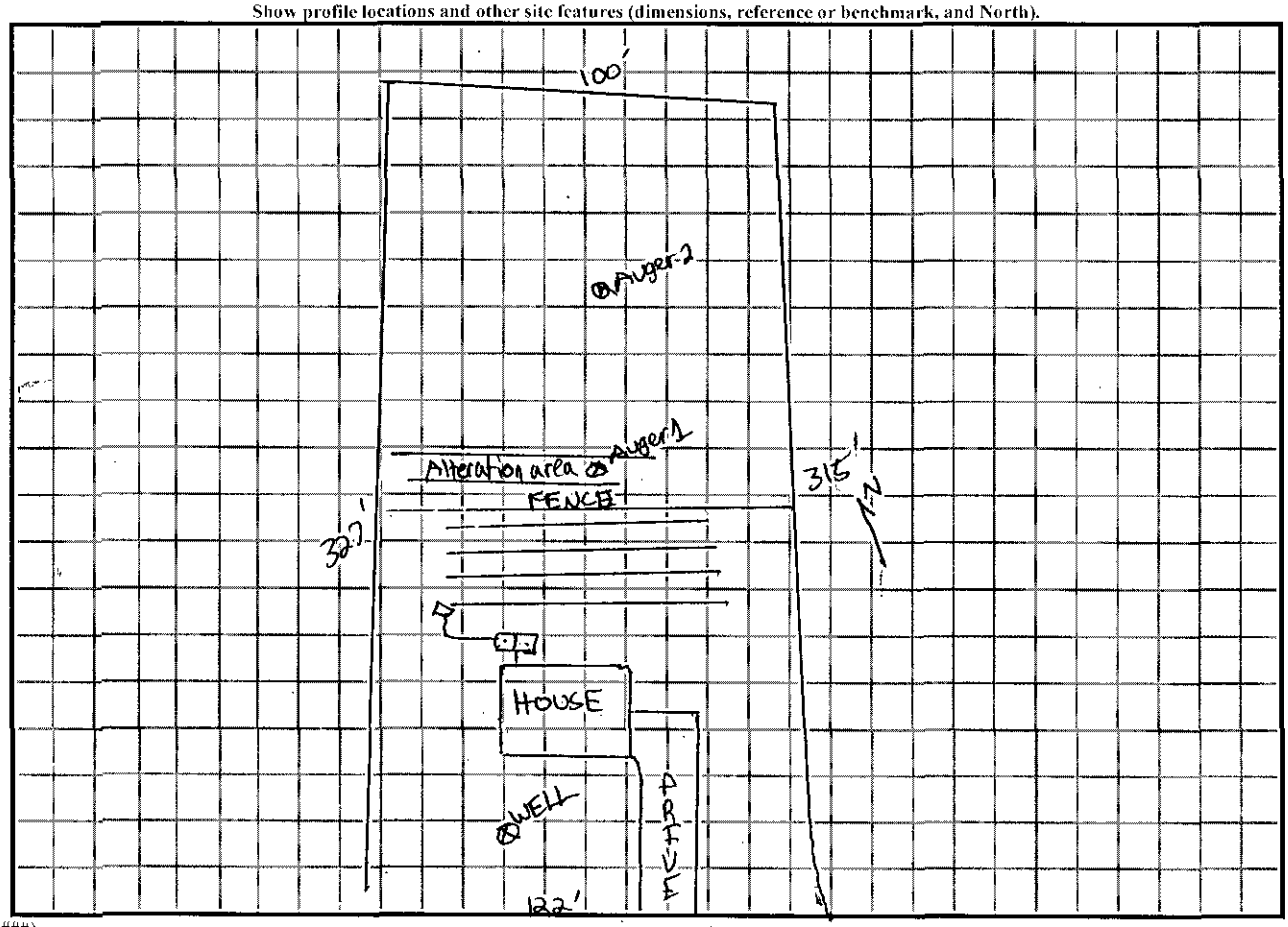

DENR (######)
Review (#####)

5010 Tracewood Court

SOIL EVALUATION LOCATIONS FOR
Parcel # 111-321-22
WAPSPS APPLICATION # 4706

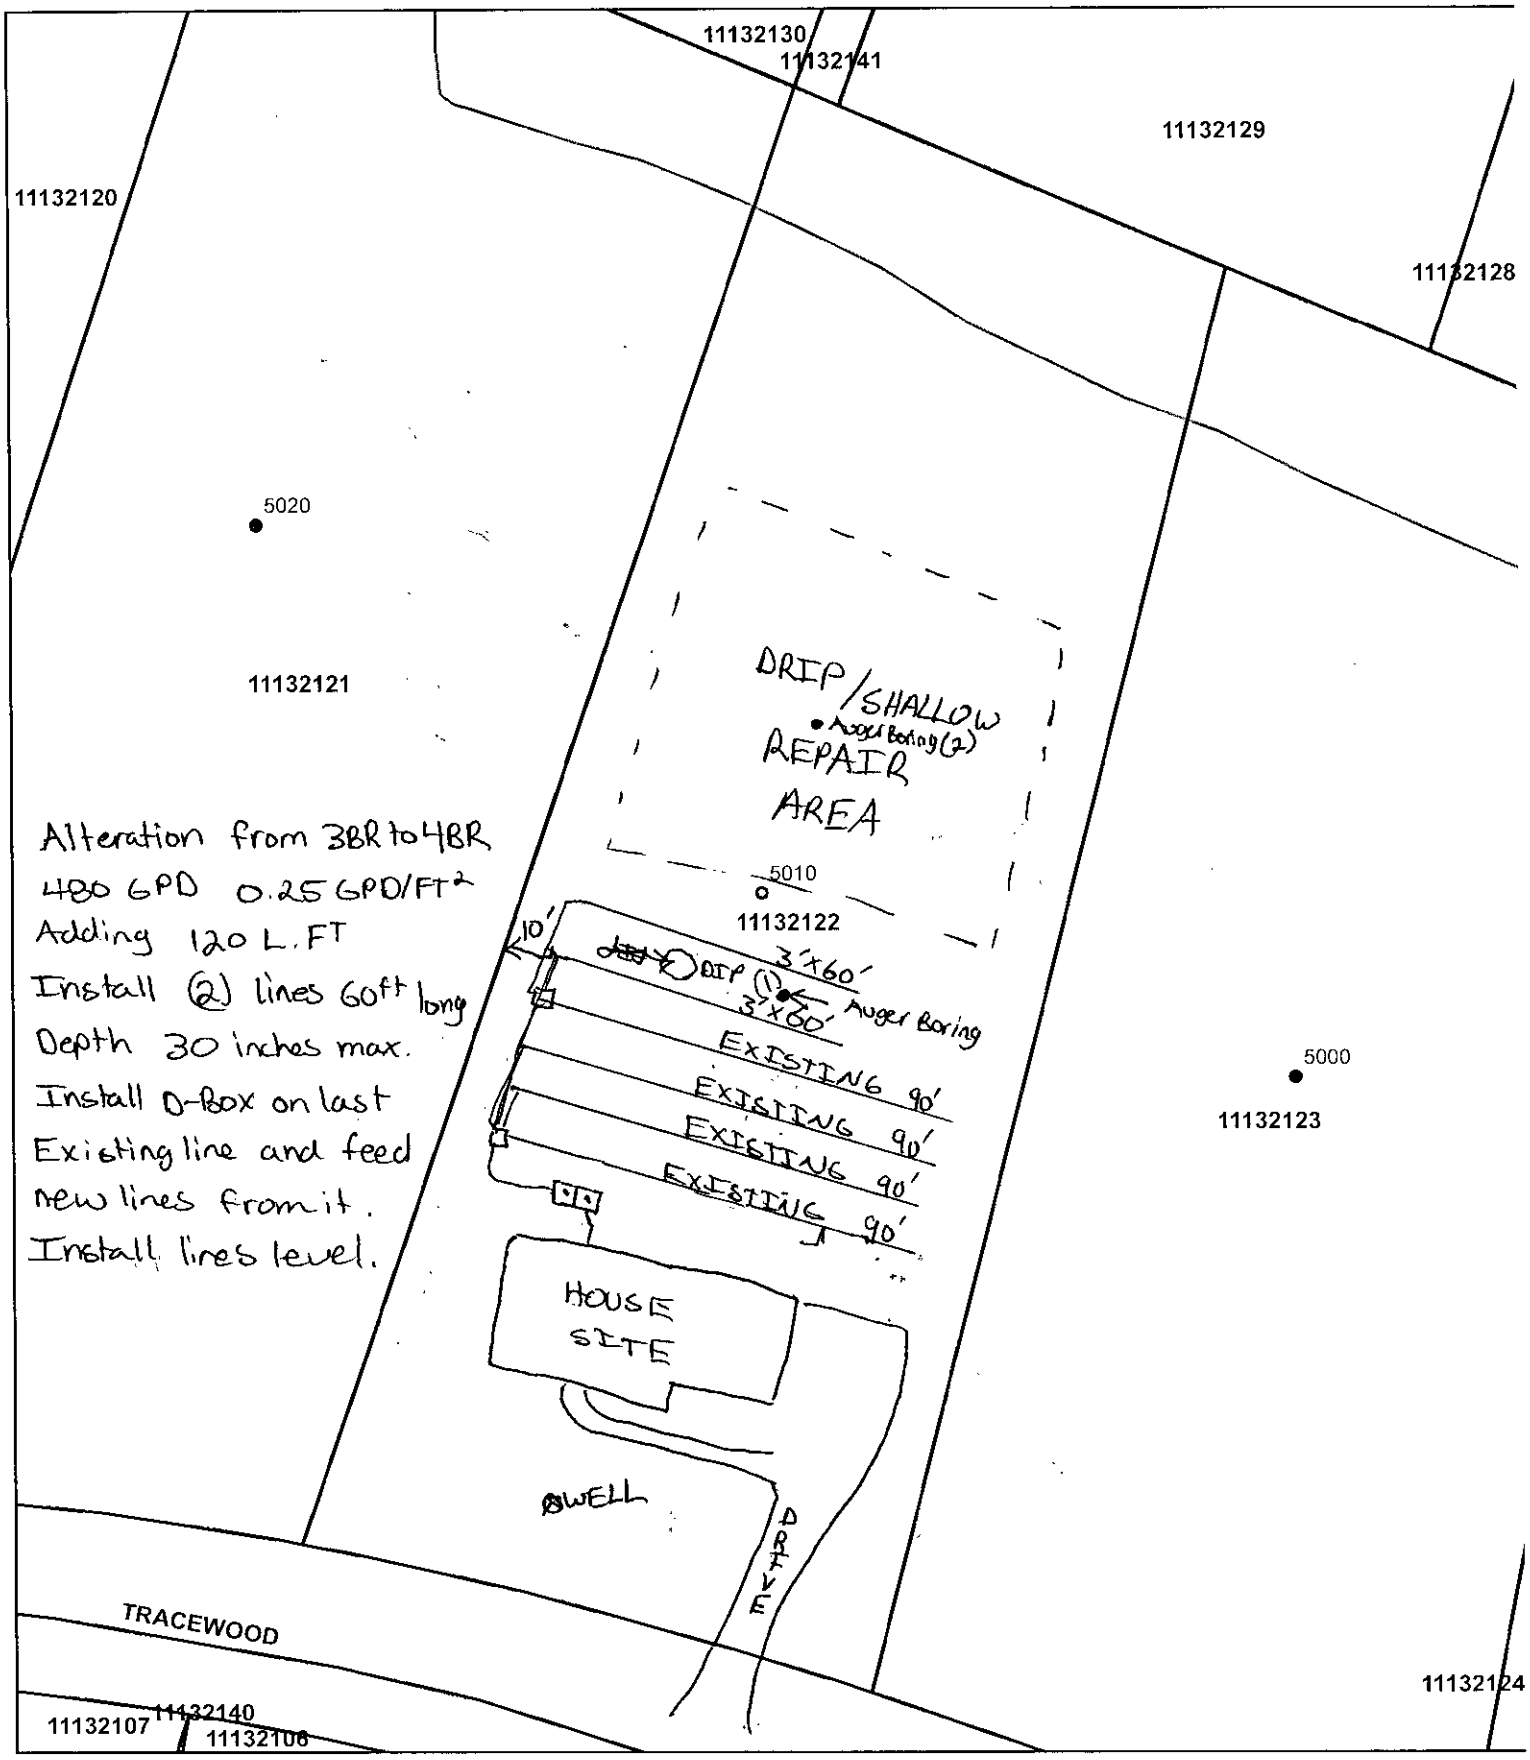

Alteration from 3BR to 4BR
480 GPD 0.25 GPD/FT²
Adding 120 L.FT
Install (2) lines 60ft long
Depth 30 inches max.
Install D-Box on last
Existing line and feed
new lines from it.
Install lines level.

Map Created By: J. Michael
Map Created On: 7/19/2010
Jeremy Michael 07/19/2010

0 20 40 80 Feet

○ Auger Boring Locations

CONDITIONS OF IMPROVEMENT PERMIT for an ALTERATION TO AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit Number: 4706 FILE # 3332A Tax Number: 111-321-22

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☒ Yes ☐ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other Approved
☐ Innovative or Experimental:

0.25 Long-term acceptance rate (GPD/ft^2)	480 Max gallons/day wastewater flow	360 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☒ Yes ☐ No	1500 Gallon septic tank	120 Total trench length (ft)	30 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
4 Bedrooms in residence	n/a Gallon pump tank	12 Depth of media (in)	

Any surface water present: **yes** Type: **creek** Minimum separation distance (ft): **50**

Additional conditions: **Drip system or shallow placed system designated for repair area. Design to be drawn up by a consultant if needed.**

Repair Area System

Type: ☐ I ☐ II ☐ III ☐ IV ☒ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other Drip/
☒ Innovative or Experimental:

0.2 GPD/FT^2

drip Absorption Area (ft^2) drip Total trench length (ft)	__ Depth of media (in)	__ Trench spacing (min. on centers) (ft)	6 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation Approval is granted by this Department.

*** This Improvement permit is transferable.

Jeremy Michael 07/19/2010
DENR Authorized Agent Date

Owner/Agent Signature Date

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 3332 A Permit #: _____ Tax Parcel #: 111-321-22

Property Owner: JASON YOUNG

Job Location Address: 5010 TRACEWOOD CT

City: CHARLOTTE State: NC Zip Code: 28215

Installation Approval Issuance Date: 07/20/2010

Permission is hereby given to ☐ *install* ☒ *alter* ☐ *repair an on-site wastewater treatment & and disposal system, with subsurface soil* absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before _____, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of *granting this approval. An* ***Operation Permit*** *must be obtained from the Mecklenburg County Health Department before any system* can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

NOTICE: This system shall not be installed while soils are in a wet condition.

Permitted Design Flow: 480 GPD

Site LTAR: 0.25 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: Existing 1500 gallons

Liquid Capacity of Dosing Tank: N/A gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 120 feet

# of Lines: 2 @ 60 feet

Depth of Media: 12 inches (Type) chambers

Distribution Device: DROP BOX

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

Minimum System Setbacks

Distance from Building Foundation: 10 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 50+ feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

Install system per plot plan and permit on file.

Comments: System Classification & Type: III g

DENR Authorized Agent: Jeremy Michael Signature: Jeremy Michael

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 3332A Permit #: _____ Tax Parcel #: 111-321-22

Property Owner: JASON YOUNG

Job Location Address: 5010 TRACEWOOD CT.

City: CHARLOTTE State: NC Zip Code: 28215

Operation Permit Issuance Date: 07/20/2010 Contractor Name: C Wayne ORBISON & SON

Permitted Design Flow: 480 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: N/A gallons

Effluent Pump Model: N/A

Drainfield Installation ☐ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: 124 feet

# of Lines: 1 @ 56 feet 1@68

Depth of Media: 12 inches (Type) Quick 4 Chambers

Depth of Cover: 18 inches

Distribution Device: DROP BOX

Inspection Dates

Tank(s) Inspected: EXISTING

Excavation Inspected: 07/20/2010

Pump & Controls Inspected: N/A

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


System Installation Setbacks

Distance from Building Foundation: 10 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 50'+ feet

SKETCH OF SYSTEM INSTALLATION (As-Built Drawing)

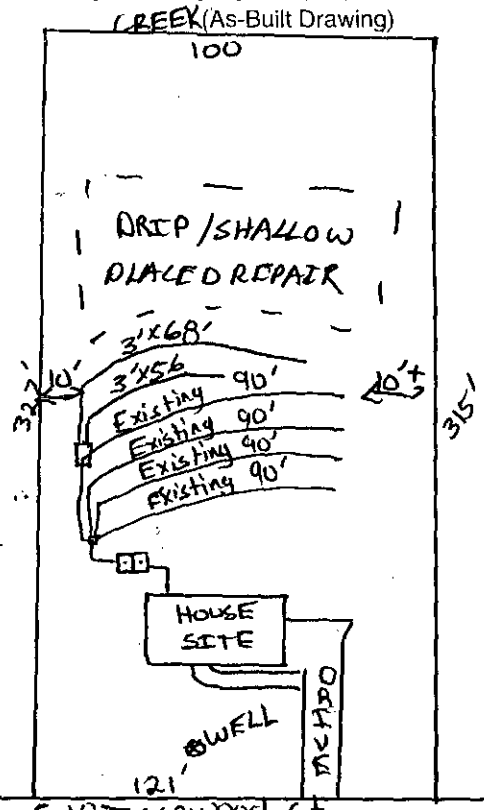

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☒ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: 111g IQ4W, G, NA, NA

DENR Authorized Agent: Jeremy Michael Signature: Jeremy Michael

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 3332A Permit #: _____ Tax Parcel #: 111-321-22

Property Owner: JASON YOUNG

Job Location Address: 5010 TRACEWOOD CT.

City: CHARLOTTE State: NC Zip Code: 28215

OPERATION PERMIT CONDITIONS:

I. *Performance:* *System shall perform in accordance with 15A NCAC 18A .1961.*

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: 111g

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☒ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ *System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.*

V. Other:

DENR Authorized Agent: Jeremy Michael Date: 07/20/2010

Signature: Jeremy Michael

FEE: 100.00
DATE: 7/14/2010
CRT I 1

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM
MECKLENBURG COUNTY - GROUNDWATER & WASTEWATER SERVICES
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

GWS – UES.APP 06/07

FILE #: 3332A

TYPE APPLCATION: JAM 4705

- [x] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A / M)
- [ ] ADDITION - RENOVATION OR GARAGE WITH NO MAJOR CHANGES (X)
- [ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
- [ ] COMMERCIAL OR INDUSTRIAL (N)

PERSON FILING APPLICATION:
NAME: Jay Young
ADDRESS: 15669 Birkdale Comm. Pkwy
CITY: Huntersville
STATE: N.C. ZIP: 28078
PHONE: 704-947-7630
ALTERNATE PHONE: 704-363-0759

PROPERTY OWNER:
NAME: Jason Young
ADDRESS: 5010 Tracewood Ct.
CITY: Char.
STATE: N.C. ZIP: 28215
PHONE: 704-947-7630
ALTERNATE PHONE:

JOB LOCATION INFORMATION
TAX/PARCEL #: 111321 22
STREET ADDRESS: 5010 Tracewood Ct.
CITY: Charlotte
STATE: NC ZIP: 28215
SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #:

TOWNSHIP:
- [x] 0-MECKLENBURG
- [ ] 1-CHARLOTTE
- [ ] 2-DAVIDSON
- [ ] 3-CORNELIUS
- [ ] 4-PINEVILLE
- [ ] 5-MATTHEWS
- [ ] 6-HUNTERSVILLE
- [ ] 7-MINT HILL

WATER SUPPLY:
- [ ] MUNICIPAL (M)
- [ ] COMMUNITY (C)
- [x] PRIVATE WELL (P)
- [ ] SHARED WELL (S)
- [ ] OTHER 'SPRINGS' (O)

RESIDENTIAL PROPERTY TYPE:
- [x] HOUSE (H)
- [ ] MODULAR HOME (M)
- [ ] MULTIPLE FAMILY (U)
- [ ] SINGLE MOBILE HOME (S)
- [ ] DOUBLE WIDE (D)
- [ ] OTHER (O)

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 3

COMMERCIAL / INDUSTRIAL PROPERTY TYPE:
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ☐ YES ☐ NO
UNDERGROUND STORAGE TANKS? ☐ YES ☐ NO

ADDITION TYPE ATTACHED TO EXISTING STRUCTURE:
- [x] BEDROOM
- [ ] BATHROOM
- [ ] KITCHEN
- [ ] DINING ROOM
- [ ] LIVING ROOM
- [ ] DEN
- [ ] GARAGE
- [ ] SUNROOM
- [ ] PORCH
- [ ] DECK
- [ ] OTHER

ADDITION TYPE DETACHED FROM EXISTING STRUCTURE:
- [ ] DETACHED GARAGE
- [ ] DETACHED GARAGE WITH PLUMBING
- [ ] POOL HOUSE
- [ ] SHOP
- [ ] BARN
- [ ] STORAGE SHED
- [ ] DETACHED PORCH / DECK
- [ ] OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature — Date: 7-13-10

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted y this Department.
- This permit is not transferable.

- [ ] ADDITION / RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE
- [ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE


EHS Signature — Date

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File # 33324
Date _____

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

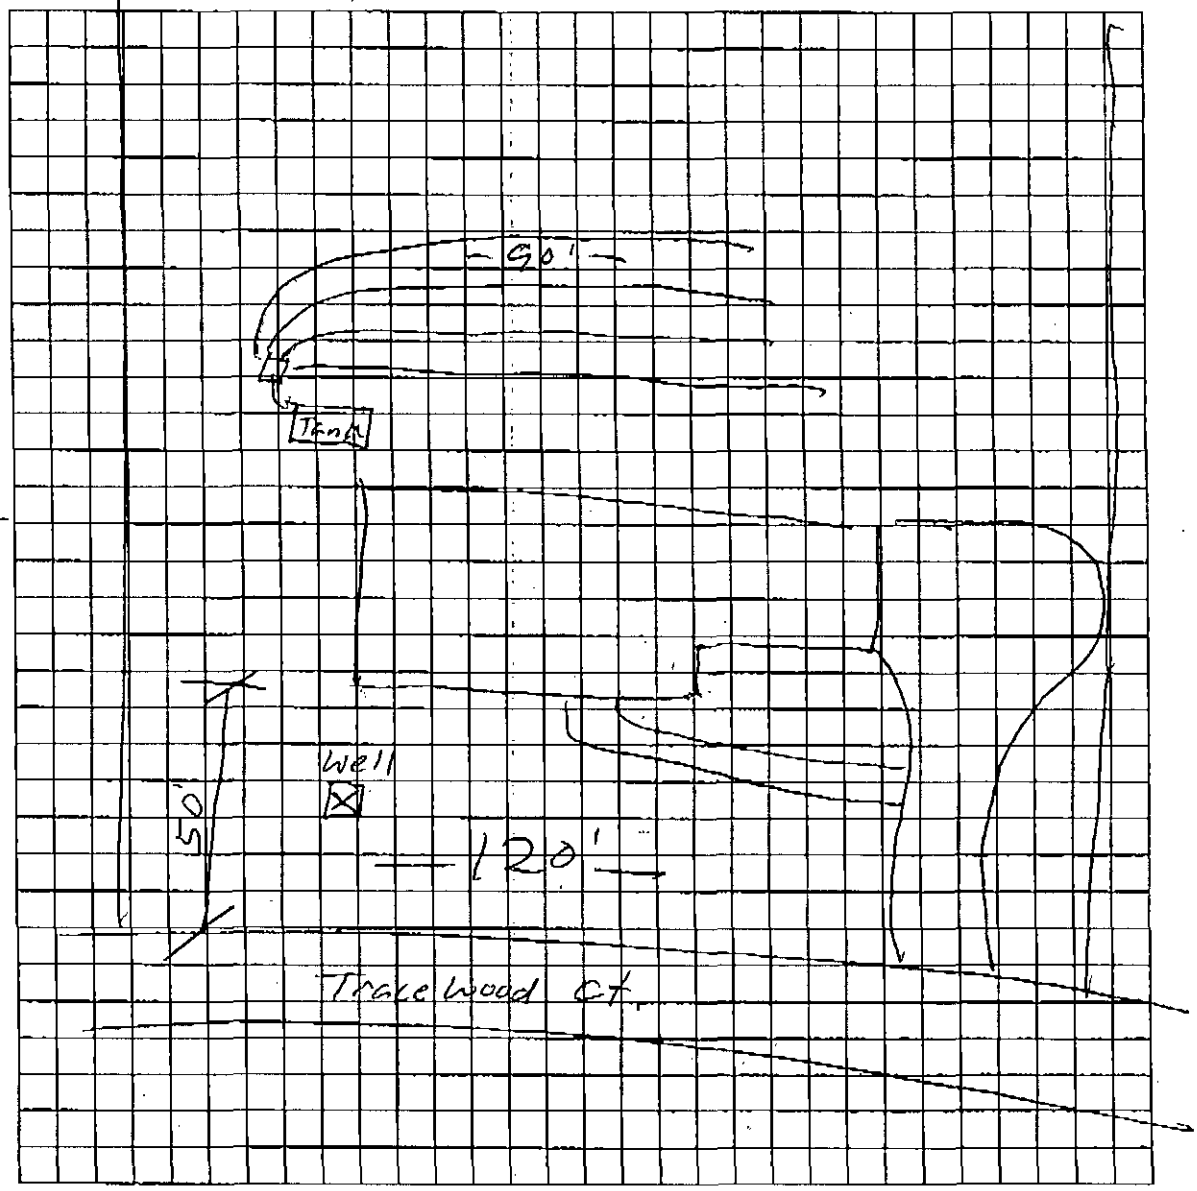

Owner/Agent Signature	Sag Young
Date	7-13-10

LBC 12/15/04

MECKLENBURG COUNTY

Land Use & Environmental Services Agency
Groundwater & Wastewater Services

July 19, 2010

Jason Young
15669 BirkdaleCommons Pkwy
Huntersville, NC 28078

Re: Application for approval to use an existing on-site wastewater treatment & disposal system.
Property Location: 5010 Tracewood Ct.
Health Department file number: **3332A**

Dear Property Owner or Owner's Agent:

On July 19, 2010 the Mecklenburg County Health Department, Groundwater & Wastewater Services Section, evaluated the above-referenced property to determine if approval to use an existing on-site wastewater treatment & disposal system could be granted for your proposed project. This evaluation was done in accordance with the laws and rules governing wastewater systems in North Carolina General Statute 130A-333 and related statutes, Title 15A, Subchapter 18A, of the North Carolina Administrative Code, Rule .1900 and related rules, and the Mecklenburg County Groundwater Well Regulations.

Based on the information provided in the application, dated July 15, 2010, and findings from the site evaluation conducted by our office, your request for approval to use an existing on-site wastewater treatment & disposal system is **not** being granted. This decision is based on the following conditions that were identified during the site visit:

- ☐ The existing on-site wastewater treatment & disposal system was not functioning properly at the time the site evaluation was conducted.
- ☐ The proposed plans do not meet the required setbacks for the on-site wastewater treatment & disposal system serving the property.
- ☐ The proposed plans do not meet the required setbacks for the reserved repair area for an on-site wastewater treatment & disposal system.
- ☐ The proposed plans do not meet the required setbacks for water supply wells.
- ☒ The proposed project will exceed the permitted daily design flow for the existing on-site wastewater treatment & disposal system. System alteration will be required in order to accommodate your proposed project.

If you need any additional information or assistance please contact our office at (704) 336-5103.

Sincerely,

Jeremy Michael

Jeremy Michael
Environmental Specialist

Encl: (1) Application