

12006 RAMAH CHURCH RD

01926406

12/19/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 1059B(7031A DATE: 8/20/93

TC: 019 262 06 ☐ L ☐ CRT

SERIAL Nº 15345

Name of Owner Sam Duncan Juris.:

Address of Property 12006 Ramah Church Rd

Inspection Data:

Tank Material PCC

Total Length of Drainfield 268 + 135

Number of Lines 4+2 @ 67'+20'

Cover Depth 12"

Water Supply Source well

Distance to Water Source 750'

Excavation Inspected 8/20/93

Tank(s) Inspected 8/20/93

Wash Line Inspected 8/20/93

High Water Alarm Inspected —

Design: 1993, Repair

This one has 2 file #

1122B/1094A Also

The undersigned has inspected the
☒ installed or constructed
☒ in accordance with the peri
and meets the provisions of 10 NCA
And Disposal" in effect on the date
☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS: Septic System replaced. Old system to remain and used as backup.

Philo S. Walker R. S.
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603


// 10598/9031A

FILE: ~~H22B/9094A~~ DATE: 7/19/93

TC: 019-262-06 L 24.8

SERIAL Nº 14419

Permission is hereby given to ____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 6/29/93. All work shall be completed on or before 8/19/93, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

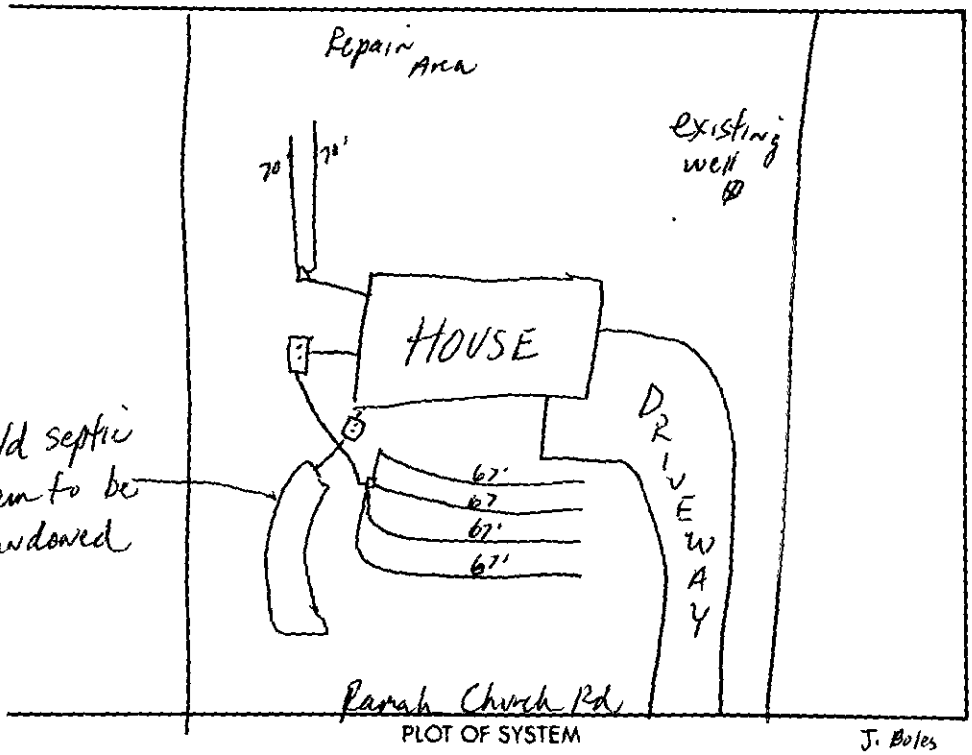

PLOT OF SYSTEM J. Boles

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction Pcc

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length wc 2 + 4 SL / 135 + 268 feet

Number of Lines 2 + 4 70' + 67'

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well >50 feet

NAME OF OWNER Sam Duncan

LOCATION OF PROPERTY 12006 Ramah Church Rd

Comments: Washer 2 lines x 70' long x 3' wd x 12" stone | septic 4 lines x 67' long x 3' wd x 12" stone | Old septic system to be abandoned (Too deep in ground)

Philo S. Walker R.S.

Division or Section Head — Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

105B 9031A

~~H228~~ / ~~9044A~~

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

Repair

[] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:
NAME: Duncan (last) Sam (first) 664-5606 (mi)
ADDRESS: / PHONE: (__) _____
CITY: STATE: ZIPCODE:

Date:

PROPERTY OWNER:
NAME: Dishman (last) H E (first) (mi)
ADDRESS: 12006 Ramah Church Rd PHONE: (__) _____
CITY: Huntersville STATE: NC ZIPCODE:

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 019-262-06
STREET ADDRESS: 12006 Ramah Ch Rd
ZONING:

Township (check one):
[] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [X] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: LOT SIZE (in acres):

TYPE APPLICATION (check one):

[] SOIL TEST - INDIVIDUAL LOT (D)
[] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] SOIL TEST DEVELOPMENT (P)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[X] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [] HOUSE (H) [] MULTIPLE FAMILY (U)
[X] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of procesaing this request.

Signed: Date: 6/29/93

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...


[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

P.S Walker 6/29/93
Environmentalist Date

Director or Authorized Section Head Date

WWATER : 122791

met Julian Boles (contractor)
on property 6/29/93

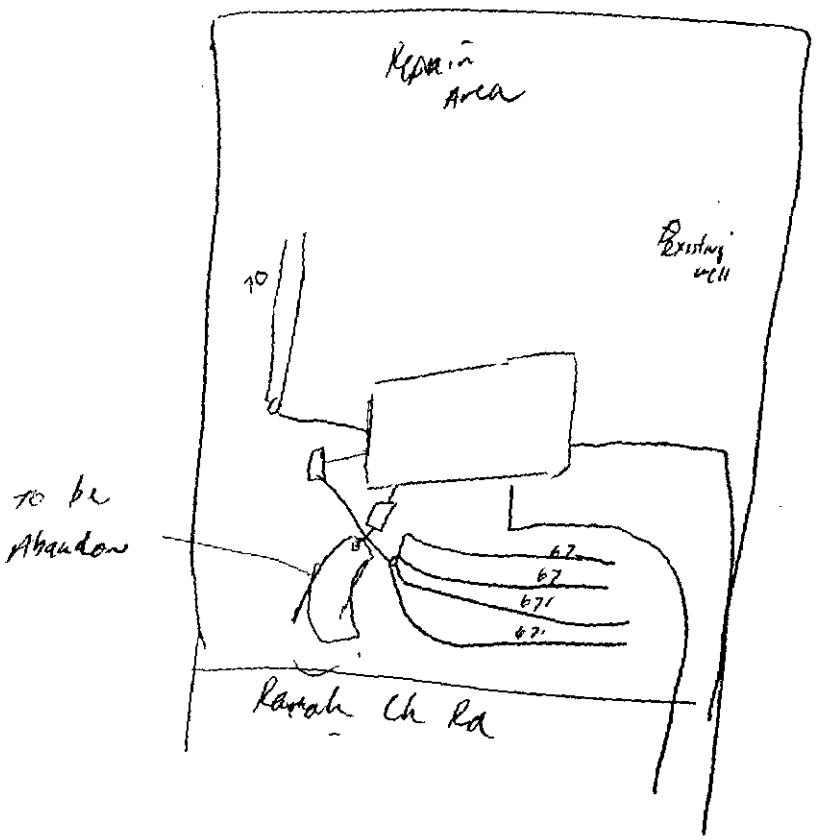

1500 ST
Abandon old septic System
Septic 4 lines x 67' long x 12" stone
Erosion 2 lines x 70' long x 0" stone

Sam Duncan
P.O. Box 1453
Mooresville, NC
28115

Repair

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

10590/903A

[] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date:

PERSON FILING APPLICATION:

NAME: Duncan Jr. (last) Samuel (first) Henry (mi)

ADDRESS: P.O. Box 1453 PHONE: (704) 664-5606

CITY: Mooresville STATE: N.C ZIPCODE: 28115-1453

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 019-262-06

STREET ADDRESS: 12006 Ramah CH. Rd.

ZONING:

PROPERTY OWNER:

NAME: Duncan (last) Brenda (first) D. (mi)

ADDRESS: Rt. 5, Box 466A PHONE: (704) 663-1277

CITY: Mooresville STATE: N.C ZIPCODE: 28115

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [✓] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres):

[] SOIL TEST - INDIVIDUAL LOT (D)
[] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] SOIL TEST DEVELOPMENT (P)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[X] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[X] SINGLE MOBILE HOME (S) [] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS: 1

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[✓] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Date:

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date

Director or Authorized Section Head Date

WATER : 122791

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 1059B (9031A) DATE: 7/19/93

TC: 019 262 06 ☐ L

SERIAL NO 14419

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated _____. All work shall be completed on or before 7/19/94, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

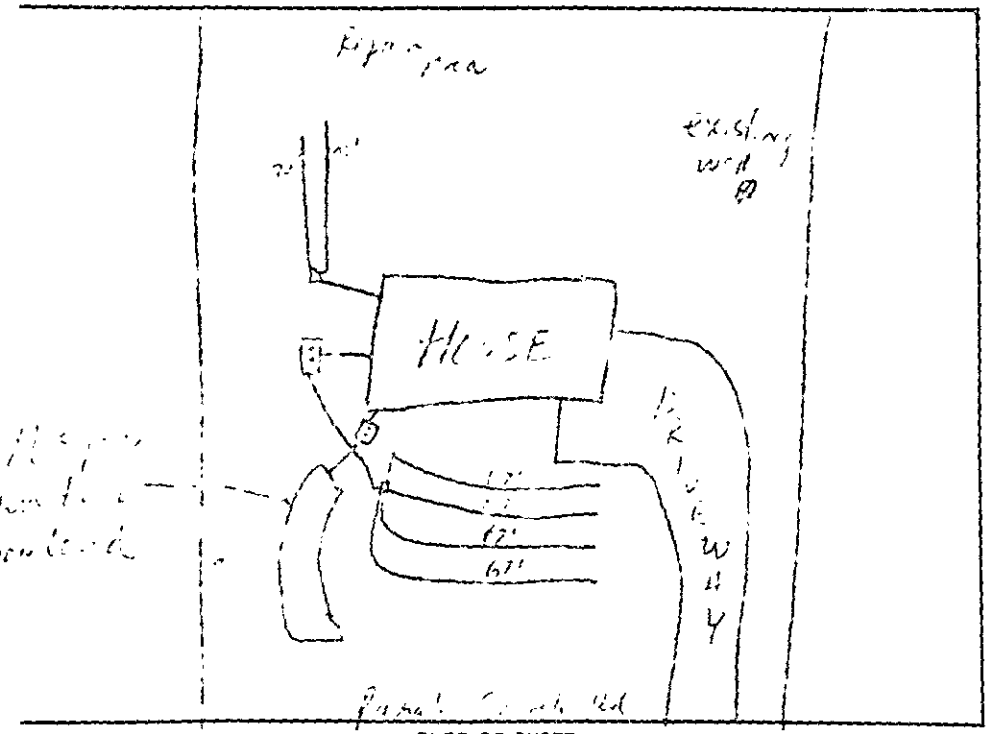

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank - gallons

Tank Construction Pec

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 2 + 4 sc. 135 + 268 feet

Number of Lines 2 + 4 TC 7

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well >50 feet

NAME OF OWNER Sam Pearson

LOCATION OF PROPERTY [illegible] Pond Creek Rd

Comments: [illegible]

Division or Section Head

Environmentalist

[illegible] installation or construction of a new system, it must be signed by the division or a section head of the [illegible] County. The signature of the environmentalist is required where an existing system is being [illegible]