Date Received 1/2/80

RECEIVED
JAN 7 1980

ICAN(S) Application No. 7040

T. C. No. 055-341-07


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to

1) Install or Construct 2 X Alter or Repair an individual septic tank wastewater treatment system with a subsurface soil absorption, effluent discharge

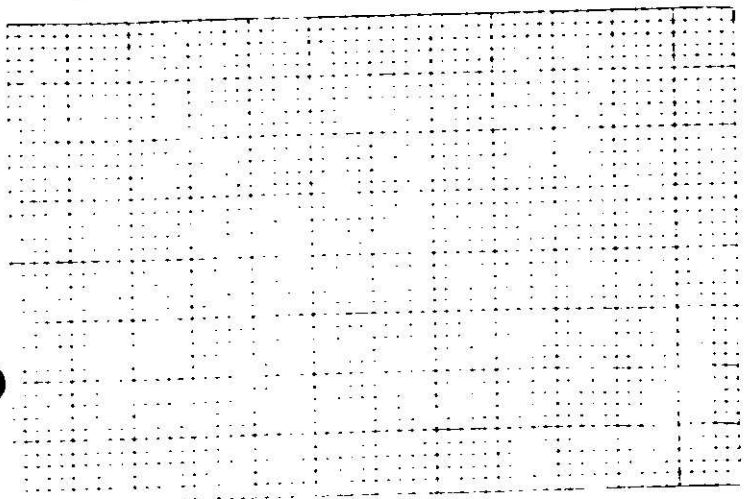

3 PLOT PLAN ACCURATELY DIMENSIONED

Mobile Home ___Yes___No
Residence X Yes ___No
4 No of Bedrooms 2
5 Business Use - Max No Employees ___
6 Washing Machine ___Yes X No
Garbage Disposal ___Yes X No
7 Dishwasher ___Yes X No
8 Water Supply
A Individual Well X
B Governments System ___
C Community System
1 Well source ___
2 Governments source ___
9 Sewage System
If public sewer is within 200 feet of property ___Yes X No
If public sewer is located within 200 feet of property ___Yes X No
11 EHA Case No ___
12 VA Case No ___

13) NAME OF OWNER WILSON (LAST) MARGARET (FIRST) EVELYN (MIDDLE)

14) ADDRESS OF OWNER 6616 TUCKASEEGEE ROAD 28214

15) PHONE NO Home 399-6434 Office ___

16) LOCATION OF SYSTEM 6616 TUCKASEEGEE ROAD (STREET OR COUNTY ROAD)

17 SUBDIVISION ___ Lot No ___ Block No. ___

Map Book No ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19 HAS A SOIL INVESTIGATION BEEN RUN? YES X NO DATE RUN ___

20 PTR NUMBER (See Instructions ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

1-4-80
DATE OF APPLICATION

Margaret Evelyn Wilson
OWNER

EHD-5-74

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY


Date Issued 1-15-80 Serial 3490 ICAR(S) Permit No. 7040

T. C. M. 55-344-07

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 7040, dated 1-7-80 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 2-15-80 after which date this permit shall be null and void.

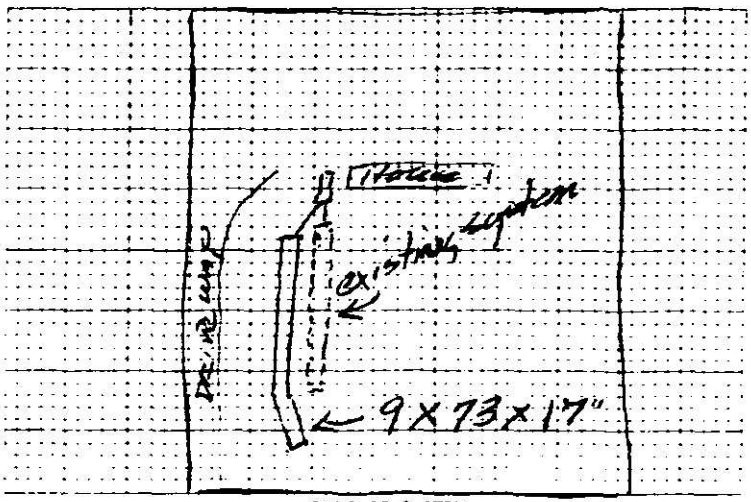

PLOT OF SYSTEM

Permeability Rate: 8/5

Liquid Capacity of Tank: Existing

Tank Construction: Existing

Absorption Area or Application Rate:

Total Line Length: 220'

Number of Lines: 3

Distance from House: 10'+

Distance from Property Line: 10'+

Distance from Well: 50+

NAME OF OWNER: MARGARET EVELYN ALLISON

LOCATION OF PROPERTY: 6816 Tuckaseegee Rd

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning controlling or using such system from any liability resulting from the failure of the system to operate properly.

old field completely bricked up - installing 220 (new field) for 2-Bedroom House.

Division or Section Head

Marshall Edwards
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

C of A (s) No. 7040

Serial 3381

Date Issued 1-16-80

T C065-344-07

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Wilson (LAST) Margaret (FIRST) Evelyn (MIDDLE)

Location of Property 6814 Tuckaseegee Rd

Application Number 7040 Permit Number 7040

Inspection Date:

Liquid Capacity of Tank Existing Tank Material Existing

Total Length of Drain Tile 220' Number of Lines 3

Depth of Filter Material 17" Cover Depth 24"

Water Suppl. Source Well Distance from Water Source 50'+

Excavation Inspected 1-16-80 (DATE) Tank Inspected ~~N/A~~ 1-16-80 (DATE) Pumped

Nitrification Field Inspected 1-16-80 (DATE)

Washing Machine Drain Inspected If Applicable N.A (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface soil absorption effluent discharge as described above and it has been ✓ installed or constructed altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown in the permit in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments

Marshall Edwards
Environmentalist

EHD-5-76

Environmental Health Department's Copy

Serial 3476

ICAR(S) Permit No. 7070


Date Issued 12-12-79

T C No

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, Alter or Repair the individual septic tank waste water treatment system with subsurface soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application _____, dated _____ and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before _____, after which date this permit shall be null and void

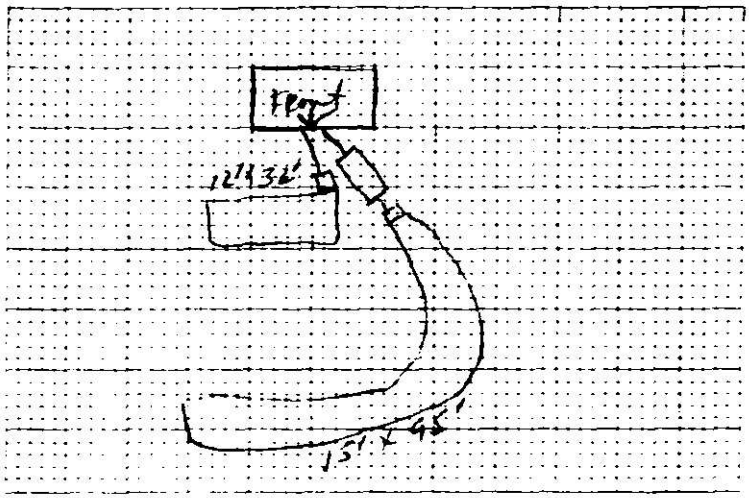

PLOT OF SYSTEM

Permeability Rate P.S.

Liquid Capacity of Tank 1500 Gal

Tank Construction P.C.

Absorption and/or Nitrification Line

Total Line Length 491'+125'

Number of Lines 5'+4

Distance from House 10'

Distance from Property Line 10'

Distance from Well 50'+

NAME OF OWNER Eddie Hodges

LOCATION OF PROPERTY Ellenmore Dr.

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning controlling or using such system from any liability resulting from the failure of the system to operate properly.

151' x 95' x 17" Stone Septic System

12' x 32' Washing Machine

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

C of A (s) No. 7070

Date Issued 12-19-75 **Serial** 3346 T C No.

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Hodges (LAST) Eddie (FIRST) (MIDDLE)

Location of Property Clemmons Rd.

Application Number 7626 Permit Number 7626

Inspection Data:

Liquid Capacity of Tank 1500 gal Tank Material C.C.

Total Length of Drain Tile 495+125 Number of Lines 5 + 4

Depth of Filter Material 12" Cover Depth 15"

Water Supply Source Well Distance from Water Source 50'

Excavation Inspected 12-19-75 (DATE) Tank Inspected 12-19-75 (DATE)

Nitrification Field Inspected 12-19-75 (DATE)

Washing Machine Line Inspected If Applicable 12-19-75 (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface soil absorption of effluent discharge as described above and it has been ✓ installed or constructed altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permits in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments

Environmentalist

EHD-5-76

Environmental Health Department's Copy