

1908 POPLARCREST LN

05318102

5/20/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

2080

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: ~~6246~~ B WASPS App #: 3506

Primary ES assigned to project: C Sherill

Secondary ES assigned to project: _____

Project Type: New System ☐ Alteration ☐ Repair ☐ Modified Plot Plan ☐ YES ✓

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☐
.1945(b) 130A-336 (a)(3)	Proposed System Type stated-Repair System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: _____

OP issued date: _____

Review performed by: Mike Walker RS Date performed: 5/19/08

C AP#04527

FEE: 100.00
DATE: 5/12/08
CRT [ ]

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM
MECKLENBURG COUNTY - GROUNDWATER & WASTEWATER SERVICES
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894 3506

GWS – UES.APP 06/07

FILE #: 2080

TYPE APPLCATION: CS

- ☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A / M)
- ☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
- ☒ ADDITION - RENOVATION OR GARAGE WITH NO MAJOR CHANGES (X)
- ☐ COMMERCIAL OR INDUSTRIAL (N)

PERSON FILING APPLICATION:
NAME: Yvette Tripney
ADDRESS: 1908 Poplarcrest Ln.
CITY: Charlotte NC 28214
STATE: NC ZIP: 28214
PHONE: 980-722-2735
ALTERNATE PHONE: (704) 401-6250 Jamie

PROPERTY OWNER:
NAME: Yvette - Jamie Tripney
ADDRESS: 1908 Poplarcrest Ln
CITY: Charlotte
STATE: NC ZIP: 28214
PHONE: 980-722-2735
ALTERNATE PHONE: (704) 401-6250

JOB LOCATION INFORMATION
TAX/PARCEL #: 053-181-02
STREET ADDRESS: 1908 Poplarcrest Ln.
CITY: Charlotte
STATE: NC ZIP: 28214
SUBDIVISION OR MOBILE HOME PARK NAME: Westwood Forest
LOT #: 81, 82

TOWNSHIP:
- ☒ 0-MECKLENBURG
- ☐ 1-CHARLOTTE
- ☐ 2-DAVIDSON
- ☐ 3-CORNELIUS
- ☐ 4-PINEVILLE
- ☐ 5-MATTHEWS
- ☐ 6-HUNTERSVILLE
- ☐ 7-MINT HILL

WATER SUPPLY:
☐ MUNICIPAL (M) ☐ COMMUNITY (C) ☐ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

RESIDENTIAL PROPERTY TYPE:
- ☐ HOUSE (H)
- ☐ MODULAR HOME (M)
- ☐ MULTIPLE FAMILY (U)
- ☒ SINGLE MOBILE HOME (S)
- ☐ DOUBLE WIDE (D)
- ☐ OTHER (O)

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 2
NUMBER OF OCCUPANTS: 4

COMMERCIAL / INDUSTRIAL PROPERTY TYPE:
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ☐ YES ☐ NO
UNDERGROUND STORAGE TANKS? ☐ YES ☐ NO

ADDITION TYPE ATTACHED TO EXISTING STRUCTURE:
- ☐ BEDROOM
- ☐ BATHROOM
- ☐ KITCHEN
- ☐ DINING ROOM
- ☐ LIVING ROOM
- ☐ DEN
- ☐ GARAGE
- ☐ SUNROOM
- ☒ PORCH
- ☐ DECK with roof
- ☐ OTHER

ADDITION TYPE DETACHED FROM EXISTING STRUCTURE:
- ☐ DETACHED GARAGE
- ☐ DETACHED GARAGE WITH PLUMBING
- ☐ POOL HOUSE
- ☐ SHOP
- ☐ BARN
- ☐ STORAGE SHED
- ☐ DETACHED PORCH / DECK
- ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature — Date: 5.12.08

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted y this Department.
- This permit is not transferable.

☐ ADDITION / RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE

OK TO USE EXISTING SYSTEM


EHS Signature — Date: 5/15/08

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File # 2080
Date_____

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

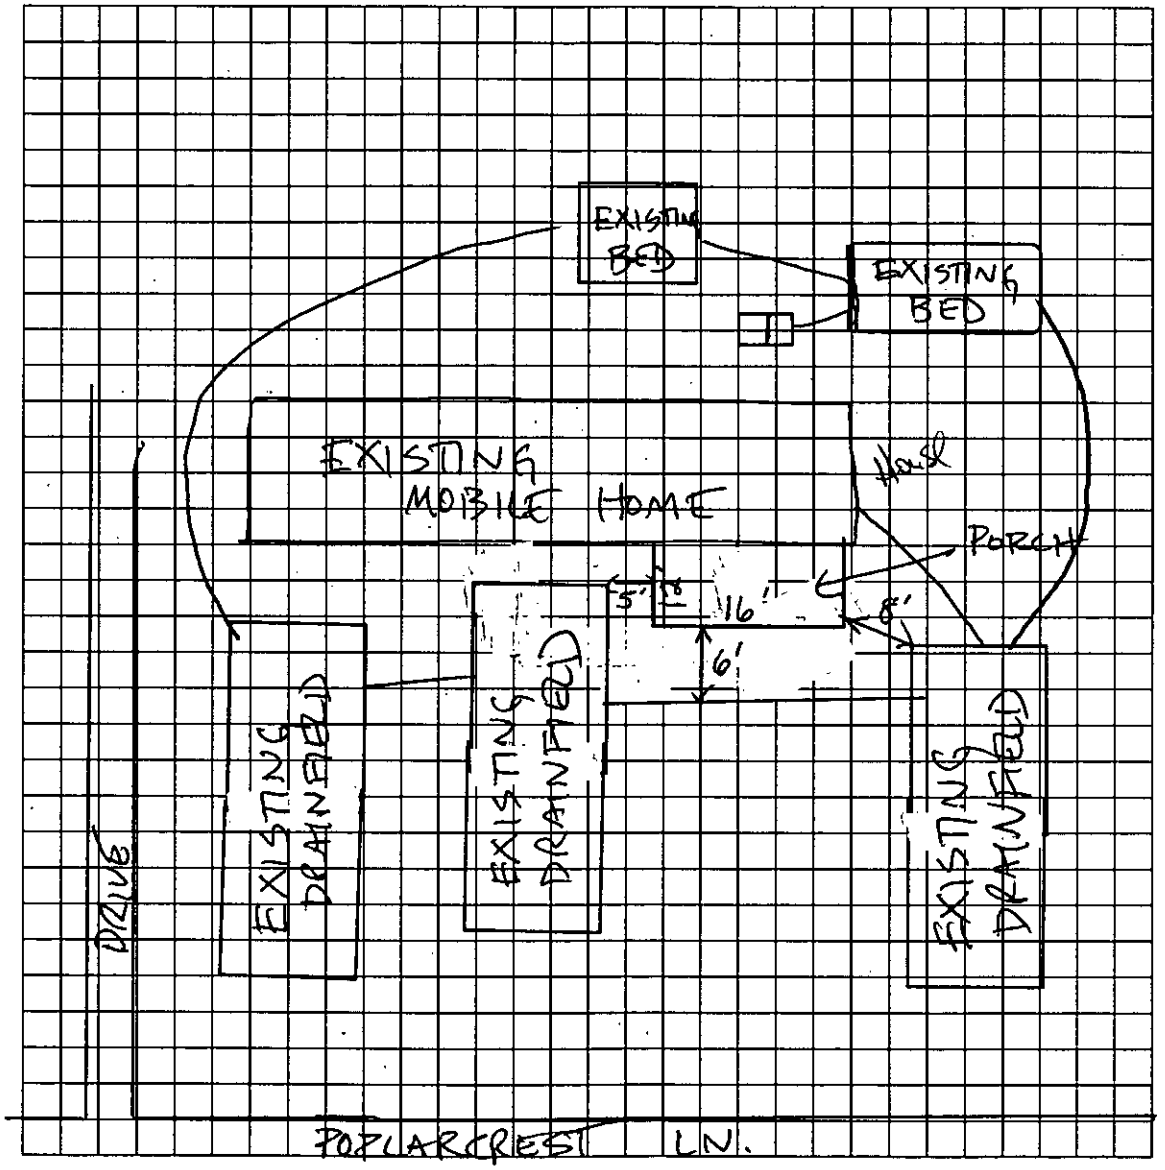

Owner/Agent Signature
Date

LBC 12/15/04

FEE: _____

DATE: _____

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION/ ALTERATION OF EXISTING SYSTEM X REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 2080

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 053-181-02

STREET ADDRESS: 1908 Poplarcrest Ln.

SUBDIVISION OR MOBILE HOME PARK NAME: Westwood Forest

LOT NUMBER: 81 OD < 1990

TYPE OF BUILDING (CHECK ONE):

- ✓ SINGLE MOBILE HOME(S)
- ___ DOUBLE WIDE (D)
- ___ HOUSE (H)
- ___ MODULAR HOME (M)
- ___ MULTIPLE FAMILY (U)
- ___ OTHER (O)

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS: 2 NUMBER OF OCCUPANTS: 4

FOUNDATION FOR RESIDENCE:

- ___ WITHOUT BASEMENT ON SLAB
- X CRAWL SPACE
- ___ WITH BASEMENT /PLUMBING
- ___ WITH BASEMENT /NO PLUMBING

TOWNSHIP (CHECK ONE):

- ✓ 0 MECKLENBURG
- ___ 1 CHARLOTTE
- ___ 2 DAVIDSON
- ___ 3 CORNELIUS
- ___ 4 PINEVILLE
- ___ 5 MATTHEWS
- ___ 6 HUNTERSVILLE
- ___ 7 MINT HILL

CLOSING DATE _____

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

- ✓ COMMUNITY (C)
- ___ MUNICIPAL (M)
- ___ PRIVATE WELL (P)
- ___ SHARED WELL (S)
- ___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	___ YES ✓ NO	WELL, SPRINGS OR WATERLINES	___ YES ___ NO
EXISTING WASTEWATER SYSTEMS	___ YES ___ NO	DESIGNATED WETLANDS	___ YES ___ NO
EASTMENTS OR RIGHT-OF-WAYS	___ YES ___ NO		

PROPERTY OWNER:

NAME: Triponey Jamie William
(LAST) (FIRST) (MI)

ADDRESS: 1908 Poplarcrest Ln.

CITY: Charlotte STATE: NC ZIP: 28214

DAYTIME PHONE: (704) 588-1911

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) —

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Jamie Triponey DATE: 3/08/00

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

Permit Number: 2080 Tax Number: 053-181-02

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	X No	___ Partial Basement	
Type Primary Wastewater System Type (circle one): I II III IV V VI EXISTING	___ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1	
___ Long-term acceptance rate	240 Max gallons/day wastewater flow	___ Absorption Area (sq ft)	___ Trench spacing (min. on centers)	
YES Serviced by private well	___ Gallon septic tank	___ Total trench length (ft)	___ Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)	
2 Bedrooms in residence	___ Gallon pump tank	___ Depth of stone		
Any surface waters present: NO Type;		Minimum separation distance:		
Site modifications required:				
Additional Conditions: → Repair to existing system → Install 6' x 50' x 18" stone x 6" SAND				
Repair Area System Type Type (circle one): I II III IV V VI	X Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1	
300' Absorption Area (Sq ft) 100' Total Trench Length (Ft)	18" Depth of Stone Trench 6" SAND	NA Trench spacing (min. on centers)	36" Maximum Trench Depth	
For existing system, enter the year originally installed:				

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for th Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effe at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Departme
- This Improvement permit is transferable.

Jerry L. Michaels 3/10/00
DEHNR Authorized Agent Date

Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FEE: _____ **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION**
DATE: _____ **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE**

DATE: 3/10/00 PERMIT NO: 2080
PARCEL NO: 055-181-02
JOB LOCATION ADDRESS: 1908 Poplarcrest Lane
PROPERTY OWNER: Sandie Triponey
BUILDING CONTRACTOR:
SUBDIVISION NAME: Westwood Forest
AUTHORIZATION ISSUED BY: Larry P. Michele DATE: 3/10/00
DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 2080, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED **PRIOR** TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: Repair to existing system.
Install 6' x 50' x 18" Stone x 6" Sand

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE DATE


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2080

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

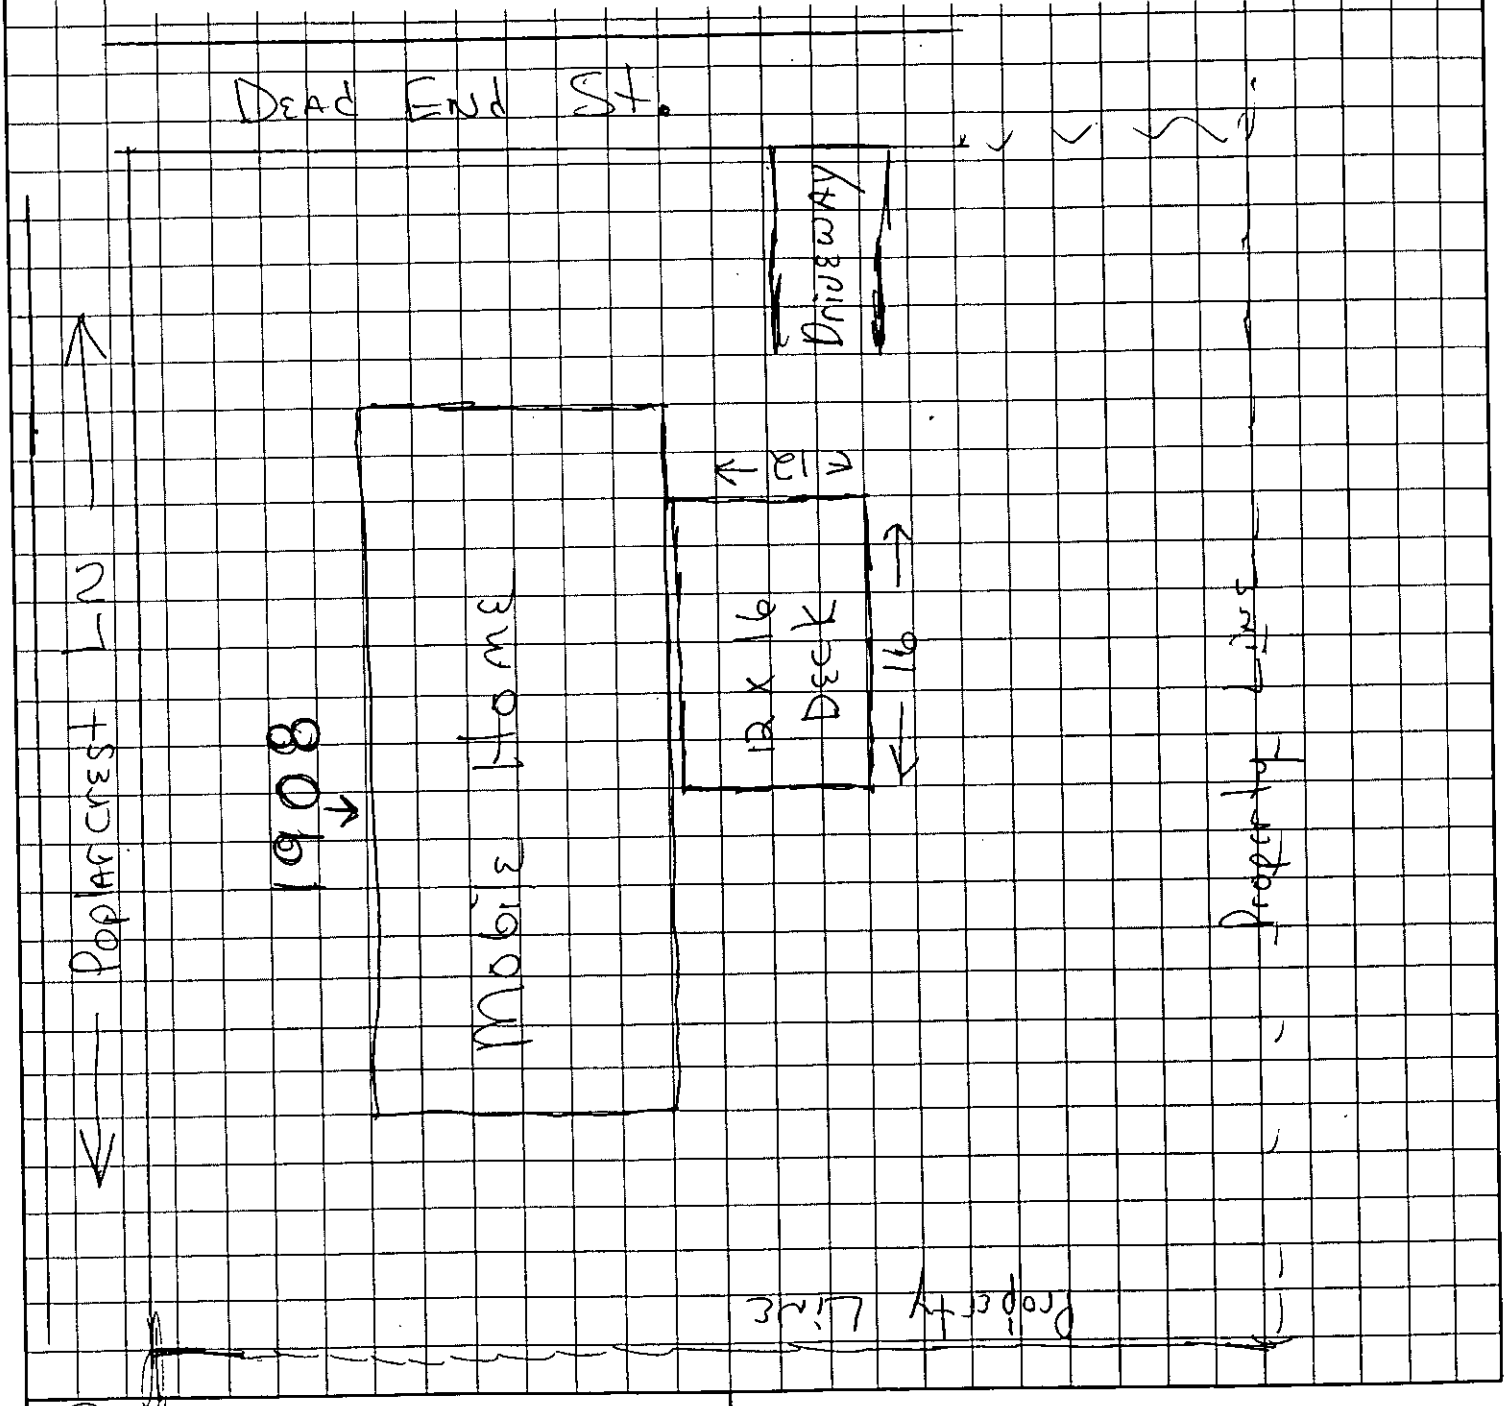

Jamie Mooney
OWNER/AGENT SIGNATURE

DATE 3/1/95

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

2080 $50.00 3/1/95 Ck. # 527 ☐ CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: Triponey (last) Jamie (first) W (mi)

ADDRESS: 1908 Poplarcrest Ln. PHONE: (704) 393-8173

CITY: Charlotte STATE: NC ZIPCODE: 28214

Date: 3/1/95

PROPERTY OWNER:

NAME: Triponey (last) Jamie (first) W (mi)

ADDRESS: 1908 Poplarcrest Ln. PHONE: (704) 393-8173

CITY: Charlotte STATE: NC ZIPCODE: 28214

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 053-181-02

STREET ADDRESS: 1908 Poplarcrest Ln

ZONING:

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
☑ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☐ 1 Charlotte ☐ 3 Cornelius ☐ 5 Mattheus ☐ 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres):

☐ SOIL TEST - INDIVIDUAL LOT (O)
☐ NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☑ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M) STORAGE RM
☐ COMMERCIAL OR INDUSTRIAL (N)
☐ SOIL TEST DEVELOPMENT (P)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☐ MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
☐ REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
☑ SINGLE MOBILE HOME (S) ☐ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 2 NUMBER OCCUPANTS: 3

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☑ Community (C) ☐ Shared Well (S)
☐ Municipal (M) ☐ Other 'spring' (O)
☐ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☐ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☑ None
☐ Garage ☐ Storage Building ☐ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Jamie Triponey Date: 3/1/95

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

☐ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date

Director or Authorized Section Head Date

WATER : 122791

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2080 DATE: 3/8/00

TC: 053-181-02 ☐ L

SERIAL Nº 18383 P

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein ~~at the described~~ location. This permit is granted based upon the information supplied in the application dated 3/8/00. All work shall be completed on or before 4/8/00, after which date this permit shall be null and void. The system shall meet all of the construction requirements of I5A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

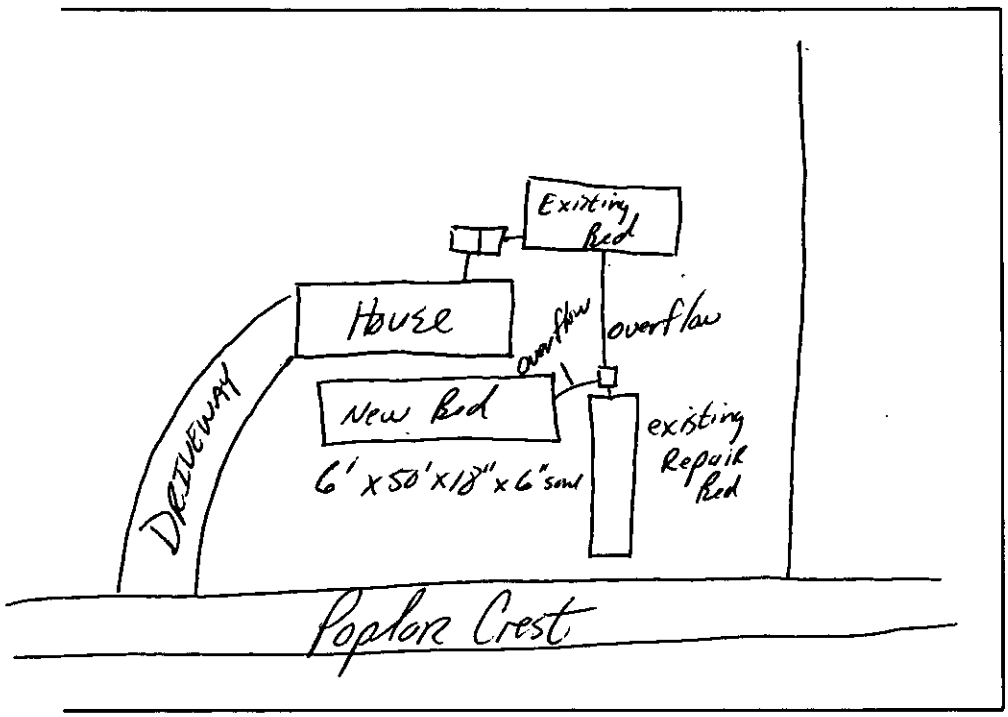

PLOT OF SYSTEM

Liquid Capacity of Septic Tank existing gallons

Liquid Capacity of Dosing Tank NA gallons

Tank Construction existing

Trench Depth 36"

Absorption and/or Nitrification Lines:

Trench Width 6' feet

Trench Walls Scored and Porous yes

Total Line Length 100' feet

Number of Lines 2 lines x 50'

Depth of Stone 18" + 6" sand inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well NA feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Jamie Tripaney

LOCATION OF PROPERTY 1908 Poplar Crest

Comments: Install 6' x 50' x 18" Stone x 6" sand with overflow

Jenny L. Nichols
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2080 DATE: 3/23/00

TC: 053-181-02 ☐ LPT ☐ CRT

SERIAL Nº 18077

Name of Owner Jamie Tripoway Juris.: _____

Address of Property 1908 Poplar Crest

Inspection Data:

Tank Material existing

Total Length of Drainfield 30'

Number of Lines 3 @ 10'

Cover Depth 24"

Water Supply Source Municipal


Distance to Water Source NA

Excavation Inspected 3/23/00

Tank(s) Inspected existing

Wash Line Inspected NA

High Water Alarm Inspected NA

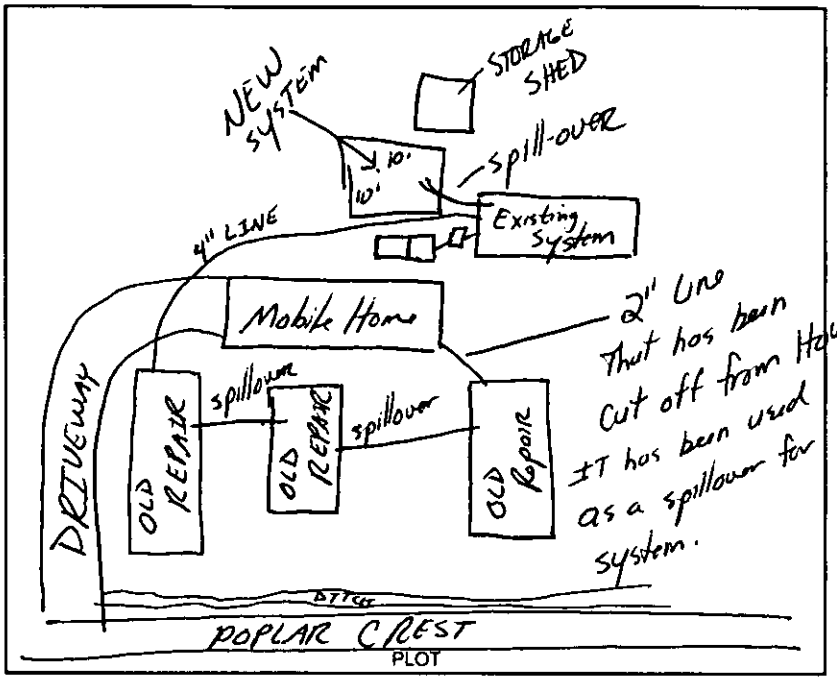

Design 2000, Repair, 10' x 10' x 48" stone Rd CTR# Dennis Joyce

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☒ altered or repaired

☐ in accordance with the permit issued ☒ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: System Repaired for 2 bedroom Mobile Home.
Type II Conventional system

Jenny P. Mickelson
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.