

Mecklenburg County Council, Boy Scouts of America

5/8/07

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 3588 A DATE: 7/7/87

TC: 99-301-15 ☐ L ☑ CRT

SERIAL № 10289

Name of Owner: Meck. County Council Boy Scouts Of America Juris.:

Address of Property: 16024 Camp Steer Rd

Repair Data:

Inspection Data:

Tank Material: /

Total Length of Drainfield: 90'

Number of Lines: 3 @ 30'

Cover Depth: 18"

Water Supply Source: Well

Distance to Water Source: 50'

Excavation Inspected: 7/7/87

Tank(s) Inspected:

Wash Line Inspected:

High Water Alarm Inspected:

Iris,
I Need A Certificate Of Hold in the occupancy.
Existing Structure to be disconnected from System— Plumbing to be removed prior to Power to new residence

PLOT

Design: 1987 Repair CTR#:

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☐ altered or repaired

☐ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☐ ~~Certificate~~ of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS:

Judy J. Kerr R.S.
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


MECKLENBURG COUNTY · ENVIRONMENTAL HEALTH ·
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 35884 DATE: 6/30/87

TC: 99-301-15 ☐ L

SERIAL Nº 10975

Permission is hereby given to ____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 6/18/87. All work shall be completed on or before 7/30/87, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Department of Environmental Health before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

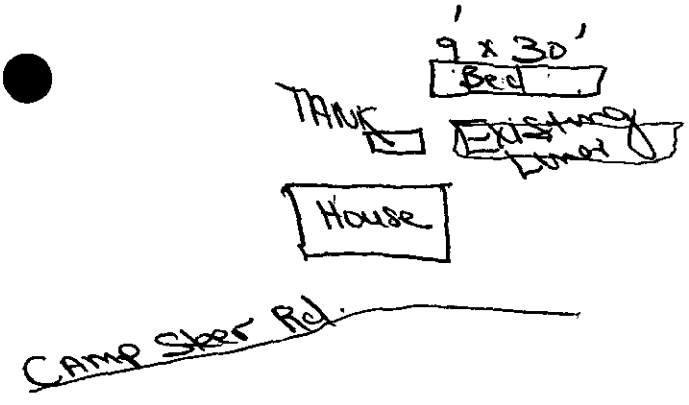

PLOT OF SYSTEM

Liquid Capacity of
Septic Tank ____ gallons

Liquid Capacity of
Dosing Tank ____ gallons

Tank Construction ____
Repair Data:
Absorption and/or Nitrification Lines:

Trench Width 9' Bed feet

Total Line Length 90' feet

Number of Lines 3

Depth of Stone 17 inches

Distance from House 10' feet

Distance from
Property Line 10'+ feet

Distance from Well 50' feet

NAME OF OWNER Meck. County Council, Boy Scouts of America

LOCATION OF PROPERTY 16024 Camp Steer Rd

Comments: Tie into Existing D-Box (or Install T - if no Box) Set New D-Box at New Bed 9' x 30', 17" Stone, 3' Centers.

Division or Section Head

Judy J. Klein R.S.
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - ENVIRONMENTAL HEALTH DEPARTMENT'S COPY ● CANARY - ENVIRONMENTALIST'S COPY ● PINK - OWNER OR AGENTS COPY

APPLICATION FOR AN IMPROVEMENT PERMIT

MECKLENBURG COUNTY · ENVIRONMENTAL HEALTH ·

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

(OFFICE USE ONLY)

FILE: 3588A

TC: 199-301-15

SERIAL: Nº 13803

☐ L. ☑ CRT

JOB LOCATION

① ADDRESS: 16024 (STREET NO.) CAMP STEER ROAD (STREET) ② FILE: _____

③ JURISDICTION: _____ ④ TAX PARCEL NO.: 199-301-15

⑤ SUBDIVISION: _____ ⑥ LOT: _____ ⑦ BLOCK: _____

OWNER

⑧ NAME: MECKLENBURG (FIRST) COUNTY COUNCIL, BOY (MIDDLE) SCOUTS OF AMERICA (LAST)

⑨ MAILING ADDRESS: 1410 EAST SEVENTH STREET

⑩ CITY: CHARLOTTE ⑪ STATE: NC ⑫ ZIP: 28204

⑬ PHONE: (WORK) 333-5471 ⑭ (HOME) N/A

REQUEST

This request is for a(n):

⑮ ☐ New permit ⑰ ☐ Authorization for mobile home exchange

⑯ ☐ Repair or alteration permit ⑱ ☒ Other (specify) TEMPORARY HOME PERMIT

DESIGN CRITERIA

System will serve:

⑲ ☒ Residence ⑳ ☐ Mobile home ㉑ ☐ Business or place of public assembly

㉒ Number of bedrooms? 3 ㉕ Type? N/A

㉓ Maximum occupancy? 3 ㉖ Maximum number of employees? N/A

㉔ Basement? ☐ yes ☒ no ㉗ Maximum number of seats? N/A

WATER SUPPLY

㉘ Water supply from (present or proposed):

A ☒ Individual well

B ☐ Municipal system

C ☐ Community well

D ☐ Community system

㉙ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH to enter onto the property for the purpose of processing this request.

Signed: _____

Date: 6/18/87

IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

. . . No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair permit is issued by this Department.

. . . This permit is not transferable, and shall become null and void 36 months from the date of issuance. May use existing system for new structure. Existing structure to be disconnected from system.

_____ 7/7/87
Environmentalist Date

_____ 7/9/87
Director or Authorized Section Head Date

*This permit must be signed by the Director of Environmental Health or an authorized section head in order to be valid.


PROPOSED PLOT PLAN

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 3588A

TC: 199-301-15

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

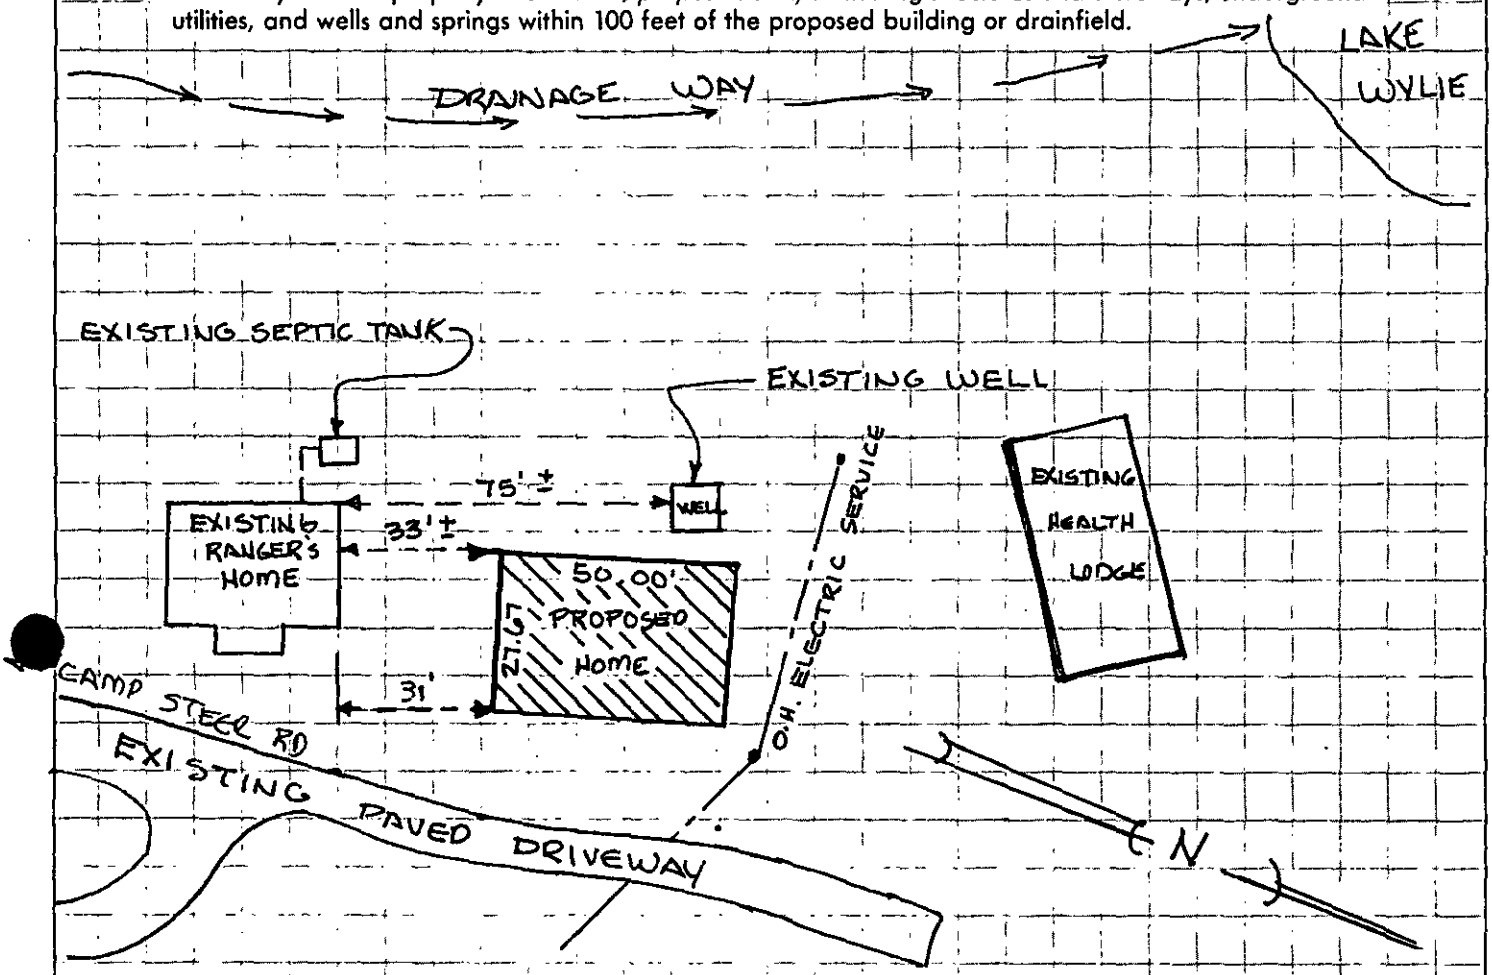

APPROXIMATE SCALE 1" = 40'

NOTE TO ENVIRONMENTALIST: REQUEST IS FOR PERMISSION TO INSTALL TEMPORARY HOME FOR A PERIOD OF 6 MONTHS. EXISTING HOME WILL BE VACATED. WATER AND SEWER HOOKUPS TO BE PROVIDED FROM EXISTING HOME.

Signed: Paul Moore Scout Executive

Date: 6/18/87