3993

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

APPLICATION FOR A COMMERCIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. **SEPTIC / TYPE APPLICATION:** ☐ N/A ☒ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ☐ N/A ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. **JOB LOCATION INFORMATION:**
TAX PARCEL NUMBER: 019-151-13
STREET ADDRESS: 13123 Alexanderana Road
CITY: Huntersville, NC 28078
STATE: NC ZIP:
LOT #: LOT SIZE (acres):
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☒ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☐ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. **BUILDING INFORMATION:**
DESCRIBE TYPE OF BUSINESS: _____
☒ COMMERCIAL DAY CARE ☐ INDUSTRIAL
SQUARE FOOTAGE OF FACILITY: 1127
NUMBER OF EMPLOYEES PER SHIFT: 2
NUMBER OF SHIFTS: 1 NUMBER OF ~~SEATS~~: 25
TYPE OF WASTEWATER GENERATED: CHILDREN
☒ DOMESTIC SEWAGE ☐ INDUSTRIAL WASTEWATER
☐ OTHER _____

5. ***IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM, INFORMATION DOCUMENTING THE INCREASED WASTEWATER FLOW AND/OR A JUSTIFICATION FOR SYSTEM ALTERATION IS REQUIRED.***

6. **WATER SUPPLY:** ☒ MUNICIPAL ☐ PRIVATE WELL ☐ PUBLIC WELL ☐ SHARED WELL ☐ OTHER _____

7. **PROPOSED USE OF WELL:** ☐ N/A ☐ IRRIGATION ☐ POTABLE (DRINKING WATER) ☐ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED)*:
☐ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. **RANK:** ____ ____ ____ ____ ____

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	☒ YES ☐ NO		GRADING/SOIL REMOVAL PERFORMED	☐ YES ☒ NO	
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☒ YES ☐ NO		*JURISDICTIONAL WETLANDS*	☐ YES ☒ NO	
WELLS, SPRINGS, OR WATER LINES	☒ YES ☐ NO		APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES ☐ NO ?	
EASEMENTS OR RIGHT-OF-WAYS	☒ YES ☐ NO		WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES ☒ NO	
CHEMICAL/PETROLEUM STORAGE TANKS	☐ YES ☒ NO		KNOWN UNDERGROUND CONTAMINATION	☐ YES ☒ NO	
WASTE STORAGE	☐ YES ☒ NO		GROUNDWATER USE RESTRICTIONS/VARIANCES	☐ YES ☒ NO	

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____ ☒ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☐ N/A

12. **PROPERTY OWNER:**
NAME: ~~East~~ News Hower Church
ADDRESS: 13123 Alexanderana Road
CITY:
STATE: Huntersville, NC 28078
HOME PHONE:
WORK PHONE: 704-992-6799
MOBILE PHONE:
FAX: 704-890-7492

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**
NAME: Clary Architecture PLLC
ADDRESS: 4730 Park Road
CITY:
STATE: Charlotte NC 28209 ZIP:
HOME PHONE:
WORK PHONE: 704-527-5123
MOBILE PHONE: 704-533-0772
FAX: 704-527-1426

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 7/1/08

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

MRC (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below.

Property Owner's or Owner's Legal Representative Signature

Nov 25, 2008
Date

OFFICE USE ONLY

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEES RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEES RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 7/1/08

PLANTATION PIPE LINE COMPANY
2740 South New Hope Road
Gastonia, NC 28056-8318

704-833-1007

CONTROL NUMBER	NUMERICAL FILE NUMBER	PLANTATION R/W REFERENCE

REQUEST FOR PERMIT TO CROSS RIGHT OF WAY AND FACILITIES OF PLANTATION PIPE LINE COMPANY

The Good News House hereby requests a permit to cross the right of way
(Name of Applicant)

and interstate pipeline facilities of Plantation Pipe Line Company (Plantation), a Delaware and Virginia Corporation,

with Septic lines to serve a Septic Tank
(Size and Type of Installation) Name of Subdivision or other Geographic Area

in Huntersville NC .
(County/Parish) (State) If said permit is granted, applicant agrees its foreign line(s) or road(s) will be installed pursuant to the following specifications, unless it is installed on existing highway right of way or specific written waivers are granted by Plantation:

SPECIFICATIONS OF ALL CROSSINGS

1. Applicant, or its agent, will give a representative of Plantation's Gastonia Maintenance Office, telephone number 704-833-1007, 48-hours' notice of the day on which the crossing(s) will be made, in order that arrangements can be made for necessary representatives of Plantation to be present. Plantation's representative will establish the width of the pipeline confinement strip.

2. Applicant shall investigate, defend, indemnify, and hold Plantation, its officers, employees, agents, servants and representatives, harmless from all claims, loss, liability, attorney fees, cost and expense, including death, personal injury, and property damage occurring to applicant or its Contractor, or its subcontractors or Plantation, their respective officers, employees, agents, servants, and representatives, or to third parties which arise out of or in connection with, or by reason of, performance of the work herein contemplated or the existence of said installations, thereafter, including those claims which are alleged to have been caused from Plantation's sole or concurrent negligence, but which arise out of, or in connection with, or by reasons of, performance of the work development herein contemplated or the existence of said installations thereafter.

3. It is further understood and agreed between Applicant and Plantation:

   A. That Plantation does not, by consenting to the proposed installation of this underground facility across its pipeline confinement strip and its facilities, assume any responsibility for the protection of its pipeline(s). Furthermore, all work performed in connection with these installations will be without expense, risk, or liability to Plantation or any of its directors, officers, agents, representatives, or employees.

   B. That Plantation will make every reasonable effort to avoid damage to the applicants installation that may be permitted pursuant to this permit for the purpose of exercising its easement rights. Plantation will attempt to notify the applicant, except in cases of an emergency nature, prior to interruption of service. Plantation will accept no liability for restoring the installation or for the interruption of service in the use of said installation.

   C. That except to the extent made necessary by the construction and maintenance of such permitted to applicant shall not interfere with or supersede the rights of Plantation under its easements.

SPECIFICATIONS FOR ROAD CROSSINGS

1. Private residential driveway(s) shall cross as nearly as possible at right angles to Plantation's line(s). The existing cover will be maintained over the line(s) at all points including side ditches, after construction is completed. If cutting is permitted, a minimum of 48 inches of cover shall remain. Any fill added over Plantation's right-of-way of way must have specific prior Plantation approval in each case. The private residential driveway surface shall be of asphalt or concrete but designed in a manner that sections can be readily and easily removed with light, common excavating equipment, unless state, county or municipal specifications require concrete curbs and gutters.

SPECIFICATIONS FOR UTILITY CROSSINGS

1. No excavating machinery will be operated upon Plantation's confinement strip until Plantation's representative is present at the crossing site, and further, no mechanical excavation will be permitted within five (5) feet of any pipeline absent the express authorization of a Plantation on-site representative, which authorization will be given after visual inspection of the pipeline.

2. The line crossing Plantation's line(s) will be laid with minimum clearance of twenty-four (24) inches. Plantation's representative at the crossing will determine if the line crossing Plantation's line(s) is to be installed over or under Plantation's line(s), unless this decision has been made by Plantation prior to the date of the crossing. The depth of the line crossing Plantation's line(s) is to be maintained for the full distance across the pipeline confinement strip, and the crossing is to be made as nearly as possible at right angles to Plantation's line(s).

3. Electrical power and telephone cables will be encased for the entire width of Plantation's right-of-way of way. Schedule 40 EC-PVC duct is preferable; however, other materials may be used if approved by Plantation. Electrical power cables shall be installed with two to four inches of concrete around the duct or casing.

4. The use of explosives will not be permitted within the pipeline confinement strip and any use of explosives in the general area of the pipeline will be conducted in a manner so as to avoid any damage to Plantation's pipeline facilities.

The Good News Baptist Church
APPLICANT'S NAME

13123 Alexanderana Rd.
Huntersville, NC 28078
APPLICANT'S STREET ADDRESS

TOMMY LONG JR
PRINT SIGNER'S NAME

11721 Eastfield Rd
APPLICANT'S MAILING ADDRESS
Huntersville, NC 28078

Pastor
PRINT SIGNER'S TITLE

CITY STATE ZIP

BY:
SIGNATURE OF SIGNER

2-7-07 704-992-6099 (office)
DATE 704-890-7492 (cell)
TELEPHONE

To the extent of its rights or interest and without warranty, Plantation hereby permits the crossing described in this request for Permit to Cross Right-Of-Way and Facilities of Plantation Pipe Line Company.

PLANTATION PIPE LINE COMPANY

BY:

Phil Threlkeld
PRINT SIGNER'S NAME

Right Of Way Technician
TITLE

7-9-08
DATE

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a COMMERCIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30003993** GWS File #: **5953B** Tax Parcel #: **019-151-13**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 12/9/2013

Intallation Type: Commercail/Industrial - New System Business Type: Commercial

Facility Size (ft^2): 0 # Employees/Shift: 5 # Shifts: 1

Water Supply: Municipal

II. Initial System Type: Pump to Approved **System Classification:** IIIb

Initial System Specifications:

Design Flow (gpd):	450	LTAR (gpd/ft^2):	0.25	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1350	Total Trench Length (ft):	450
Maximum Trench Depth (in):	24	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

III. Repair System Type: Pump to Approved **System Classification:** IIIb

Repair System Specifications:

Design Flow (gpd):	450	LTAR (gpd/ft^2):	0.25	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1350	Total Trench Length (ft):	450
Maximum Trench Depth (in):	24	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone Owner/Legal Agent: _____
Print Name

Signature: _____ Signature: _____

Date Issued: 12/9/2008

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a COMMERCIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30003993** GWS File #: **5953B**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- This Improvement Permit is being issued based on a supplemental soil investigation performed by staff from our office.
- Proper well abandonment is required prior to receiving an Installation Approval from our office to install the septic system.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone

Signature: Jeremy Michelone, R.S.

Date Issued: 12/9/2008

Owner/Legal Agent: _____
Print Name

Signature: _____

FILE # 5953B

PERMIT # 3993

PARCEL # 019-151-13

N

H RD.

COMMENTS:

- SCALE = 1" = 20'
- SYSTEM DESIGNED FOR A MAXIMUM OF 30 PEOPLE INCLUDING STAFF AND CHILDREN
- → 450 GPD.
- → 1500 SEPTIC TANK
- → 1000 PUMP TANK
- → TYPE III6 PUMP TO 25% RED. SYSTEM & REPAIR.
- → 6 X 75' X 3'
- → EXISTING WELL MUST BE PROPERLY ABANDONED BY A CERTIFIED WELL CONTRACTOR BEFORE INSTALLATION PERMIT WILL BE GIVEN.

Jimmy Mudd, R.S. 12/9/08

X _____

100% REPAIR AREA

75'
75'
75'
75'
75'
75'

S 74°39'22" W
291.23' TOTAL
(291.31')

□ — WELL
(TO BE ABANDONED)


RAILROAD R.

U. EASEMENT COMMUNICATIONS, LLC
B. 10750 PG. 101

℄ 827.0

35'
15'

G
FO
10" FINE
14" GASLINE

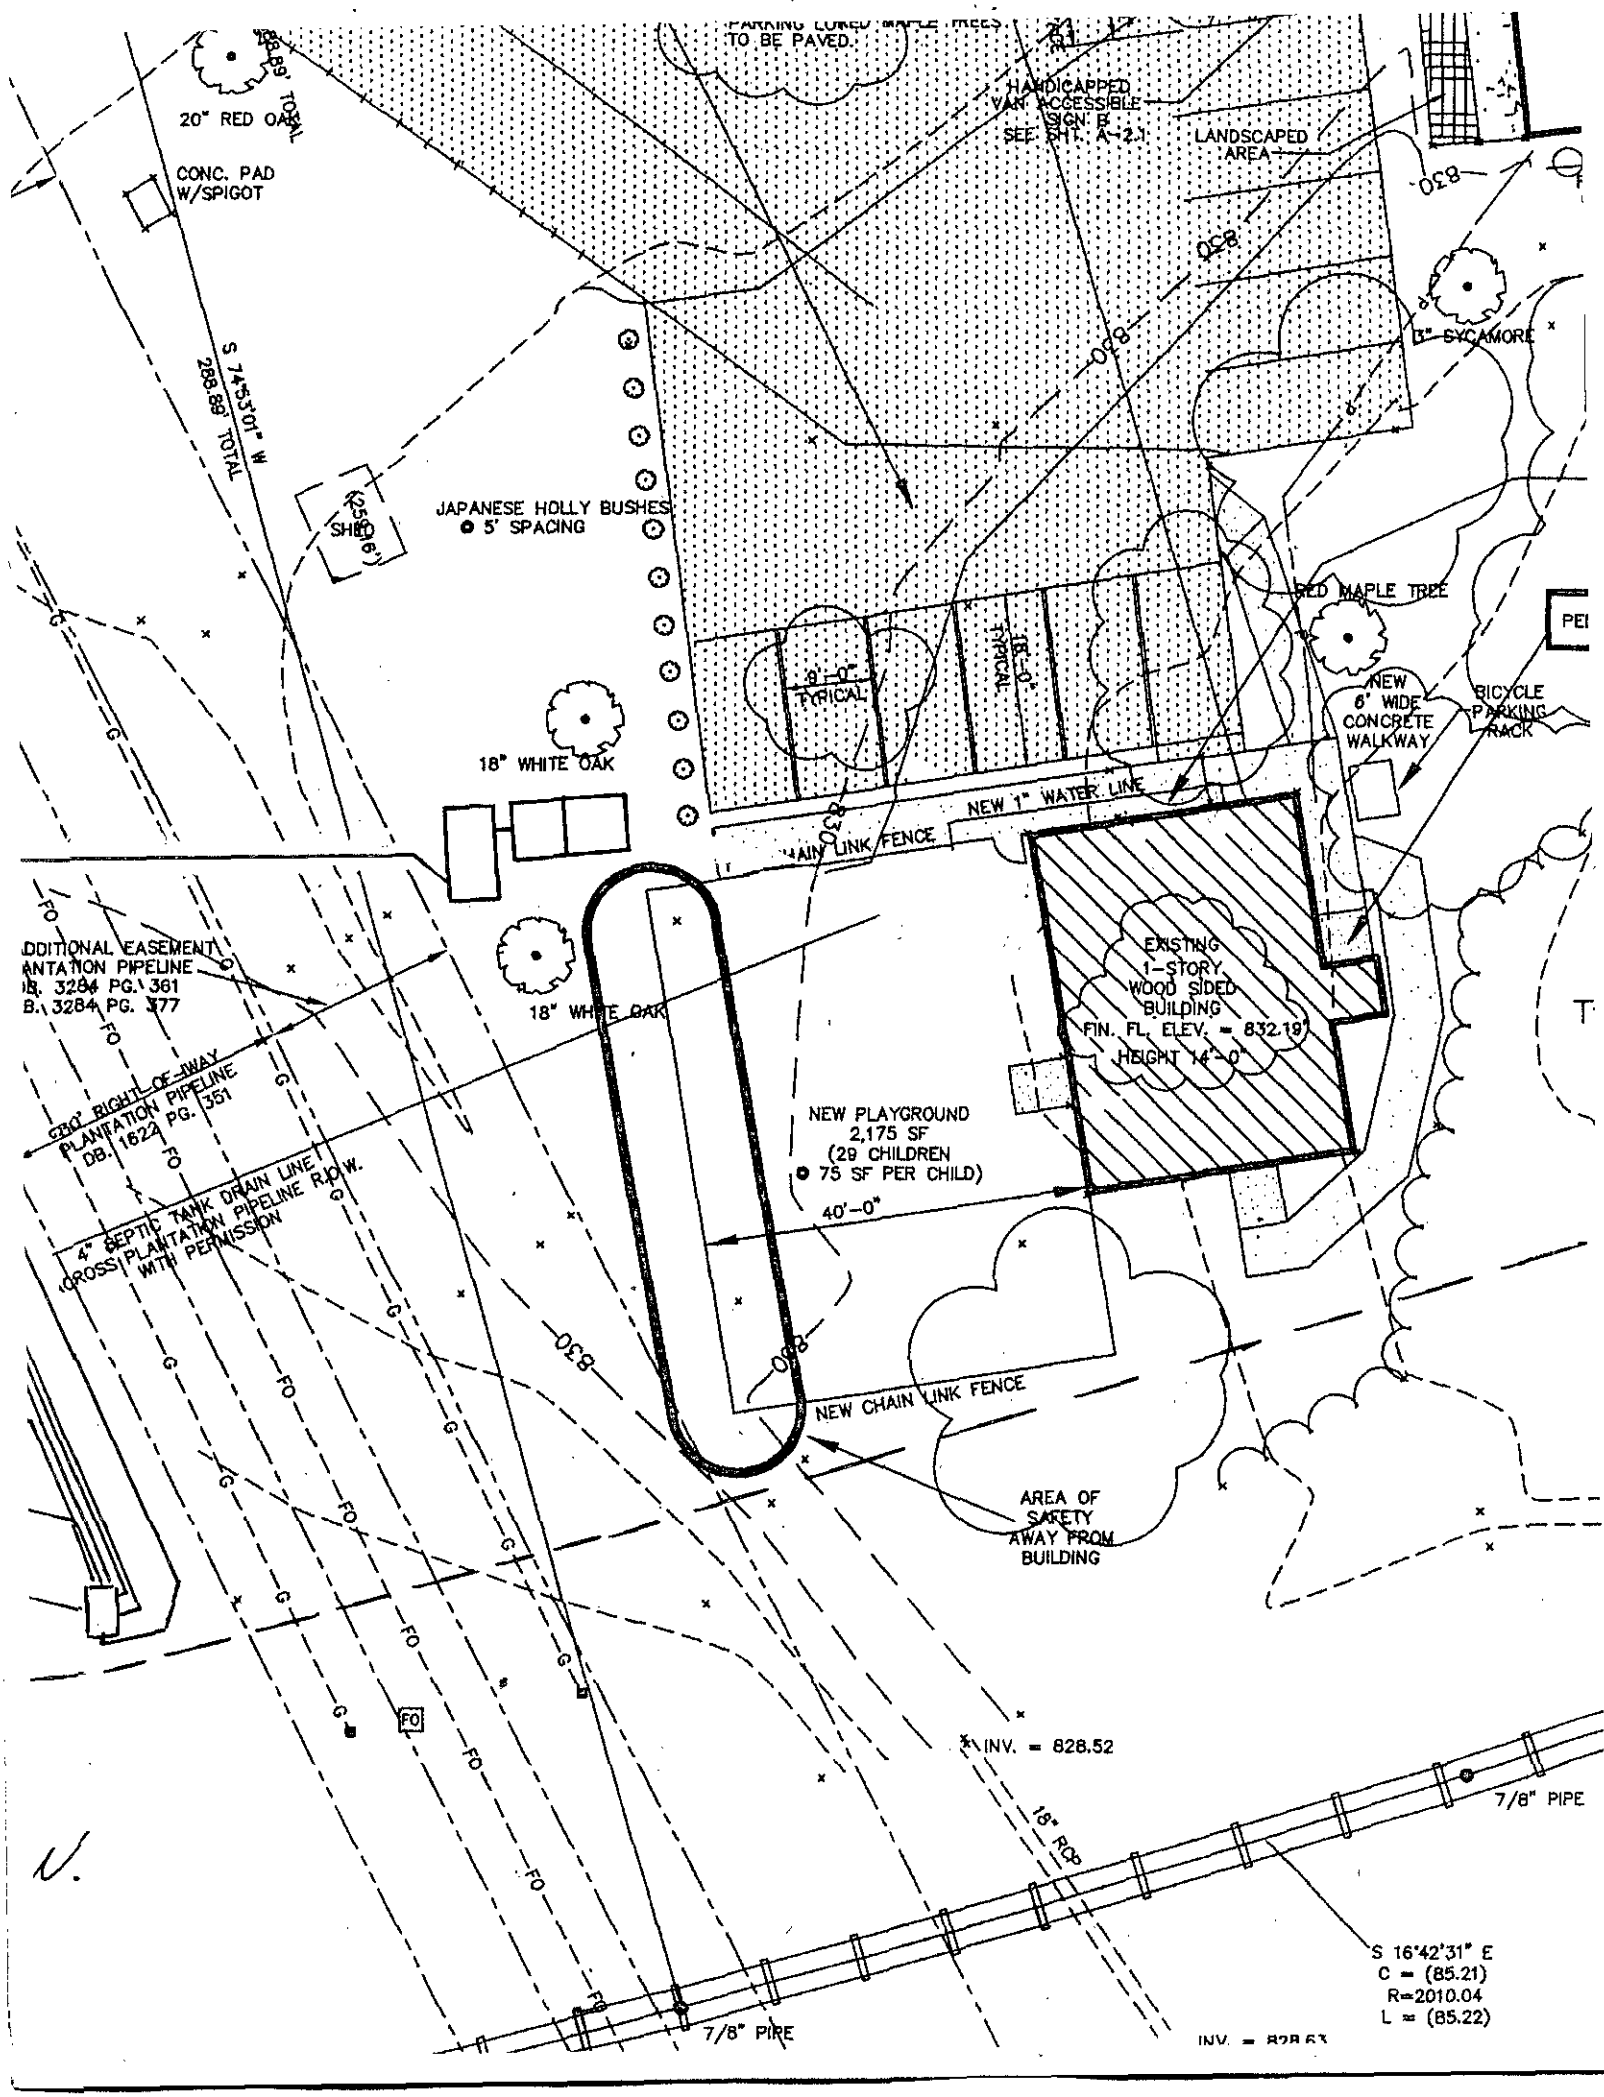
PARKING LINED MAPLE TREES TO BE PAVED.
HANDICAPPED VAN ACCESSIBLE SIGN B SEE SHT. A-2.1
LANDSCAPED AREA
20" RED OAK
CONC. PAD W/SPIGOT
S 74°53'01" W 288.89' TOTAL
3" SYCAMORE
JAPANESE HOLLY BUSHES @ 5' SPACING
RED MAPLE TREE
9'-0" TYPICAL
18'-0" TYPICAL
NEW 6' WIDE CONCRETE WALKWAY
BICYCLE PARKING RACK
18" WHITE OAK
NEW 1" WATER LINE
CHAIN LINK FENCE
ADDITIONAL EASEMENT PLANTATION PIPELINE DB. 3284 PG. 361 B. 3284 PG. 377
60' RIGHT-OF-WAY PLANTATION PIPELINE DB. 1622 PG. 351
4" SEPTIC TANK DRAIN LINE CROSS PLANTATION PIPELINE R/O/W. WITH PERMISSION
EXISTING 1-STORY WOOD SIDED BUILDING FIN. FL. ELEV. = 832.19' HEIGHT 14'-0"
NEW PLAYGROUND 2,175 SF (29 CHILDREN @ 75 SF PER CHILD)
40'-0"
NEW CHAIN LINK FENCE
AREA OF SAFETY AWAY FROM BUILDING
INV. = 828.52
18" RCP
7/8" PIPE
S 16°42'31" E
C = (85.21)
R=2010.04
L = (85.22)
7/8" PIPE
INV. = 828.63

3993

Optional Site Evaluation Recd Check #1199

CWC 1759

$1000.00

8/17/05 V.A.W

GWS- COM. APP 12/04

SEPTIC FEE: 400.00
DATE: 4/11/05
CRT [I]: gc

PERMIT APPLICATION FOR A COMMERCIAL / INDUSTRIAL SITE IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATION FOR ON-SITE WASTEWATER SYSTEM NEW WELL INSTALLATION OR REPAIR OF EXISTING WELL MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES

FILE # 5553B

WELL FEE:
DATE:
CRT [I]:

SEPTIC / TYPE APPLICATION: ☐ NONE ☒ NEW SYSTEM ☐ EXISTING SYSTEM ☐ EXPANSION/ALTERATION ☐ REPAIR

WELL / TYPE APPLICATION: ☐ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

JOB LOCATION INFORMATION

PROJECT TRACKING #:
TAX/PARCEL #: 01915113
STREET ADDRESS: 13123 Alexanderana Rd
CITY: Huntersville
STATE: NC ZIP: 28078
LOT #:
TOWNSHIP:

☒ 0-MECKLENBURG ☐ 4-PINEVILLE
☐ 1-CHARLOTTE ☐ 5-MATTHEWS
☐ 2-DAVIDSON ☐ 6-HUNTERSVILLE
☐ 3-CORNELIUS ☐ 7-MINT HILL

BUILDING INFORMATION:

DESCRIBE TYPE OF BUSINESS: Day Care 75 children

☒ COMMERCIAL ☐ INDUSTRIAL
SQUARE FOOTAGE OF FACILITY: 9000
NUMBER OF EMPLOYEES PER SHIFT: 5
NUMBER OF SHIFTS: 1
TYPE OF WASTEWATER:
☒ SEWAGE ☐ INDUSTRIAL PROCESS WASTEWATER
HOW WILL WATER BE USED IN THE FACILITY?:
☒ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☐ CRAWLSPACE ☐ BASEMENT WITH NO PLUMBING

IF PLANNING TO EXPAND/ALTER THE EXISTING SYSTEM, INFORMATION DOCUMENTING THE INCREASED WASTEWATER FLOW AND/OR A JUSTIFICATION FOR SYSTEM ALTERATION WILL BE REQUIRED.

WATER SUPPLY:
☒ MUNICIPAL (M) ☐ PUBLIC (C) ☐ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

ARE ANY OF THE FOLLOWING LOCATED ON THE PROPERTY? IF SO, PLEASE SHOW LOCATION ON SITE PLAN/PLAT.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES ☒ NO	WELLS, SPRINGS, OR WATER LINES	☒ YES ☐ NO
EXISTING WASTEWATER SYSTEMS	☒ YES ☐ NO	DESIGNATED WETLANDS	☐ YES ☒ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES ☒ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES ☒ NO

PROPERTY OWNER:
NAME: Merle King
ADDRESS: 2509 W. Mallard Creek Church Rd
CITY: Charlotte
STATE: NC ZIP: 28262
HOME PHONE: (704)597-0118 WORK PHONE:
MOBILE PHONE: FAX :

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:
NAME: Tommy Lore JR
ADDRESS: 11721 Eastfield Rd
CITY: Huntersville
STATE: NC ZIP: 28078
HOME PHONE: (704)992-6799 WORK PHONE:
MOBILE PHONE: (704)896-7492 FAX: (704)947-0442

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?
WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? 6/1/2005

*An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

4/11/05
Owner's/Agent's Signature Date


NORTH CAROLINA DEPARTMENT OF
ENVIRONMENT & NATURAL RESOURCES DIVISION
OF ENVIRONMENTAL HEALTH ON-SITE
WASTEWATER SECTION

*A Well Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature Date

MECKLENBURG COUNTY HEALTH DEPARTMENT
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
704-336-5103 / FAX:704-336-6894

6735

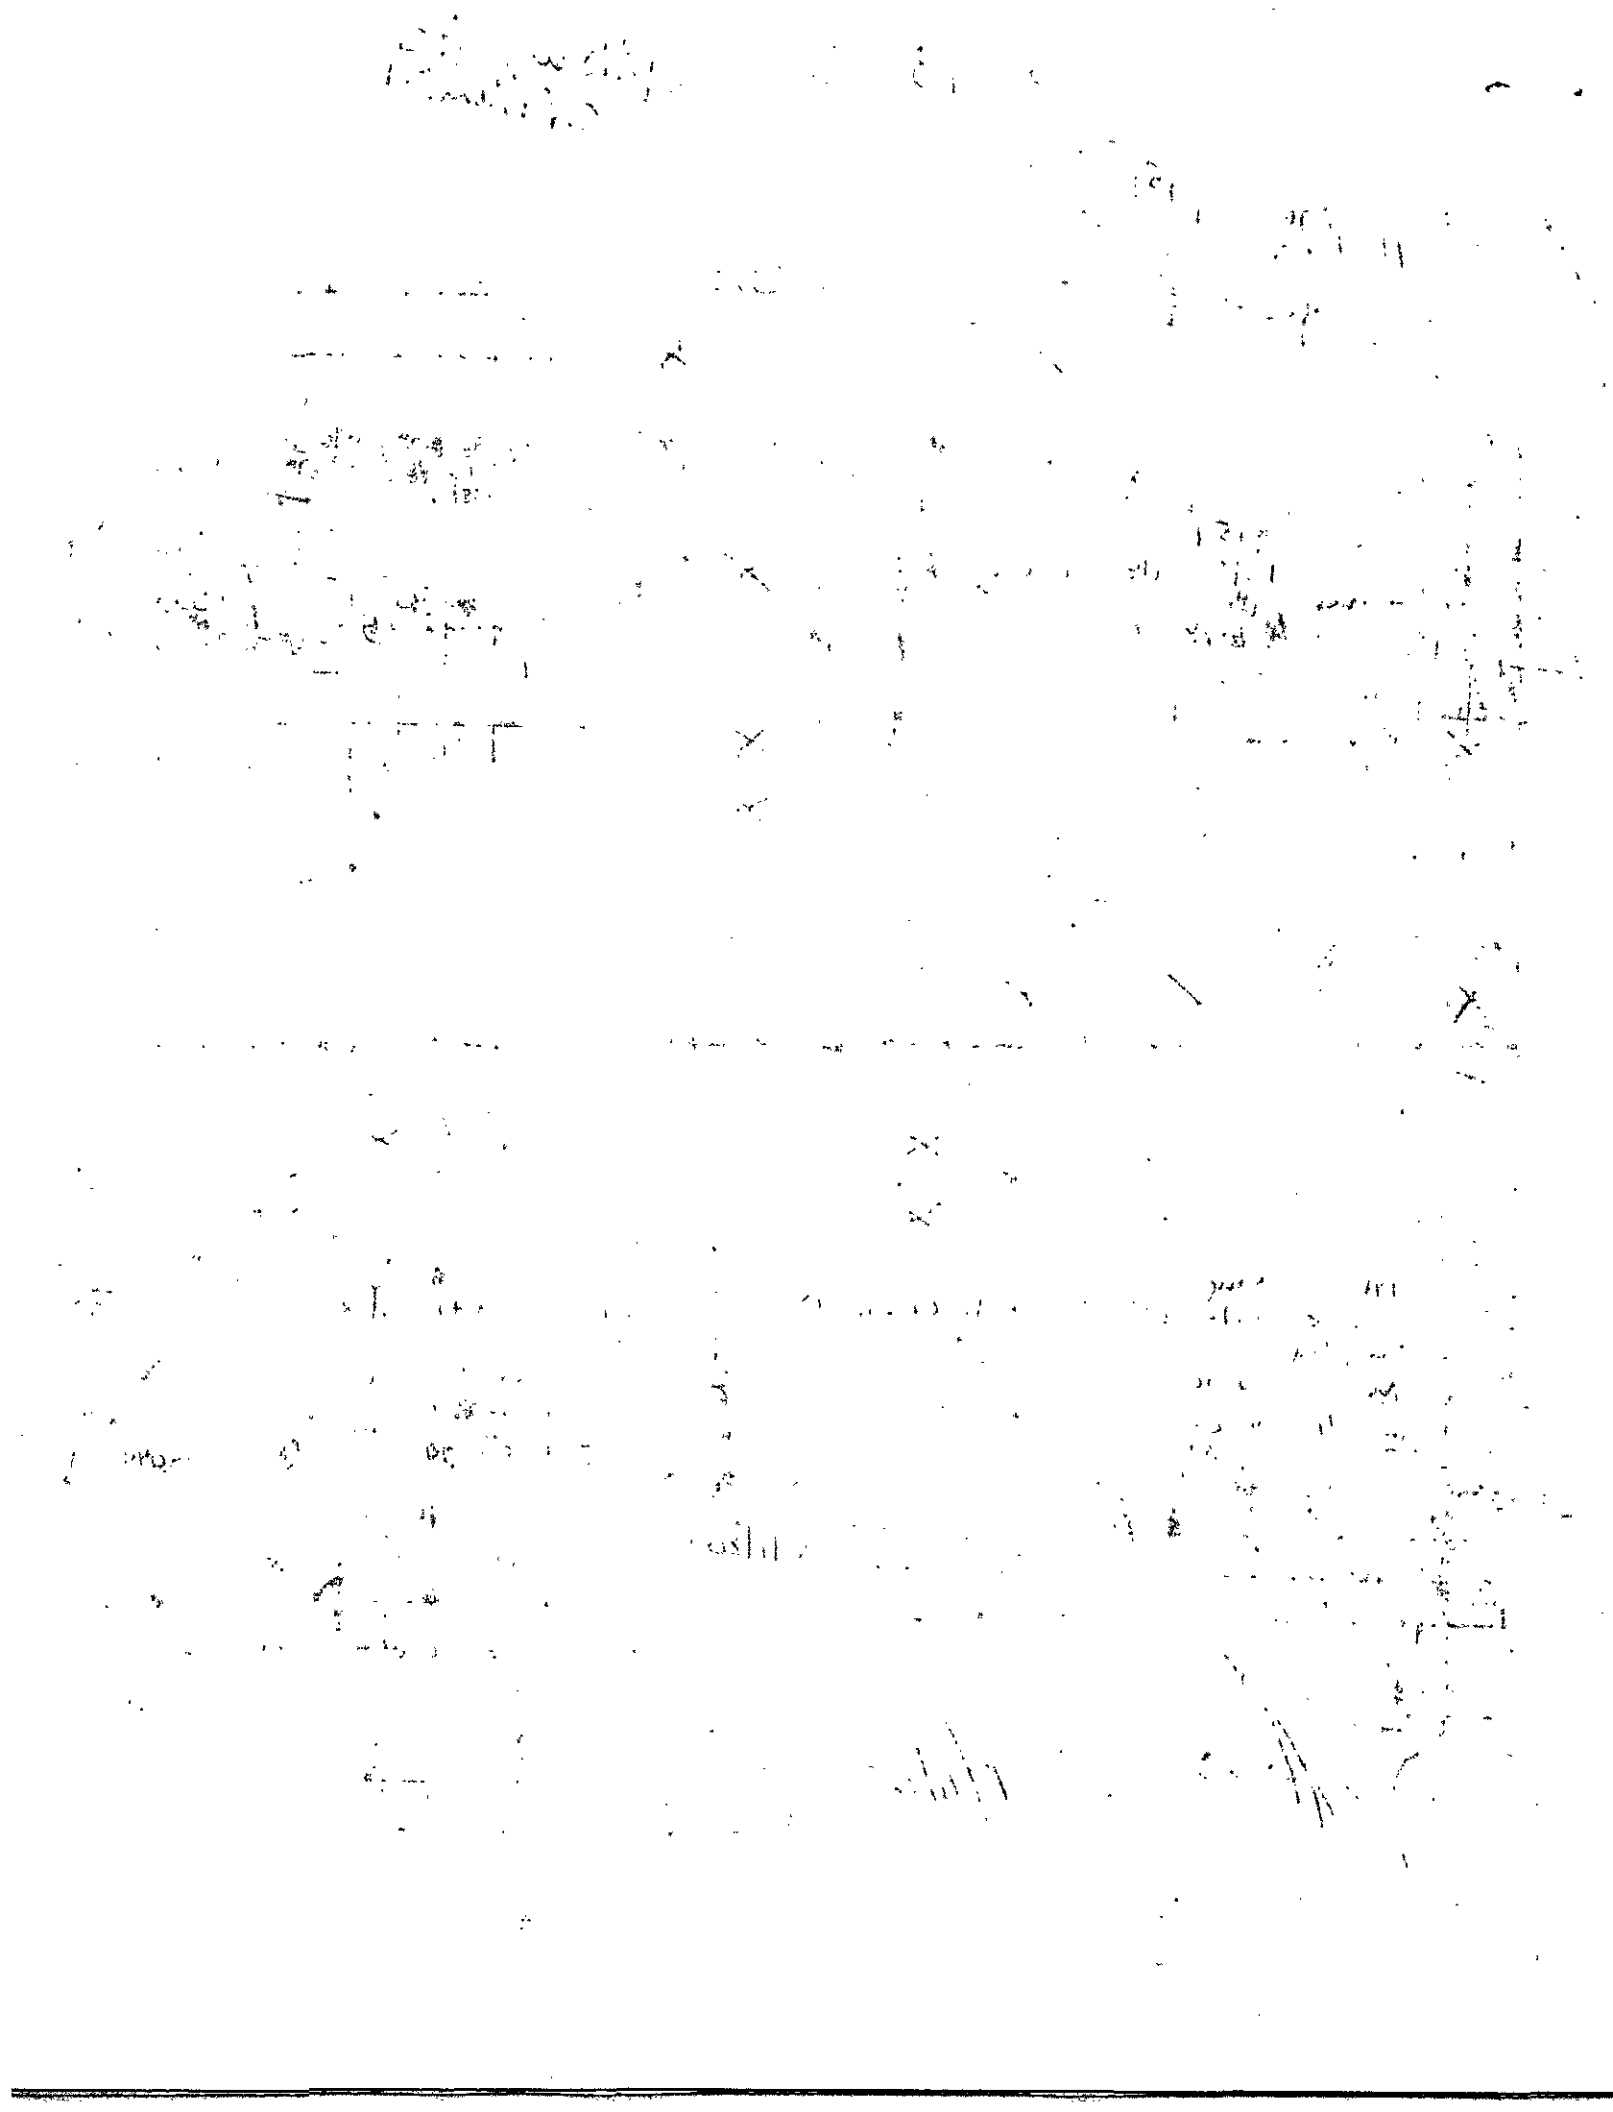


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 5953B

TC: 019-151-13

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

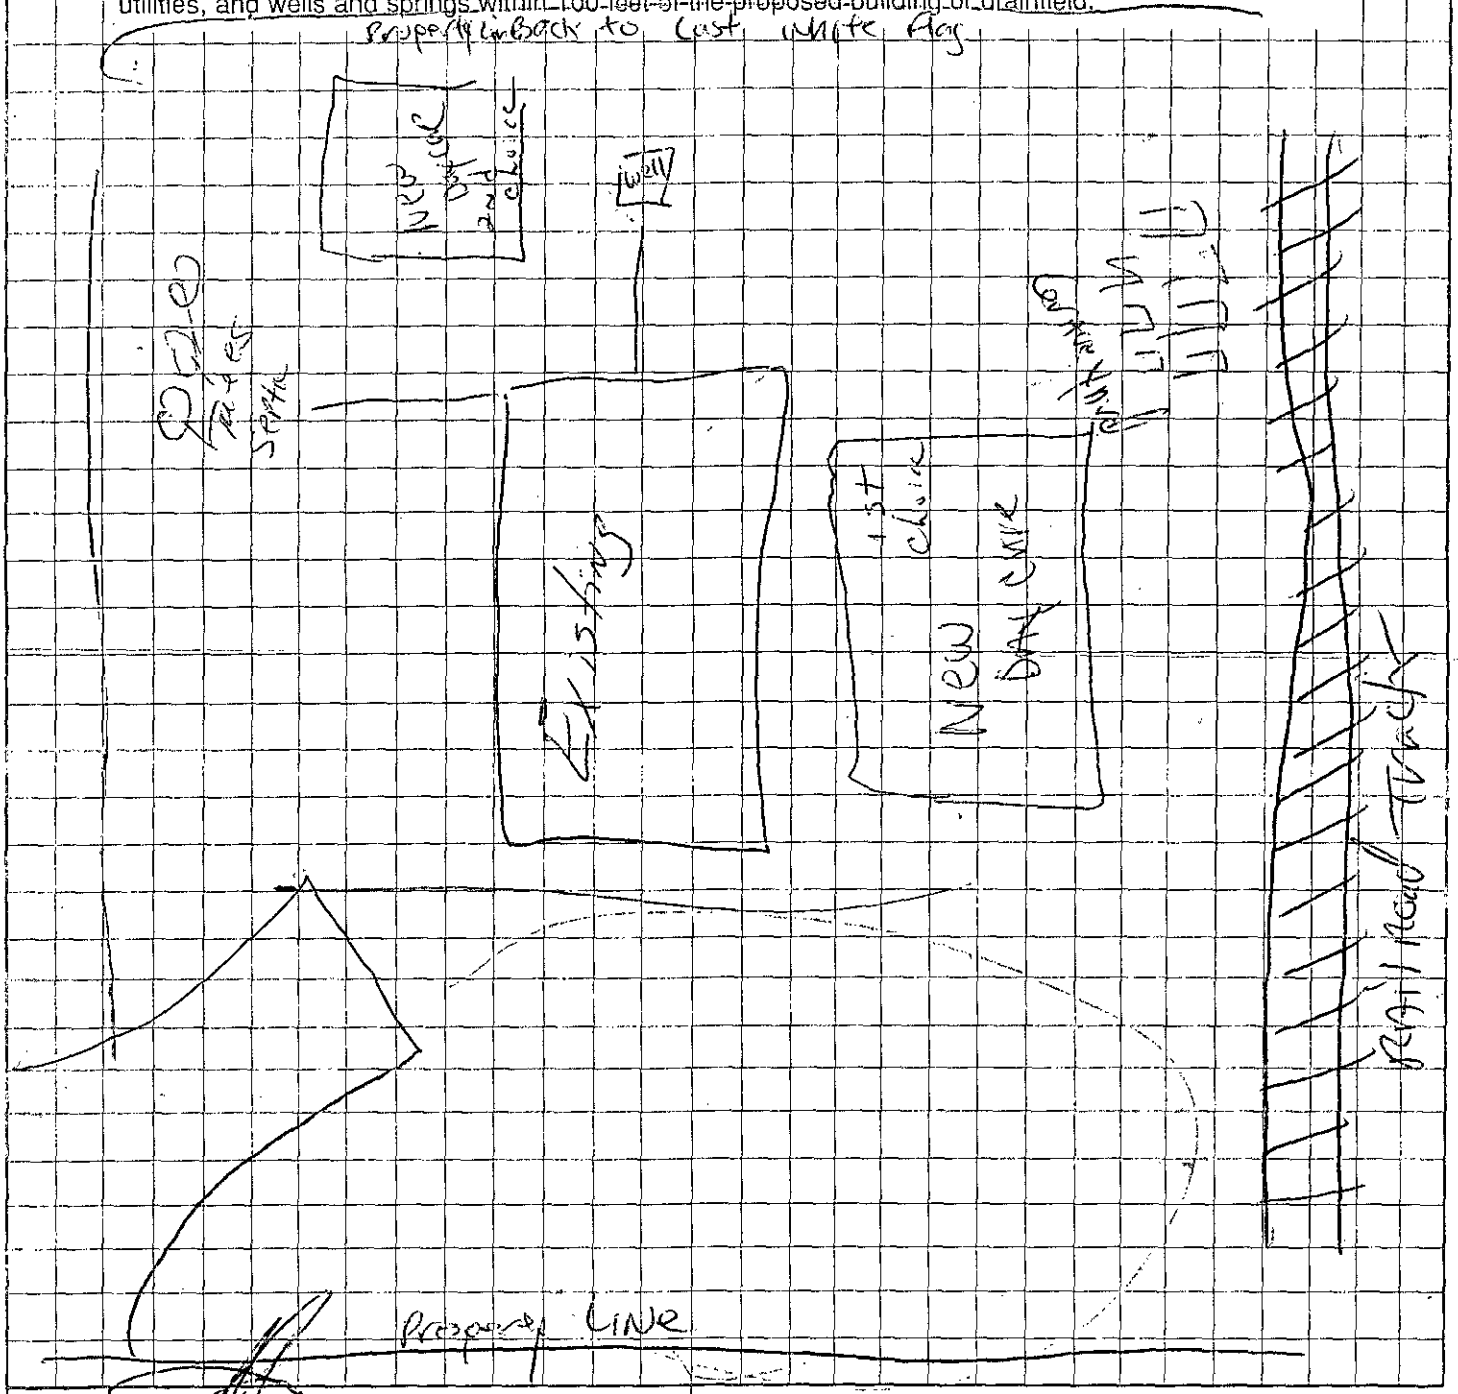

OWNER/AGENT SIGNATURE

DATE 4/11/05

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 019-151-13
Lot #:
File #: 5953B
Code: 2

ACO

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Merle King
Applicant:
Address: 2509 W. Mallard Creek Church Road, Charlotte, N. C. 28262
Date Evaluated: 4/20/2005
Proposed Facility: Residence
Design Flow (.1949): 1250
Property Size: .5a inv.
Location of Site: 13123 Alexanderanna Road
Property Recorded:
Water Supply: [x] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941 1941 Structure/ Texture	1941 Consistence Mineralogy	OTHER PROFILE FACTORS 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
1	LS, 8	0-4	GR/CL	FR/SEXP/SS/SP	>32" TO SOIL WETNESS	32	N/A	NONE	US, IV
		4-32	SBK/C	FI/SEXP/S/P					.25GPD/FT^2
		32+	M/C	"					
2	"	0-4	GR/CL	FR/SEXP/SS/SP	2.5Y7/1 at 38"	38	"	"	PS, IV
		4-38	SBK/ABK/C	FI/SEXP/S/P					.25GPD/FT^2
3	"	0-13	DISTURBED						
		13-48	SBK/ABK/C	FI/SEXP/S/P					

Description	Initial System	Repair System
Available Space (.1945)	US	US
System Type(s)		
Site LTAR	.25GPD/FT^2	.25GPD/FT^2


Other Factors (.1946):
Site Classification (.1948): UNSUITABLE
Evaluated By: W. R. Marlin, LSS, 4/25/2005, W. R. Marlin
Others Present:

COMMENTS:
100% repair

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

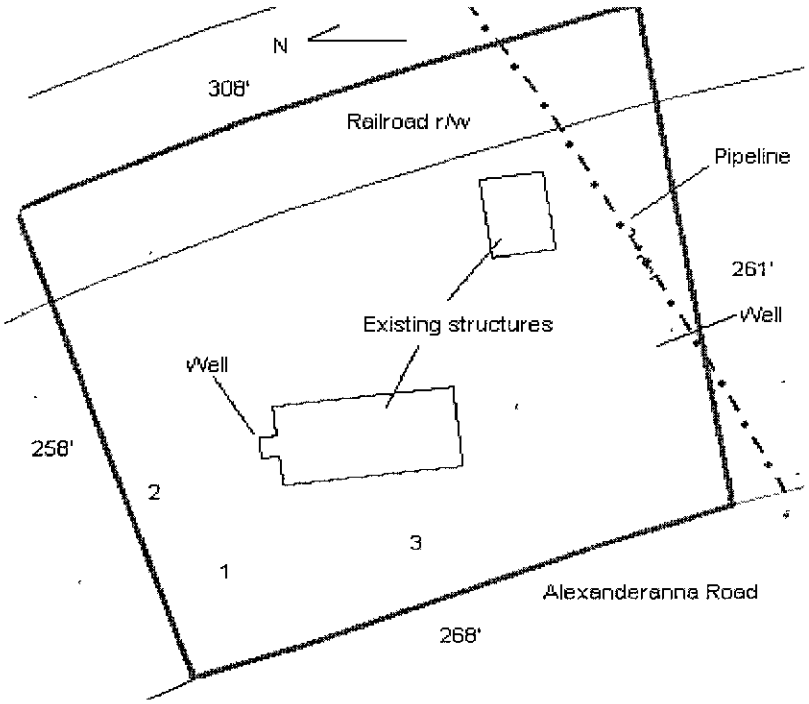

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID # 019-151-13, 14
Lot #:
File #: 5953B
Code: 2

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Merle King
Applicant: Tommy Long , Jr.
Address: 2509 Mallard Creek Church Road, Charlotte, N. C. 28262
Date Evaluated: 8/29/05
Proposed Facility: Day care facility
Design Flow (.1949): 450gpd
Property Size: 1.5a inv.
Location of Site: 13123 Alexanderana Road
Property Recorded:
Water Supply: [x] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 8	0-2	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	48	N/A	NONE	PS, IV
		2-45	SBK/C	FI/SEXP/S/P					.3GPD/FT^2
		45-48	SBK/CL	FR/SEXP/SS/SP					
2	"	0-4	GR/CL	"	"	"	"	"	"
		4-36	SBK/C	FI/SEXP/S/P					
		36-48	SBK/CL	FR/SEXP/SS/SP					
3	LS, 6	0-5	GR/CL	"	2.5Y7/1 at 38"	39+	"	"	PS, IV
		5-39	SBK/C	FI/SEXP/S/P					.25GPD/FT^2
4	LS, 8	0-6	Gravel		>40" TO SOIL WETNESS	40+	"	"	"
		6-40	SBK/ABK/C	FI/SEXP/S/P					
		POSS.	PLATY @	38"					
5	"	0-6	GR/SL	FR/SEXP/SS/SP	>31" TO SOIL WETNESS	31	"	"	US, IV
		6-31	SBK/C	FI/SEXP/S/P					.25GPD/FT^2
6	"	0-18	GR/SCL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	48	"	"	PS, IV
		18-48	SBK/C	FI/SEXP/S/P					.3GPD/FT^2
7	"	0-6	GR/SCL	FR/SEXP/SS/SP	2.5Y 7/1 at 42"	43	"	"	PS, IV
		6-43	SBK/C	FI/SEXP/S/P					.25GPD/FT^2

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	III b	III b
Site LTAR	.25GPD/FT^2	.25GPD/FT^2

Other Factors (.1946):
Site Classification (.1948): PS
Evaluated By: W. R. Marlin, LSS, 8/31/2005
Others Present: C. Sherrill, T. Long


COMMENTS:

100% repair, pipeline r/w and perimeter of 019-151-14 need marking

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Food Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

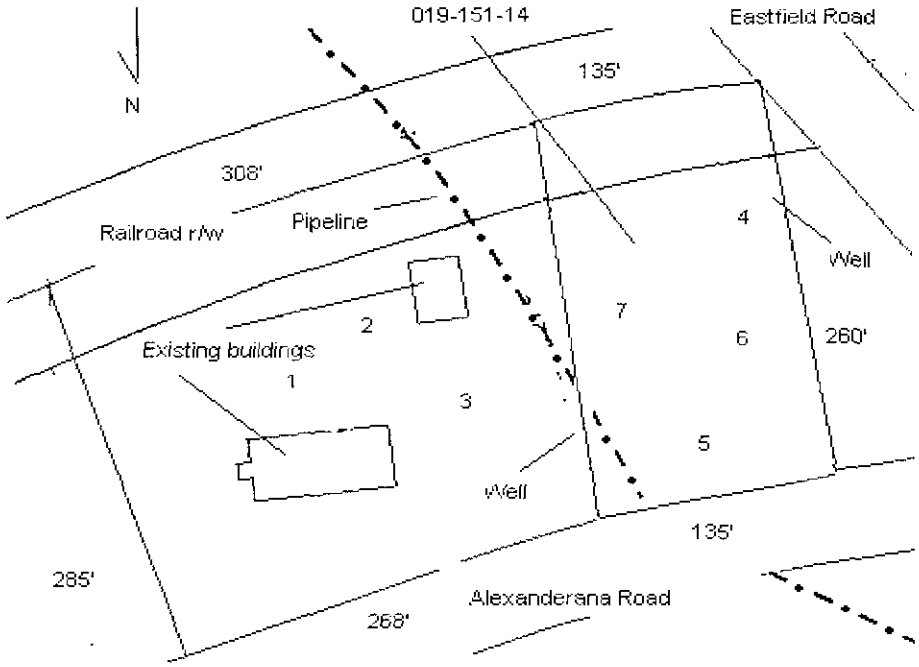

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

LD 12/17/08

GWS File #: 5953B WASPS App #: 3993

Primary ES assigned to project: OJ

Secondary ES assigned to project:

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☑
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☑
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 7			
	Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR .25	Yes ☑	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☑
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☑	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: _____

OP issued date: _____

Review performed by: KR Date performed: 12 10 08

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a COMMERCIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30003993** GWS File #: **5953B** Tax Parcel #: **019-151-13**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 12/9/2013

Intallation Type: Commercail/Industrial - New System Business Type: Commercial

Facility Size (ft^2): 0 # Employees/Shift: 5 # Shifts: 1

Water Supply: Municipal

II. Initial System Type: Pump to Approved **System Classification:** IIIb

Initial System Specifications:

Design Flow (gpd):	450	LTAR (gpd/ft^2):	0.25	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1350	Total Trench Length (ft):	450
Maximum Trench Depth (in):	24	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

III. Repair System Type: Pump to Approved **System Classification:** IIIb

Repair System Specifications:

Design Flow (gpd):	450	LTAR (gpd/ft^2):	0.25	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1350	Total Trench Length (ft):	450
Maximum Trench Depth (in):	24	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone Owner/Legal Agent: Darryl G. Mansel
Print Name

Signature: Jeremy Michelone, RS Signature: Darryl Mansel

Date Issued: 12/9/2008

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a COMMERCIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30003993** GWS File #: **5953B**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- This Improvement Permit is being issued based on a supplemental soil investigation performed by staff from our office.
- Proper well abandonment is required prior to receiving an Installation Approval from our office to install the septic system.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone

Signature: Jeremy Michelone, R.S.

Date Issued: 12/9/2008

Owner/Legal Agent: Darryl G. Mansel
Print Name

Signature: Darryl Mansel

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	12/17/08	**Amount:**	200.00
Receipt #:	59999	**Tendered:**	0.00
Check / Auth #:	CHARGE	**Returned:**	0.00
Received By:	CRAIGGY		

Account Information

Account #: X32932
Contractor: MANSEL CONTRACTORS LLC
Attn:
Address: 3324 GRANARD LANE
Address:
City/State/Zip: CHARLOTTE, NC 28269

Item	Description	Permit#	Quantity	Unit Price	Total Price
0734	Auth for Waste Wtr Sys Constr 13123 ALEXANDERANA/FILE 5953B		1	200.00	200.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
968.10					

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	12/17/08	**Amount:**	200.00
Receipt #:	60000	**Tendered:**	0.00
Check / Auth #:	CHARGE	**Returned:**	0.00
Received By:	CRAIGGY		

Account Information

Account #: X32932
Contractor: MANSEL CONTRACTORS LLC
Attn:
Address: 3324 GRANARD LANE
Address:
City/State/Zip: CHARLOTTE, NC 28269

Item	Description	Permit#	Quantity	Unit Price	Total Price
0703	Installation/Final Approval 13123 ALEXANDERANA/FILE 5953B		1	200.00	200.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
1,168.10					

STATE OF NORTH CAROLINA

COUNTY OF MECKLENBURG

LEASE WITH OPTION TO PURCHASE

THIS LEASE WITH OPTION TO PURCHASE (hereinafter referred to as "Instrument") by and between **MERLE KING and wife ELIZABETH L. KING** (hereinafter referred to as "Seller"), and **THE GOOD NEWS HOUSE, INC**, a North Carolina Non-Profit Corporation (hereinafter referred to as "Buyer");

W I T N E S S E T H:

Seller agrees to sell and Buyer agrees to buy two parcels of real estate having the addresses of 13123 and 13129 Alexanderana Road, Huntersville Township, Mecklenburg County, North Carolina; and

The purchase price for said property is **TWO HUNDRED TWENTY-FIVE THOUSAND and NO/100 ($225,000.00)** for 13123 Alexanderana Road (Tax Code 019-151-12 & 13) and **ONE HUNDRED TWENTY-FIVE THOUSAND and NO/100 ($125,000.00)** for 13129 Alexanderana Road (Tax Code 019-151-14); and

Beginning July 1, 2004, through December 31, 2004, Buyer shall pay the sum of Four Hundred and No/100 ($400.00) per month as rent for both properties. Beginning January 1, 2005, the rent shall be One Thousand and No/100 ($1,000.00) per month. All payments shall be due and payable on the first day of each month.

Buyer shall have until December 31, 2005, to purchase said property and any amounts paid to Seller over and above the rental payments shall be applied to the purchase price.

In the event that Buyer, for any reason, fails to close on the purchase of said property on or before December 31, 2005, any and all monies paid to Seller shall not be refundable. Further, if Buyer fails to close as previously stated, Buyer shall have sixty (60) days to remove any mobile classrooms and personal property from the property.

A church building is located on the parcel having the address of 13123 Alexanderana Road. It is understood that Seller is selling said building "AS IS" and will not be responsible for any faults in the building, including but not limited to the electrical system, heating and cooling systems, plumbing, roof, or any structural defects which may be detected.

Seller has promised the family of Bland Young Jackson that she could be buried in the small cemetery located on the property. Buyer hereby agrees that Bland Young Jackson may be buried on the property.

Buyer agrees to hold Seller harmless for any incident which may occur on the property and shall provide liability and fire insurance on the property and, until the property is purchased, shall provide Seller with proof of insurance.

IN WITNESS WHEREOF, the parties hereto have caused this instrument ro be signed the day and year hereinafter set out.

SELLER:

Merle King (SEAL)
MERLE KING

Elizabeth L. King (SEAL)
ELIZABETH L. KING

BUYER:

THE GOOD NEWS HOUSE, INC.

By: _____
TOMMY LONG JR., President

(CORPORATE SEAL)
0631344

STATE OF NORTH CAROLINA

COUNTY OF MECKLENBURG

I, A. NEAL BRUMLEY a Notary Public of the County and State aforesaid, certify that **MERLE KING and wife, ELIZABETH L. KING** personally appeared before me this day and acknowledged the execution of the foregoing instrument.

Witness my hand and official stamp or seal, this 30th day of June, 2004.

A. Neal Brumley
NOTARY PUBLIC
My Commission Expires: 3/16/07

FILE # 5953B

PERMIT # 3993


PARCEL # 019-151-13

COMMENTS:

- SCALE = 1" = 20'
- SYSTEM DESIGNED FOR A MAXIMUM OF 30 PEOPLE INCLUDING STAFF AND CHILDREN
- → 450 GPD.
- → 1500 SEPTIC TANK
- → 1000 PUMP TANK
- → TYPE III6 PUMP TO 25% RED. SYSTEM & REPAIR.
- → 6 X 75' X 3'
- → EXISTING WELL MUST BE PROPERLY ABANDONED BY A CERTIFIED WELL CONTRACTOR BEFORE INSTALLATION PERMIT WILL BE GIVEN.

Jimmy Mack, R.S. 12/9/08

X _____

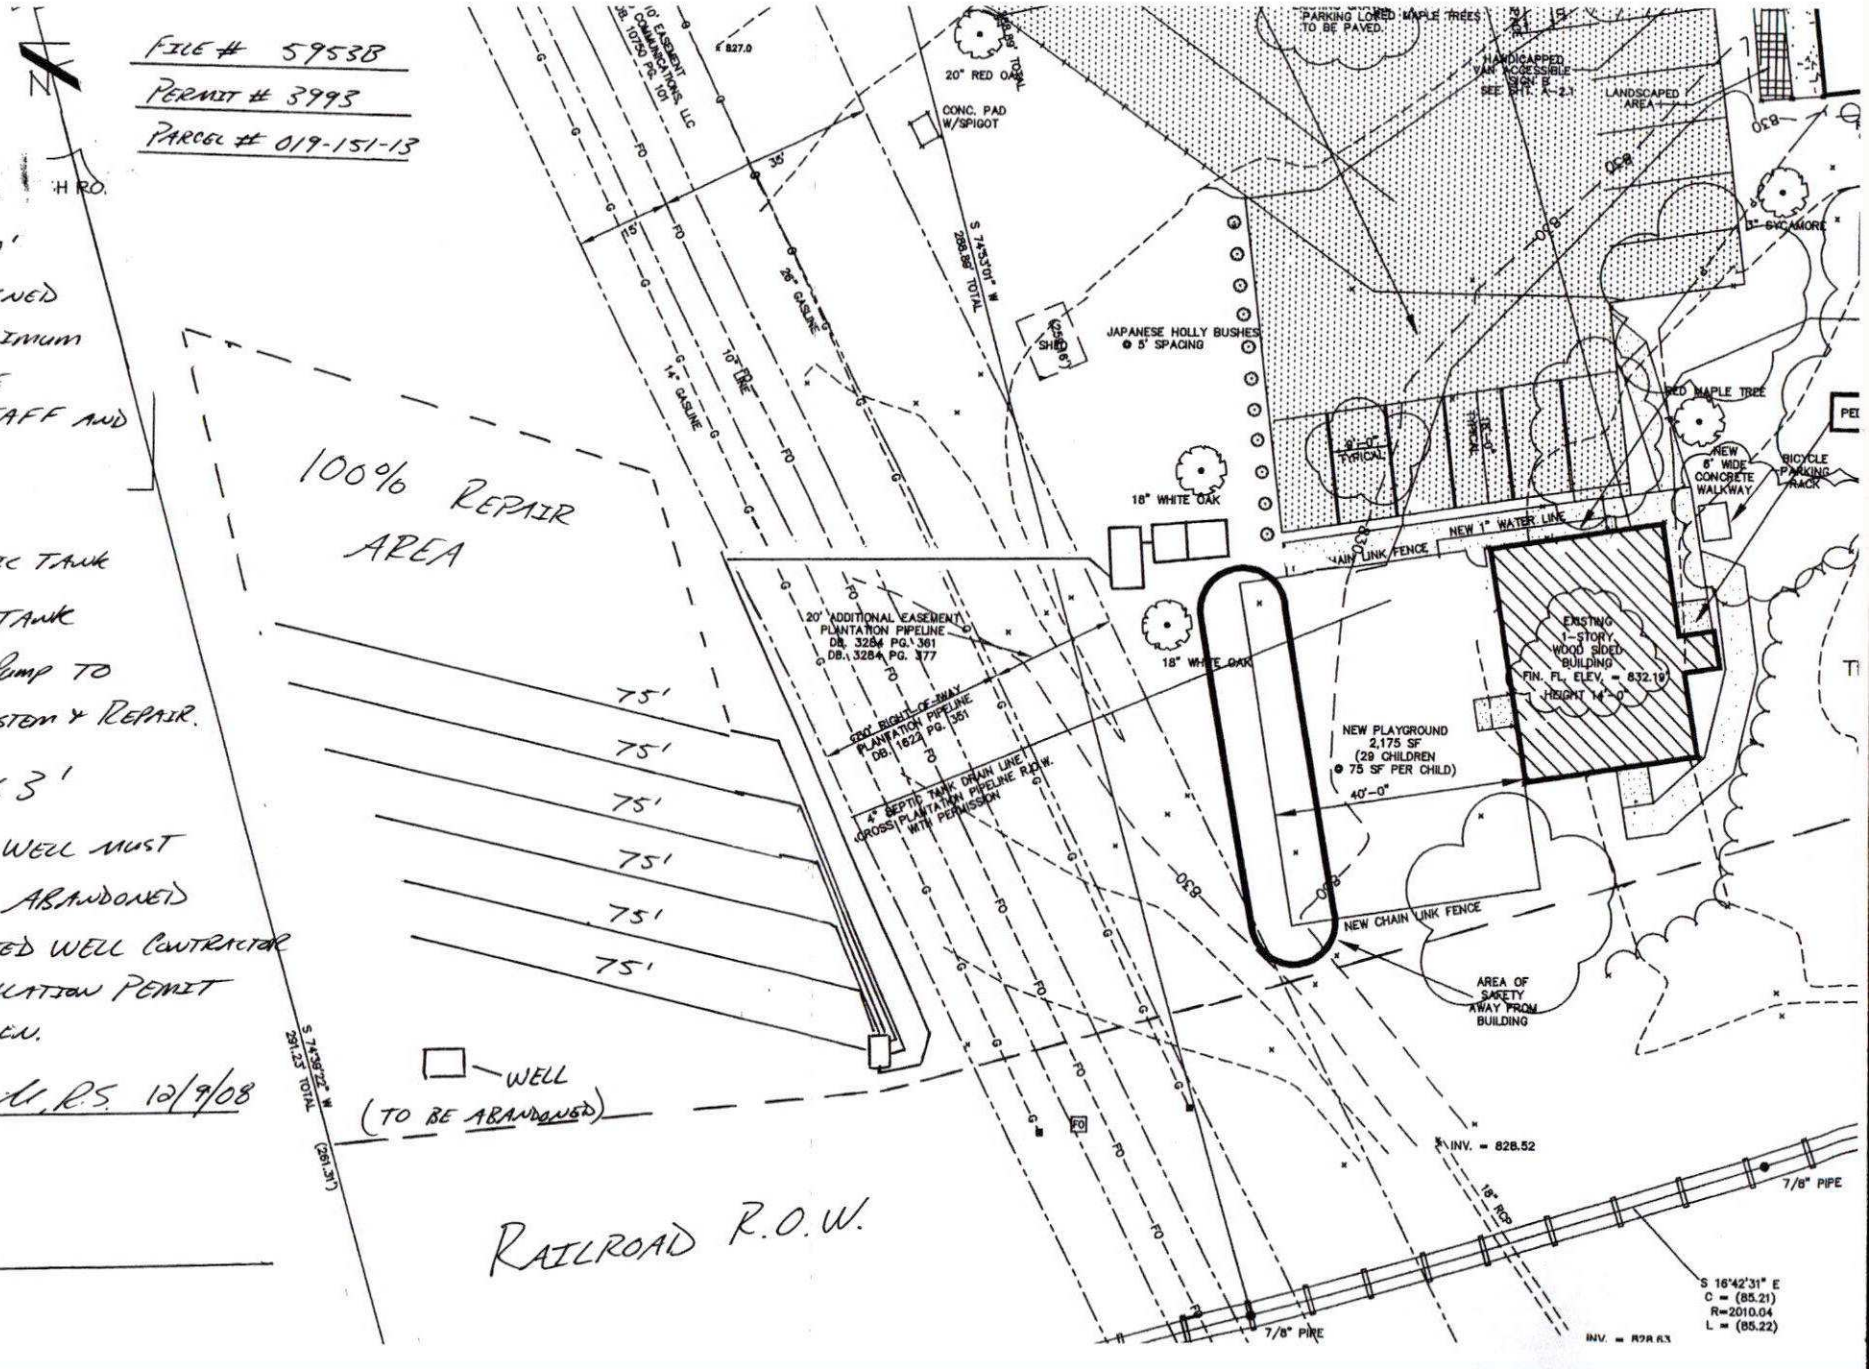



Clary Architects Inc.

MOODYE R. CLARY

4730 PARK ROAD
SUITE C
CHARLOTTE, NC 28209

704/527-5123
FAX 704/527-1426
E-MAIL: mclary@claryarchitects.com

Plantation Pipeline
Contact
Phil Threlkeld
704-813-6256

45 -

Phil Therkeld

704-813-6256