

12831 ASBURY CHAPEL RD

01938103

5/18/2007

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 448SA DATE: 5/9/98

TC: D19211 21 ☐ L ☐ CRT

SERIAL № 11069

Name of Owner Childers D. L. Juris.:

Address of Property 12831 Asbury Chapel Rd

Inspection Data:

Tank Material \

Total Length of Drainfield 200'

Number of Lines 2 @ 100'

Cover Depth 24"

Water Supply Source Well

Distance to Water Source 70'

Excavation Inspected 5/9/98

Tank(s) Inspected \

Wash Line Inspected \

High Water Alarm Inspected \

PLOT

Design: 480 Repair CTR#

The *undersigned has inspected* the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☑ ~~altered~~ or repaired

☐ ~~in accordance~~ with the permit issued ☑ *as detailed in the plot above*

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☐ ~~Certificate~~ of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS:

Judy J. Kerr
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


MECKLENBURG COUNTY · ENVIRONMENTAL HEALTH ·
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 4485 A DATE: 4/27/88

TC: 019-211-21 ☐ L

SERIAL № 11780

Permission is hereby given to ___ Install or Construct, ✓ ~~Alter or Repair~~ the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. *This permit is granted based upon the information* supplied in the application dated 4/18/88. All work shall be completed on or before 5/27/88, after which date this permit shall be null and void. The system shall meet all of the construction requirements of *10 NCAC 10A .1900 which are in effect* on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Department of Environmental Health before any system can be covered up or placed into service. The issuance of this permit *does not in any way guarantee* that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from ~~the failure of the system to operate~~ properly.

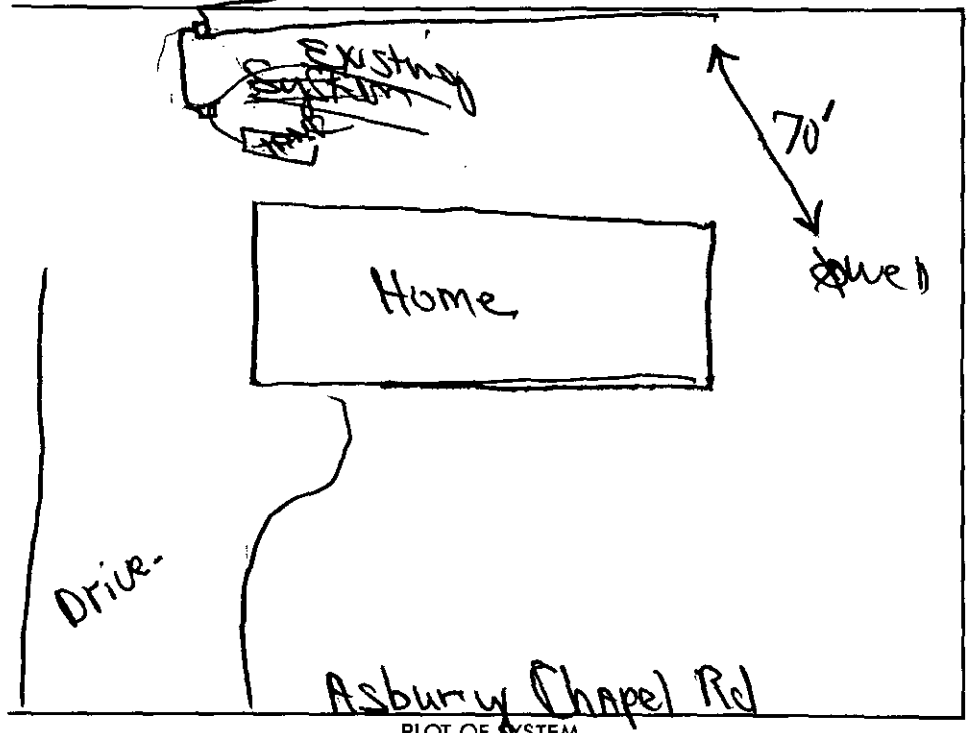

PLOT OF SYSTEM

Repair Data

Liquid Capacity of Septic Tank ___ gallons

Liquid Capacity of Dosing Tank ___ gallons

Tank Construction ___

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 200 feet

Number of Lines 2

Depth of Stone 12 inches

Distance from House 5' feet

Distance from Property Line 10' feet

Distance from Well 70' feet

Minimum distance 50'

NAME OF OWNER Childers D. L.

LOCATION OF PROPERTY 12831 Asbury Chapel Rd.

Comments: Repair to Existing System: INSTALL 2 trenches, 3' x 100', 12" rock, STRAW Cover. Tie into Existing D-Box

Division or Section Head

Judy J Kiser R.S.
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered ~~or repaired~~.

WHITE - ENVIRONMENTAL HEALTH DEPARTMENT'S COPY ● CANARY - ENVIRONMENTALIST'S COPY ● PINK - OWNER OR AGENTS COPY

APPLICATION FOR AN IMPROVEMENT PERMIT

MECKLENBURG COUNTY · ENVIRONMENTAL HEALTH

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

RECEIVED
MECKLENBURG COUNTY
HEALTH DEPT.
APR 20 1988
ENVIRONMENTAL HEALTH DIVISION

(OFFICE USE ONLY)
FILE: 4485A
TC:
SERIAL: № 15908
☐ L ☐ CRT

JOB LOCATION

① ADDRESS: 12831 (STREET NO.) Asbury Chapel Rd (STREET) ② FILE:
③ JURISDICTION: ④ TAX PARCEL NO.: 019-211-21
⑤ SUBDIVISION: ⑥ LOT: ⑦ BLOCK:

OWNER

⑧ NAME: Denver. (FIRST) Carey (MIDDLE) Childers (LAST)
⑨ MAILING ADDRESS: P.O Box 242
⑩ CITY: Huntersville ⑪ STATE: NC ⑫ ZIP: 28078
⑬ PHONE: (WORK) 704-827-0224 ⑭ (HOME) 704-875-6326

REQUEST

This request is for a(n):

⑮ ☐ New permit
⑯ ☑ Repair or alteration permit
⑰ ☐ Authorization for mobile home exchange
⑱ ☐ Other (specify)

DESIGN CRITERIA

System will serve:

⑲ ☑ Residence ⑳ ☐ Mobile home ㉑ ☐ Business or place of public assembly
㉒ Number of bedrooms? 3 ㉕ Type?
㉓ Maximum occupancy? 3 people ㉖ Maximum number of employees?
㉔ Basement? ☐ yes ☒ no ㉗ Maximum number of seats?

WATER SUPPLY

㉘ Water supply from (present or proposed):

A ☑ Individual well
B ☐ Municipal system
C ☐ Community well
D ☐ Community system

㉙ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH to enter onto the property for the purpose of processing this request.

Signed: Denver Carey Childers
Date: 4-18-88

IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal *in effect at* the time of issuance of the permit and is subject to the following provisions:

. . . *No work shall be conducted on the septic tank system until an* Installation, Construction, Alteration and/or Repair permit is issued by this Department.

. . . This permit is not transferable, and shall become null and void 36 months from the date of issuance.

Environmentalist / Date

Director or Authorized Section Head / Date

*This permit must be signed by the Director of Environmental Health or an authorized section head in order to be valid.