#12868

SUPERVISOR/ADMINISTRATIVE PROFESSIONAL CHECKLIST

NEW SEPTIC ☐ NEW WELL ☐ USE EXISTING ☐ MODIFIED PLOT PLAN ☐

New Septic Fees Paid

IP ($250.00) _____ Initial/Date

CA ($200.00) _____Initial/Date

OP ($200.00) _____Initial/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fees Paid: $550.00 _____ Initial/Date

Use Existing Fees Paid: $100.00 _____Initial/Date

Alteration Fees Paid: $300 Total $200 JB 02.17.22 Initial/Date (If use existing was part of payment)

Modified Plot Plan Fees Paid: $100.00 _____Initial/Date

Floor plans need to be submitted and reviewed before CA can be issued ☐ Review ☐

This site is served by septic and well. Verify each is complete before final hold is released ☐

Septic file complete ☒ 5/29/22 Well complete ☐ _____

Send permit for signature ☒ AB 3-1-22 Signature received ☐ _____

This septic system requires a certified operation contract before final hold is released ☐

Certified operator contract is on file ☐ _____

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 06/10/22
Receipt #: 136376
Check / Auth #: MC 093041
Received By: RAMSEMA

Amount: 75.00
Tendered: 75.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: FREDERIKSEN GAYLE
Attn:
Address:
Address:
City/State/Zip: ,

Item	Description	Permit#	Quantity	Unit Price	Total Price
0718	Residential Pool Permit 9300 HORSESHOE BEND DRIVE		1	75.00	75.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
230.00					

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 2203A WASPS App #: 12868

Primary ES assigned to project: B. Shelton

Secondary ES assigned to project:

Project Type: New System ☐ Alteration ☒ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☐	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☐	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☐	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☐	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☐	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☐

Moving Tanks

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments: Relocating Tanks & Reconnecting to existing system.

IA issued date: _____

OP issued date: _____

Review performed by: A. Bumgarner Date performed: 3-1-22

16 FEB '22 PM 2:06

MECKLENBURG COUNTY
HEALTH DEPARTMENT

2203A #12868

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ○ NEW SYSTEM ☒ ALTERATION ○ REPAIR ☑ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☑ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER: 105-26141
STREET ADDRESS: 9300 Horseshoe Bend Drive
CITY: Charlotte, NC
STATE: NC ZIP:
SUBDIVISION NAME: Farmwood North
LOT #: 30 LOT SIZE (acres): .72
TOWNSHIP:
☑ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:

BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
☑ HOUSE ○ OTHER
HEATED SQUARE FOOTAGE: 5,200
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
☑ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
○ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: 0 NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: 0

6. WATER SUPPLY: ☑ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER

7. PROPOSED USE OF WELL: ☑ N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ☑ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ☑ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☑ YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ☑ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ☑ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ☑ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ☑ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ☑ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ☑ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ☑ NO
WASTE STORAGE	○ YES ☑ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ☑ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☑ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____ ☑ N/A

12. PROPERTY OWNER:

NAME: David Gerber
ADDRESS: 9300 Horseshoe Bend Drive
CITY: Charlotte
STATE: NC ZIP: 28215
WORK PHONE: 704-890-2000
MOBILE PHONE: 704-890-2000
FAX:
E-MAIL: gerberconcrete@gmail.com

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME:
ADDRESS:
CITY:
STATE: ZIP:
WORK PHONE:
MOBILE PHONE:
FAX:
E-MAIL:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 9300 Horseshoe Bend Drive Tax Parcel #: 10526141

Subdivision Name: Farmwood North Lot #: 30

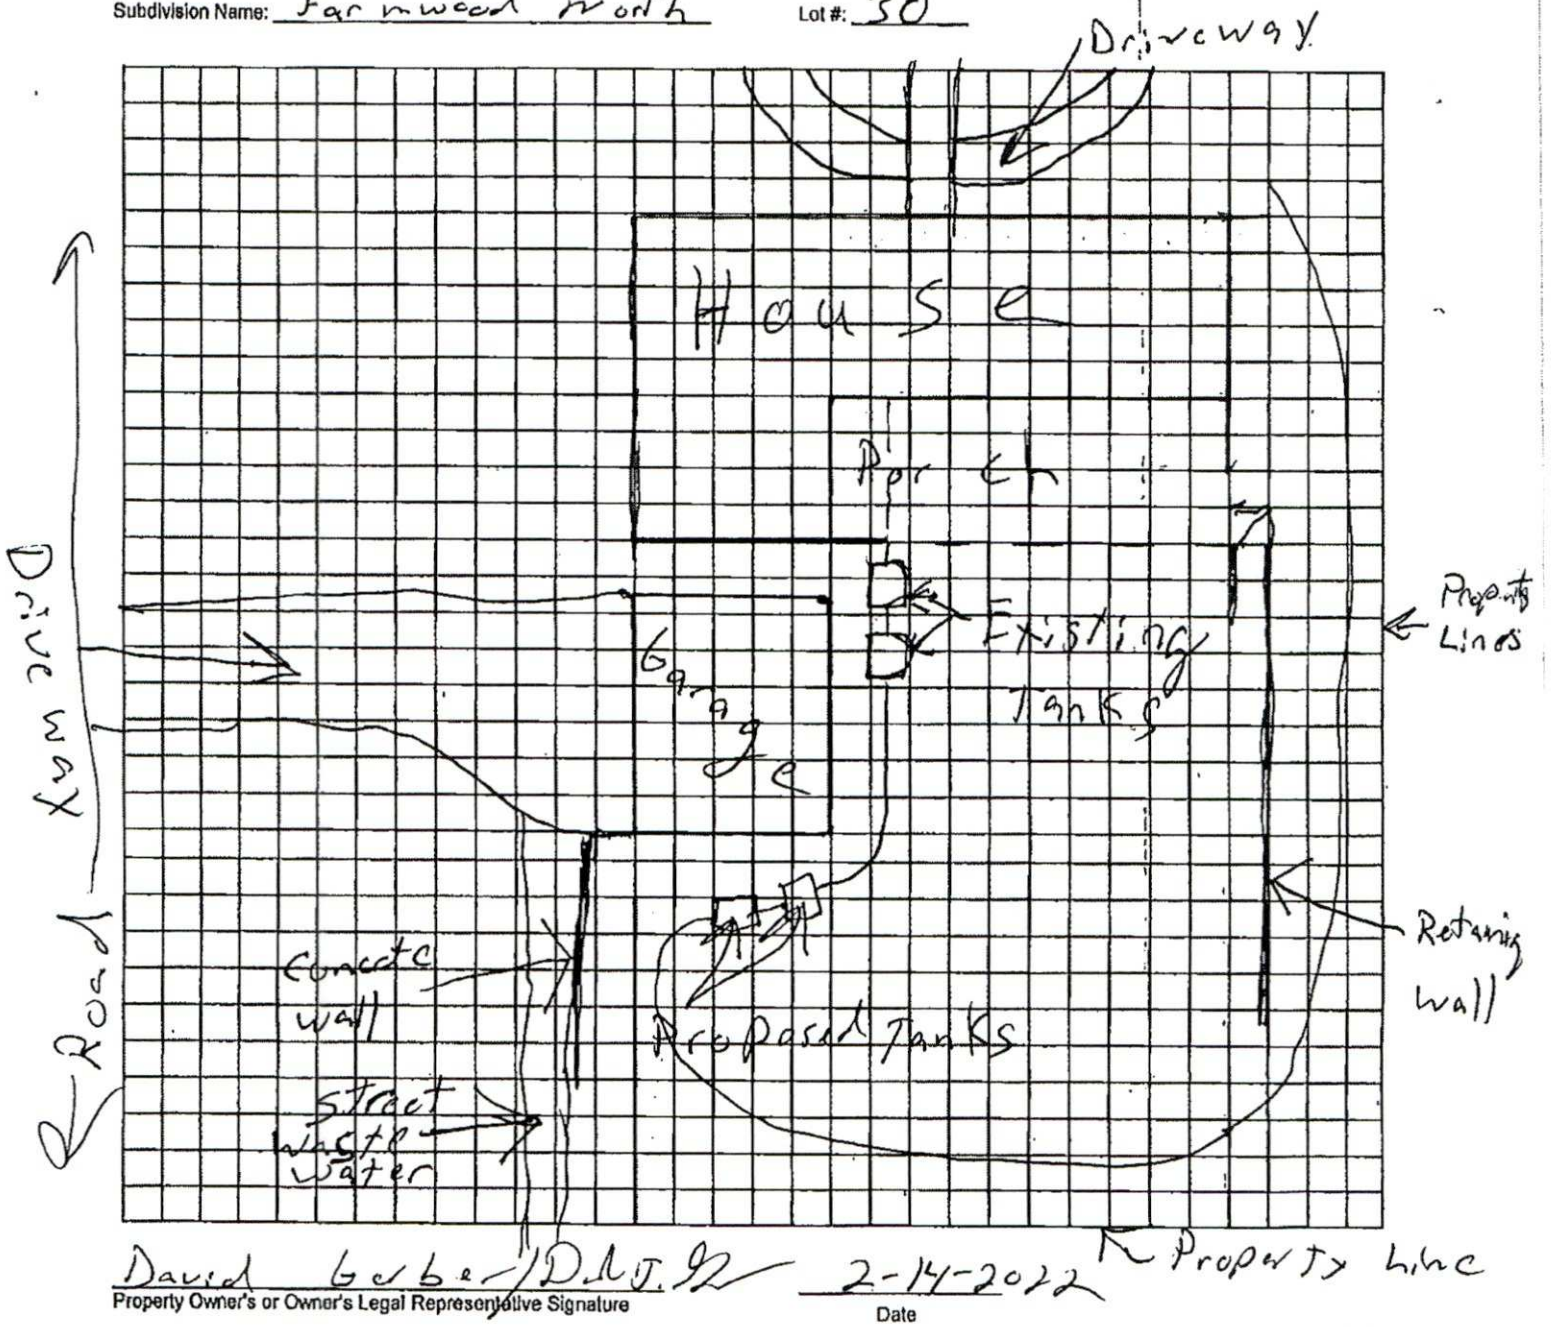

David Gerber D.M.D. 2-14-2022

Property Owner's or Owner's Legal Representative Signature — Date

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

D.L. (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

D.L. (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

Dale T. Lee
Property Owner's or Owner's Legal Representative Signature

2-14-2022
Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ✓ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	02/17/22	**Amount:**	300.00
Receipt #:	133335	**Tendered:**	300.00
Check / Auth #:	DISCOVER 0	**Returned:**	0.00
Received By:	CABANLA		


Account Information

Account #: 200000
Contractor: GERBER, DAVID
Attn:
Address:
Address:
City/State/Zip: ,

Item	Description	Permit#	Quantity	Unit Price	Total Price
0706	Septic Alteration Permit 9300 HORSESHOE BEND		1	300.00	300.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
-20.00					

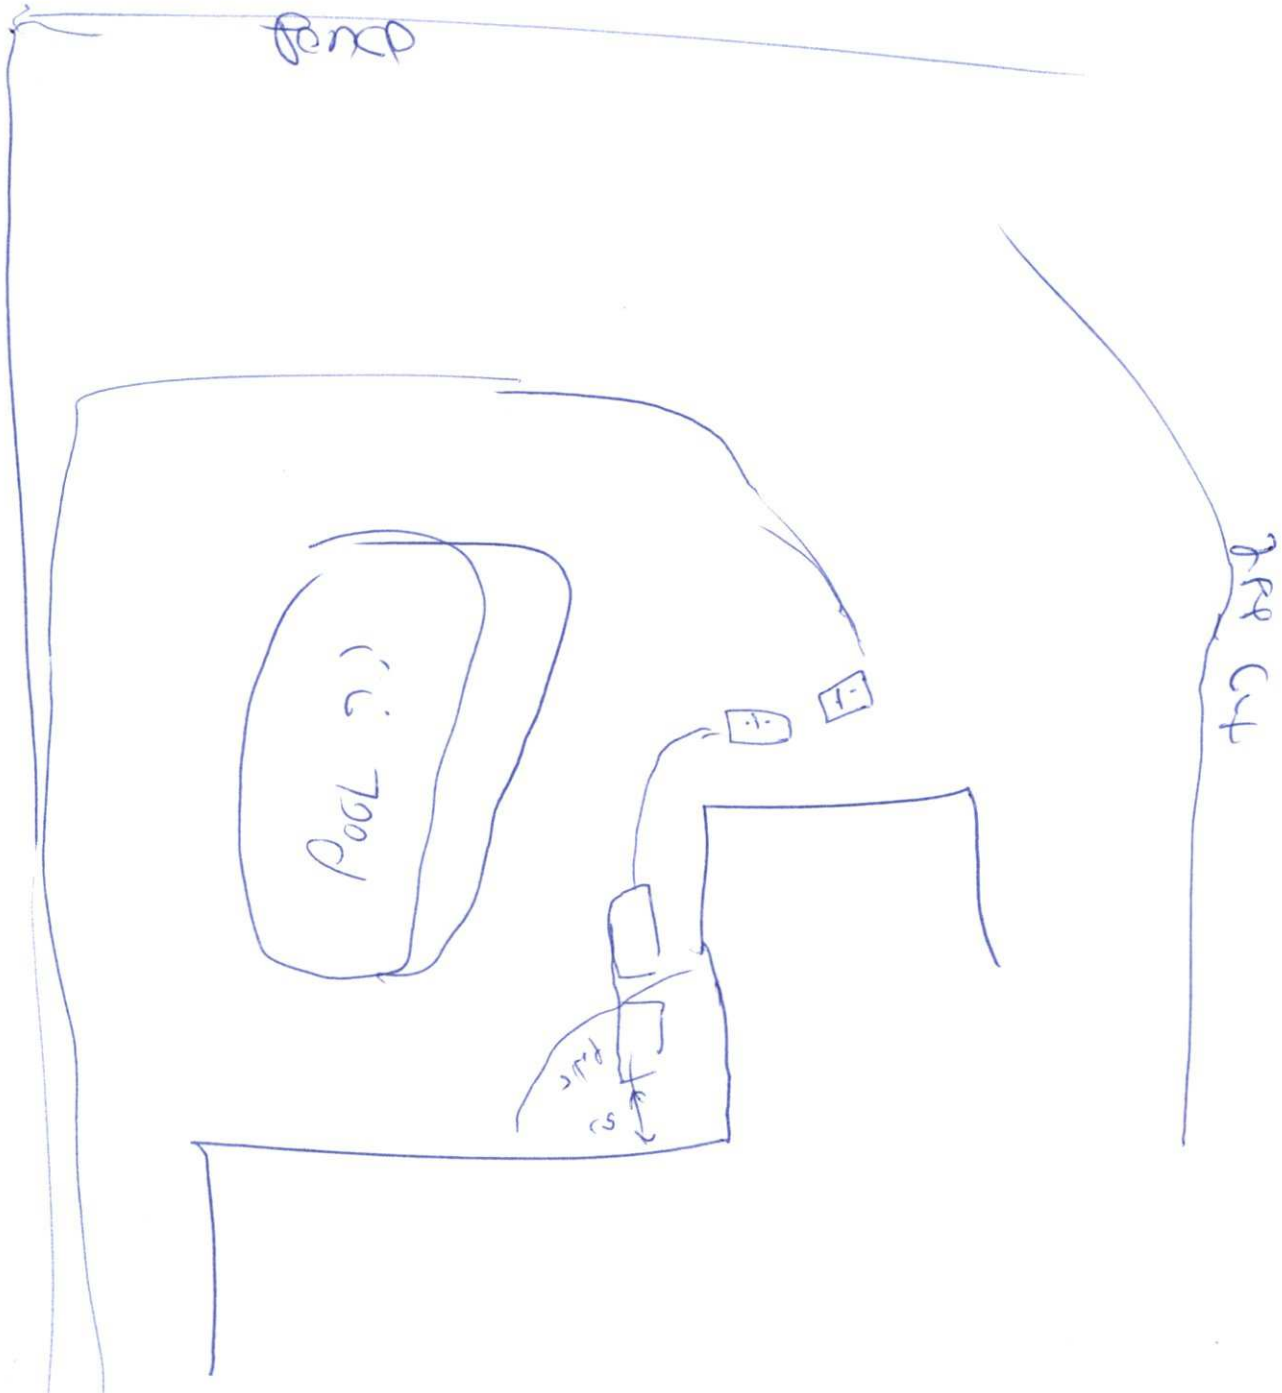
fence
pool
septic
system

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2203A DATE: 10-15-02

TC: 165-261-41 ☐ L

SERIAL 19161

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 7-20-99. All work shall be completed on or before _____, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

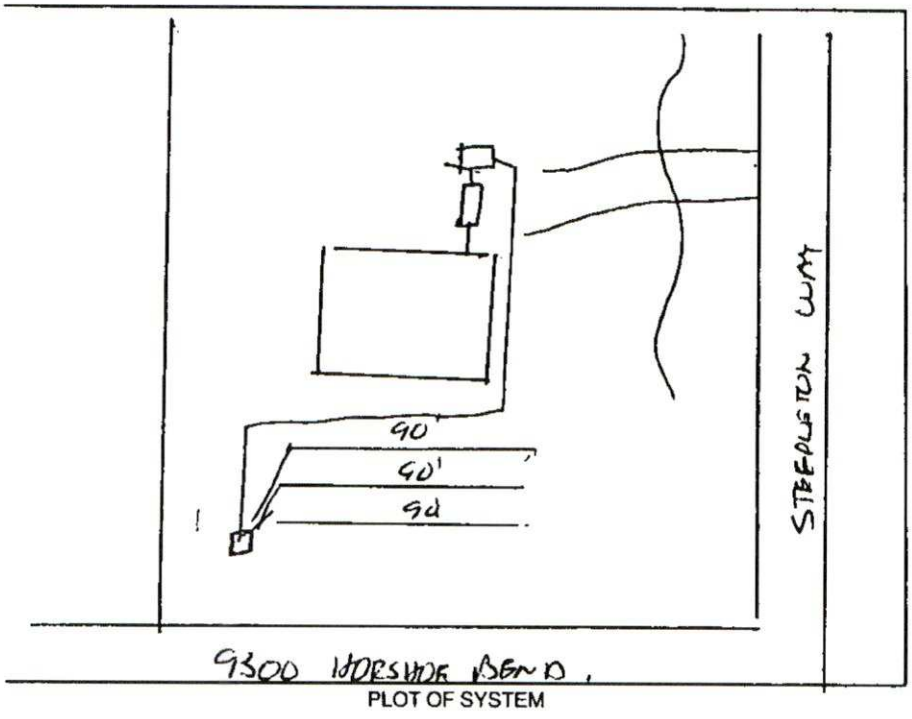

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank 1000 gallons

Tank Construction PCC

Trench Depth 30"

Absorption and/or Nitrification Lines:

Trench Width @ 3 feet

Trench Walls Scored and Porous yes

Total Line Length 270 feet

Number of Lines 3

Depth of Stone NA inches

Distance from House 20' feet

Distance from Property Line 10' feet

Distance from Well 250' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER DAVID GERBER

LOCATION OF PROPERTY 9300 HORSESHOE BEND

Comments: (1) TO SAVE TREES, CONTRACTOR CHOOSES TO INSTALL A 35% REDUCED FM FILTRATOR DRAINFIELD. (2) WARRANTY AND AGREEMENT FORMS ARE REQUIRED.

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2203 A DATE: 12/19/02

TC: 105 261 - 41 ☒ L ☐ CRT

SERIAL Nº 18988

Name of Owner DAVID GERBER Juris.:

Address of Property 9300 HORSESHOE BEND Drive

Inspection Data:

Tank Material 1500/1000

Total Length of Drainfield 270'

Number of Lines 3 @ 90'

Cover Depth 12"

Water Supply Source MUNICPLE


Distance to Water Source >10'

Excavation Inspected 10/24/02

Tank(s) Inspected 12/19/02

Wash Line Inspected –

High Water Alarm Inspected 12/19/02

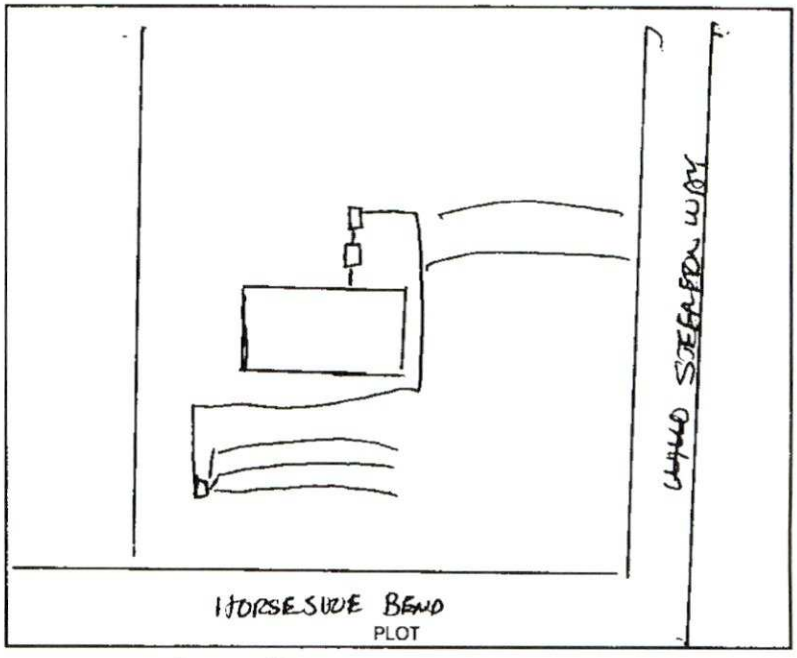

Design 1500 ST 1000 DT 1200 SFT INNOVATIVE [35%] CTR# BOBBY McCARVER

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☐ altered or repaired

☐ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: 10/24/02 PRESSURE MANIFOLD AND 3 LINES 90' INFILTRATOR [35% REDUCTION] INSPECTED BY JEROMY MICHELOVE.

TYPE II - B, G INNOVATIVE.

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr., Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30012868** GWS File #: **2203A** Tax Parcel #: **105-261-41**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 2/25/2027

Type of Installation: Residential - Alteration Lot Number: 30

Structure Type: HOUSE Size (ft^2): 5200 # Bedrooms: 3 Max. Occup.: 6

Building Foundation: Concrete Slab Water Supply: Municipal

II. Initial System Type: N/A Moving S.T + P.T **System Classification:**

Initial System Specifications:

Design Flow (gpd): 360 LTAR (gpd/ft^2): Septic Tank Size (gal): 1000 Pump Tank Size (gal): 1000

Trench Width (ft): Existing Trench Spacing (ft): Existing Absorption Area (ft^2): Existing Total Trench Length (ft): Existing

Maximum Trench Depth (in): Existing Depth of Media (in): Existing Distribution Device: Pressure Manifold

III. Repair System Type: N/A **System Classification:**

Repair System Specifications:

Design Flow (gpd): 0 LTAR (gpd/ft^2): 0 Septic Tank Size (gal): 0 Pump Tank Size (gal): 0

Trench Width (ft): 0 Trench Spacing (ft): 0 Absorption Area (ft^2): 0 Total Trench Length (ft): 0

Maximum Trench Depth (in): 0 Depth of Media (in): 0 Distribution Device: N/A

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Braedon Shelton Owner/Legal Agent: _____
Print Name

Signature: Braedon Shelton Signature: _____

Date Issued: 2/25/2022

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr., Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30012868** GWS File #: **2203A**

IV. Permit Conditions/Comments:

- TANKS ONLY, RECONNECT TO EXISTING DRAIN FIELD

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Braedon Shelton


Signature: Braedon Shelton

Date Issued: 2/25/2022

Owner/Legal Agent: _____
Print Name

Signature: _____

On-site Wastewater Improvement Permit Diagram

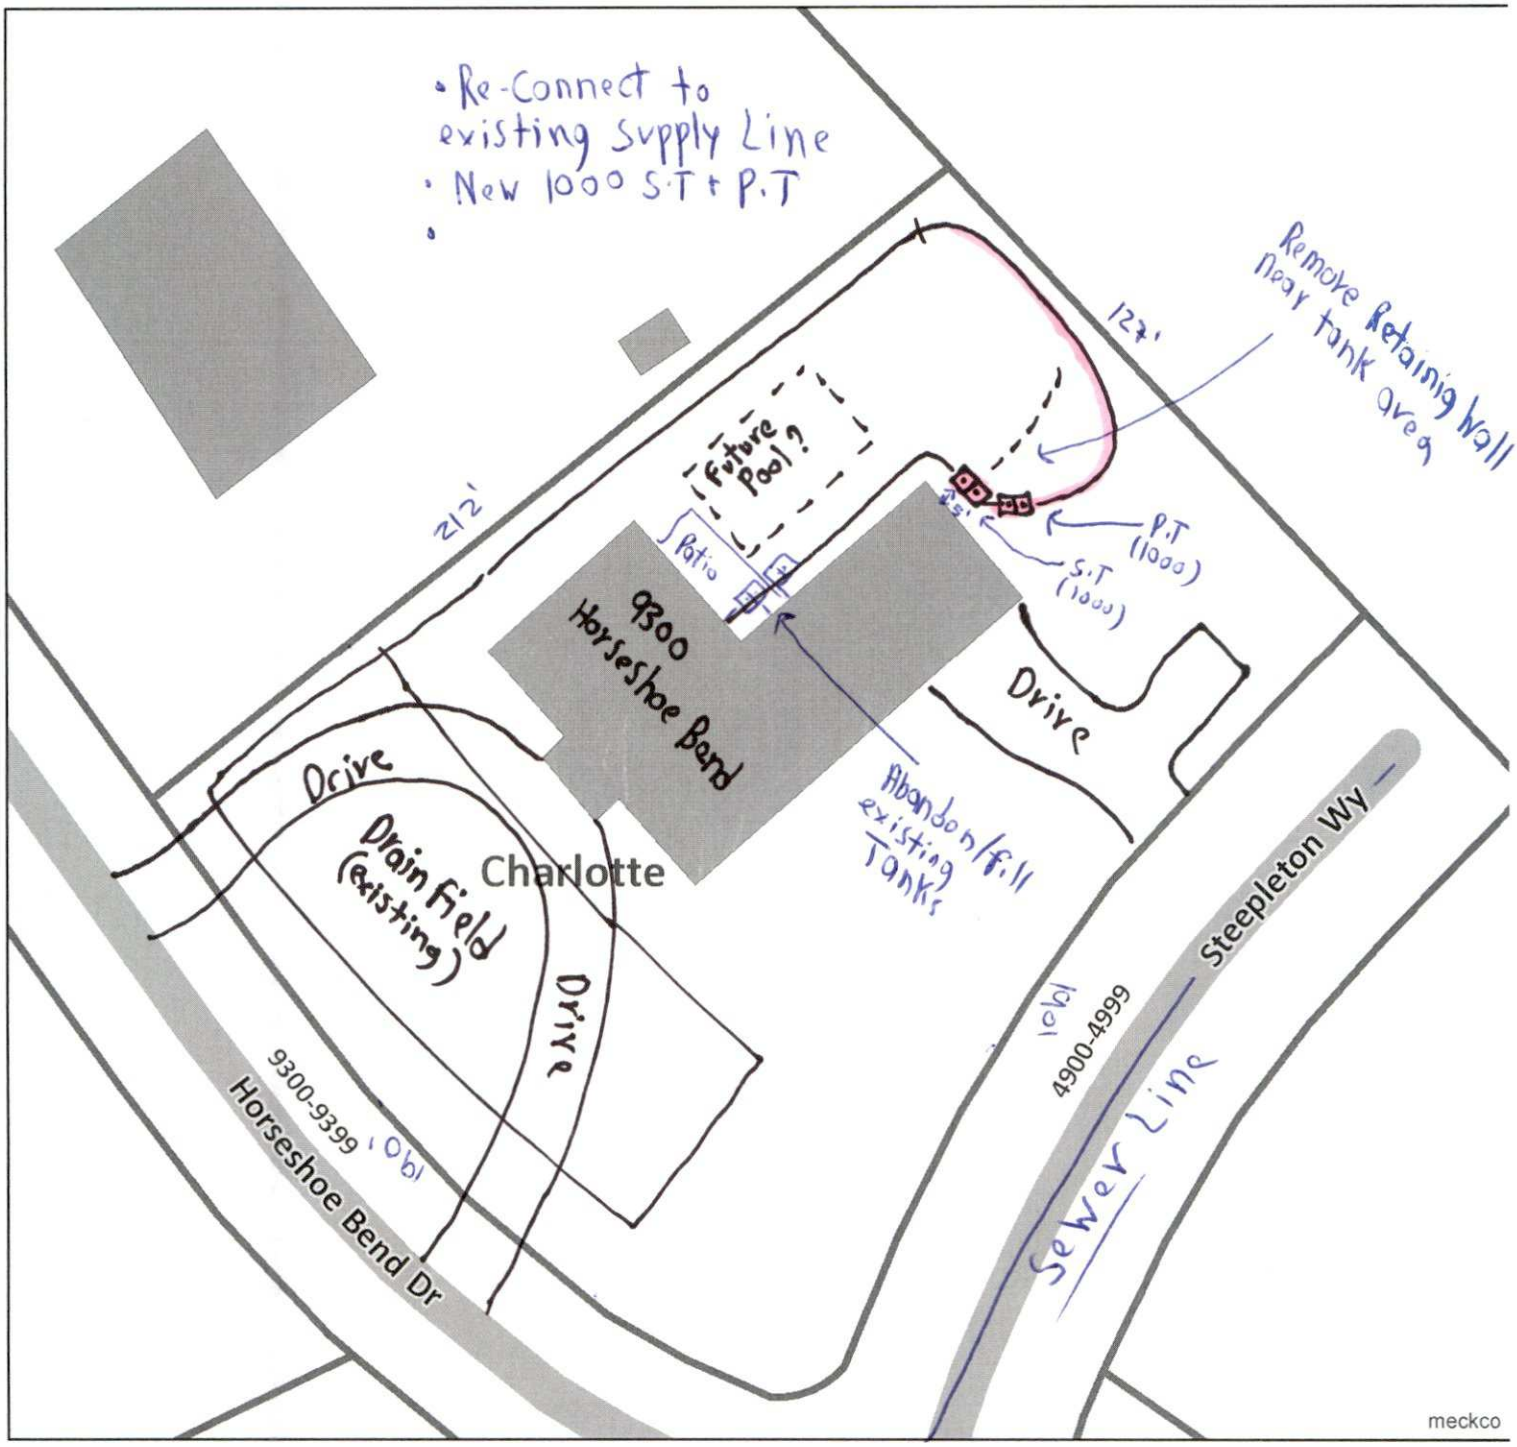

Mecklenburg County Health Department
Environmental Health - Groundwater and Wastewater Services

Permit #:
PID #: 10526141
File #: 2203 A

Authorized Agent: Brandan Shelton Date: 2/25/22

Owner/ Legal Agent: _____ Date: _____

1 inch = 40 fee


Mecklenburg County Health Department
3205 Freedom Drive, Suite 8000
Charlotte, NC 28208
PHONE (980) 314-1620
FAX(704) 336-6894

PLOT PLAN FOR SWIMMING POOL INSTALLATION

ADDRESS: 9300 Horseshoe Bend Drive, Charlotte NC 28215

Draw in all proposed pool, property lines, address road, proposed or existing structures or driveways, underground storage tanks, wells (whether on same lot or not, if within 100 feet) , and septic system drainfields. Plot/draw all dimensions, distances, etc. as needed to accurately detail pool layout in relation to structures, property lines, septic systems, etc.

MARK "X" IF SEPTIC SYSTEM OR WELL PRESENT: (X) SEPTIC SYSTEM ( ) WELL

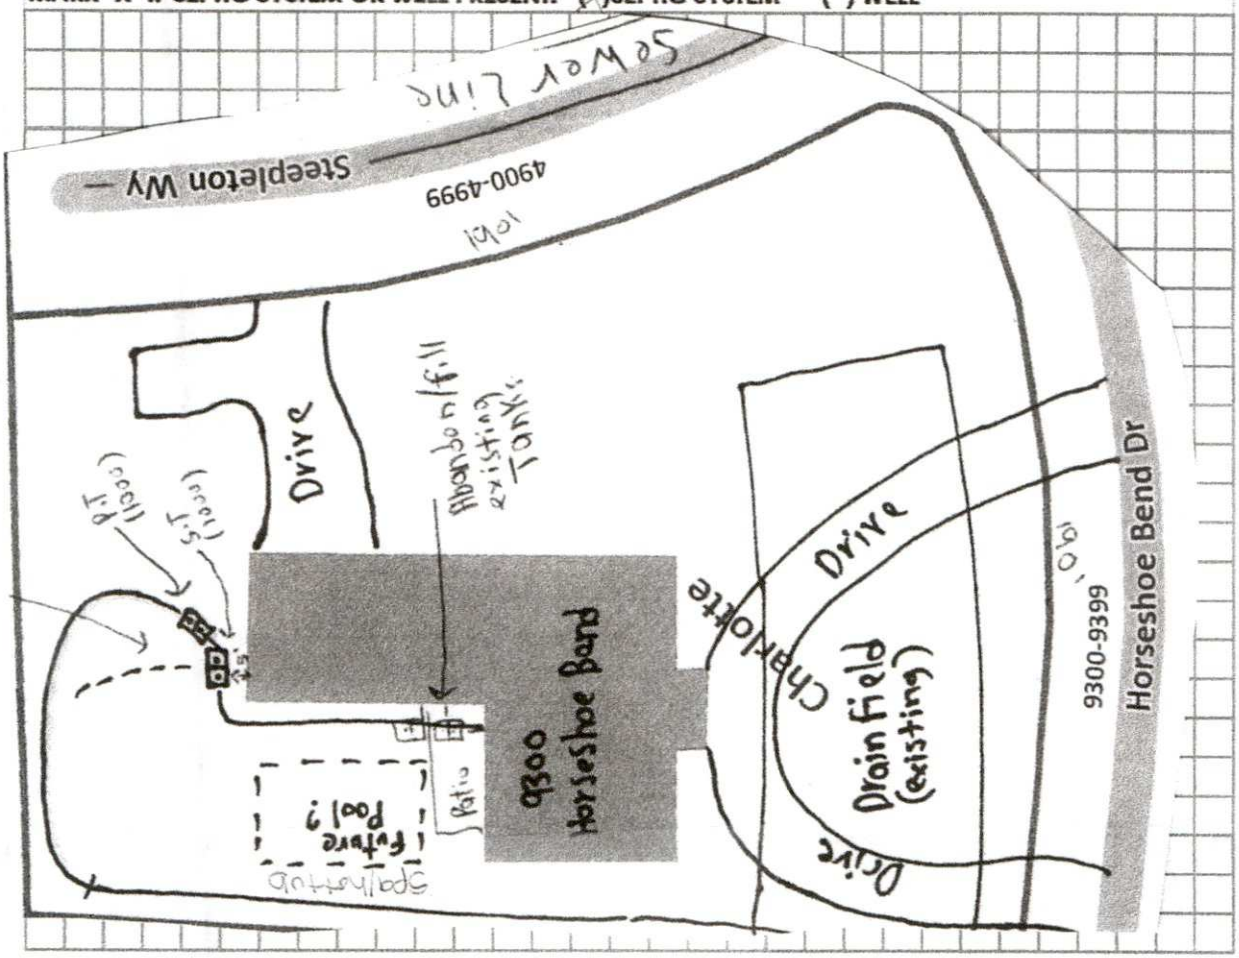


I, David J. Barber (homeowner) hereby affirm that the drawing above is accurate and understand that any deviation in construction from the pool layout, as approved, may result in removal of the pool or revocation of this approval.

HOMEOWNER SIGNATURE

5-31-2022
DATE

OFFICE USE ONLY:
HEALTH DEPT APPROVAL BY: DATE:

On-site Wastewater Improvement Permit Diagram

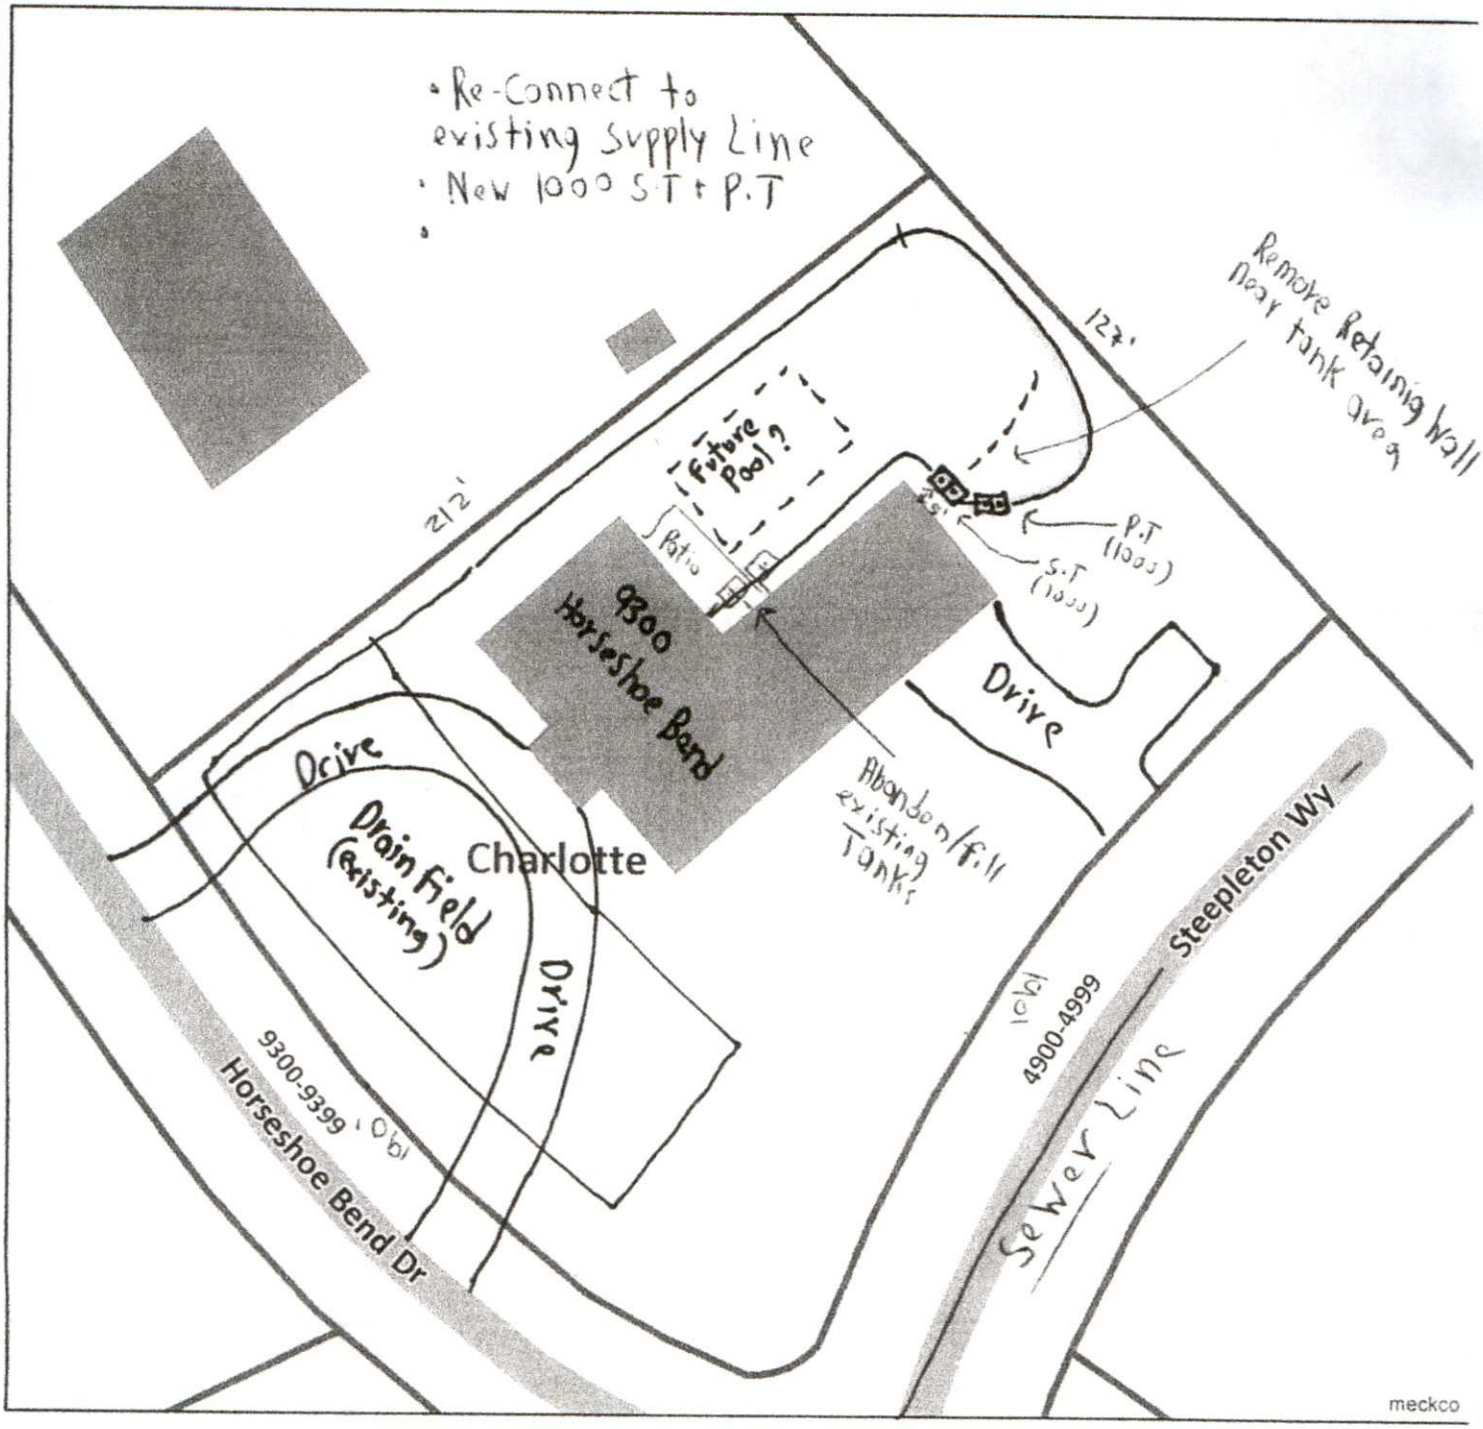

Mecklenburg County Health Department
Environmental Health - Groundwater and Wastewater Services

Permit #:
PID #: 10526141
File #: 2203 A

Authorized Agent: Brandan Shelton Date: 2/25/22

Owner/ Legal Agent: _____ Date: _____

1 inch = 40 fee

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr. Suite 8000, Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 2203A Permit #: 12868 Tax Parcel #: 105-261-41

Property Owner: David Garber

Job Location Address: 9300 Horseshoe Road Drive

City: Charlotte State: NC Zip Code: 28215

Operation Permit Issuance Date: 3/18/24 Contractor Name: Arlington Cornelius

Permitted Design Flow: 360 GPD Liquid Capacity of Dosing Tank: 1000 gallons

Liquid Capacity of Septic Tank: 1000 gallons Tank Manufacture Infiltrator Effluent Pump Model: Existing

Drainfield Installation ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >50' feet


Inspection Dates

Tank(s) Inspected: 3/18/24

Excavation Inspected: N/A

Pump & Controls Inspected: 3/18/24

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

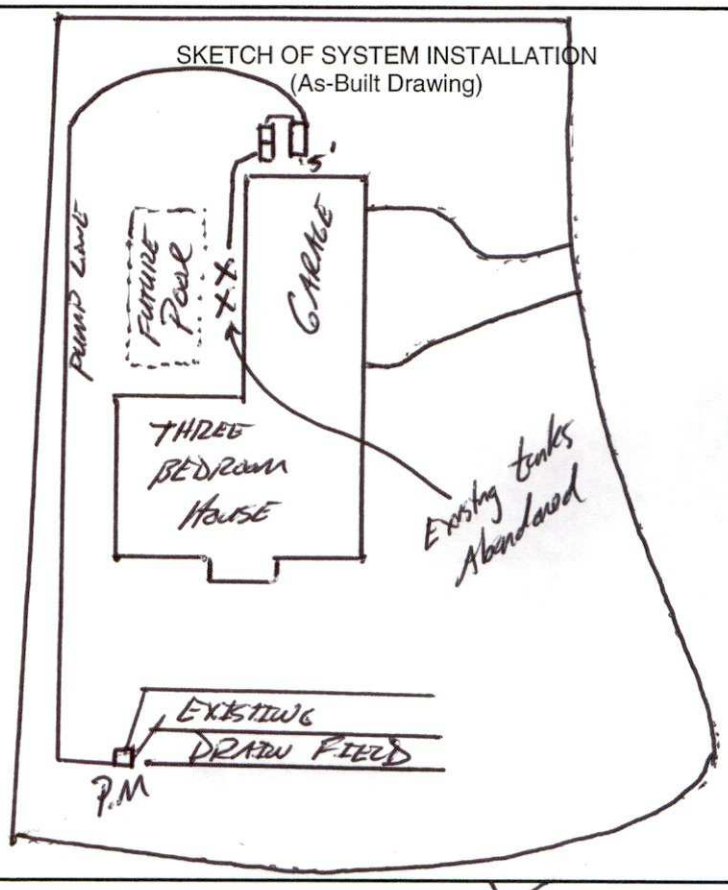

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☒ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIb, P, CHN36 (Existing), NA, NA

Tanks re-located to accomodate a swimming pool

DENR Authorized Agent: Jeremy Mudd, REHS Signature: Jeremy Mudd, REHS

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr. Suite 8000, Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 2203A Permit #: 12868 Tax Parcel #: 105-261-41

Property Owner: David Gabek

Job Location Address: 9300 Horseshoe Bend Drive

City: Charlotte State: NC Zip Code: 28215

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: III-b

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☒ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: Septic tank and Pump tank moved to accomodate a swimming pool

DENR Authorized Agent: Jeremy Mackie Date: 3/18/24

Signature: Jeremy Mackie, REHS