


19500 SUNNYPOINT CT

00109194

12/17/07

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

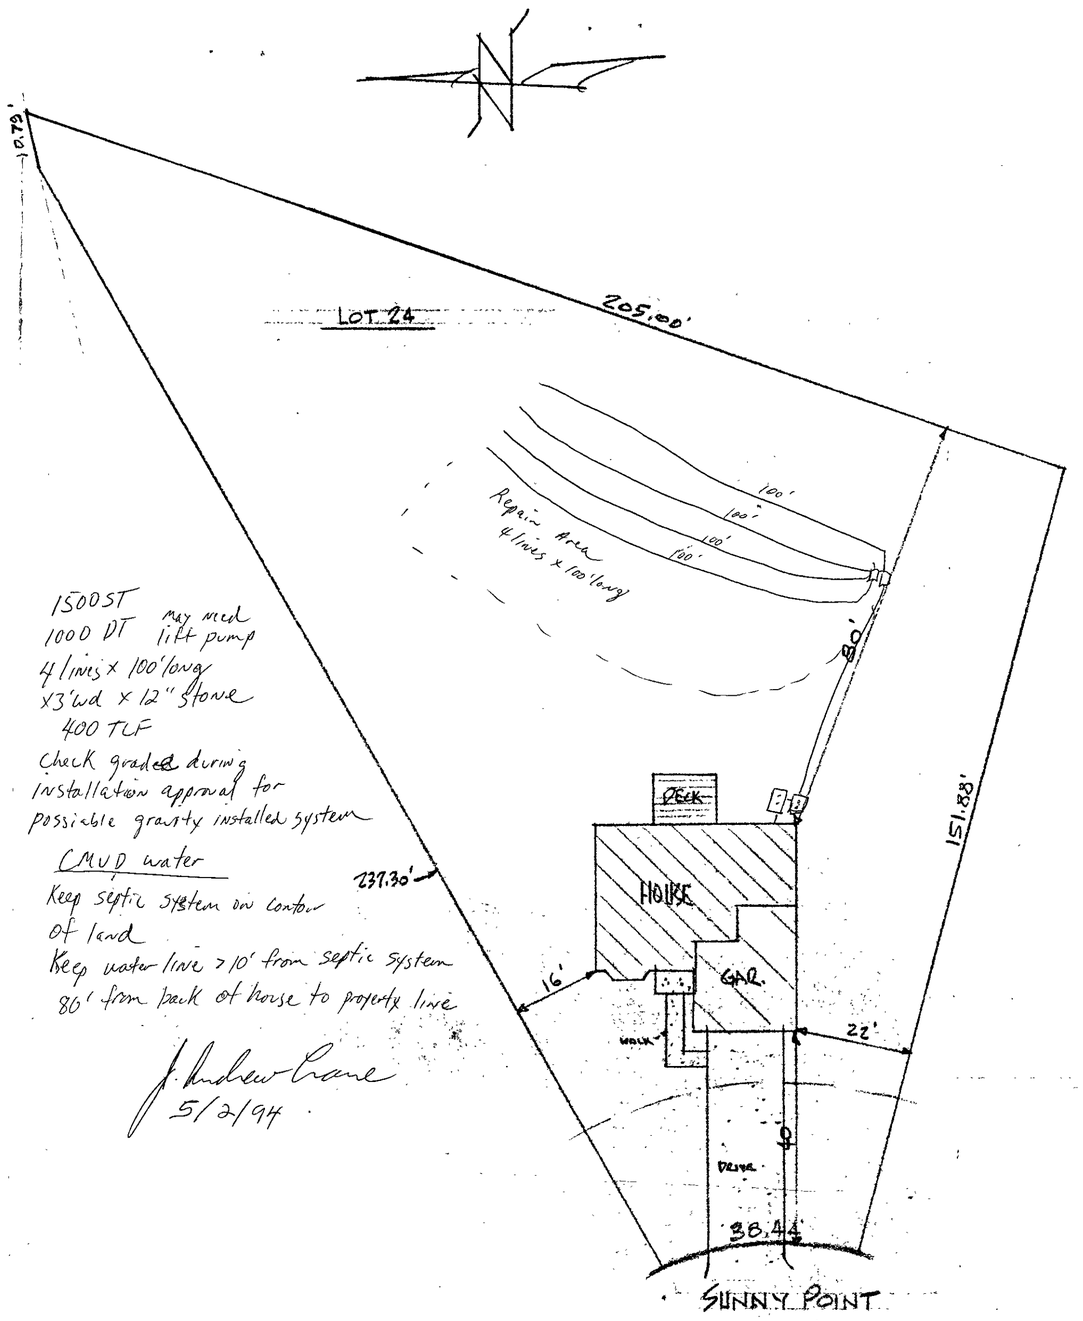

SITE PLAN
1" = 20'

1500 ST
1000 DT may need lift pump
4 lines x 100' long
x 3' wd x 12" stone
400 TLF
Check graded during installation approval for possible gravity installed system

CMUD water

Keep septic system on contour of land
Keep water line > 10' from septic system
80' from back of house to property line

J. Andrew Crane
5/2/94