Supervisor/Administrative Professional Checklist

New Septic ☒ New Well ☐ Use Existing ☐ Alteration ☐ Modified Plot Plan ☐

New Septic Fees Paid:

IP ($250.00) LE 8/18/15 Initials/Date

CA ($200.00) LE 9/17/15 Initials/Date

OP ($200.00) LE 9/17/15 Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 _____ Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was paid) _____ Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. ☑ Reviewed ☑ JAM

This site is served by septic and well. Verify each is complete before final hold is released. ☑

Septic file completed. ☑ JAM 4-18-17 Well file completed. ☐ _____

Send permit for signature. ☑ Signature received. ☑ _____

This septic system requires a certified operator contract before final hold is released. ☐

Certified operator contract is on file. ☐ _____

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 5329B WASPS App #: 7212

Primary ES assigned to project: _____

Secondary ES assigned to project: _____

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☐	No ☑	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☑	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 4			
	Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR 0.275	Yes ☑	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☑	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☑	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☑	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☑	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: 3-15-17

OP issued date: 4-13-17

Review performed by: JAM Date performed: 4-

MECKLENBURG COUNTY
HEALTH DEPARTMENT

5329B Application # 7717

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

17 AUG '15 PM 2:

1. SEPTIC / TYPE APPLICATION: ○ N/A ☒ NEW SYSTEM ○ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ○ N/A ☒ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER: 01302133

STREET ADDRESS: 14829 Henry Harrison Stillwell Drive

CITY: Huntersville

STATE: NC ZIP: 28312

SUBDIVISION NAME: Stillwell

LOT #: L1 M43-75 LOT SIZE (acres): 1.8

TOWNSHIP:

○ MECKLENBURG ○ CORNELIUS ☒ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:

BUILDING TYPE:

○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
☒ HOUSE ○ OTHER _____

HEATED SQUARE FOOTAGE: 4300 ±

NUMBER OF BEDROOMS: 5

NUMBER OF OCCUPANTS: 4

FOUNDATION TYPE:

☒ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
○ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☒ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ○ MUNICIPAL ☑ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. PROPOSED USE OF WELL: ○ N/A ☑ IRRIGATION ☑ POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ N/A ☑ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ☒ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ☒ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	○ YES ☒ NO	JURISDICTIONAL WETLANDS	○ YES ☒ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ☒ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ☒ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ☒ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ☒ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ☒ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ☒ NO
WASTE STORAGE	○ YES ☒ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ☒ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☑ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? Sept. 14th ☐ N/A

12. PROPERTY OWNER:

NAME: Lee Priest
ADDRESS: 9944 Stonebridge Way
CITY: Mint Hill
STATE: NC ZIP: 28227
WORK PHONE: 704-534-0801
MOBILE PHONE: "
FAX: _____
E-MAIL: leejpriest@yahoo.com

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME: _____
ADDRESS: _____
CITY: _____
STATE: _____ ZIP: _____
WORK PHONE: _____
MOBILE PHONE: _____
FAX: _____
E-MAIL: _____

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring. 19

_____ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

_____ 7/30/15

Property Owner's or Owner's Legal Representative Signature — Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 214 CHARLOTTE, NC 28202 OFFICE: 704.336.5103 FAX: 704.336.6804


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 14829 Henry Harrison Stillwell Dr Huntersville 28312 Tax Parcel #: _____

Subdivision Name: Stillwell Lot #: L1 M43-75

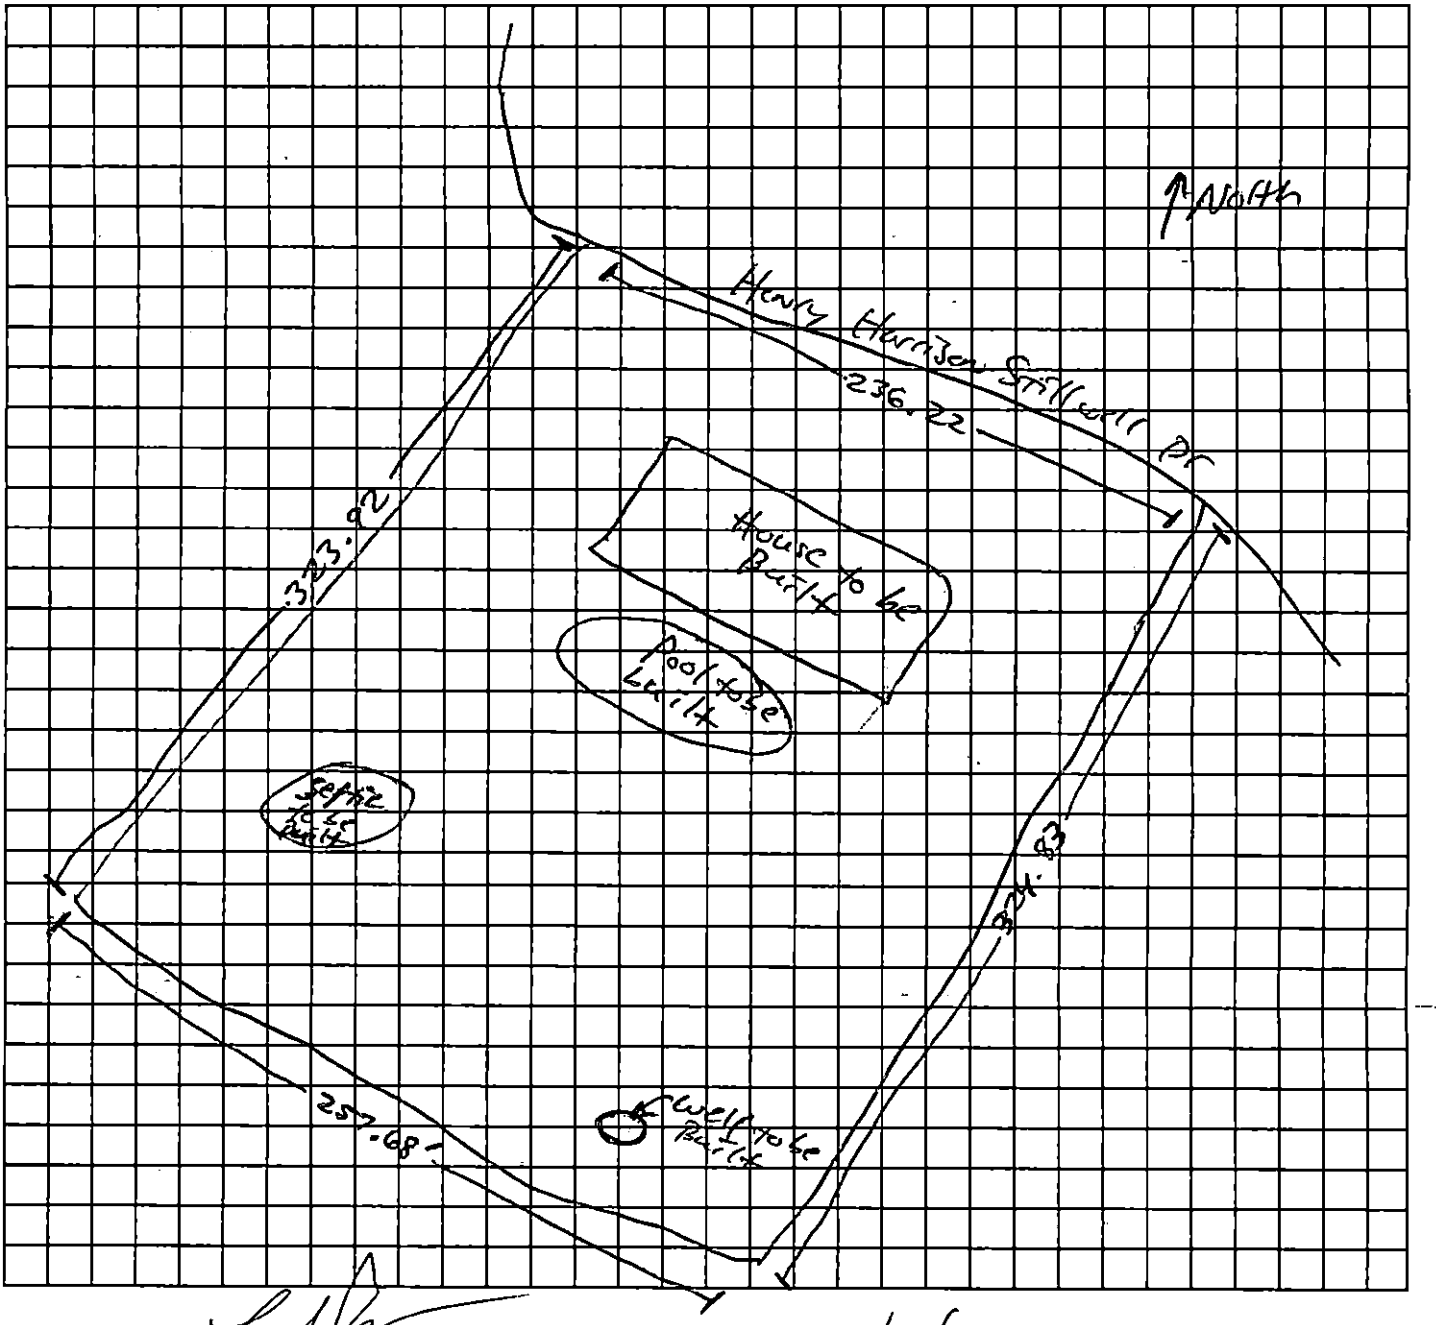

Property Owner's or Owner's Legal Representative Signature

07/30/2015
Date

Ellis, Loretta

From: Trent Carter <carterbuilders1234@gmail.com>
Sent: Thursday, July 28, 2016 8:25 AM
To: Ellis, Loretta
Subject: 14829 Henry harrison

Hey Loretta
Can you look at 14829 Henry harrison stillwell dr. Huntersville to see if the well and septic permits have been paid?
I'm trying to the pull building permit and just want to double check.

The phones seem to be not connecting. I've tried the 704. 336.5103 but no luck.
Just fyi
Please call me if you will about this info.
Thank you

Trent Carter
Carter Custom Builders,Inc.
704-201-6704

5329B

s

FEE: 200.00
DATE:7/28/2016

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 5329B

PERMIT NUMBER: 30007717

PARCEL NUMBER: 01322133

JOB LOCATION INFORMATION

ADDRESS: 14829 HENRY HARRISON STILLWELL DR

CITY: HUNTERSVILLE **STATE: NC** **ZIP:** 28078

ISSUED TO: LEE PRIEST

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 7/28/2016

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30007717, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. A PRE-CONSTRUCTION MEETING MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A LICENSED SEPTIC TANK CONTRACTOR WITH THE NORTH CAROLINA ONSITE WASTEWATER CONTRACTOR INSPECTOR CERTIFICATION BOARD.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St. Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894



NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30007717 GWS File #: 5329B Tax Parcel #: 013-221-33

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 9/3/2020

Type of Installation: Residential - New System Lot Number: 1

Structure Type: HOUSE Size (ft^2): 4500 # Bedrooms: 5 # Occupants: 4

Building Foundation: Concrete Slab Water Supply: Private Well

II. Initial System Type: Pump to Accepted **System Classification:** IIIb

Initial System Specifications:

Design Flow (gpd):	600	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1500
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1636	Total Trench Length (ft):	545
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

III. Repair System Type: Pump to Accepted **System Classification:** IIIb

Repair System Specifications:

Design Flow (gpd):	600	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1500
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1636	Total Trench Length (ft):	545
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone Owner/Legal Agent: Lee J Frost

Signature: Jeremy Michelone Signature: Lee J Frost

Print Name

Date Issued: 9/3/2015

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30007717** GWS File #: **5329B**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone

Signature: Jeremy Michelone

Date Issued: 9/3/2015

Owner/Legal Agent: Lee J Pierce

Print Name

Signature: Lee J Pierce

Ellis, Loretta

From: Lee Priest <leejpriest@yahoo.com>
Sent: Thursday, September 10, 2015 4:48 PM
To: Ellis, Loretta
Cc: Andrea Priest
Subject: Re: 14829 HENRY HARRISON STILLWELL RD
Attachments: Lee Priest - 14829 Henry Harrison Stillwell septic system permit 09 10 2015.pdf; Black and White0261.pdf

Hi There Loretta,

Hope you are doing well. Called you back today, but you must be tied up. Attached please find the signed document. Believe I also need to give you an additional payment so I will call back again tomorrow.

Thanks,

Lee Priest
704-534-0801

From: "Ellis, Loretta" <Loretta.Ellis@mecklenburgcountync.gov>
To: "LEEJPRIEST@YAHOO.COM" <LEEJPRIEST@YAHOO.COM>
Sent: Wednesday, September 9, 2015 9:07 AM
Subject: 14829 HENRY HARRISON STILLWELL RD

Please sign the Improvement Permit & Drawing for 14829 HENRY HARRISON STILLWELL RD, and return back to me. Thank you

Loretta W. Ellis
Administrative Assistant III
Environmental Health Services
Mecklenburg County Health Department
704-336-7291
Email Loretta.Ellis@MecklenburgCountyNC.gov
http://Groundwater.charmeck.org
http://Meckpools.charmeck.org

CONFIDENTIALITY NOTICE: This message and any attachments included are from the Mecklenburg County Health Department and are for sole use by the intended recipient(s). The information contained herein may include confidential or privileged information. Unauthorized review, forwarding, printing, copying, distributing, or using such information is strictly prohibited and may be unlawful. If you received this message in error, or have reason to believe you are not authorized to receive it, please contact the sender by reply email and destroy all copies of the original message. Thank you!

Payment Receipt

Mecklenburg County POS

Environmental Health
700 N. Tryon Street
Charlotte, NC 28202
Phone: 704-336-5100

Enter Account # or Customer Name Here: LEE PRIEST

Bill To:

LEE PRIEST
9944 STONEBRIDGE WAY

Charlotte, NC 28227

Single Payment

Transaction Date: 08/18/2015 9:50 AM Pacific Time
Pay Method: VISA **********2565
Approval #: 018719
Trace Number: d2cdff75-ce74-405b-bf4b-5061712104a6
Amount: $250.00

Payment Amount: $250.00

Total: $250.00

Thank you for your payment.

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	08/18/15	**Amount:**	250.00
Receipt #:	95806	**Tendered:**	250.00
Check / Auth #:	VISA 018719	**Returned:**	0.00
Received By:	ELLISLW		

Account Information

Account #: 200000
Contractor: PRIEST, LEE
Attn:
Address: 9944 STONEBRIDGE WAY
Address:
City/State/Zip: CHARLOTTE, NC 28227

Item	Description	Permit#	Quantity	Unit Price	Total Price
0701	Improvment Permit App-Residen 14829 HENRY HARRISON STILLWELL DR		1	250.00	250.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 013-221-33
Lot #: L1 M43-75
File #: 5329B
AppID: 7717

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Property Owner: Lee Priest
Address: 9944 Stonebridge Way, Mint Hill, NC 28227
Proposed Facility: 5 Bedroom House
Design Flow (.1949): 600 GPD
Location: 14829 Henry Harrison Stillwell Dr, Huntersville, NC 24312
Water Supply: [ ] Public [ ] Individual [X] Well [ ] Spring [ ] Municipal
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

Applicant: owner
Date Evaluated: 8/27/15
Property Size: 1.8 ac
Property Recorded: Unknown

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
Boring #1	LS 4%	0 - 8	gr SL	SS SP FR SEXP							
		8 - 18	wfsbk CL	SS SP FR SEXP	2 chroma	45	NA	NA		PS IV	30"
		18 - 45	wfsbk C	S P FI SEXP	@ 43"					0.275	
Boring #2	LS 4%	0 - 6	gr SL	SS SP FR SEXP							
		6 - 29	wfsbk CL	SS SP FR SEXP	>48"	48	NA	NA		PS IV	35"
		29 - 48	wfsbk C	S P FI SEXP						0.275	
Boring #3	LS 4%	0 - 10	gr SL	SS SP FR SEXP							
		10 - 48	wfsbk C	S P FI SEXP	>48"	48	NA	NA	yellow brown mottles 28 - 48"	PS IV 0.275	35"
Boring #4	LS 4%	0 - 4	gr SL	SS SP FR SEXP							
		4 - 40	wfsbk C	S P FI SEXP	>48"	48	NA	NA	yellow brown mottles 24 - 48"	PS IV 0.275	35"
		40 - 48	wfsbk CL	SS SP FR SEXP							

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)		
Site LTAR (gpd/sq ft)	0.275	0.275

Other Factors (.1946): NA
Soil Evaluation By: Jacob Presley, REHS, LSS
Others Present:
Site Classification (.1948):
Site Evaluation By:
Others Present:


COMMENTS:

Sheet: 2 of 2
File #: 5329B
AppID: 7717

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	sg-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		mass-Massive
LS-Linear Slope				cr-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	gr-Granular
NS-Nose Slope		L-Loam		sbk-Subangular Blocky
HS-Head Slope				abk-Angular Blocky
CC-Concave Slope	III	Si-Silt	0.6 - 0.3	pl-Platy
CV-Convex Slope		SiCL-Silty Clay Loam		pr-Prismatic
T-Terrace				Sap-Saprolite
FP-Flood Plain		CL-Clay Loam		**Structure Prefixes**
D-Drainage Way		SCL-Sandy Clay Loam		w-weak
				m-moderate
		SiL-Silt Loam		s-strong
				f-fine
	IV	SC-Sandy Clay	0.4 - 0.1	m-medium
		SiC-Silty Clay		c-coarse
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	SS-Slightly Sticky	SEXP-Slightly Expansive
FR-Friable	S-Sticky	EXP-Expansive
FI-Firm	VS-Very Sticky	
VFI-Very Firm	NP-Non-Plastic	**Classification**
EFI-Extremely Firm	SP-Slightly Plastic	US-Unsuitable
	P-Plastic	PS-Provisionally Suitable
	VP-Very Plastic	S-Suitable
		NA-Not Applicable

Soil Boring Location Sketch

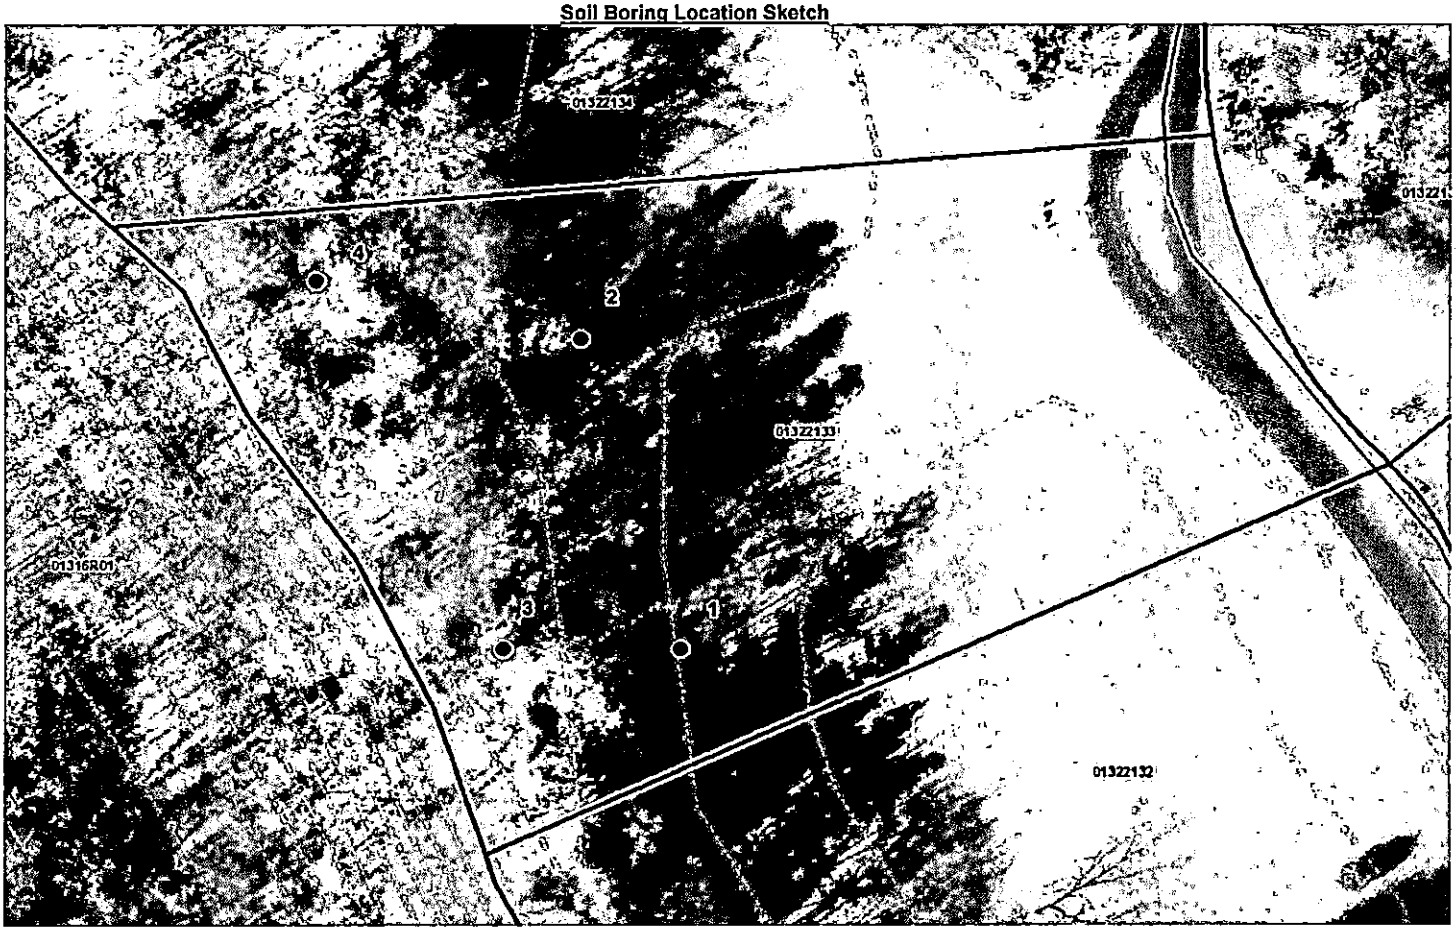

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 013-221-33
Lot #: L1 M43-75
File #: 5329B
AppID: 7717

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Property Owner: Lee Priest
Address: 9944 Stonebridge Way, Mint Hill, NC 28227
Proposed Facility: 5 Bedroom House
Design Flow (.1949): 600 GPD
Location: 14829 Henry Harrison Stillwell Dr, Huntersville, NC 24312
Water Supply: [ ] Public [ ] Individual [X] Well [ ] Spring [ ] Municipal
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

Applicant: owner
Date Evaluated: 8/27/15
Property Size: 1.8 ac
Property Recorded: Unknown

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	PROFILE FACTORS b .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
Boring #1	LS 4%	0 - 8	gr SL	SS SP FR SEXP	2 chroma @ 43"	45	NA	NA		PS IV 0.275	30"
		8 - 18	wfsbk CL	SS SP FR SEXP							
		18 - 45	wfsbk C	S P FI SEXP							
Boring #2	LS 4%	0 - 6	gr SL	SS SP FR SEXP	>48"	48	NA	NA		PS IV 0.275	35"
		6 - 29	wfsbk CL	SS SP FR SEXP							
		29 - 48	wfsbk C	S P FI SEXP							
Boring #3	LS 4%	0 - 10	gr SL	SS SP FR SEXP	>48"	48	NA	NA	yellow brown mottles 28 - 48"	PS IV 0.275	35"
		10 - 48	wfsbk C	S P FI SEXP							
Boring #4	LS 4%	0 - 4	gr SL	SS SP FR SEXP	>48"	48	NA	NA	yellow brown mottles 24 - 48"	PS IV 0.275	35"
		4 - 40	wfsbk C	S P FI SEXP							
		40 - 48	wfsbk CL	SS SP FR SEXP							

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	IIIb	IIIb
Site LTAR (gpd/sq ft)	0.275	0.275

Other Factors (.1946): NA
Soil Evaluation By: Jacob Presley, REHS, LSS
Others Present:
Site Classification (.1948):Provisionally Suitable
Site Evaluation By:Jeremy Michelone, REHS
Others Present:




COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	sg-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		mass-Massive
LS-Linear Slope				cr-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	gr-Granular
NS-Nose Slope		L-Loam		sbk-Subangular Blocky
HS-Head Slope				abk-Angular Blocky
CC-Concave Slope	III	Si-Silt	0.6 - 0.3	pl-Platy
CV-Convex Slope		SiCL-Silty Clay Loam		pr-Prismatic
T-Terrace				Sap-Saprolite
FP-Flood Plain		CL-Clay Loam		**Structure Prefixes**
D-Drainage Way		SCL-Sandy Clay Loam		w-weak
				m-moderate
		SiL-Silt Loam		s-strong
				f-fine
	IV	SC-Sandy Clay	0.4 - 0.1	m-medium
		SiC-Silty Clay		c-coarse
		C-Clay		


Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	SS-Slightly Sticky	SEXP-Slightly Expansive
FR-Friable	S-Sticky	EXP-Expansive
FI-Firm	VS-Very Sticky	
VFI-Very Firm	NP-Non-Plastic	**Classification**
EFI-Extremely Firm	SP-Slightly Plastic	US-Unsuitable
	P-Plastic	PS-Provisionally Suitable
	VP-Very Plastic	S-Suitable
		NA-Not Applicable

Soil Boring Location Sketch

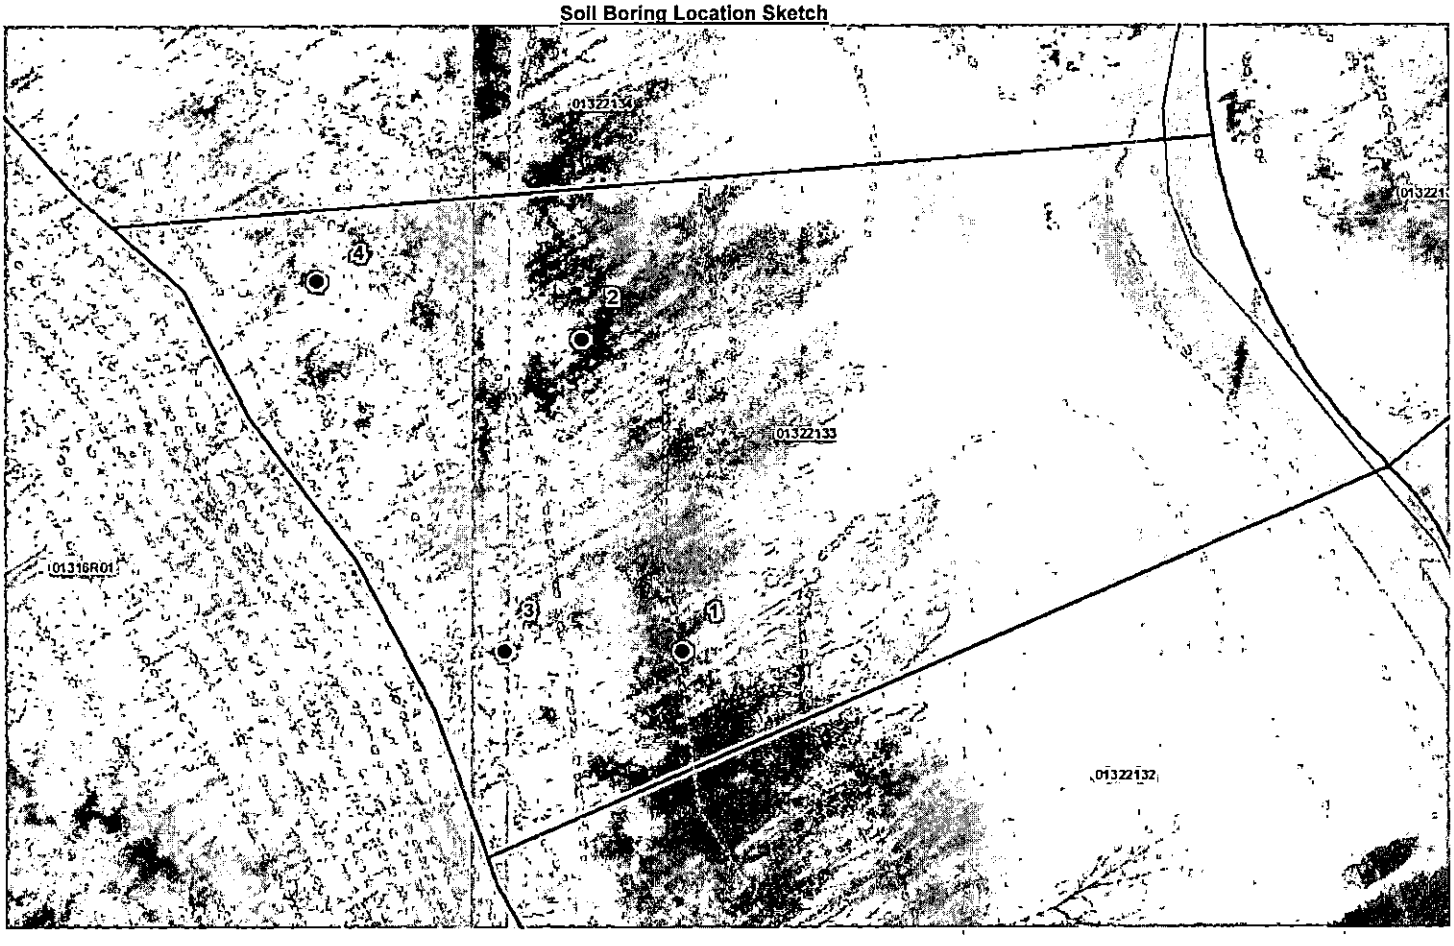

File #: 5329B
Permit #: 7717
Parcel #: 013-221-33

14829 HENRY HARRISON STILLWELL

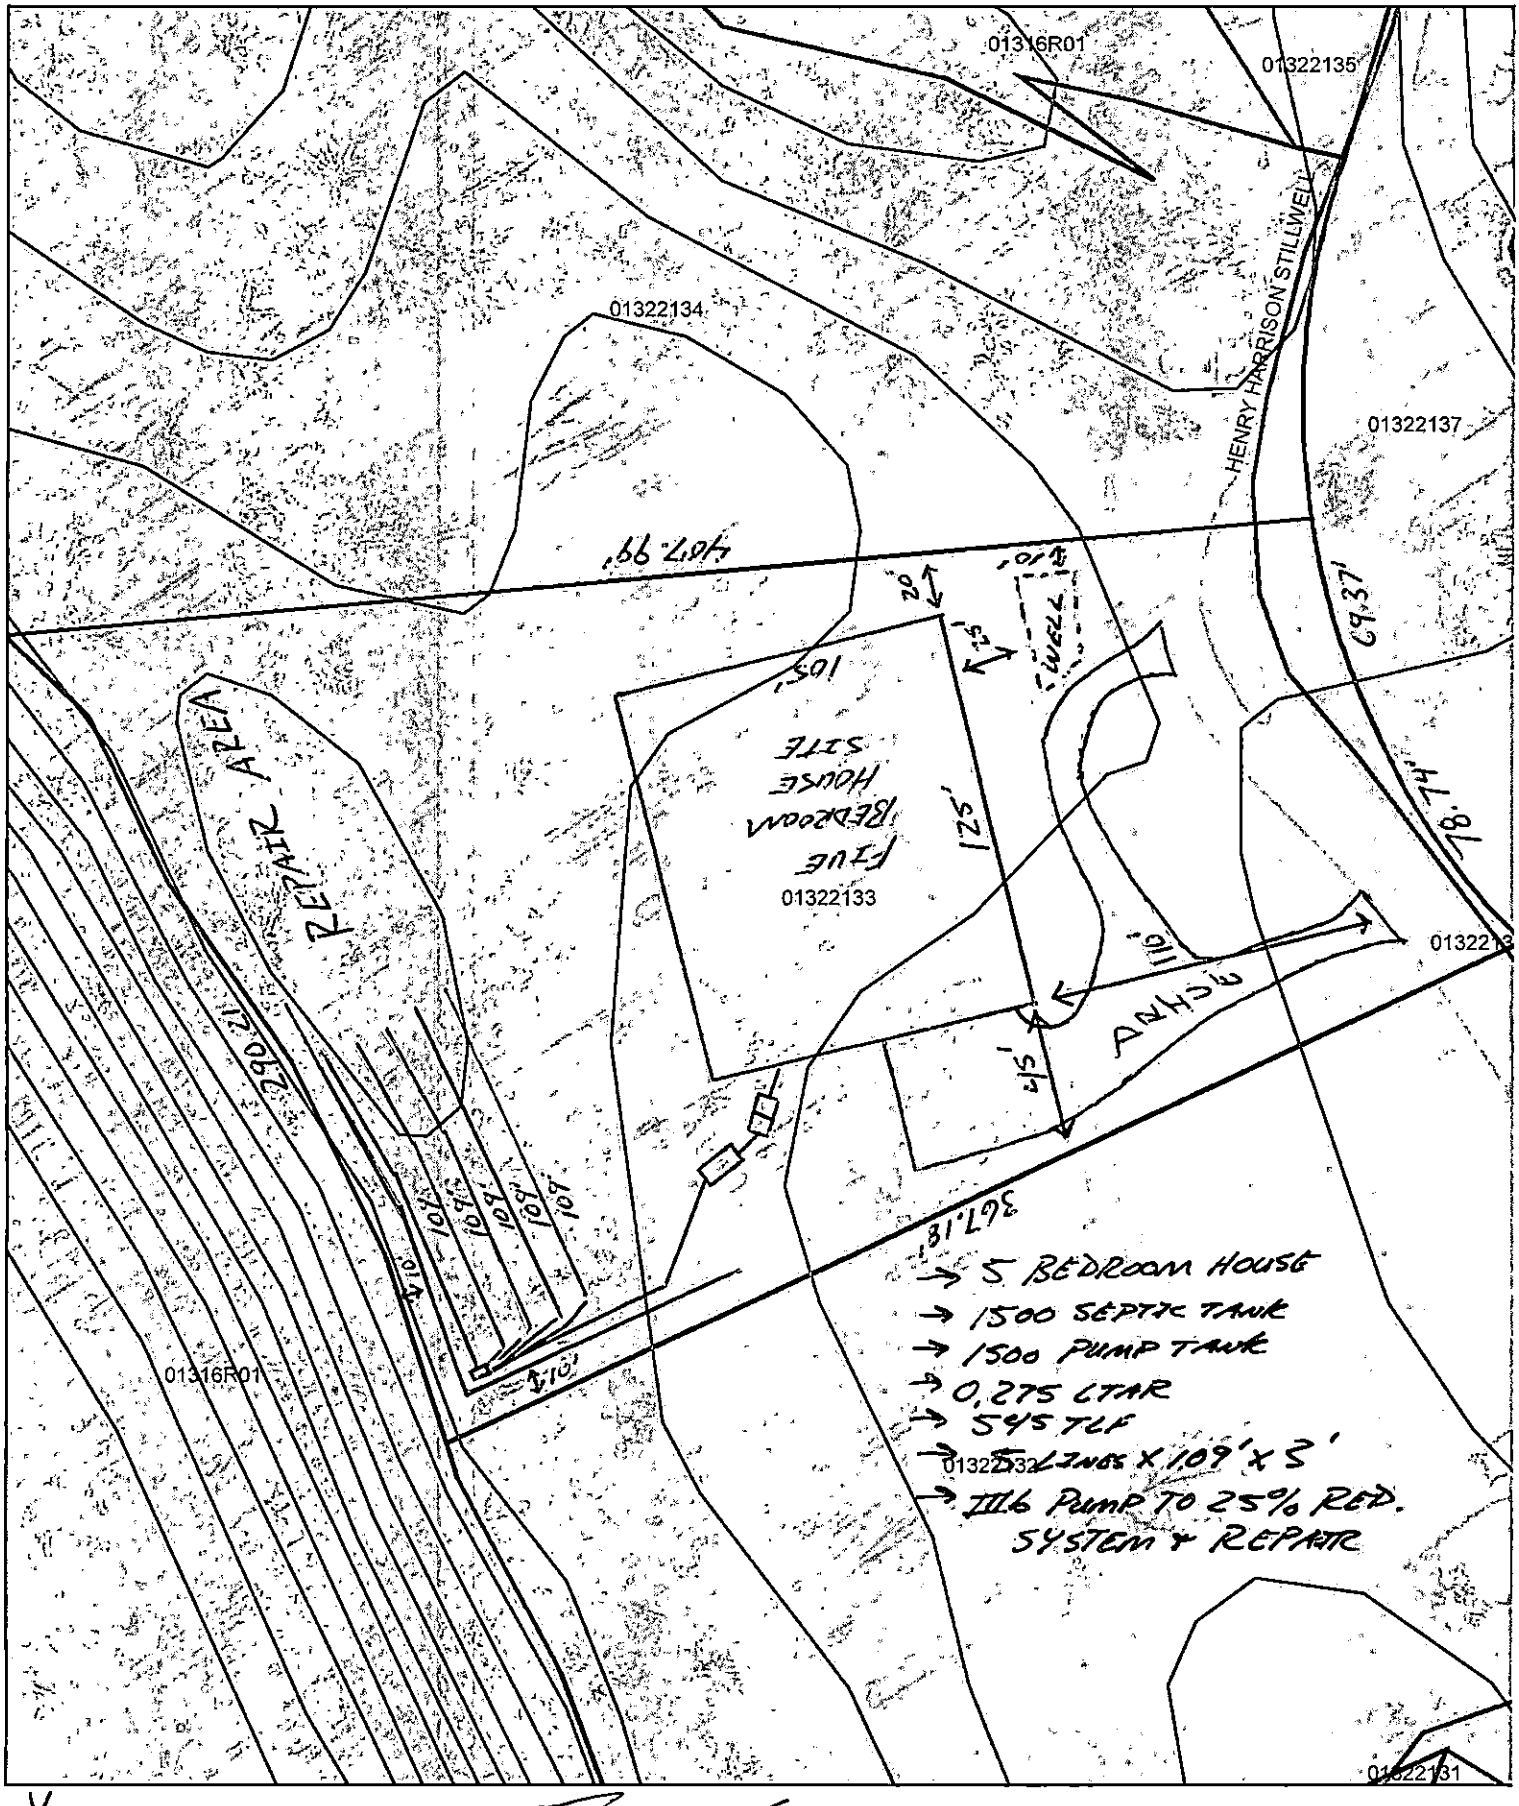

X _____

Jeremy Michelone, REHS
9/3/15

Map Created By: Jeremy Michelone, REHS
Map Created On: 9/3/15

0 30 60 120 Feet

- 2 Bedroom House
- 1250 square metre block
- 1250 Square metre block
- 2 Storey Units
- 262 sqm
- 2 Storey x 150 sqm,
- Side frame to steel Roof
- 2 Bedroom

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30007717** GWS File #: **5329B** Tax Parcel #: **013-221-33**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 9/3/2020

Type of Installation: Residential - New System Lot Number: 1

Structure Type: HOUSE Size (ft^2): 4500 # Bedrooms: 5 # Occupants: 4

Building Foundation: Concrete Slab Water Supply: Private Well

II. Initial System Type: Pump to Accepted **System Classification:** IIIb

Initial System Specifications:

Design Flow (gpd):	600	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1500
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1636	Total Trench Length (ft):	545
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

III. Repair System Type: Pump to Accepted **System Classification:** IIIb

Repair System Specifications:

Design Flow (gpd):	600	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1500
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1636	Total Trench Length (ft):	545
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone Owner/Legal Agent: _____
Print Name

Signature: Jeremy Michelone Signature: _____

Date Issued: 9/3/2015

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30007717** GWS File #: **5329B**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone


Signature: Jeremy Michelone REHS

Date Issued: 9/3/2015

Owner/Legal Agent: _____
Print Name

Signature: _____

SITE PLAN

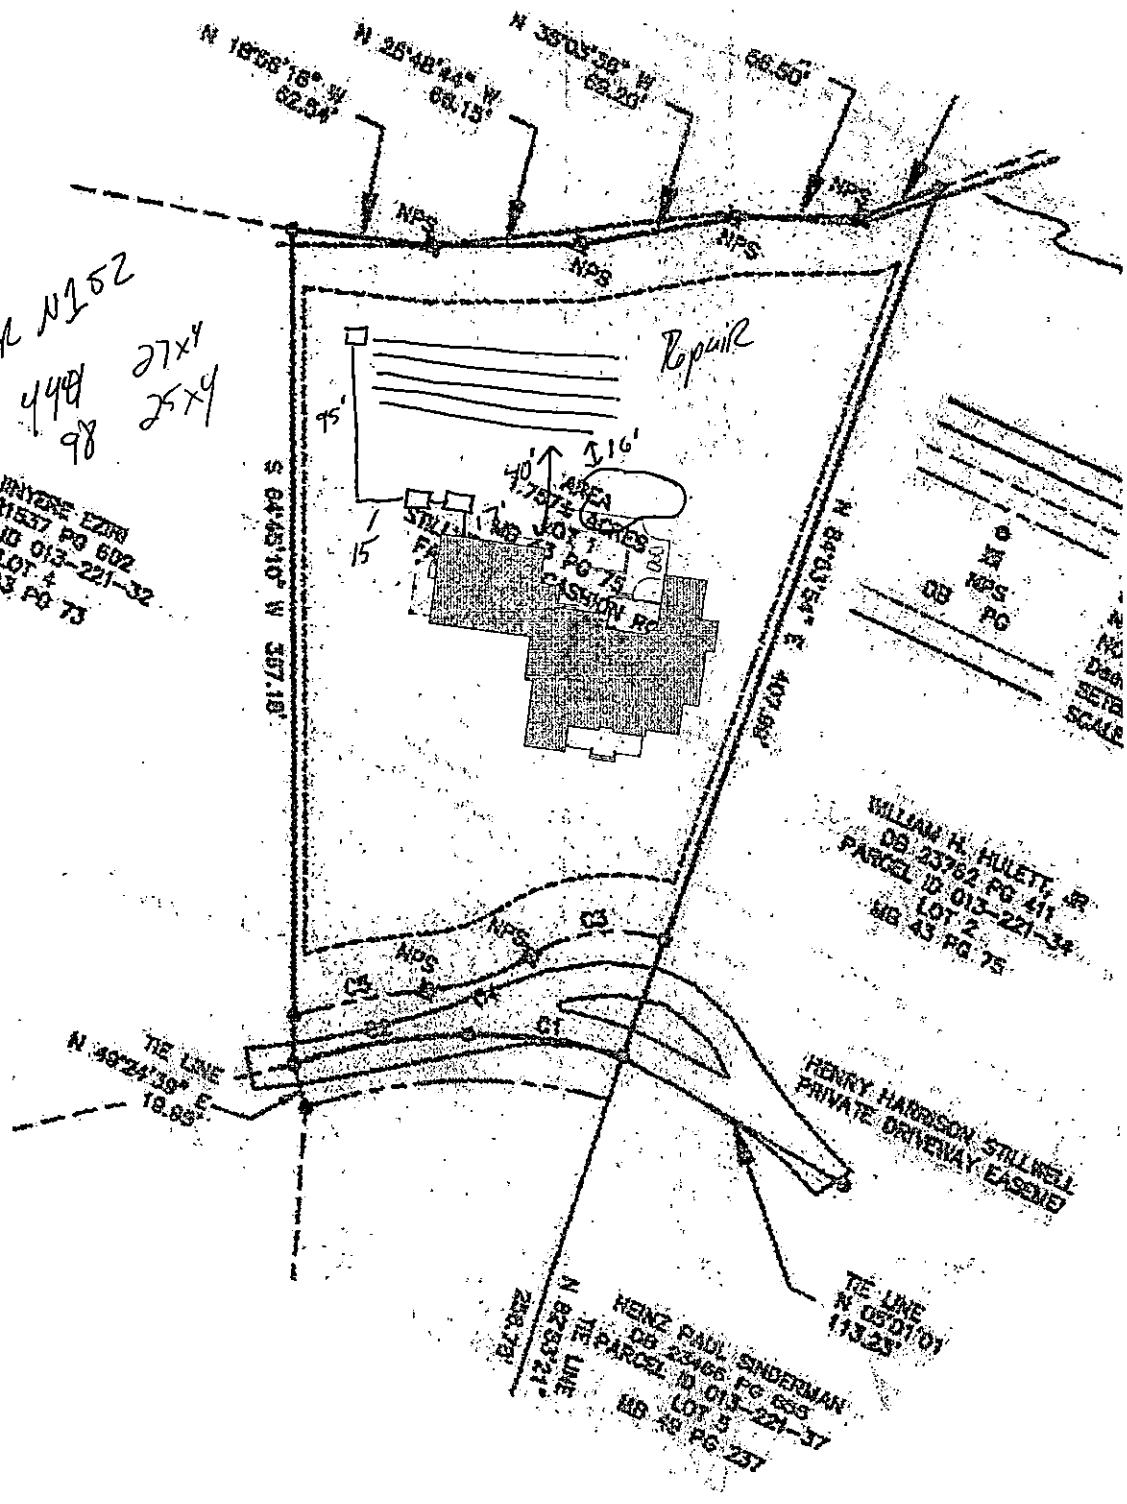

NOTE:
CONTRACTOR TO VERIFY HOUSE LOCATION ON SITE WITH LICENSED SURVEYOR

SHEET 3

PRIEST FAMILY

14829 HENRY HARRISON STILLWELL
HUNTERSVILLE, NC

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

Septic System Pre-Construction Meeting Checklist

File # 53298 App # 7717 Tax Parcel # 013-221-33

Property Owner: Lee Priest

Job Location Address: 14829 Henry Hanson Stillwell Drive

City: Huntersville State: NC Zip Code: 28078

1. Does System design match facility, flow & wastewater characteristics?

   ☒ YES ☐ NO

   Comments: _____

2. Is there sufficient available space for the septic systems initial and repair areas?

   ☒ YES ☐ NO

   Comments: _____

3. Can the septic system be installed per the permit conditions and drawing on file?

   ☒ YES ☐ NO

   Comments: _____

* If "NO" is checked for any of the above the existing permit may need to be revoked.

Permission is hereby given to ☐ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge meeting all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. **System shall not be installed while soils are in wet condition.**

Authorized Agent — Date: 3/15/17

Others Present: Rowan Septic / Trent Carter

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 53298 Permit #: 7717 Tax Parcel #: 013-221-33

Property Owner: Lee Priest

Job Location Address: 14829 Henry Harrison Stillwell Drive

City: Huntersville State: NC Zip Code: 28078

Operation Permit Issuance Date: 4/13/17 Contractor Name: Rowan Septic

Permitted Design Flow: 600 GPD Liquid Capacity of Dosing Tank: 1500 gallons

Liquid Capacity of Septic Tank: 1500 gallons Manufacture Rowan Effluent Pump Model: Zoeller N152

Drainfield Installation ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 542 feet

# of Lines: 5 @ 4x110/1x102 feet

Depth of Media: 12 inches (Type) IQ4W

Depth of Cover: 18 inches

Distribution Device: P. Manifold

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 17' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >100' feet


Inspection Dates

Tank(s) Inspected: 4/10/17

Excavation Inspected: 4/10/17

Pump & Controls Inspected: 4/13/17

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

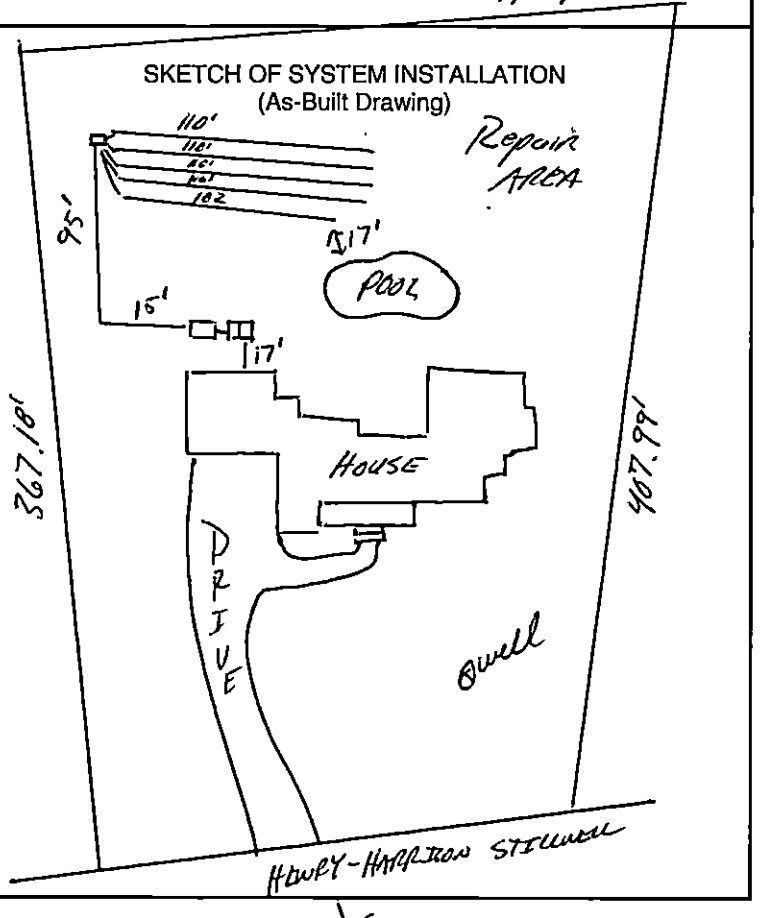

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☒ installed ☐ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: III b, IQ4W, Pressure, NA, NA

DHHS Authorized Agent: Jeremy Middlebrooks Signature: Jeremy Middlebrooks

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 5329B Permit #: 7717 Tax Parcel #: 013-221-53

Property Owner: Lee Priest

Job Location Address: 14829 Henry Harrison Stillwell Drive

City: Huntersville State: NC Zip Code: 28078

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: III

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☒ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Jeremy Medeiros REHS Date: 4/13/17

Signature: Jeremy Medeiros REHS



14829 HENRY HARRISON STILLWELL DR

01322133

1/8/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M